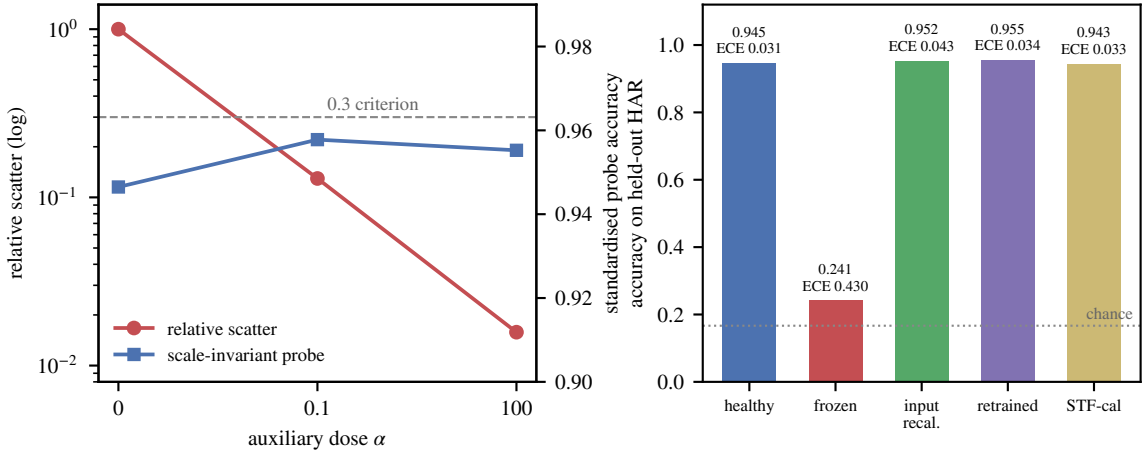
(a) contraction without information loss
relative scatter (log)
10^0
10^{-1}
10^{-2}
0.98
0.96
0.94
0.92
0.90
0.3 criterion
relative scatter
scale-invariant probe
0
0.1
100
auxiliary dose α
(b) a frozen readout breaks; STF-cal protects it
standardised probe accuracy
accuracy on held-out HAR
1.0
0.8
0.6
0.4
0.2
0.0
0.945
ECE 0.031
0.241
ECE 0.430
0.952
ECE 0.043
0.955
ECE 0.034
0.943
ECE 0.033
chance
healthy
frozen
input recal.
retrained
STF-cal