



Ablation evidence with paired-bootstrap AUROC audits


A Input-modality ablation

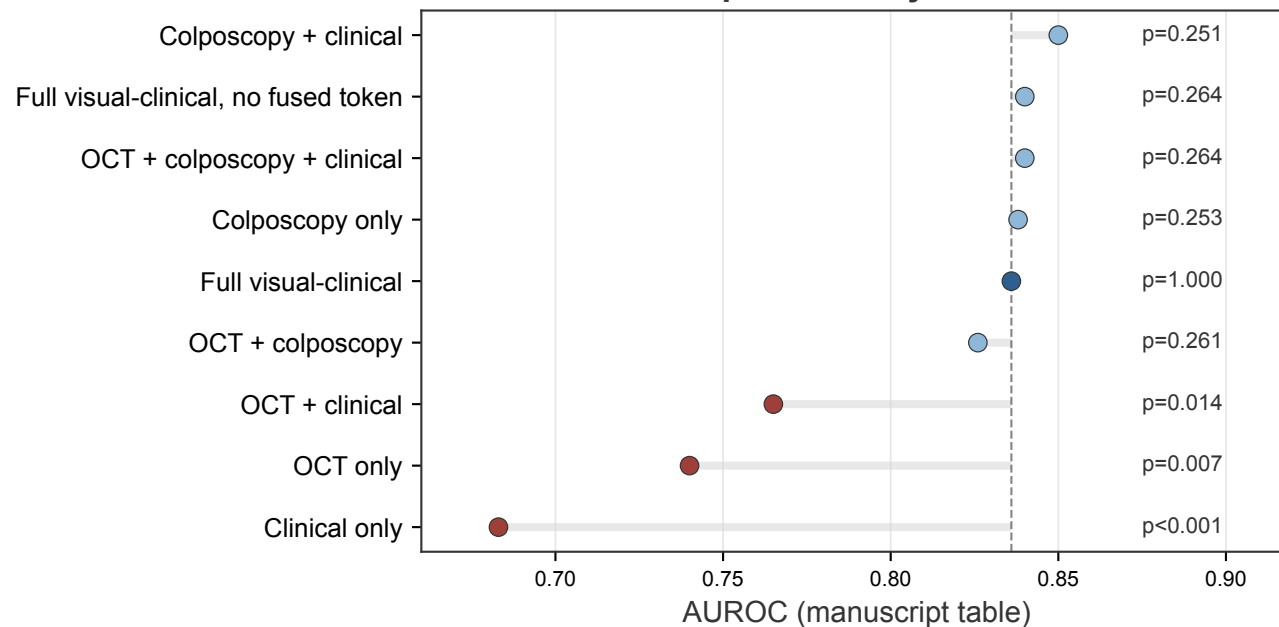


B RASA-component ablation

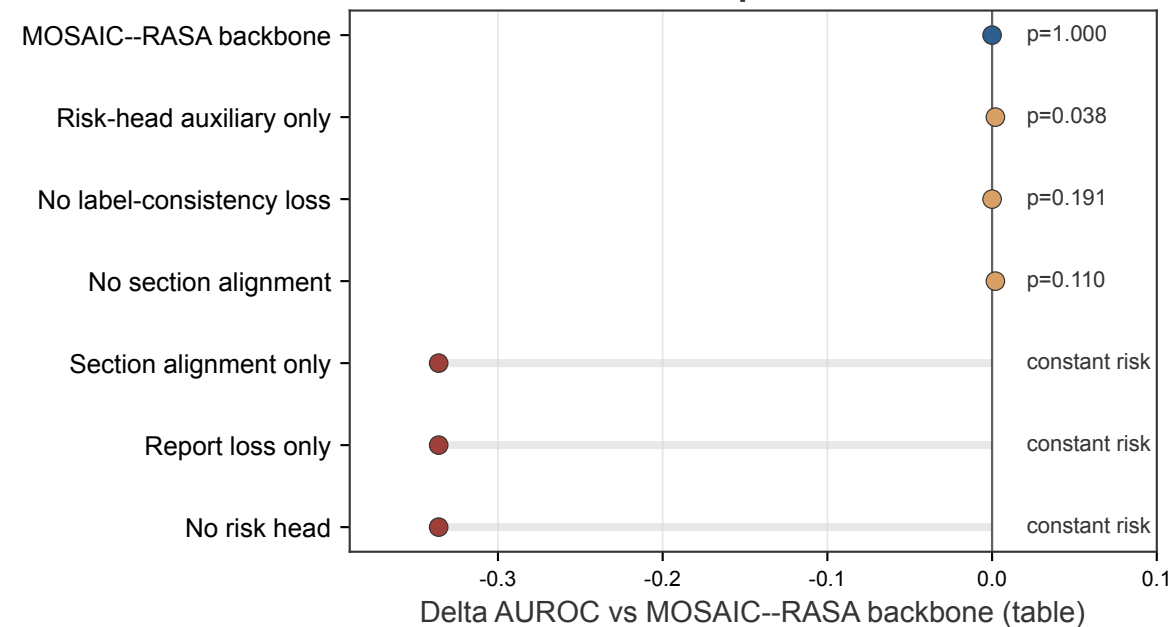

C LCAD QC / weighting ablation

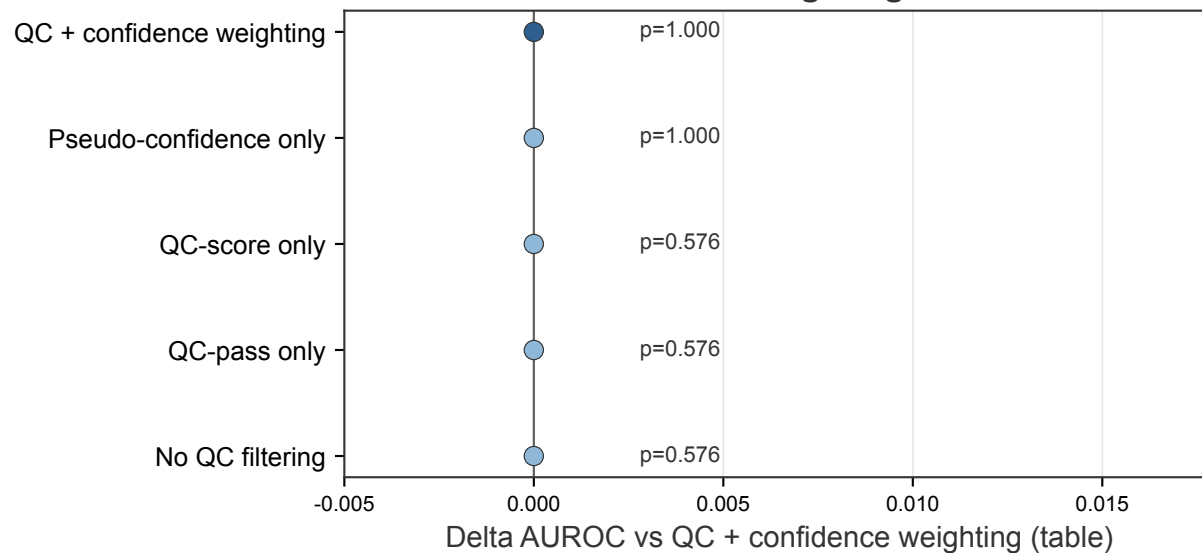

D Section-alignment weight sweep

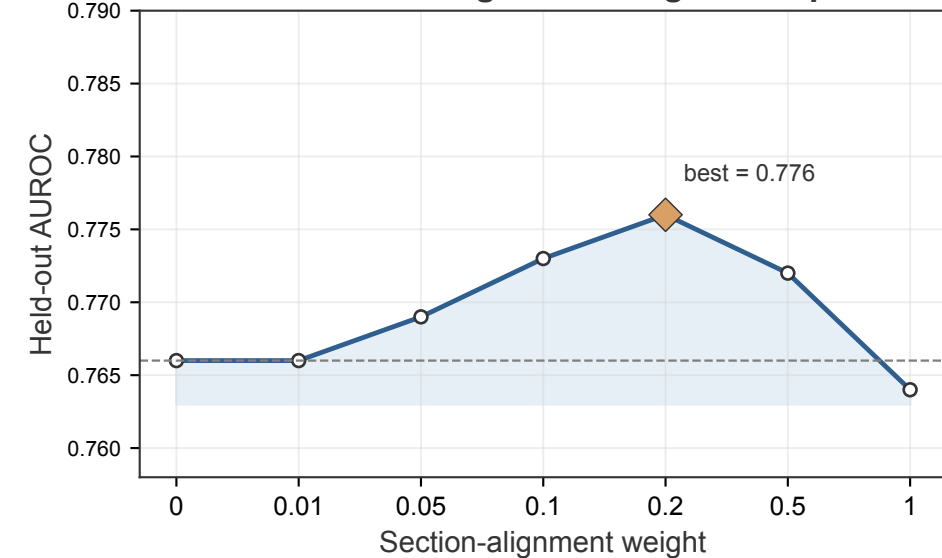

Points use manuscript-table AUROC values; p values use paired bootstrap on re-exported matched test predictions (n=288). Variants without a risk head use constant risk = 0.5.