

DOLIVO ✱

Specialist power systems due diligence for **utility-scale solar** and battery assets.

Engineer-led technical review and solutions for developers, IPPs, asset owners and investors, across grid connection, compliance, controls and operational performance.

Where We Support

Specialist power systems engineering, applied at the points in the project lifecycle where it materially affects value, deliverability and performance.

01

Development & acquisition

Reviewing grid connection requirements, electrical assumptions and capacity risks before commercial commitments.

02

Detailed design & pre-construction

Checking connection requirements, equipment selection and controller requirements stay aligned as the project develops.

03

Commissioning & handover

Reviewing models, plant settings and control-system behaviour before testing and energisation.

04

Operations & asset management

Analysing operational data to identify compliance issues, control problems and underperformance and put solutions into place.



Grid-Related Cost Exposure on Two 100 MW Solar Assets

CHALLENGE


Multi-six-figure annualised grid-related charges linked to import capacity and reactive power behaviour, with unclear root cause.

DOLIVO'S WORK

SCADA and power system modelling to separate short-duration events from the sustained operating behaviour driving the exposure, and revise plant controls and contracted import capacity accordingly.

OUTCOME

SCADA and power system modelling to separate short-duration events from the sustained operating behaviour driving the exposure, and revise plant controls and contracted import capacity accordingly.

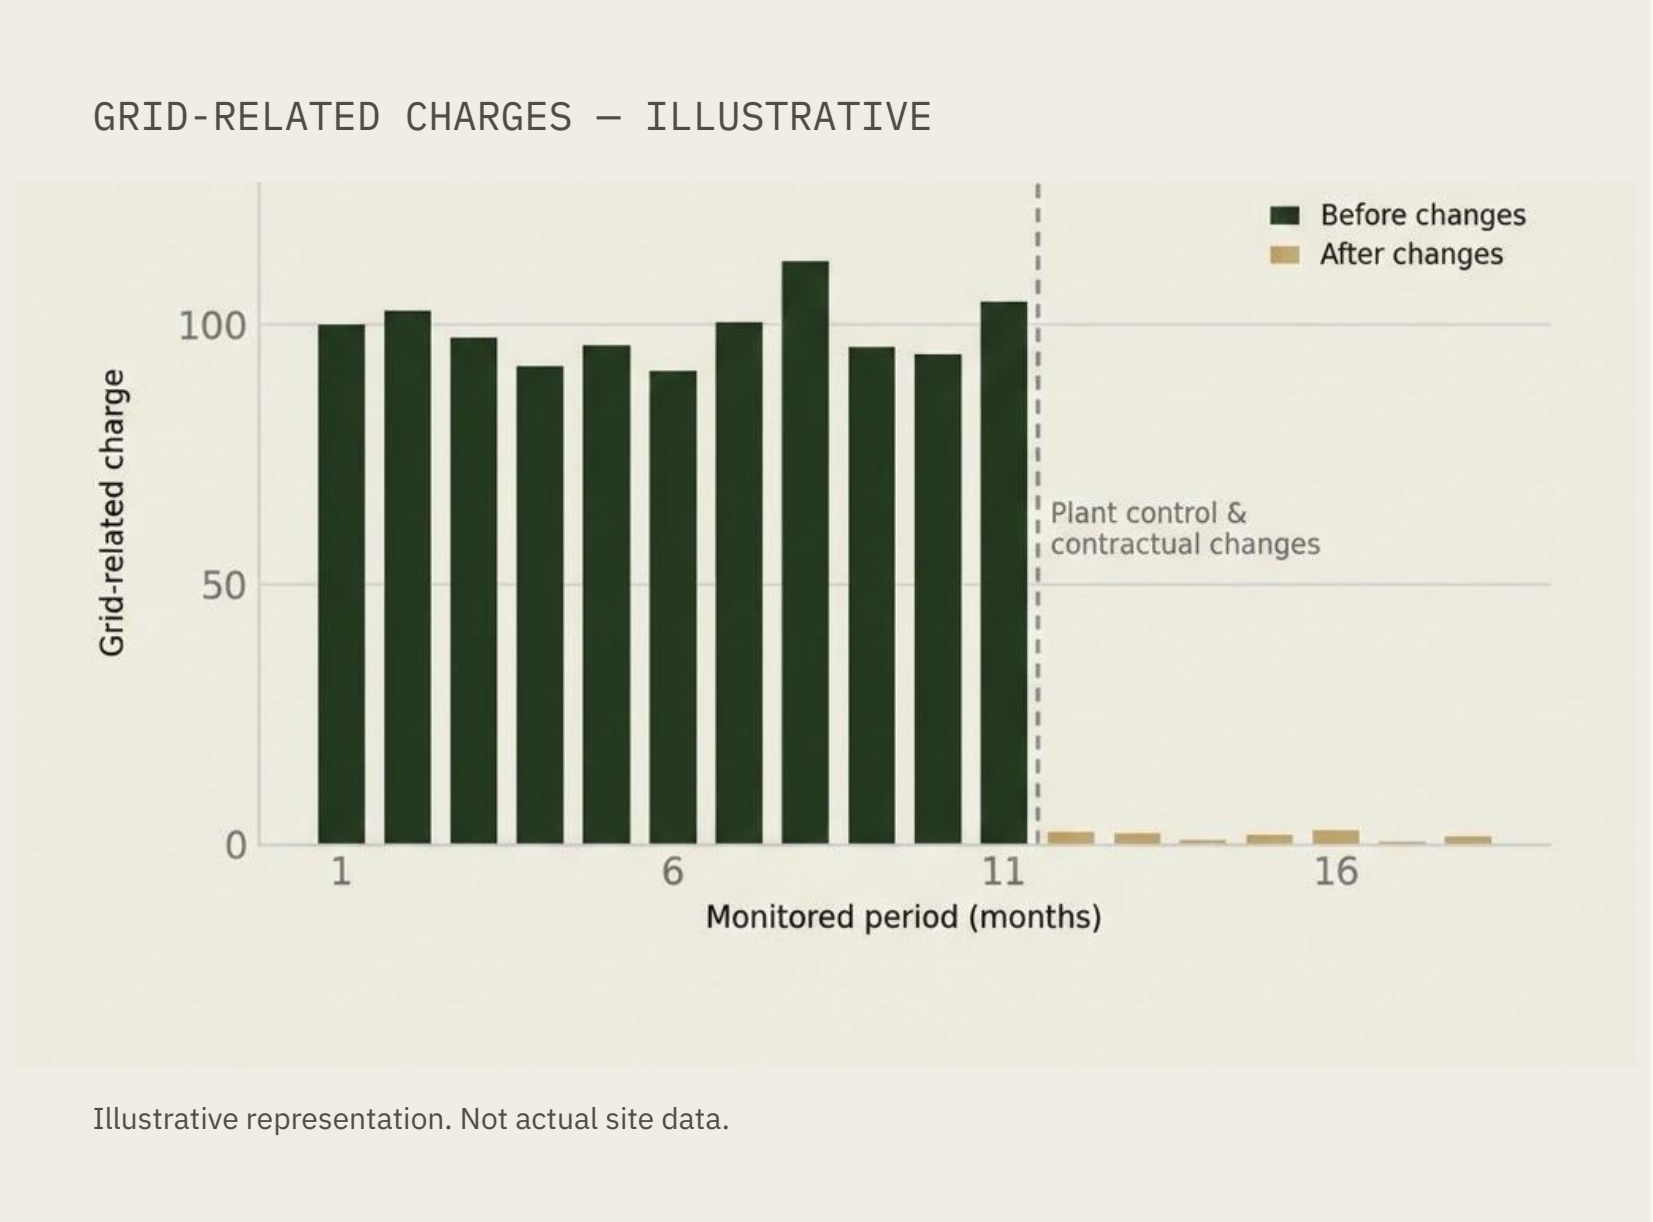

equivalent grid-related charges in the monitored post-change period



Voltage & Reactive Power Optimization on Two 6 MW Sites

CHALLENGE

The Volt-VAR curve set at commissioning matched conditions materially lower than the actual voltage at the point of interconnection, leaving the plants exporting reactive power instead of supporting the grid.

DOLIVO'S WORK


Diagnostic review of voltage distributions, inverter response and transformer tap configuration, followed by a revised Volt-VAR curve aligned with real grid conditions.

OUTCOME


Diagnostic review of voltage distributions, inverter response and transformer tap configuration, followed by a revised Volt-VAR curve aligned with real grid conditions.

+3% calculated increase in active power production from revised control settings

VOLT-VAR CURVE — ILLUSTRATIVE

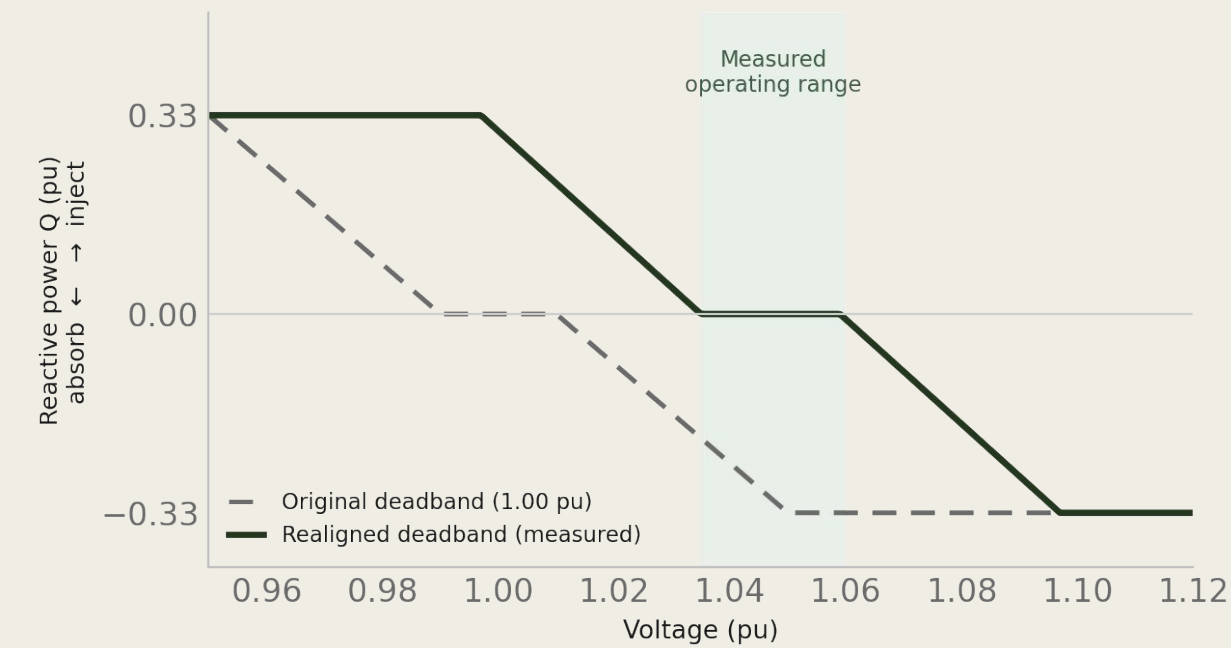

Site Voltage Distribution — ILLUSTRATIVE

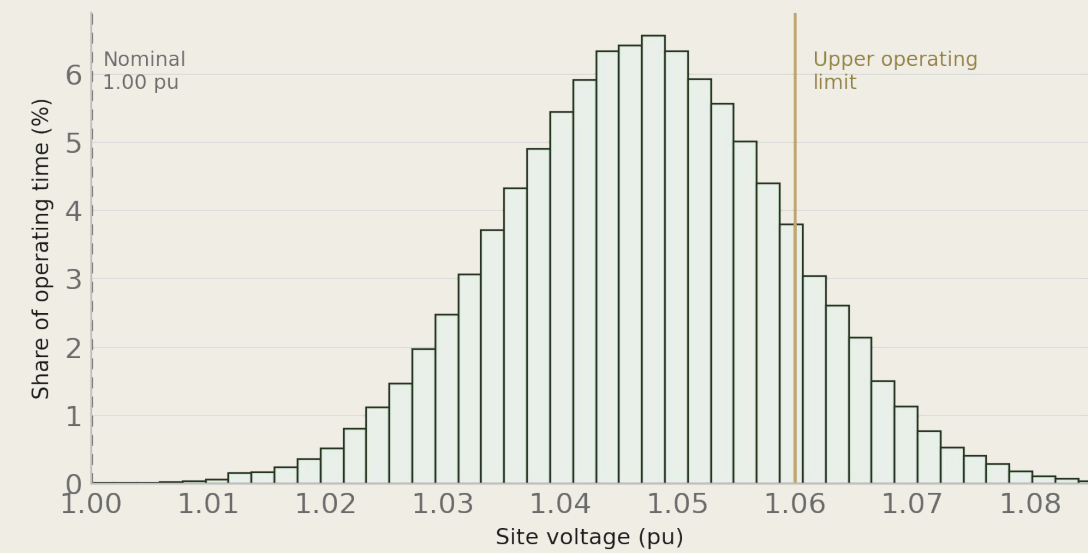

Illustrative representation. Not actual site data.



Working With Dolivo

An initial engagement typically focuses on a single project or one or more operational assets. From there, we work with you to extend the approach across your wider portfolio through a platform approach.

conall.walsh@dolivogen.com

dolivogen.com

