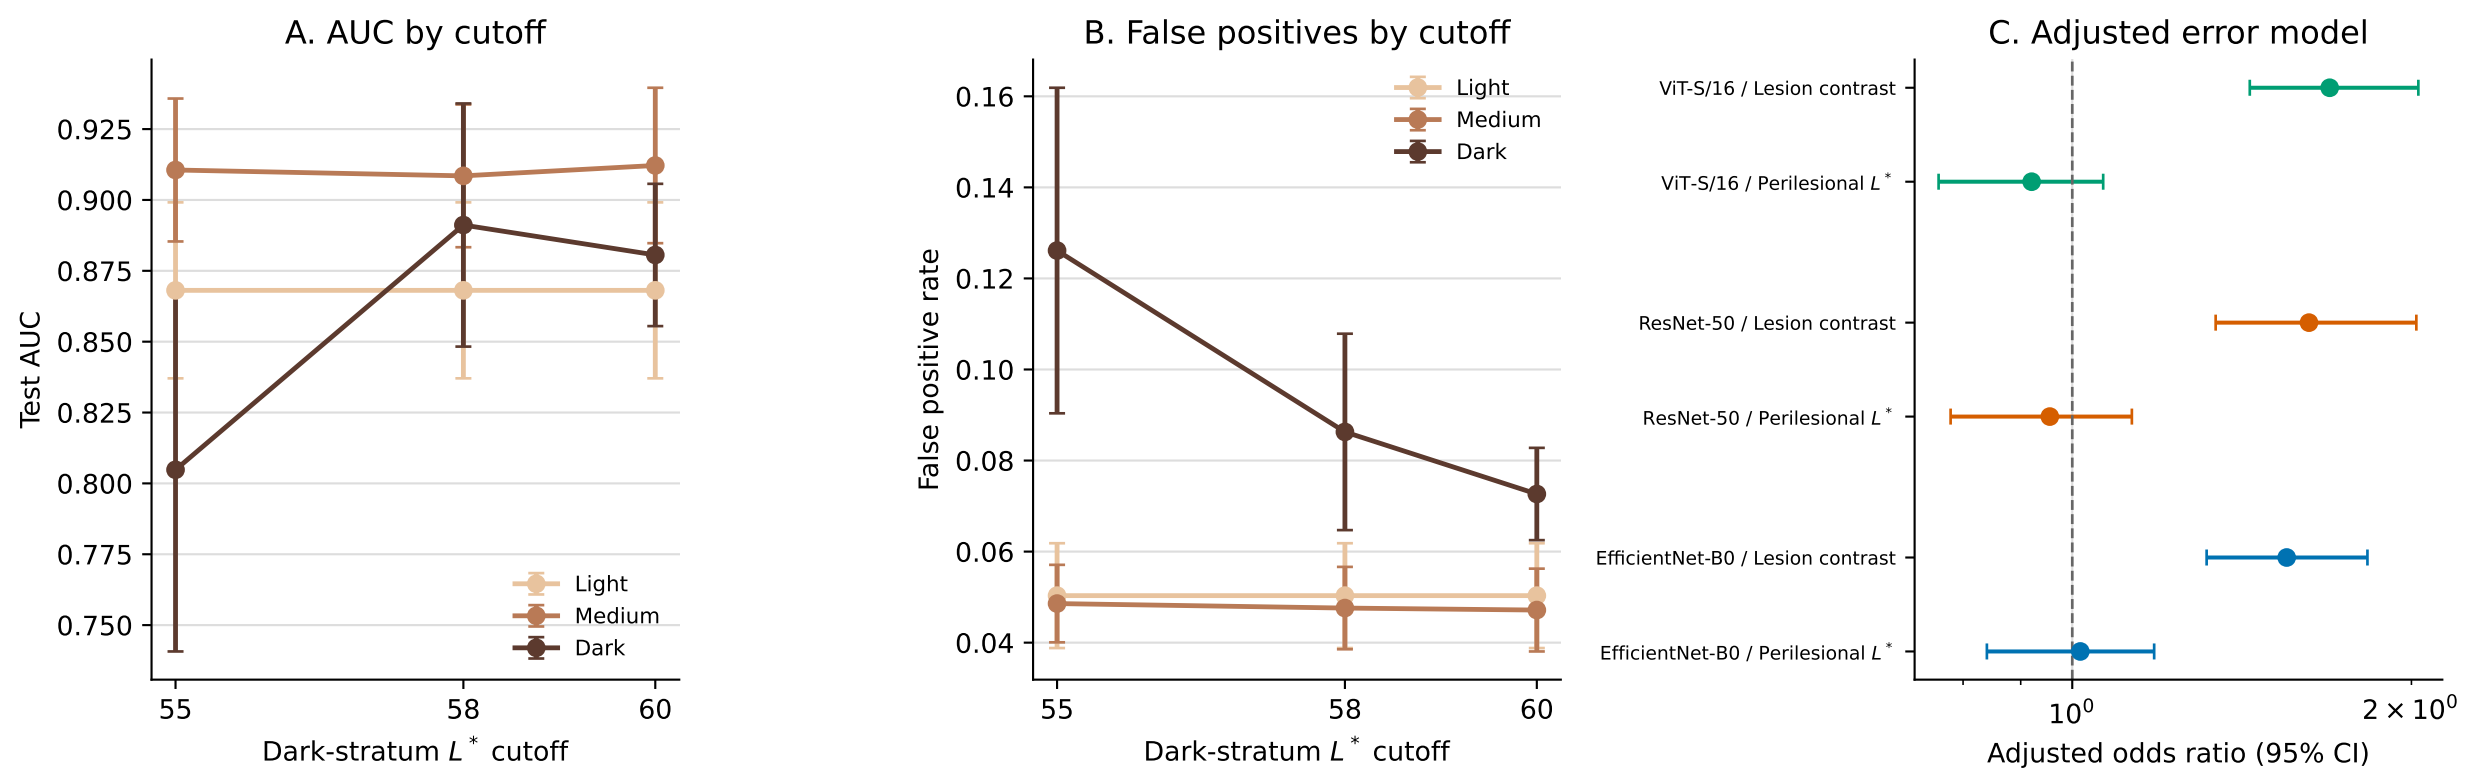
A. AUC by cutoff
Test AUC
0.925
0.900
0.875
0.850
0.825
0.800
0.775
0.750
Light
Medium
Dark
55
58
60
Dark-stratum L^* cutoff
B. False positives by cutoff
False positive rate
0.16
0.14
0.12
0.10
0.08
0.06
0.04
Light
Medium
Dark
55
58
60
Dark-stratum L^* cutoff
C. Adjusted error model
ViT-S/16 / Lesion contrast
ViT-S/16 / Perilesional L^*
ResNet-50 / Lesion contrast
ResNet-50 / Perilesional L^*
EfficientNet-B0 / Lesion contrast
EfficientNet-B0 / Perilesional L^*
10^0
2×10^0
Adjusted odds ratio (95% CI)