


本圖完工後請速歸還

[illegible]

ERECTION MATERIALS				
<u>PT NO</u>	<u>COMPONENT DESCRIPTION</u>	<u>N.S. (INS)</u>	<u>ITEM CODE</u>	<u>QTY</u>
<u>FLANGES</u>				
1	FLANGE BLIND 150# RF A182-F304 ASME B16.5	4	S1P4/FBR-4"	1
<u>GASKETS</u>				
2	GASKET 150# RF 3.0 MM THICK VIRGIN PTFE ZW#7500 ASME B16.21/B16.5	4	S1P4/GR-4"-ZW#7500	2
<u>BOLTS</u>				
3	STUD BOLT A193 GR.B8 W/ TWO HEX. HEAD HEAVY NUT A194 GR.8 ASME B1.1 B18.2.2	5/8	S1P4/BS4-5/8"X95L	16
<u>VALVES / IN-LINE ITEMS</u>				
4	BALL 150# RF A351-CF8/304SS+PTFE FULL PORT FIRE SAFE WRENCH OPER. ASME B16.34 (VOC<100 vppm)	4	S1P4/VA-4"-4144-E	1
<u>SUPPORTS</u>				
5	FLANGE GROUNDING CONDUCTOR (C-501)	4	MISC/C-501	2

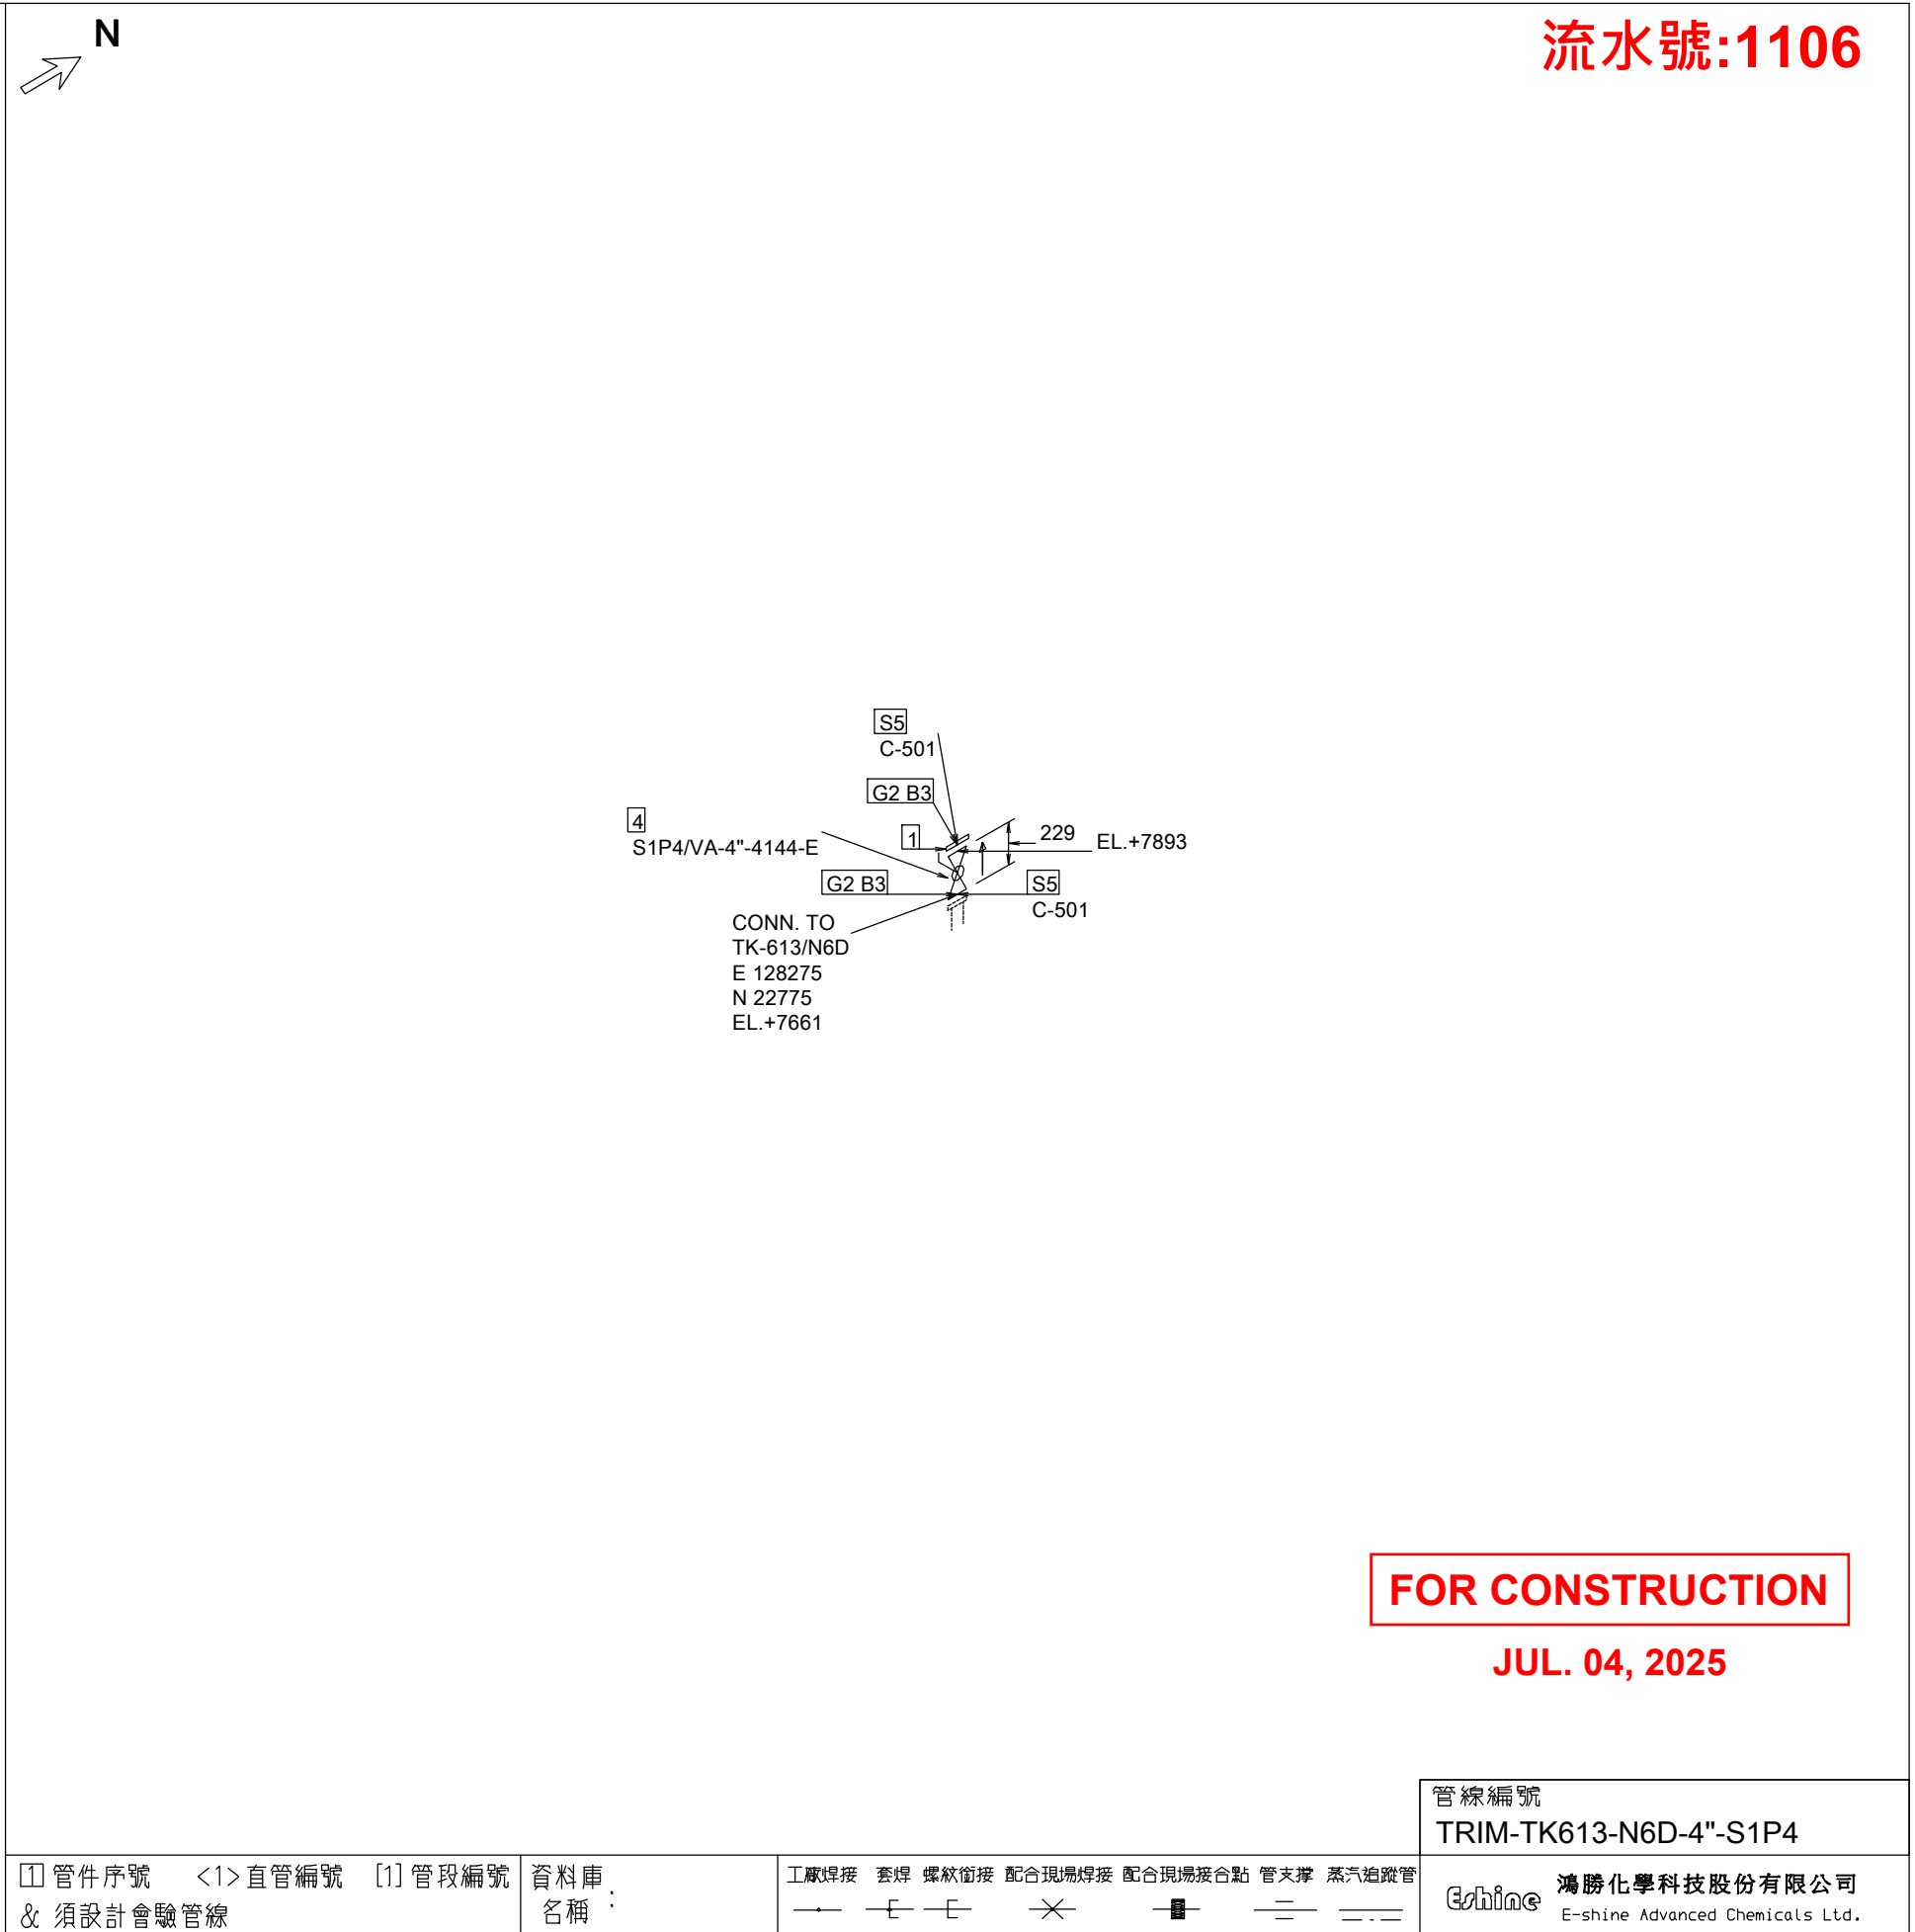

操作壓力: 0.05 $\frac{KG}{CM^2} G$		操作溫度: 38 $^{\circ}C$		管線等級: S1P4		製 圖 陳怡如 2025.04.21		會 簽			 富台工程股份有限公司 FU-TAI ENGINEERING CO., LTD.	<div>管線工程</div> <div>1</div>	
設計壓力: 0.14 $\frac{KG}{CM^2} G$		設計溫度: 80 $^{\circ}C$		保溫(冷)等級:		設 計 黃炳富 2025.04.21							<div>建廠工程</div> <div>1</div>
試驗基準: Air		0.18 $\frac{KG}{CM^2} G \times 60$ 分		熱迫縱等級:		審 核 陳安誠 2025.04.21							
管路塗裝:		管 支 撐	管 材 塗 裝		焊接基準:		認 可 陳逢明 2025.04.21						
焊道: 塗裝:			碳鋼及不銹: 鋼保溫(冷): 不銹鋼:		NDE 抽驗: 10 %		依據圖號: C2418-4-513		圖號:		檔號: TRIM-TK613-N6D-S1P4- 1		