


本圖完工後請速歸還

流水號:1123



1

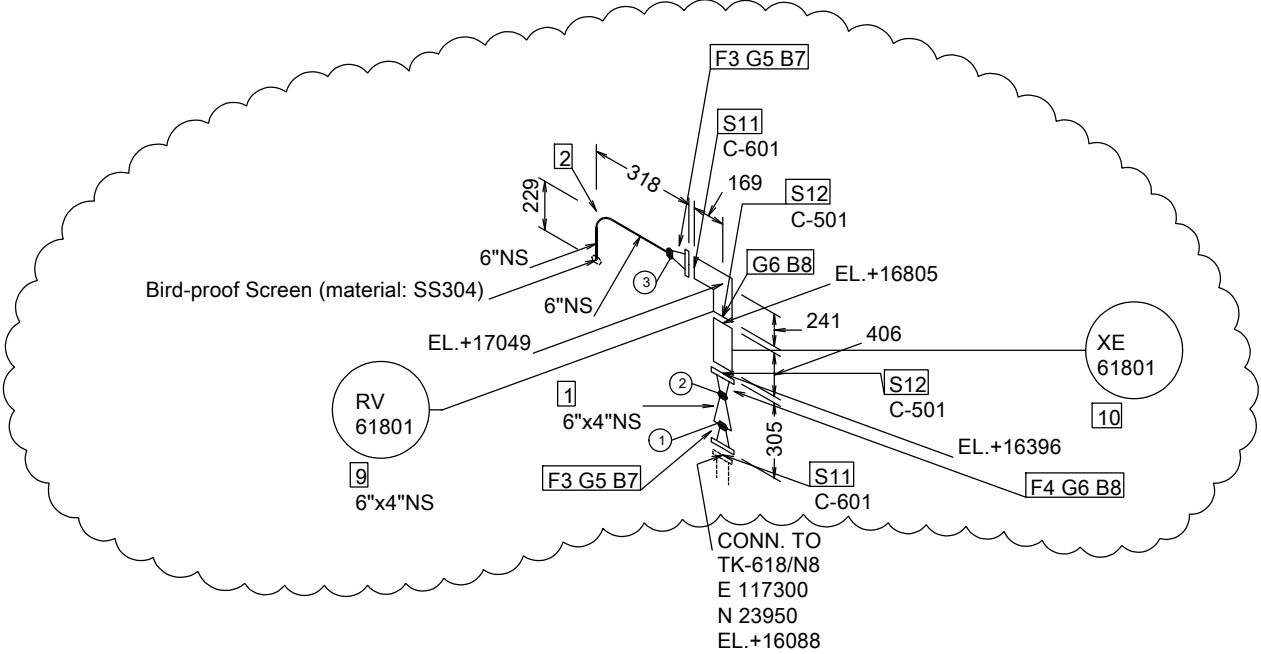

REVISED  
FOR CONSTRUCTION  
SEP. 12, 2025

管線編號  
TRIM-TK618-N8-6"-S1P4

Eshine 鴻勝化學科技股份有限公司  
E-shine Advanced Chemicals Ltd.

富台工程股份有限公司  
FU-TAI ENGINEERING CO., LTD.

管線工程  
立體配管圖

檔號: TRIM-TK618-N8-S1P4- 1

① 管件序號 <1>直管編號 [1] 管段編號 & 須設計會驗管線		資料庫名稱:	工廠焊接 套焊 螺紋銜接 配合現場焊接 配合現場接合點 管支撐 蒸汽追蹤管 — — — — —	
操作壓力: 0.05 $\frac{KG}{CM^2}G$	操作溫度: 38 °C	管線等級: S1P4	製圖: 陳怡如	2025.04.21
設計壓力: 0.14 $\frac{KG}{CM^2}G$	設計溫度: 80 °C	保溫(冷)等級:	設計: 黃炳富	2025.04.21
試驗基準: Air	0.18 $\frac{KG}{CM^2}G$ X 60 分	熱迫縱等級:	審核: 陳安誠	2025.04.21
管路塗裝:	管支撐	焊接基準:	認可: 陳逢明	2025.04.21
焊道塗裝:	管材料塗裝 碳鋼及不銹鋼保溫(冷): 不銹鋼	NDE 抽驗: 10 %	依據圖號: C2418-4-513	圖號:

FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
FITTINGS				
1	REDUCER CONC BW A403-WP304 SMLS SCH40S ASME B16.9	6 x 4	S1P4/RC-6"X4"	1
2	90 ELBOW LR BW A403-WP304 SMLS SCH40S ASME B16.9	6	S1P4/EB-6"X90	1
FLANGES				
3	FLANGE WN 150# RF A182-F304 SCH40S BORE ASME B16.5	6	S1P4/FRWN-6"	2
4	FLANGE WN 150# RF A182-F304 SCH40S BORE ASME B16.5	4	S1P4/FRWN-4"	1
ERECTION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
GASKETS				
5	GASKET 150# RF 3.0 MM THICK VIRGIN PTFE ZW#7500 ASME B16.21/B16.5	6	S1P4/GR-6"-ZW#7500	2
6	GASKET 150# RF 3.0 MM THICK VIRGIN PTFE ZW#7500 ASME B16.21/B16.5	4	S1P4/GR-4"-ZW#7500	2
BOLTS				
7	STUD BOLT A193 GR.B8 W/ TWO HEX. HEAD HEAVY NUT A194 GR.8 ASME B1.1 B18.2.2	3/4	S1P4/BS4-3/4"X105L	16
8	STUD BOLT A193 GR.B8 W/ TWO HEX. HEAD HEAVY NUT A194 GR.8 ASME B1.1 B18.2.2	5/8	S1P4/BS4-5/8"X95L	16
INSTRUMENTS				
9	BREATHER VALVE 150# RF RV 61801	6 x 4		1
10	FLAME ARRESTOR 150# RF XE 61801	4		1
SUPPORTS				
11	FLANGE GROUNDING CONDUCTOR (C-601)	6	MISC/C-601	2
12	FLANGE GROUNDING CONDUCTOR (C-501)	4	MISC/C-501	2

△						
①	2025.09.12	REVISED FOR CONSTRUCTION	黃炳富	陳逢明		
②	2025.07.03	FOR CONSTRUCTION	黃炳富	陳逢明		
③	2025.04.21	FOR APPROVAL	黃炳富	陳逢明		
序次	日期	修改說明	修改	認可		