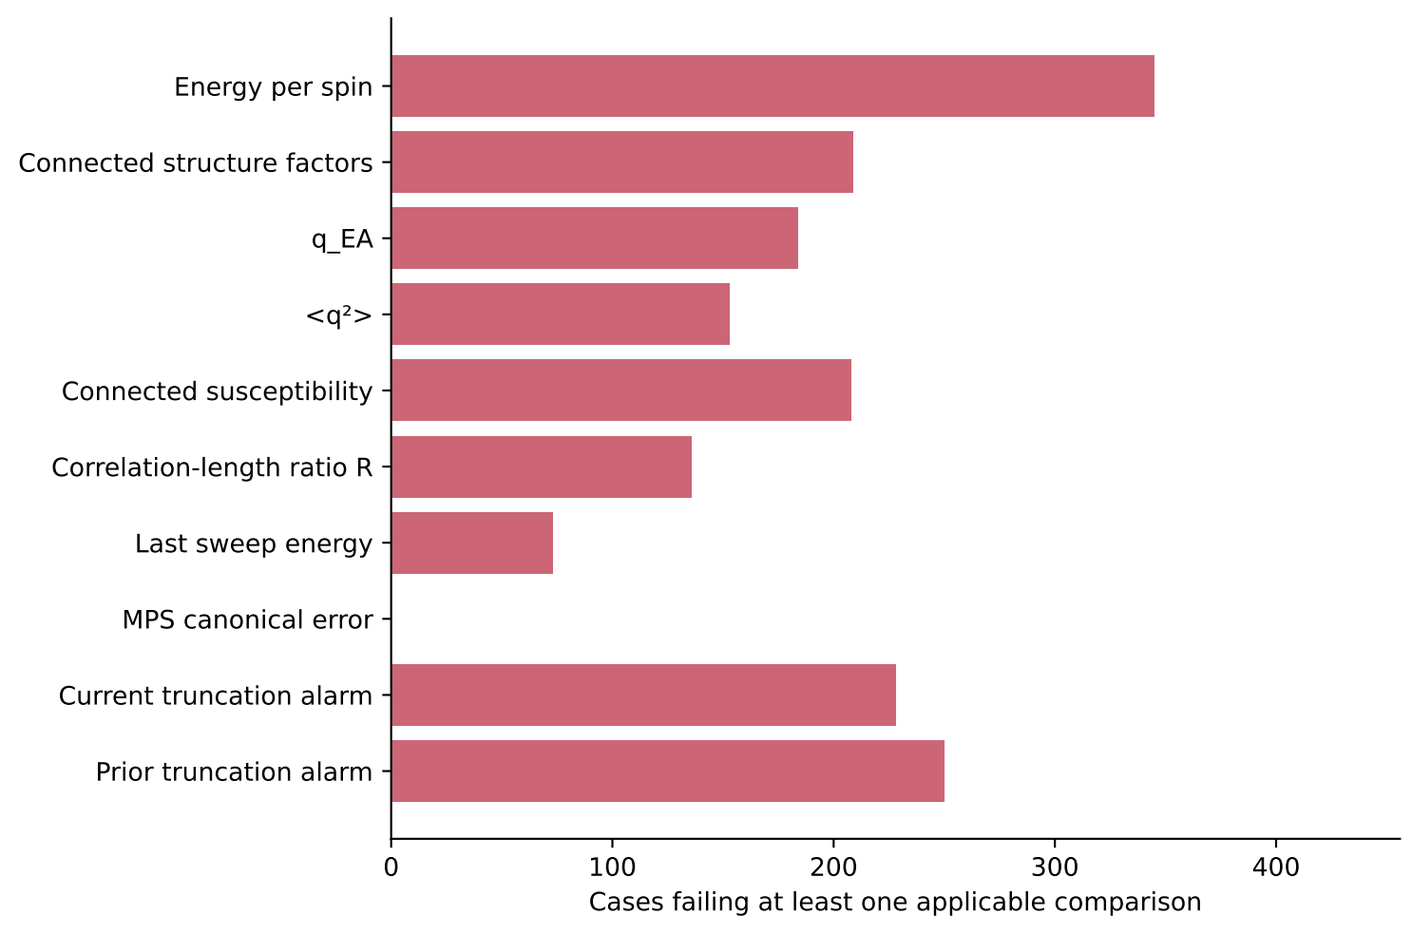
Energy per spin
Connected structure factors
q_EA
<q²>
Connected susceptibility
Correlation-length ratio R
Last sweep energy
MPS canonical error
Current truncation alarm
Prior truncation alarm
0
100
200
300
400
Cases failing at least one applicable comparison

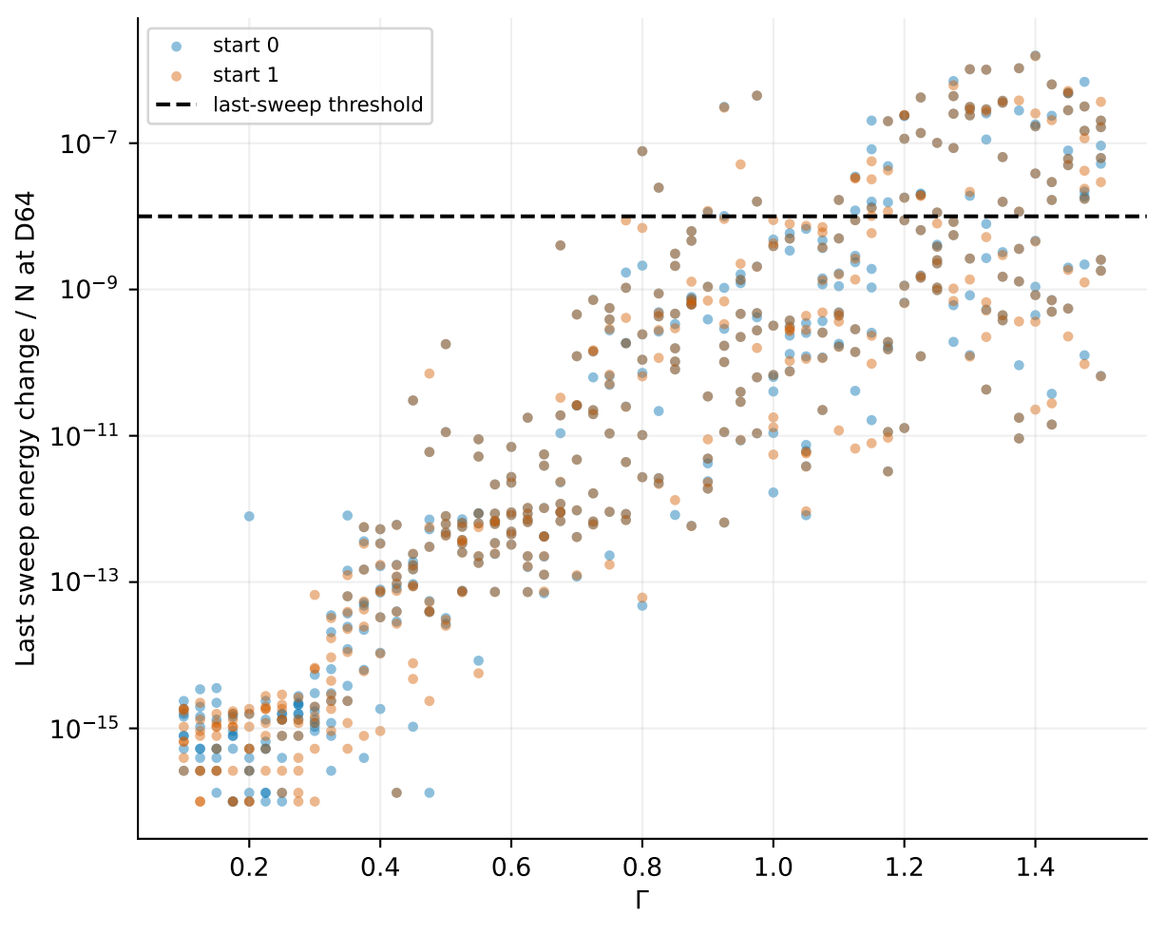
start 0
start 1
last-sweep threshold
10^{-7}
10^{-9}
10^{-11}
10^{-13}
10^{-15}
Last sweep energy change / N at D64
0.2
0.4
0.6
0.8
1.0
1.2
1.4
Γ