




Zone 1 — Rockhampton

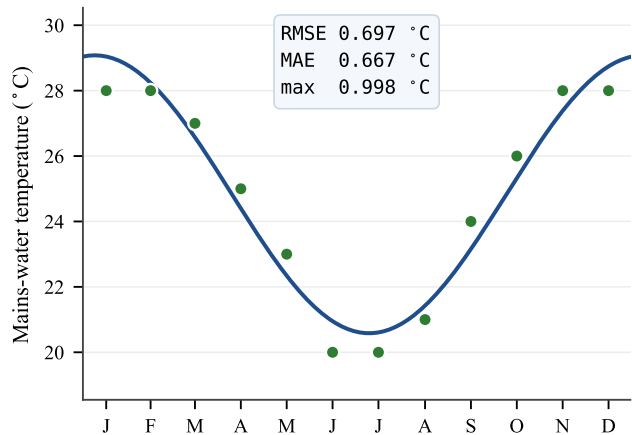


Zone 2 — Alice Springs

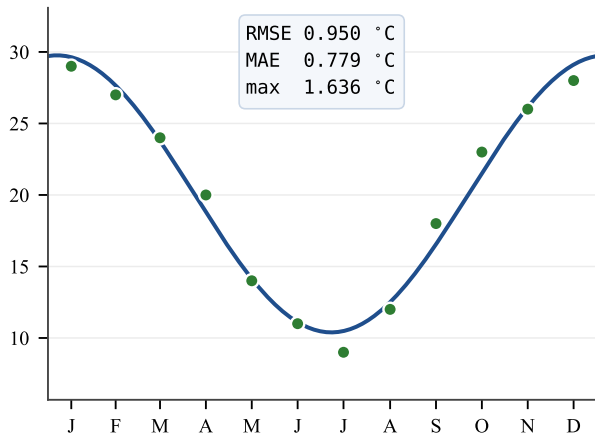

Zone 3 — Sydney

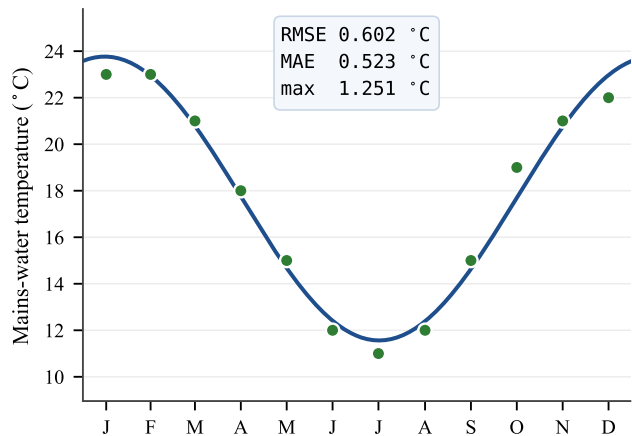

Zone 4 — Melbourne

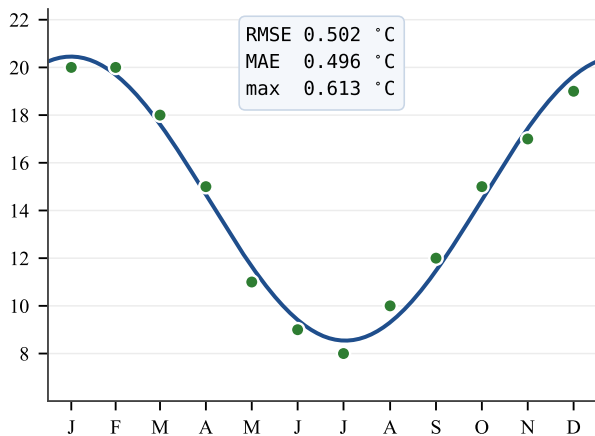

In-sample fit quality (°C)

Zone	RMSE	MAE
Rockhampton	0.697	0.667
Alice Springs	0.950	0.779
Sydney	0.602	0.523
Melbourne	0.502	0.496
All four	0.708	

All four zones of the CER solar-water-heater table are shown; the calculator's nearest-reference search can return any of them. Residuals are in-sample — these reference values were used to fit the constants.

A fifth deck (ZONEHP5_Au_Domestic.inc, Canberra) is fitted in the same run but belongs to the five-zone air-source heat-pump table, so it is outside this model's scope. Including it gives an overall RMSE of 0.705 °C.