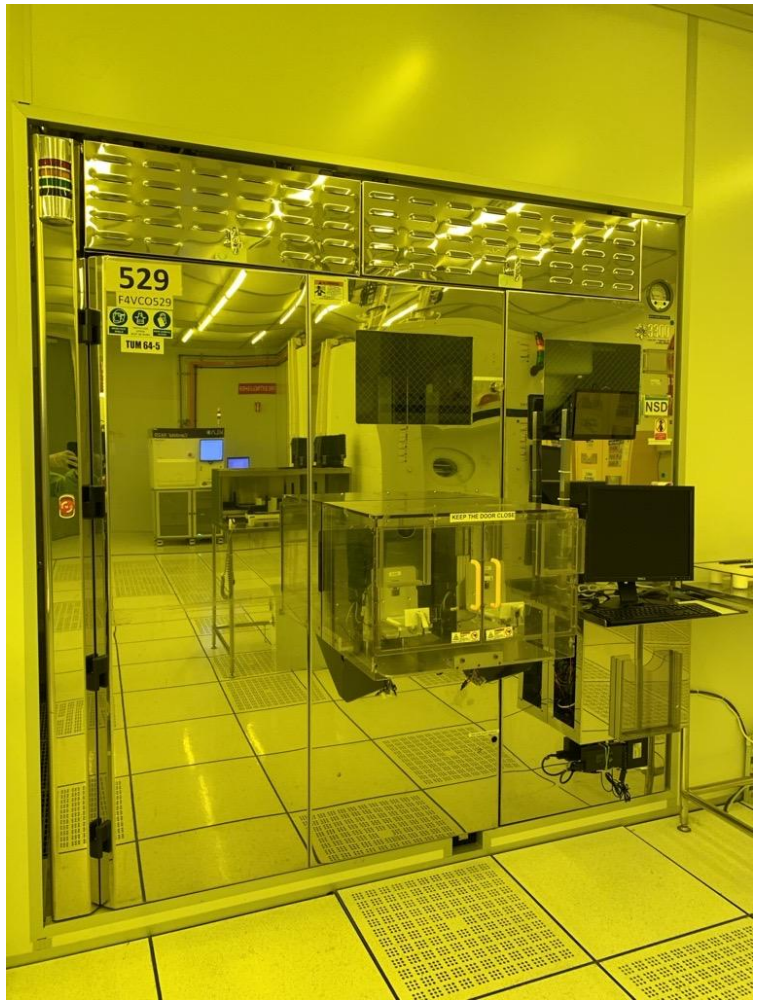
529
F4VCO529
TUM 64-5
NSD
KEEP THE DOOR CLOSE

SSEC
Solid State Equipment Corp.
185 Gibraltar Rd.
Horsham, PA 19044
Model M3305 Serial No. 2909
400VAC, 3 ph, 50 Hz, 30 A
Date of mfr. 6/16/13
AC dwg No. 330i9313
Main Protector Interrupt Rating 10,000 Amps
Conforms to ANSI/UL Std. UL 61010A-1:2002
Std. UL 61010A-2-010:2002
Cert. to CAN/CSA C22.2 No. 1010.1-92
CAN/CSA C22.2 No. 1010.2.010-94

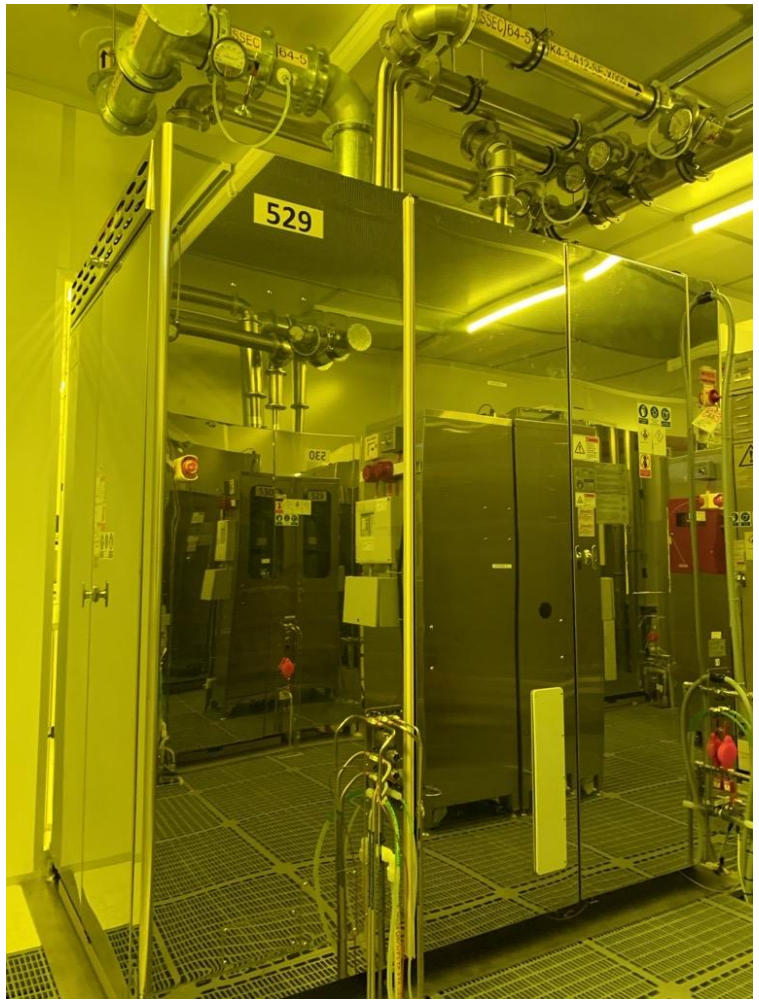
529

HPC solvent chamber 2 & 3 & Heater unit

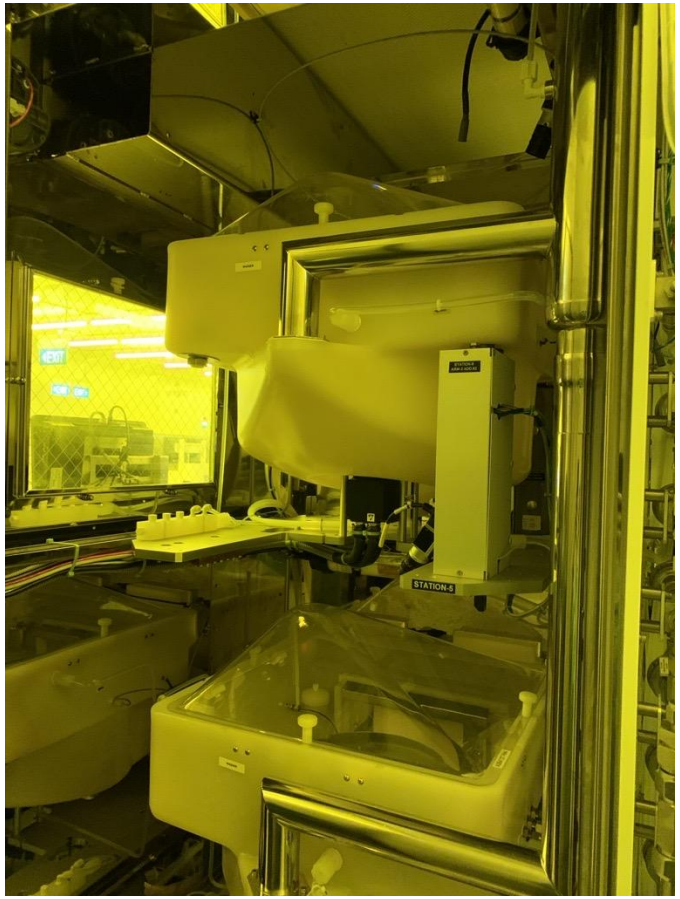

HVS Rinse chamber 4 & 5

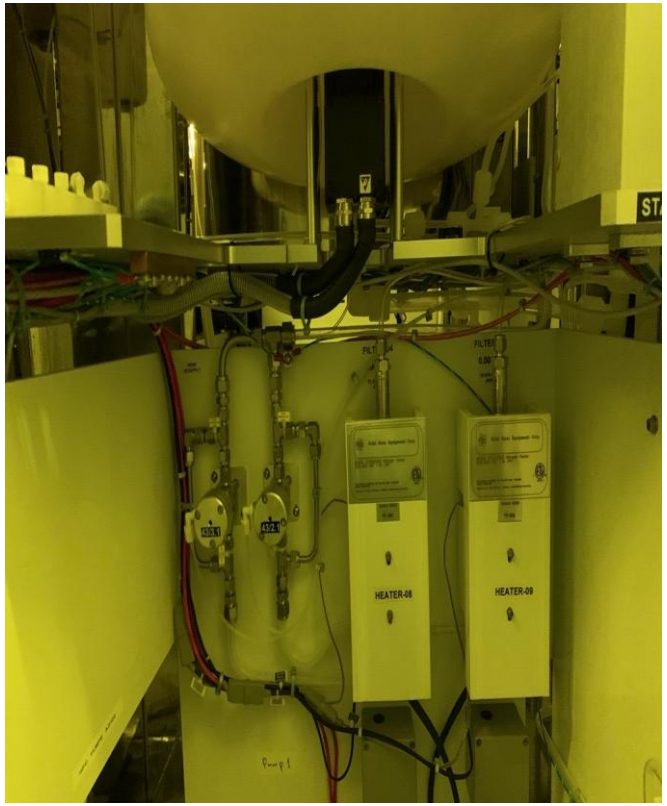

HVS Rinse chamber N2 Heater units

HVS Rinse DIW valve control

HVS Rinse DIW Tank 1 & paddle venturi valves