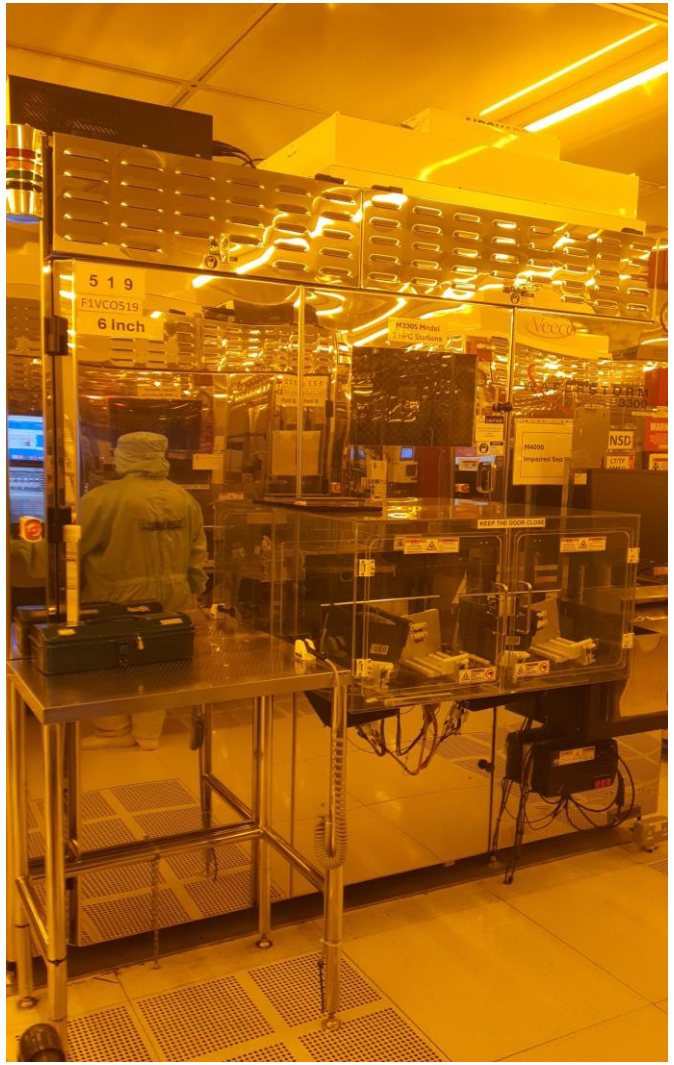
5 1 9
F1VC0519
6 inch

SSEC
Solid State Equipment LLC
185 Gibraltar Rd.
Horsham, PA 19044
Model 3305 Serial No. 3010
400VAC, 3 ph, 50Hz, 30 A
Date of mfr. 7/25/15
AC dwg No. 330i11233
Main Protector Interrupt Rating 10,000 Amps
Conforms to ANSI/UL Std. UL 61010A-1:2002
Std. UL 61010A-2-010:2002
Cert. to CAN/CSA C22.2 No 1010.1-92
CAN/CSA C22.2 No 1010.2.010-94

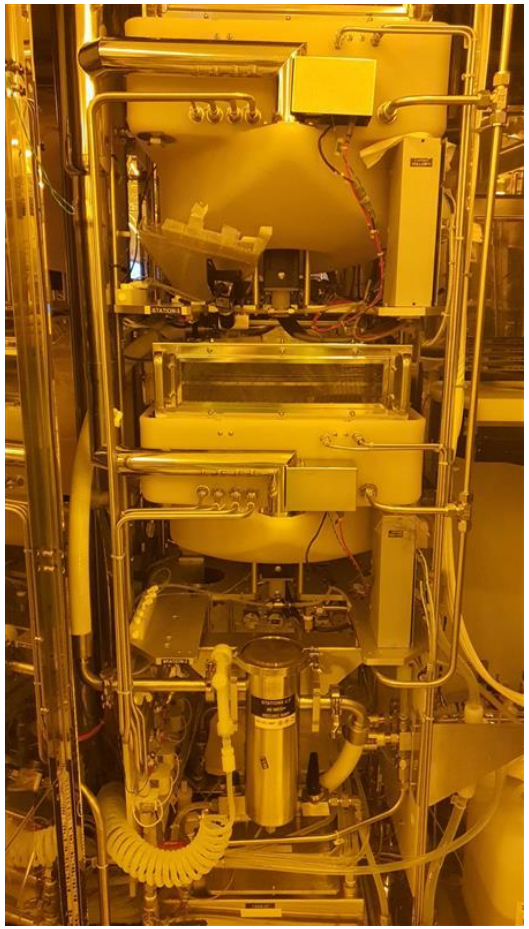

Hpc solvent chamber 2 & 3

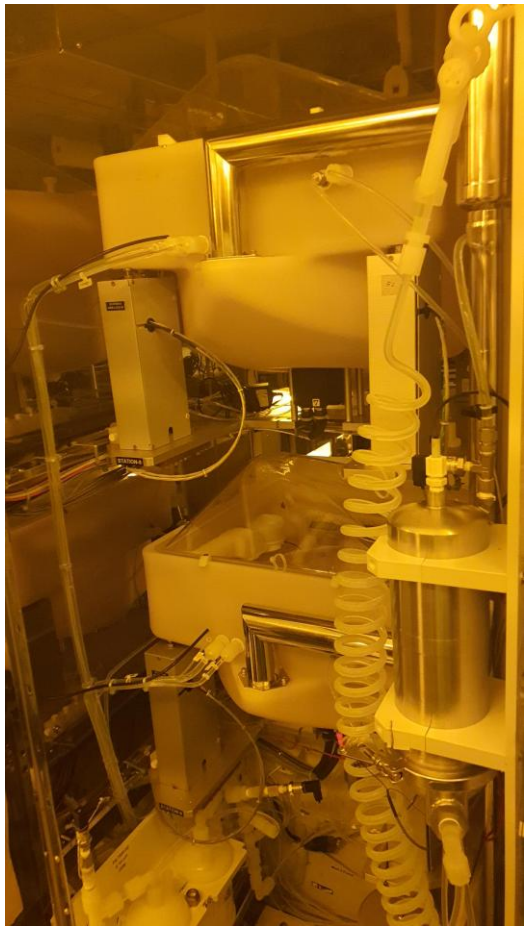

Hvs rinse chamber mod 4 & 5

N2 Heater Module 4 & 5

HPC Solvent Heaters