Conservative completion intervals; physical probability law not calibrated

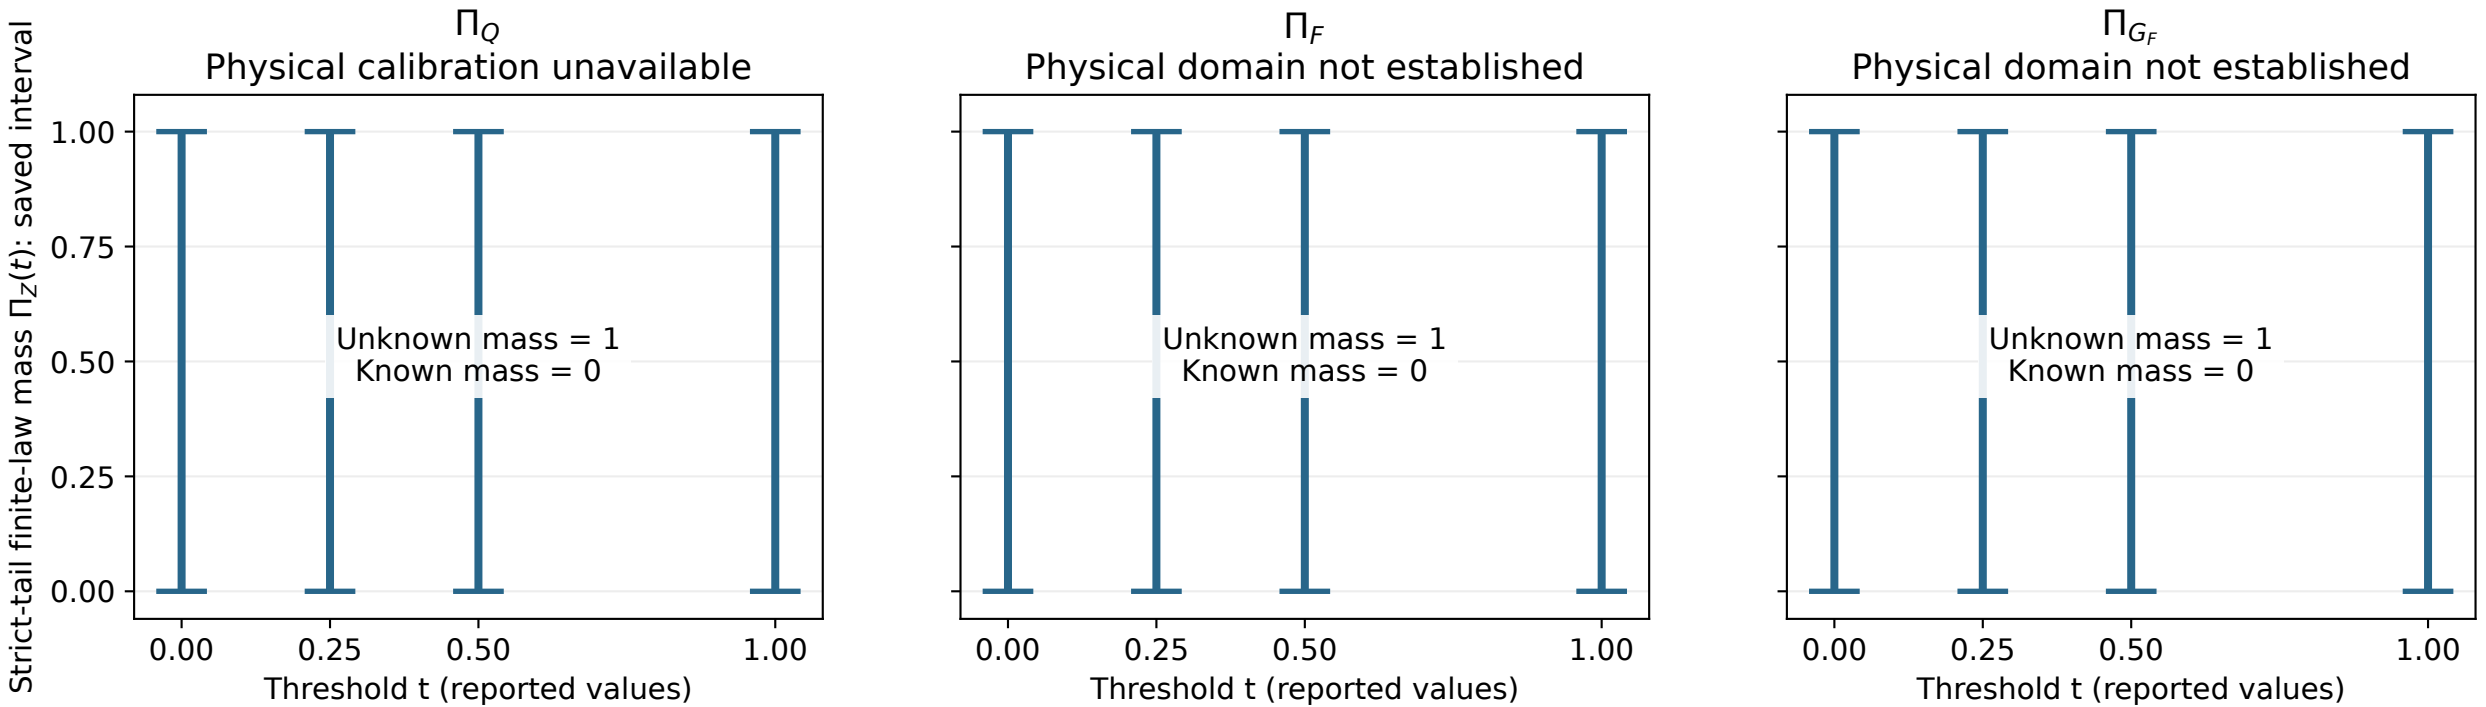

t = 1: saved upper = 1 is conservative;
not physically sharp for F in [0, 1].

G_F is not a depth measurement.

Full context: x, F, Π, Q, G_F; x_C unmeasured. All 2048 joint realizations and exact weights retained.

One coupled four-window source; unknown mass is not renormalized. No calibrated posterior or sharp physical-set claim.

diagnostic-only | transfer: none | null: unqualified | covariance: inherited conditional working law