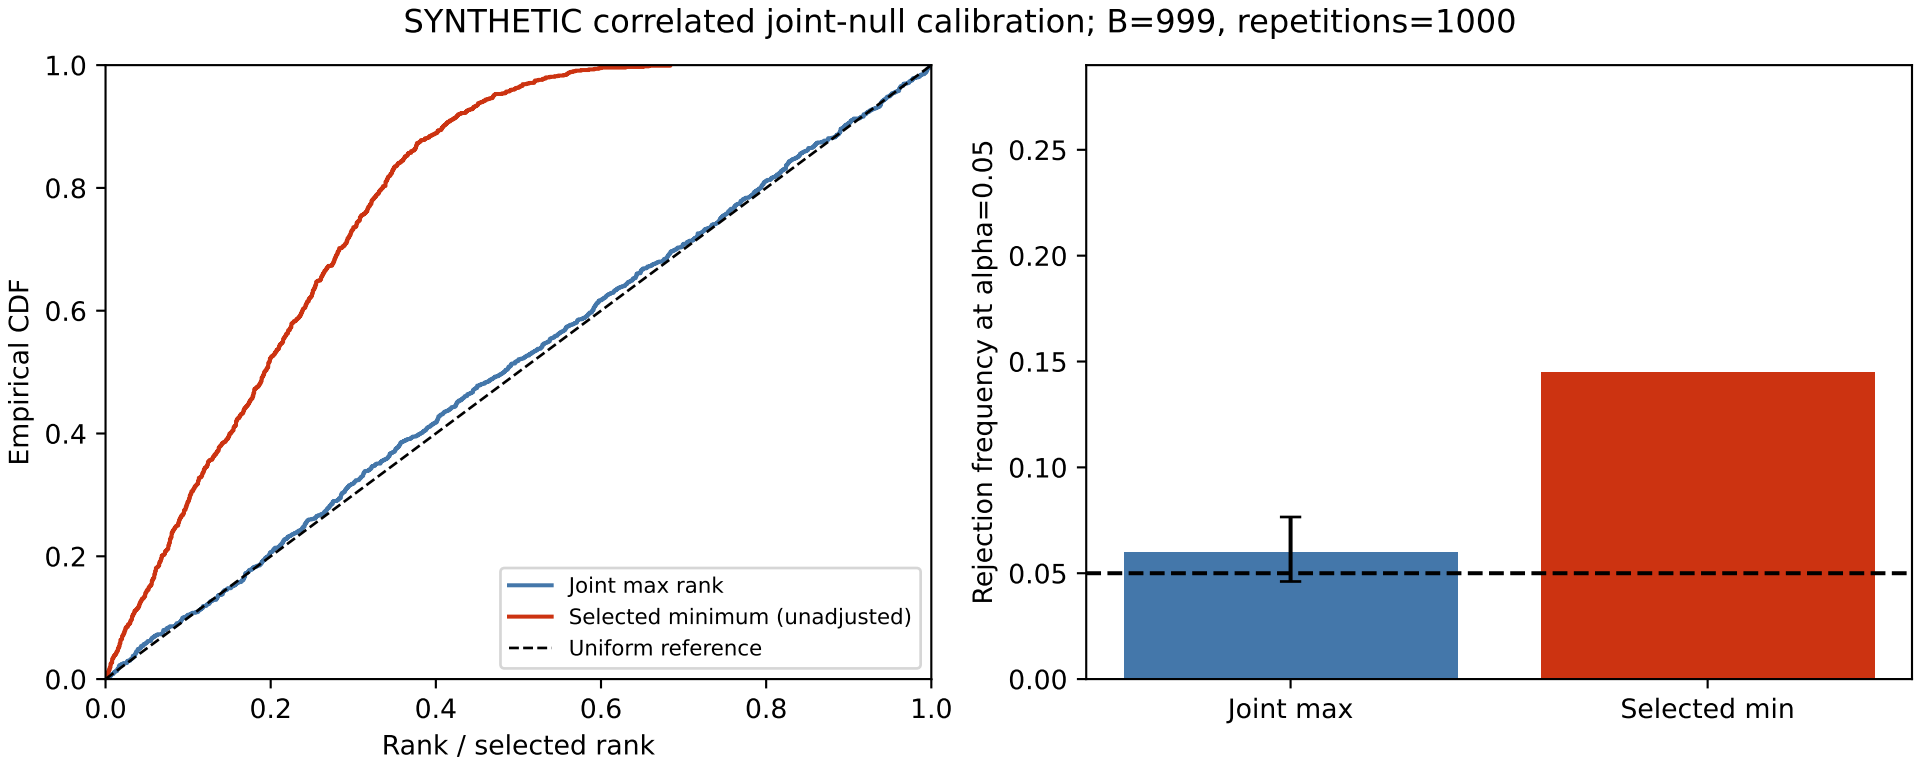
SYNTHETIC correlated joint-null calibration; B=999, repetitions=1000
Empirical CDF
Rank / selected rank
Joint max rank
Selected minimum (unadjusted)
Uniform reference
Rejection frequency at alpha=0.05
Joint max
Selected min