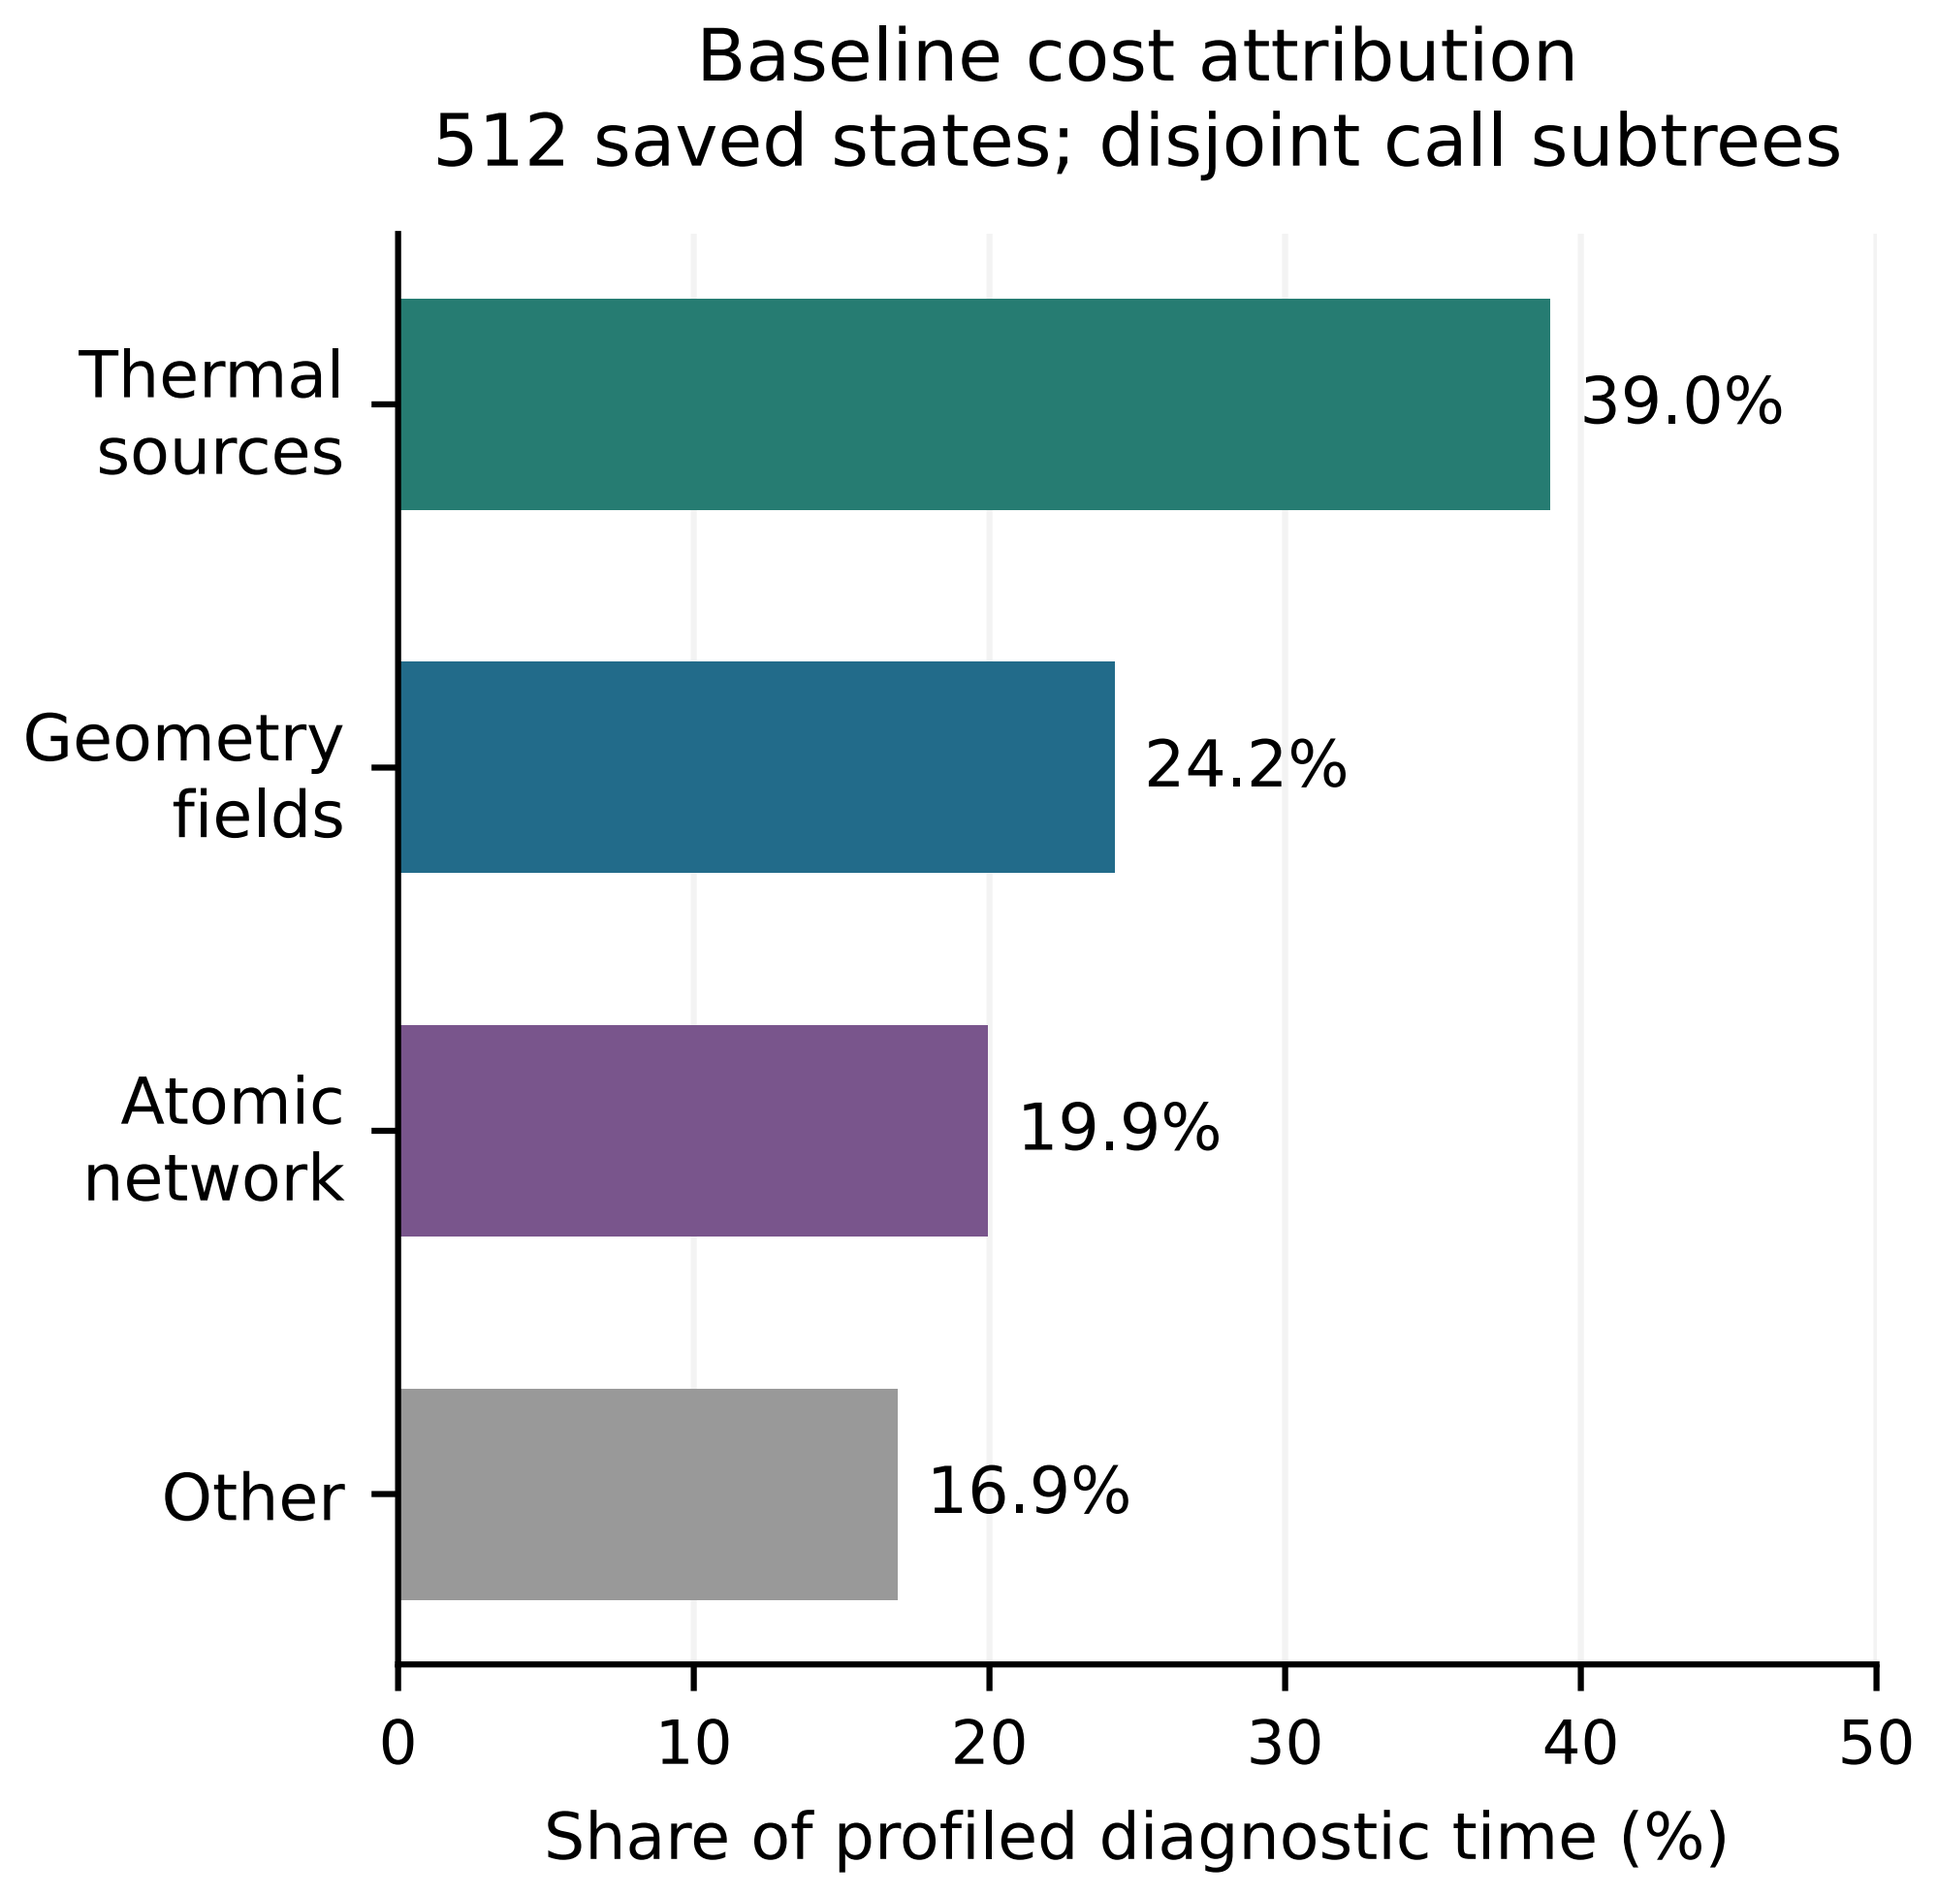
Baseline cost attribution
512 saved states; disjoint call subtrees
Thermal sources
39.0%
Geometry fields
24.2%
Atomic network
19.9%
Other
16.9%
0
10
20
30
40
50
Share of profiled diagnostic time (%)