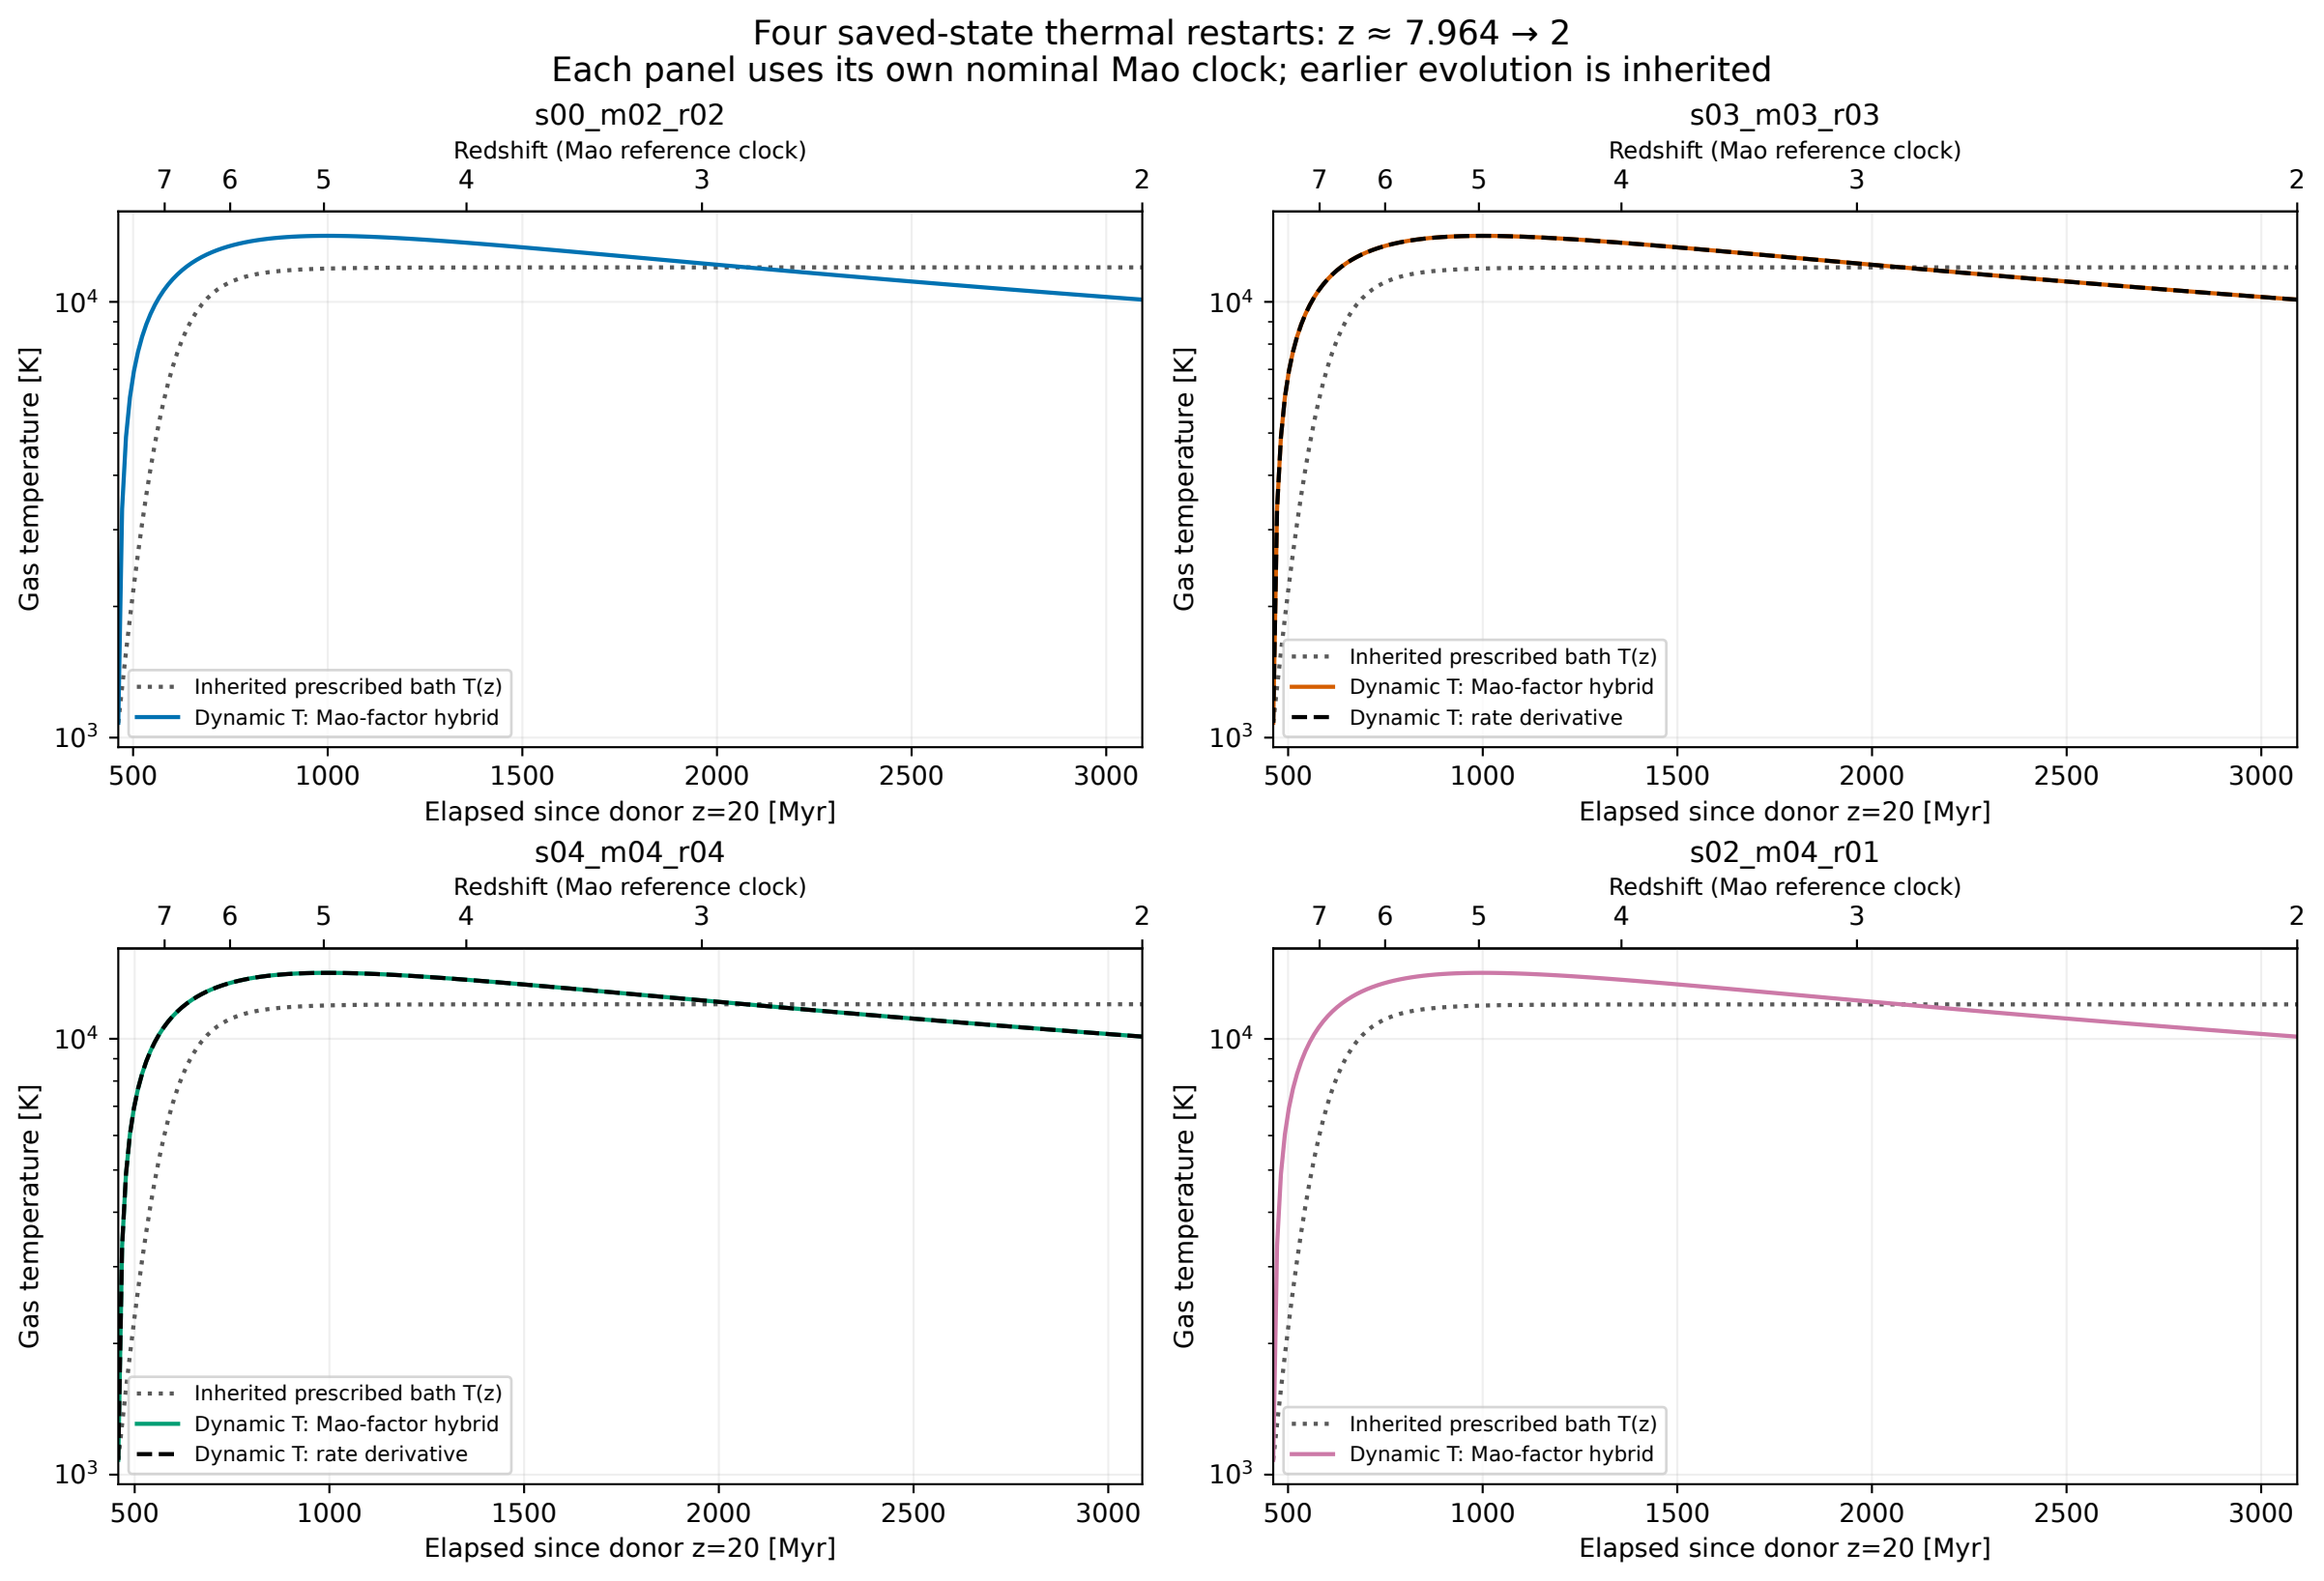
Four saved-state thermal restarts: z ≈ 7.964 → 2
Each panel uses its own nominal Mao clock; earlier evolution is inherited
s00_m02_r02
s03_m03_r03
s04_m04_r04
s02_m04_r01
Redshift (Mao reference clock)
7
6
5
4
3
2
Gas temperature [K]
10^4
10^3
500
1000
1500
2000
2500
3000
Elapsed since donor z=20 [Myr]
Inherited prescribed bath T(z)
Dynamic T: Mao-factor hybrid
Dynamic T: rate derivative