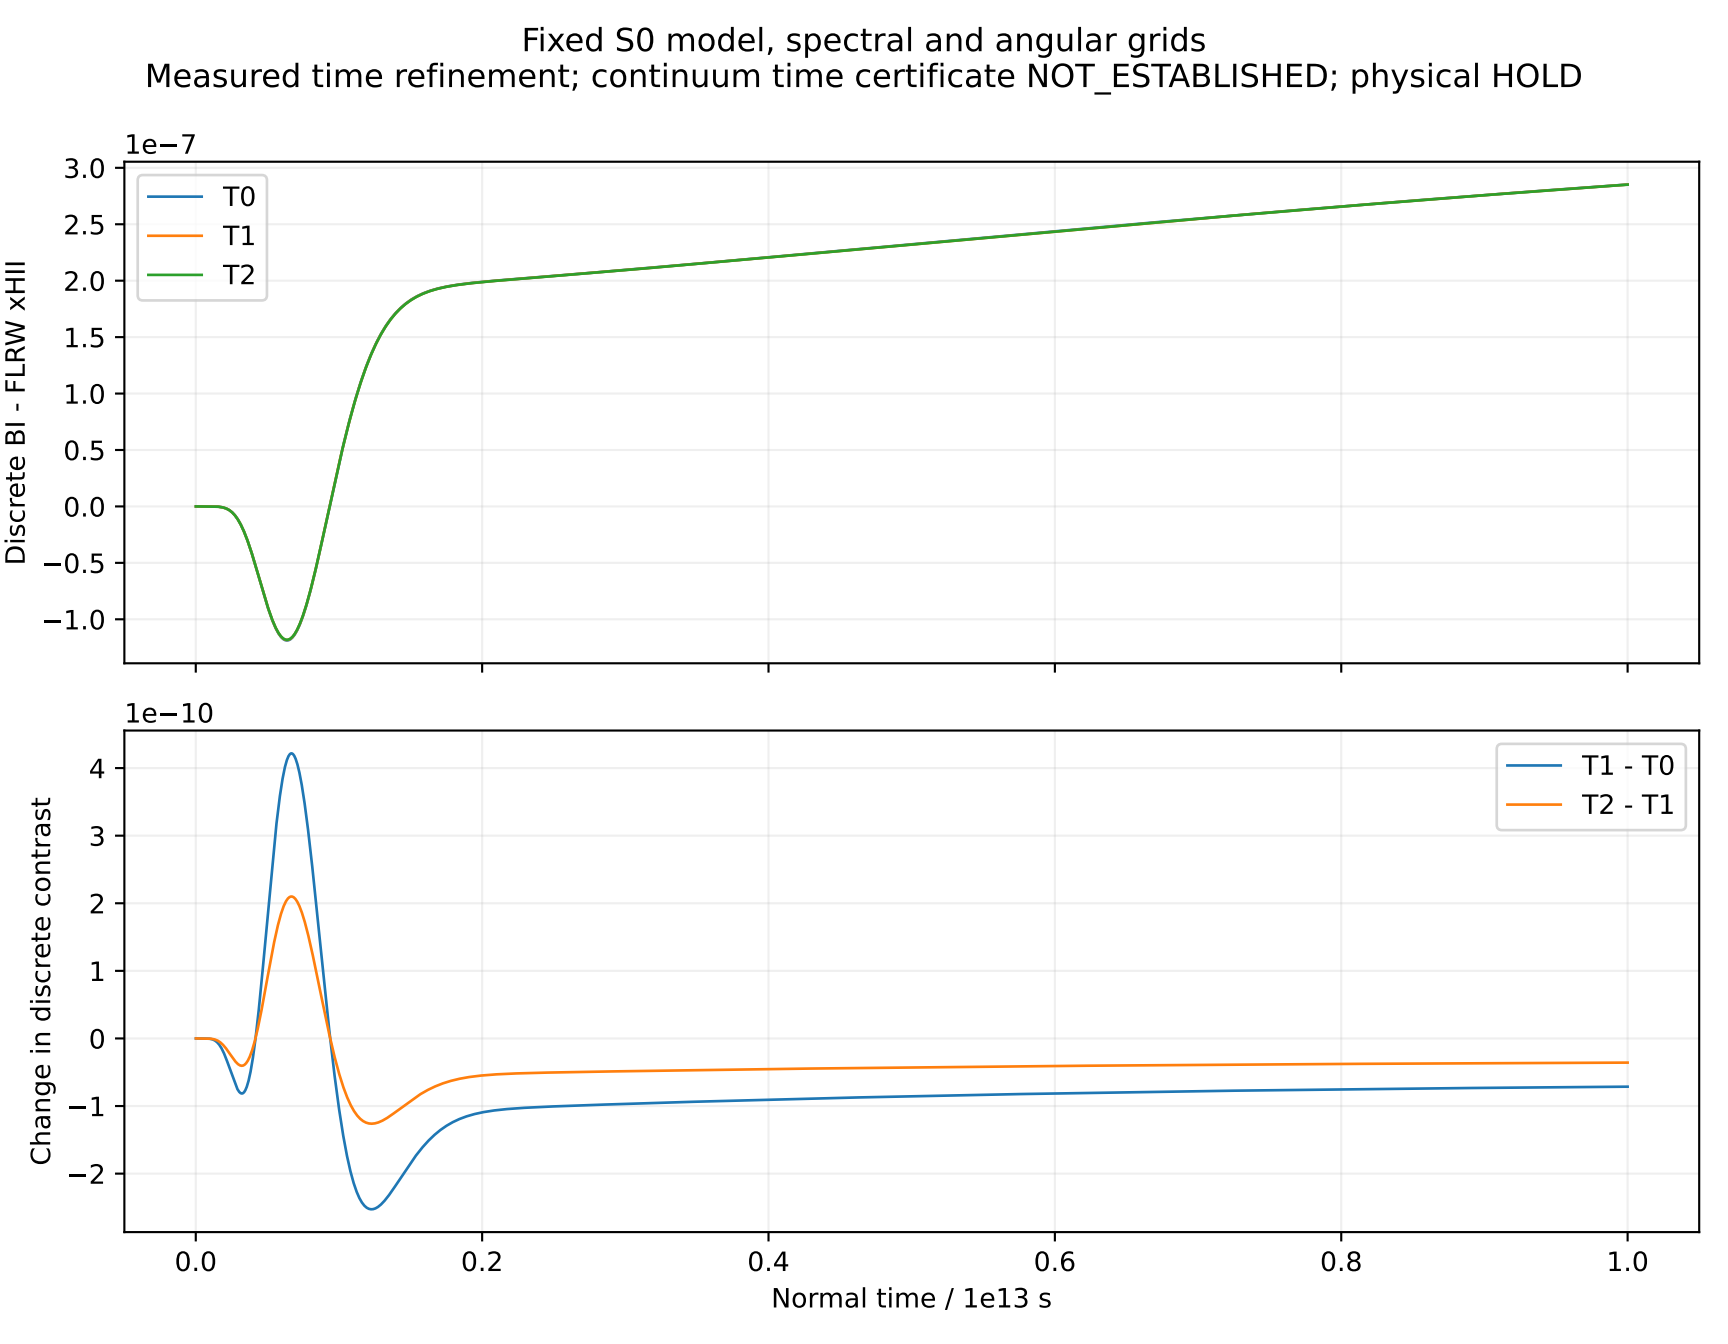
Fixed S0 model, spectral and angular grids
Measured time refinement; continuum time certificate NOT_ESTABLISHED; physical HOLD
1e−7
3.0
2.5
2.0
1.5
1.0
0.5
0.0
−0.5
−1.0
T0
T1
T2
Discrete BI - FLRW xHII
1e−10
4
3
2
1
0
−1
−2
T1 - T0
T2 - T1
Change in discrete contrast
0.0
0.2
0.4
0.6
0.8
1.0
Normal time / 1e13 s