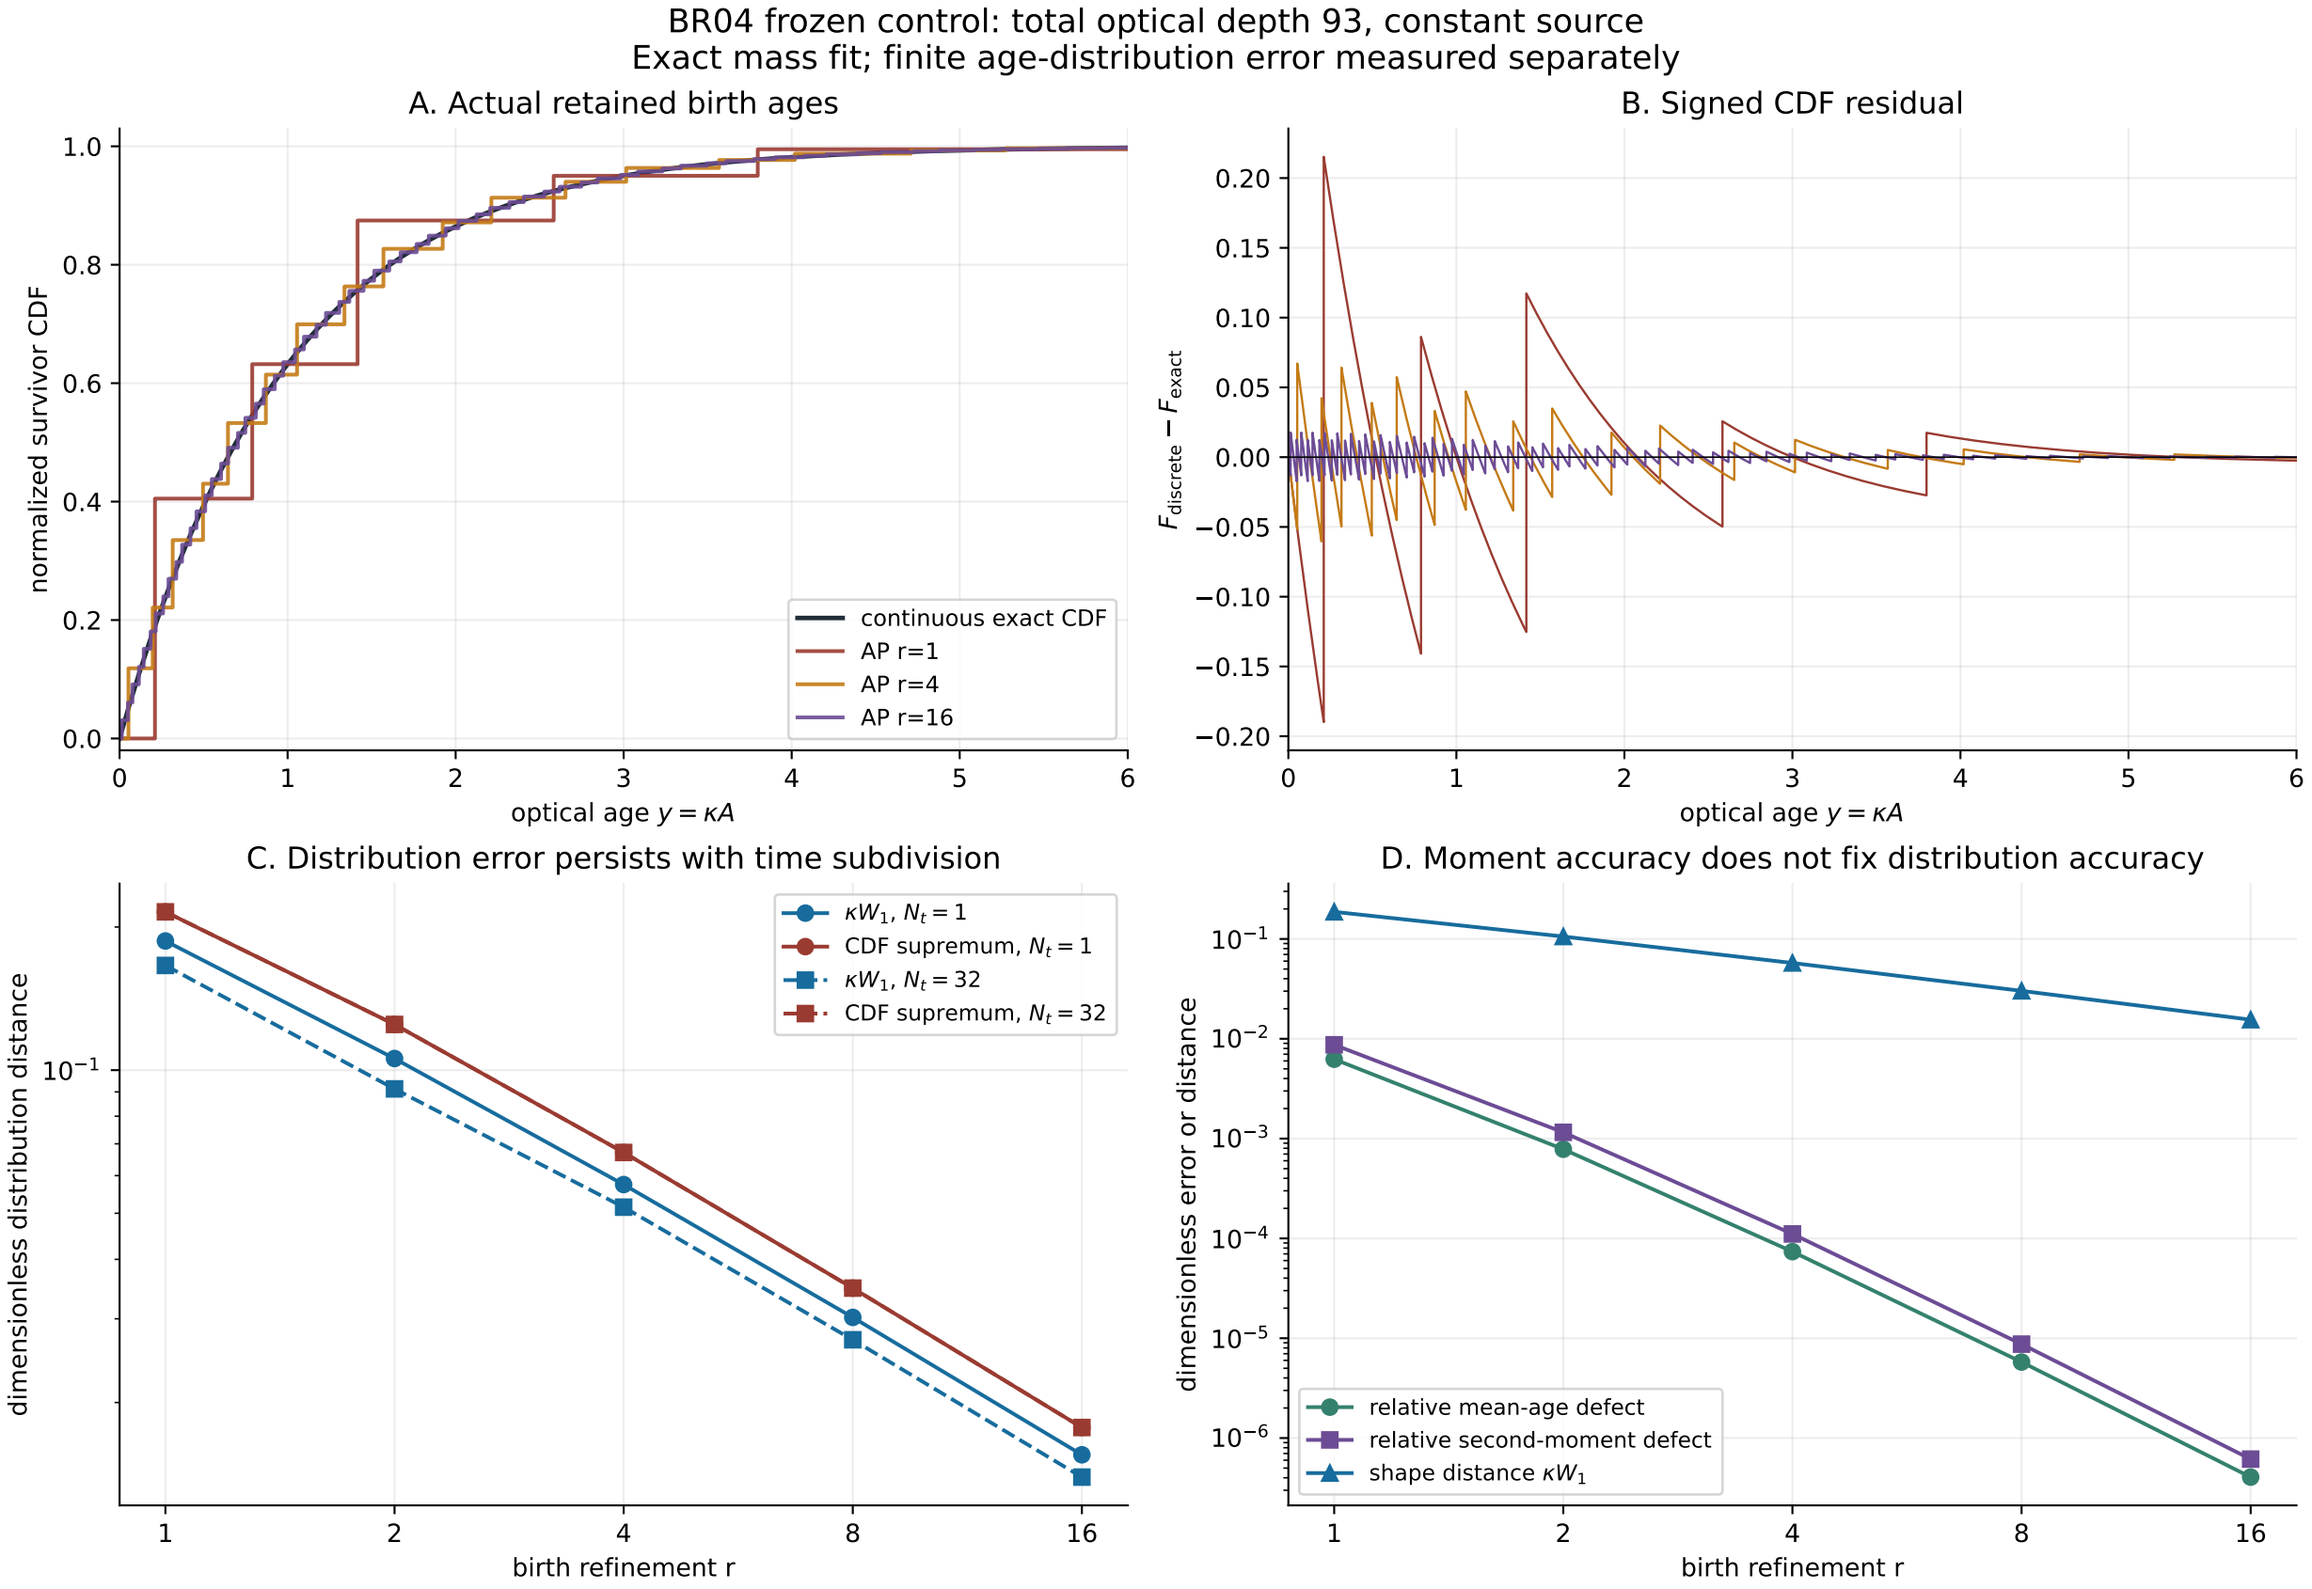
BR04 frozen control: total optical depth 93, constant source
Exact mass fit; finite age-distribution error measured separately
A. Actual retained birth ages
normalized survivor CDF
optical age $y = \kappa A$
continuous exact CDF
AP r=1
AP r=4
AP r=16
B. Signed CDF residual
$F_{\mathrm{discrete}} - F_{\mathrm{exact}}$
optical age $y = \kappa A$
C. Distribution error persists with time subdivision
dimensionless distribution distance
birth refinement r
κW_1, $N_t = 1$
CDF supremum, $N_t = 1$
κW_1, $N_t = 32$
CDF supremum, $N_t = 32$
D. Moment accuracy does not fix distribution accuracy
dimensionless error or distance
birth refinement r
relative mean-age defect
relative second-moment defect
shape distance κW_1