


SPC Control Chart Report for Wine pH Data

Column: pH | Chart: X-bar / S Chart | Date: 2026-04-29

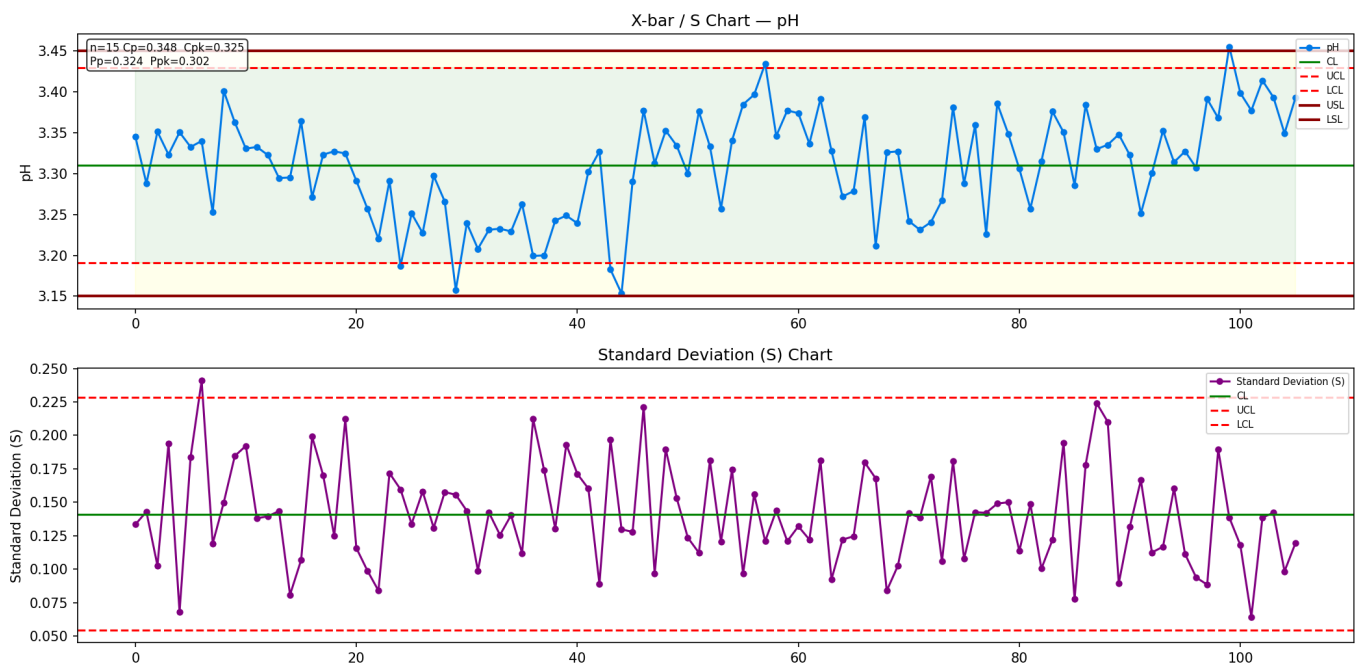

Capability		Process		Control Limits	
Cp	0.3483	Mean (X-bar)	3.3102	UCL (X-bar)	3.4298
Cpk	0.3245	Sigma ST	0.1435	CL (X-bar)	3.3102
Pp	0.3239	Sigma LT	0.1544	LCL (X-bar)	3.1907
Ppk	0.3017	Min	2.7400	USL	3.4500
		Max	4.0100	LSL	3.1500
		Observations	1599		
		Subgroup Size	15		

Process Inferences

- [X] Process is not capable - Cpk = 0.325, defects are likely
- [OK] Process is well-centered within spec limits
- [X] 6 points outside control limits - process is unstable
- [OK] Short-term and long-term performance are consistent (Cpk = 0.325, Ppk = 0.302)

This process is not capable (Cpk = 0.325), and defects are likely. The process is well-centered within spec limits. 6 points outside control limits indicate the process is unstable. Short and long-term performance are consistent (Cpk = 0.325, Ppk = 0.302).