


释放液体防飞溅指南

Guide for Preventing Liquid Splashing During Discharge


1. 出水管口应位于合法区域的垂直上方范围内

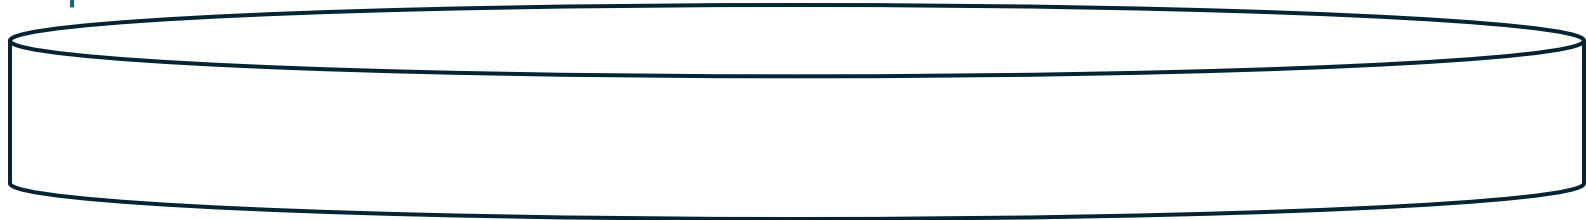

1. Positioning: The outlet of the discharge pipe must be positioned vertically directly above the designated area.


2. 调整出水管瞄准方向，使得以出水管瞄准方向延伸，应落于合法区域内


2. **Aiming:** Adjust the direction of the discharge pipe to ensure that its extended trajectory falls entirely within the designated area.

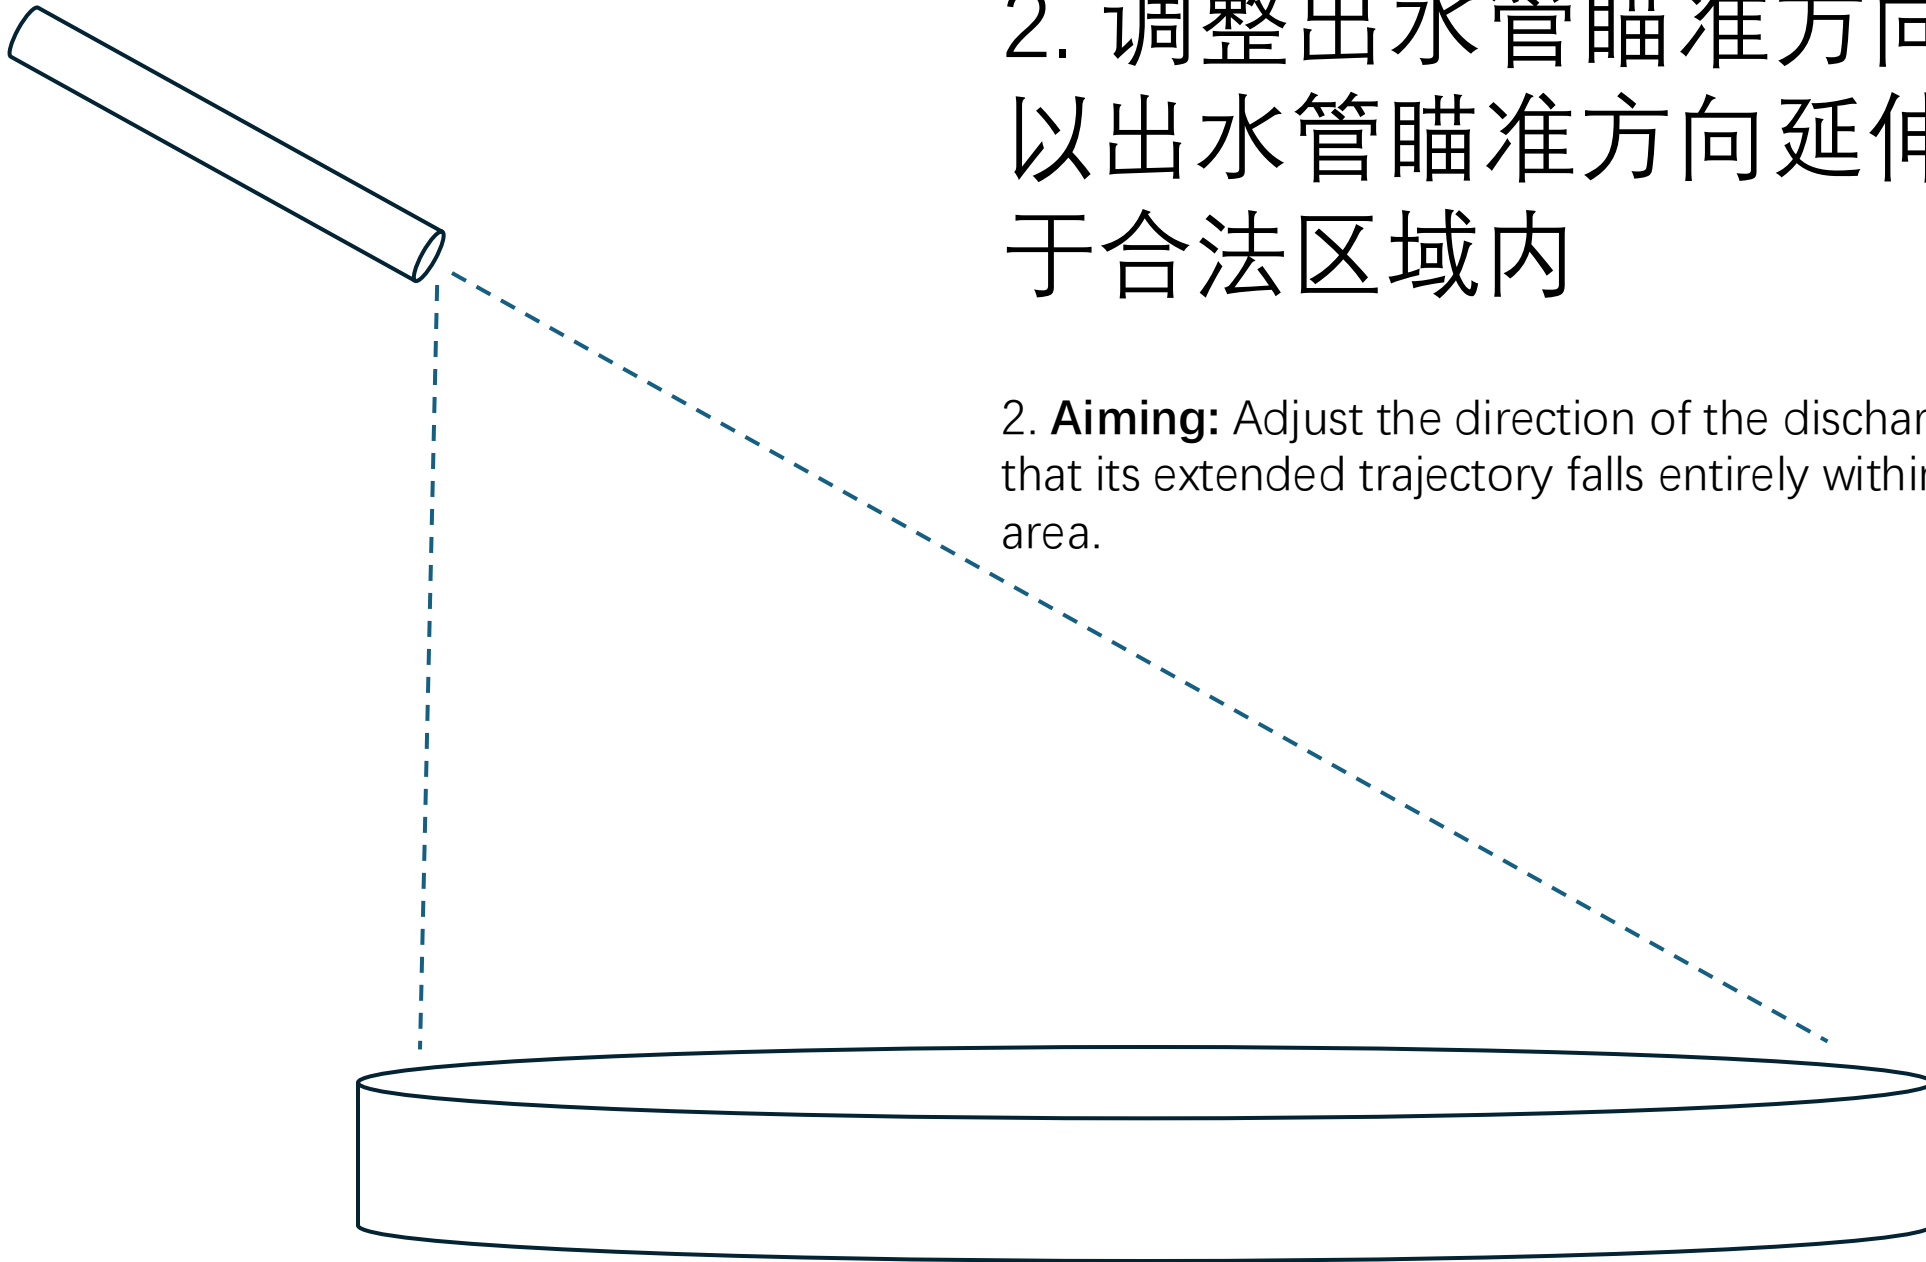

3. 从液体开始流出至停止流动， 出水管的位置和方向都应保持稳定


3. **Stability:** From the moment the liquid begins to flow until it stops completely, both the position and the direction of the discharge pipe must remain completely stable.

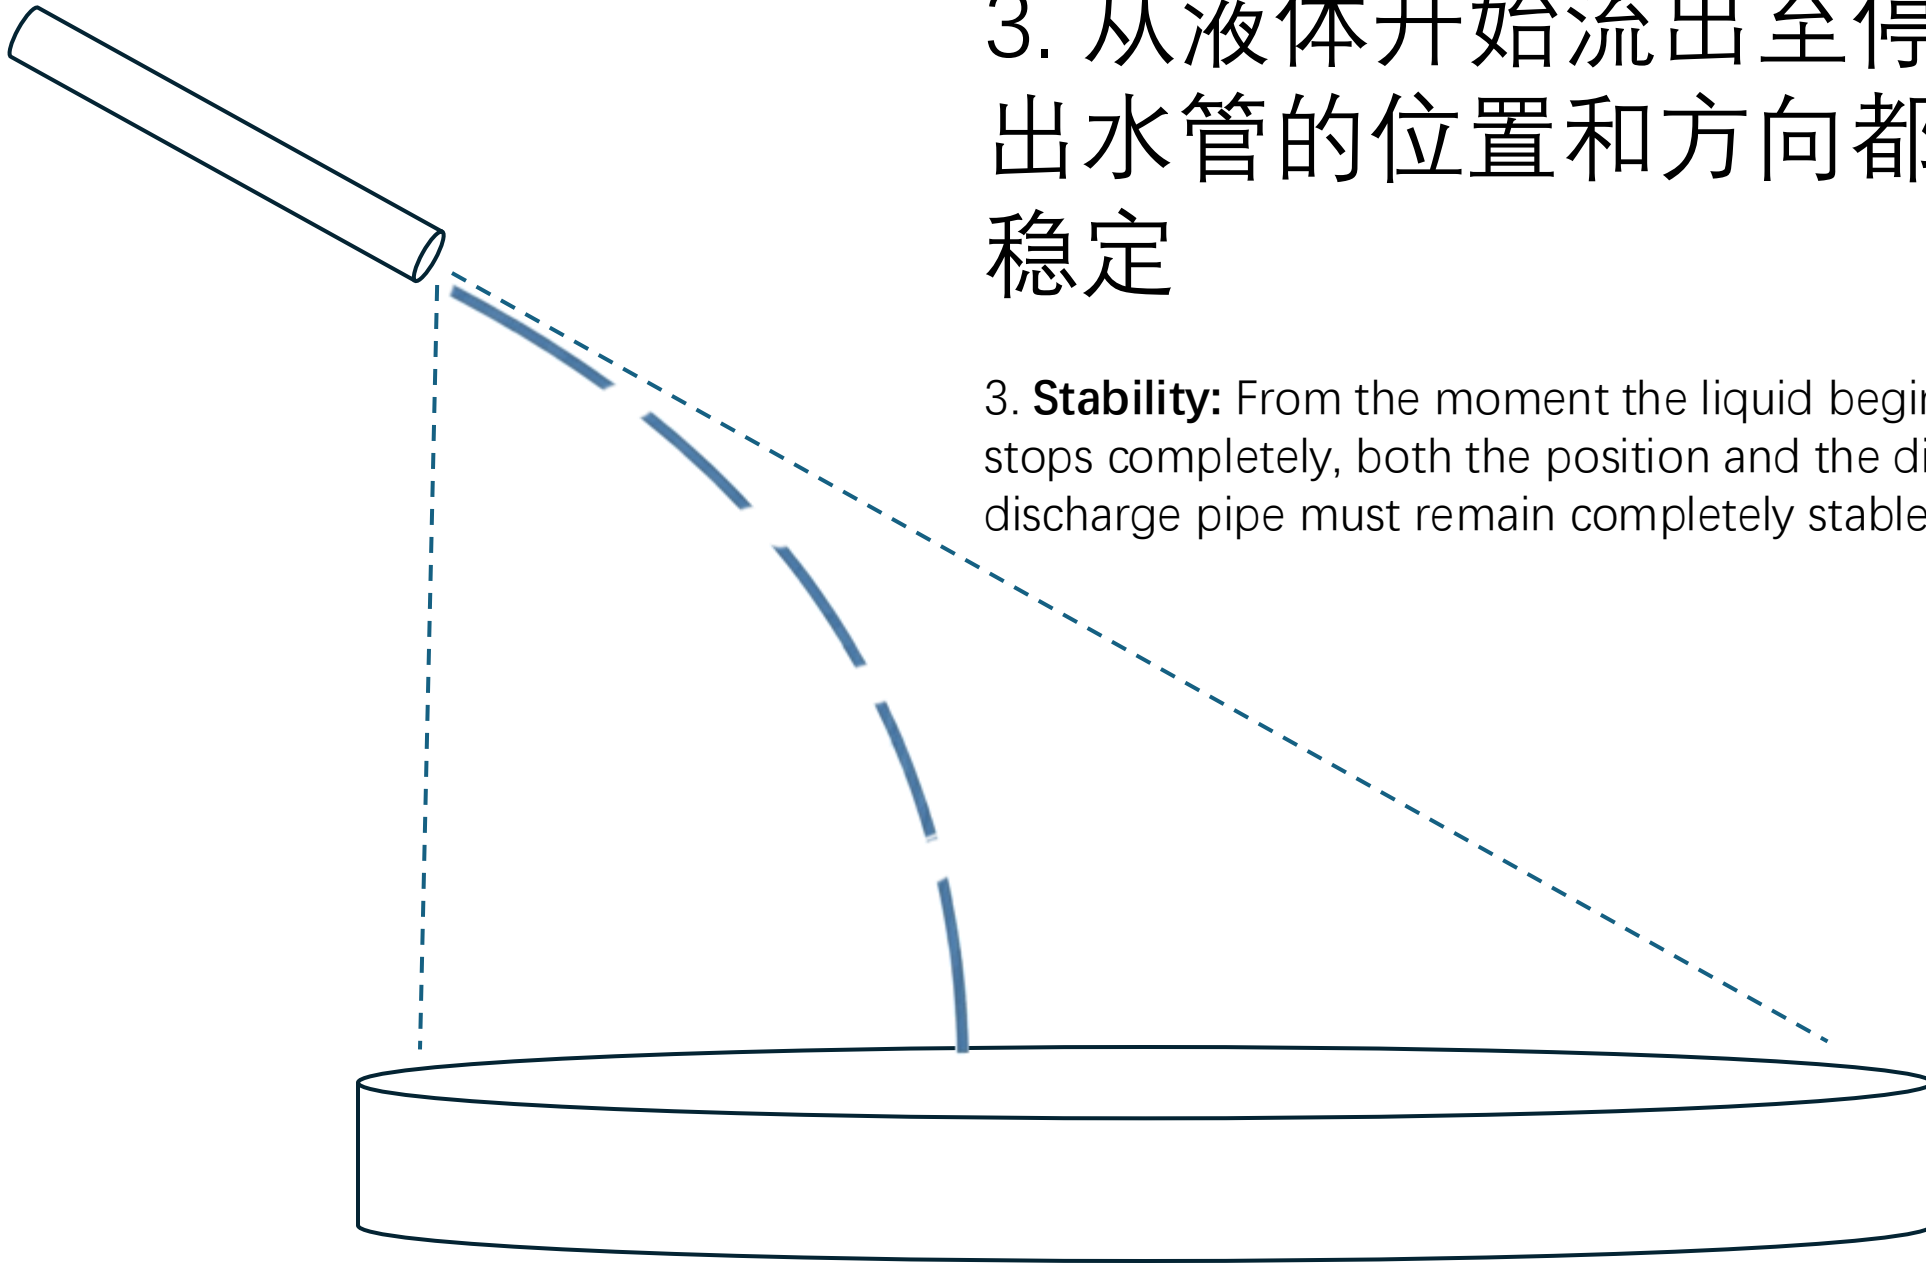

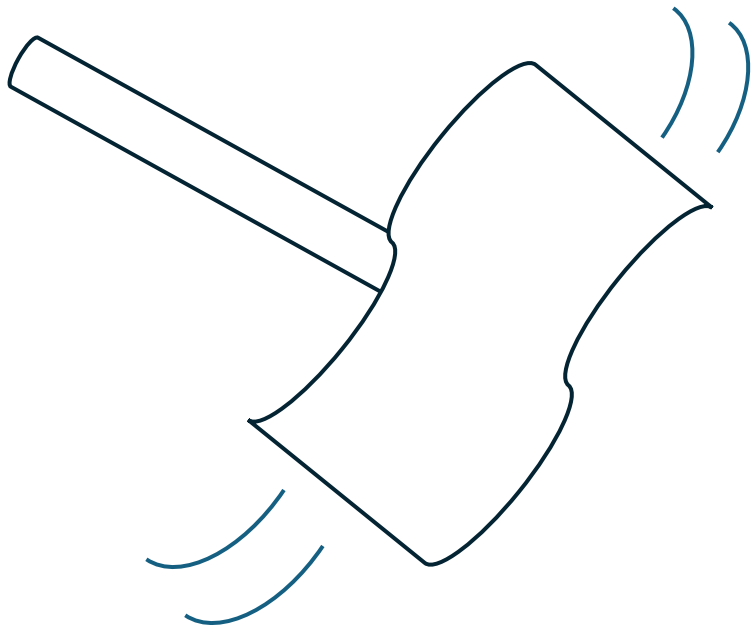

4. 在液体停止流动后，应使用吸水物覆盖/包住出水管口，再轻轻抖动出水管，使得管内残余液体被吸水物吸附。

4. **Post-Discharge Care:** Once the liquid stops flowing, use an absorbent material to cover or wrap the pipe outlet, then gently shake the pipe so that any residual liquid inside is fully absorbed.

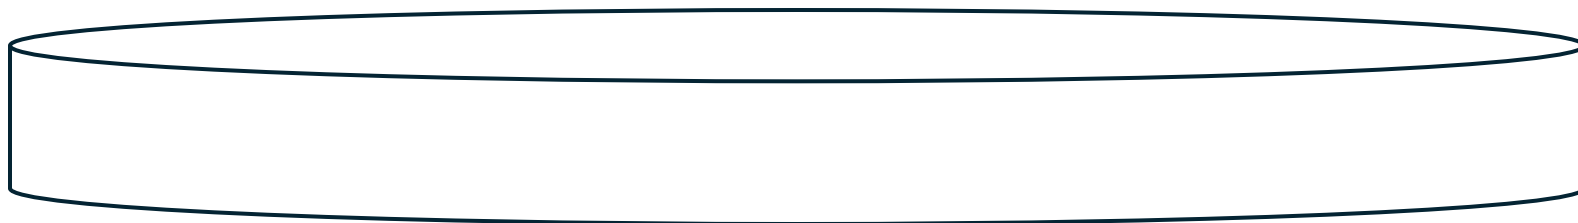

完

THE END