

			ADNOC GAS HABSHAN & BAB CONTROL SYSTEMS UPGRADE (PACKAGE 1) PROJECT NO. 0405323						  				
			COMMENTS RESOLUTION SHEET										
Document Title:			PIPING & INSTRUMENTATION DIAGRAM EARLY THAMMAMA 'B' (HABSHAN) UTILITY HOSE STATIONS			AGP Response Code			Prepared By:		OTL		
Document No:			13-00-218		Revision No:	A	1. Revise and Re-submit		3. Approved	✓	Checked By:	JM	
AG Ref. No:			ADNOCGP-WTRAN-014266		Date:	8-Nov-2024	2. Approved with comments		4. For Information only		Approved By:	YVR	
SN	Reference		COMPANY Comments				CONSULTANT Response			COMPANY Resolution			
	Page No.	Clause No.											
1	1	Process Comment	Site visit comments / tie-in points shall be incorporated/ verified				Site visit comments / tie-in points are incorporated/ verified with piping.						
2	1	Process Comment	Please review the line size(typical)				Kindly note that line size is inline with the DGS-1511-032 requirement.						


MASTER COPY

08-Nov-2024 ldm260310

TEBODIN M.E. LTD.

NOTES:

- STEAM TRAP TO BE PROVIDED AT END OF HEADERS, SUB-HEADERS AND AT LOW POINTS.
- FOR DETAILS OF LP TRAP ASSEMBLY REFER TO TECHNIP STD. DGN. NO. 03STC001360015
- FOR SYMBOLS, NOMENCLATURE, STANDARD DETAILS AND GENERAL NOTES, REFER TO DRAWING NUMBERS 05-00-201 TO 207.
- CONNECTION FOR STEAM LANCE.
- STEAM LANCE. REFER MR NO. 73-1900-53-LAC
- VP NOS. 1 & 2 DGN. NOS. 1265/94-01 & 1265/94-02.
- FOR DETAILS OF UTILITY STATION HOOK-UPS, REFER TO TECHNIP STD. DGN. NO. 03STC001340006.
- PROJ 5183 NOTES
- TIE-IN SHALL BE BY COLD TAP.
- UTILITY TIE-IN REPRESENTATION IS REPETED IN EXISTING ADNOC ONSHORE P&ID (P&ID NO PES183-GG-15-0040-003)
- FUTURE CONNECTION SHALL BE PROVIDED ON ADNOC GP SIDE.

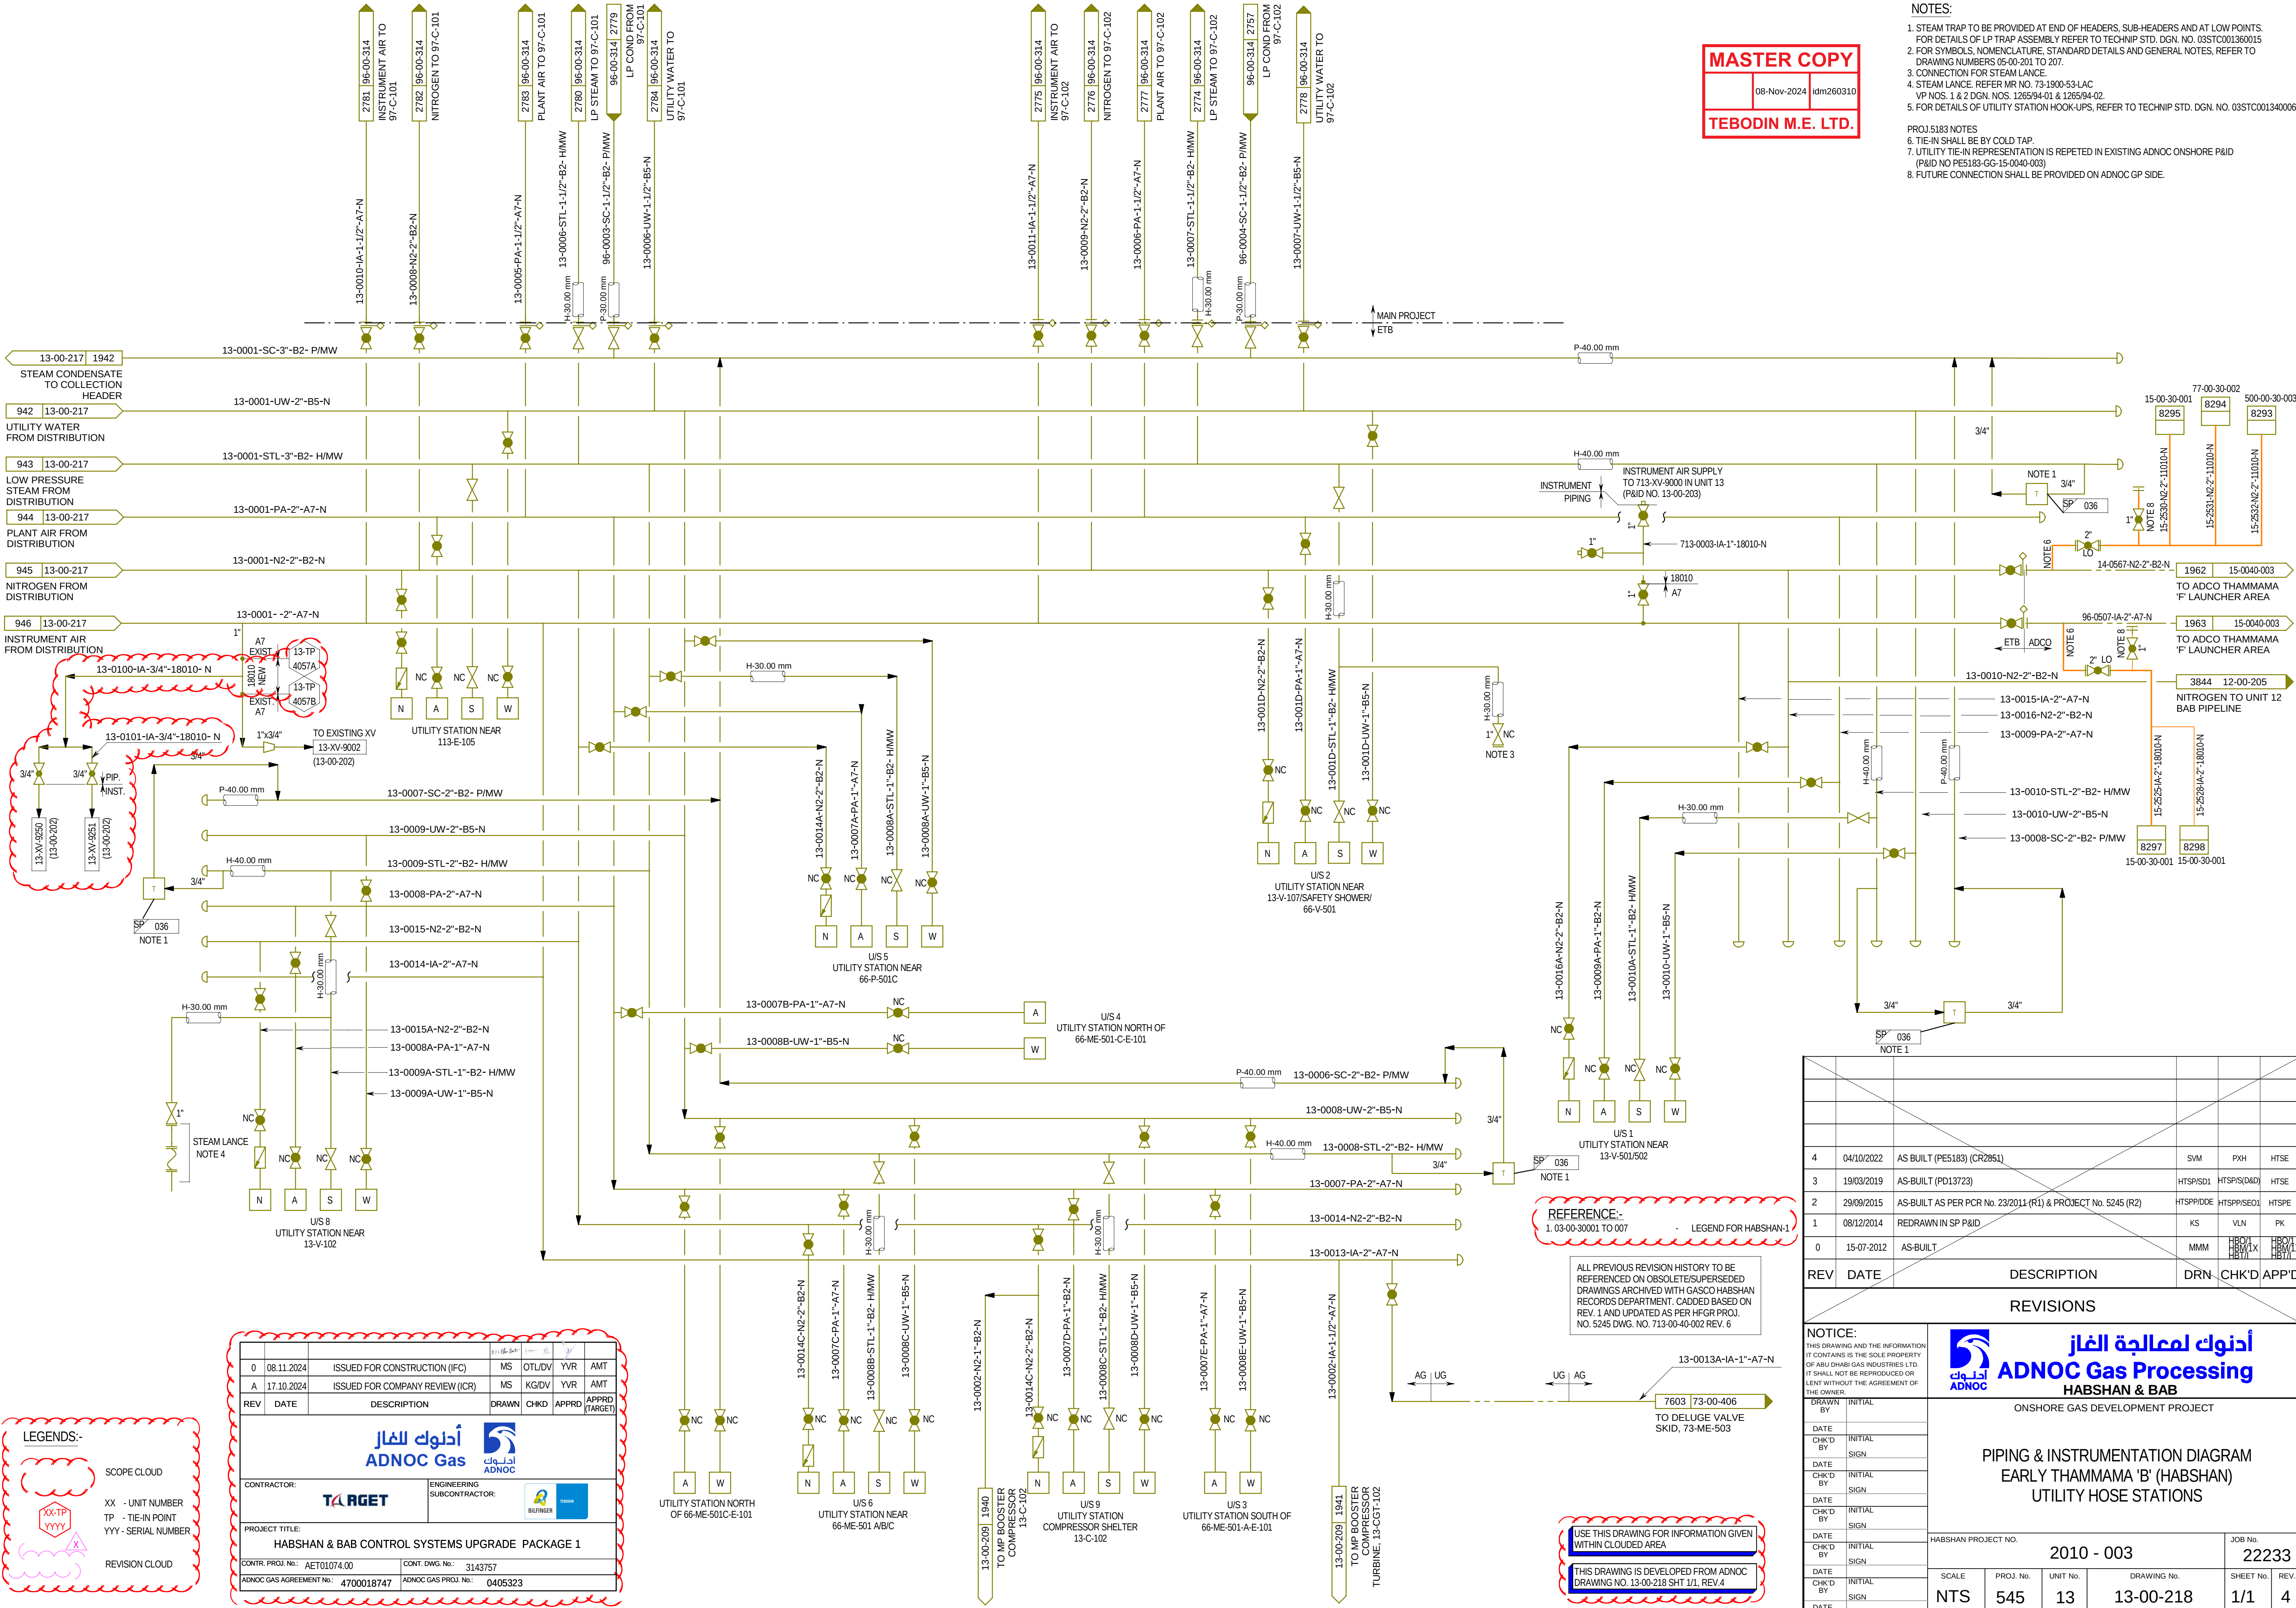

A1

AREA - COMPRESSION

FILENAME : 13-00-218.pid