

			ADNOC GAS HABSHAN & BAB CONTROL SYSTEMS UPGRADE (PACKAGE 1) PROJECT NO. 0405323						  			
			COMMENTS RESOLUTION SHEET									
Document Title:			PIPING & INSTRUMENTATION DIAGRAM THAMMAMA 'B' & 'C' GAS COOLER & HP SEPARATION				AGP Response Code			Prepared By:	JM	
Document No:			22-00-305		Revision No:	0	1. Revise and Re-submit	3. Approved	x	Checked By:	DV	
AG Ref. No:			ADNOCGP-WTRAN-004904		Date:	03-Oct-2024	2. Approved with comments	4. For Information only		Approved By:	YVR	
SN	Reference		COMPANY Comments				CONSULTANT Response			COMPANY Resolution		
	Page No.	Clause No.										
1	1	-	No Comments				Noted					
2	1	-					The following changes are made in P&ID w.r.t. Rev.0 submission. 1) Tie in location of 22-TP-4303A & 22-TP-4303B shifted based on piping input. 2) OPC CD 5000 deleted as this is connected to existing line 22-0012-WDX-1"-E15X-N based on piping input. 3) DBB drain valve updated for 22-XV-9150					

LEGENDS:-

SCOPE CLOUD

XX-TP
YYY


XX - UNIT NUMBER
TP - TIE-IN POINT
YYY - SERIAL NUMBER

REVISION CLOUD

X

22-E-106
FEED GAS COOLER
DUTY : 2.22 x 10⁶ KCAL/HR
HEADER MATERIAL : MONEL
TUBE DESIGN P/T : 76.5 barg/ 16
DRIVER NO/ POWER : 2/ 30.00
LETHAL SERVICE

22-V-109
HP SEPARATOR
SIZE : 3600.0 mm ID x 5100.0 mm T/T
MATERIAL/ S.R. : CS + 10MM CA/ YES
DESIGN P/T : 76.0 barg/ 87 °C
TRIM : 22-0002-VT-E4X

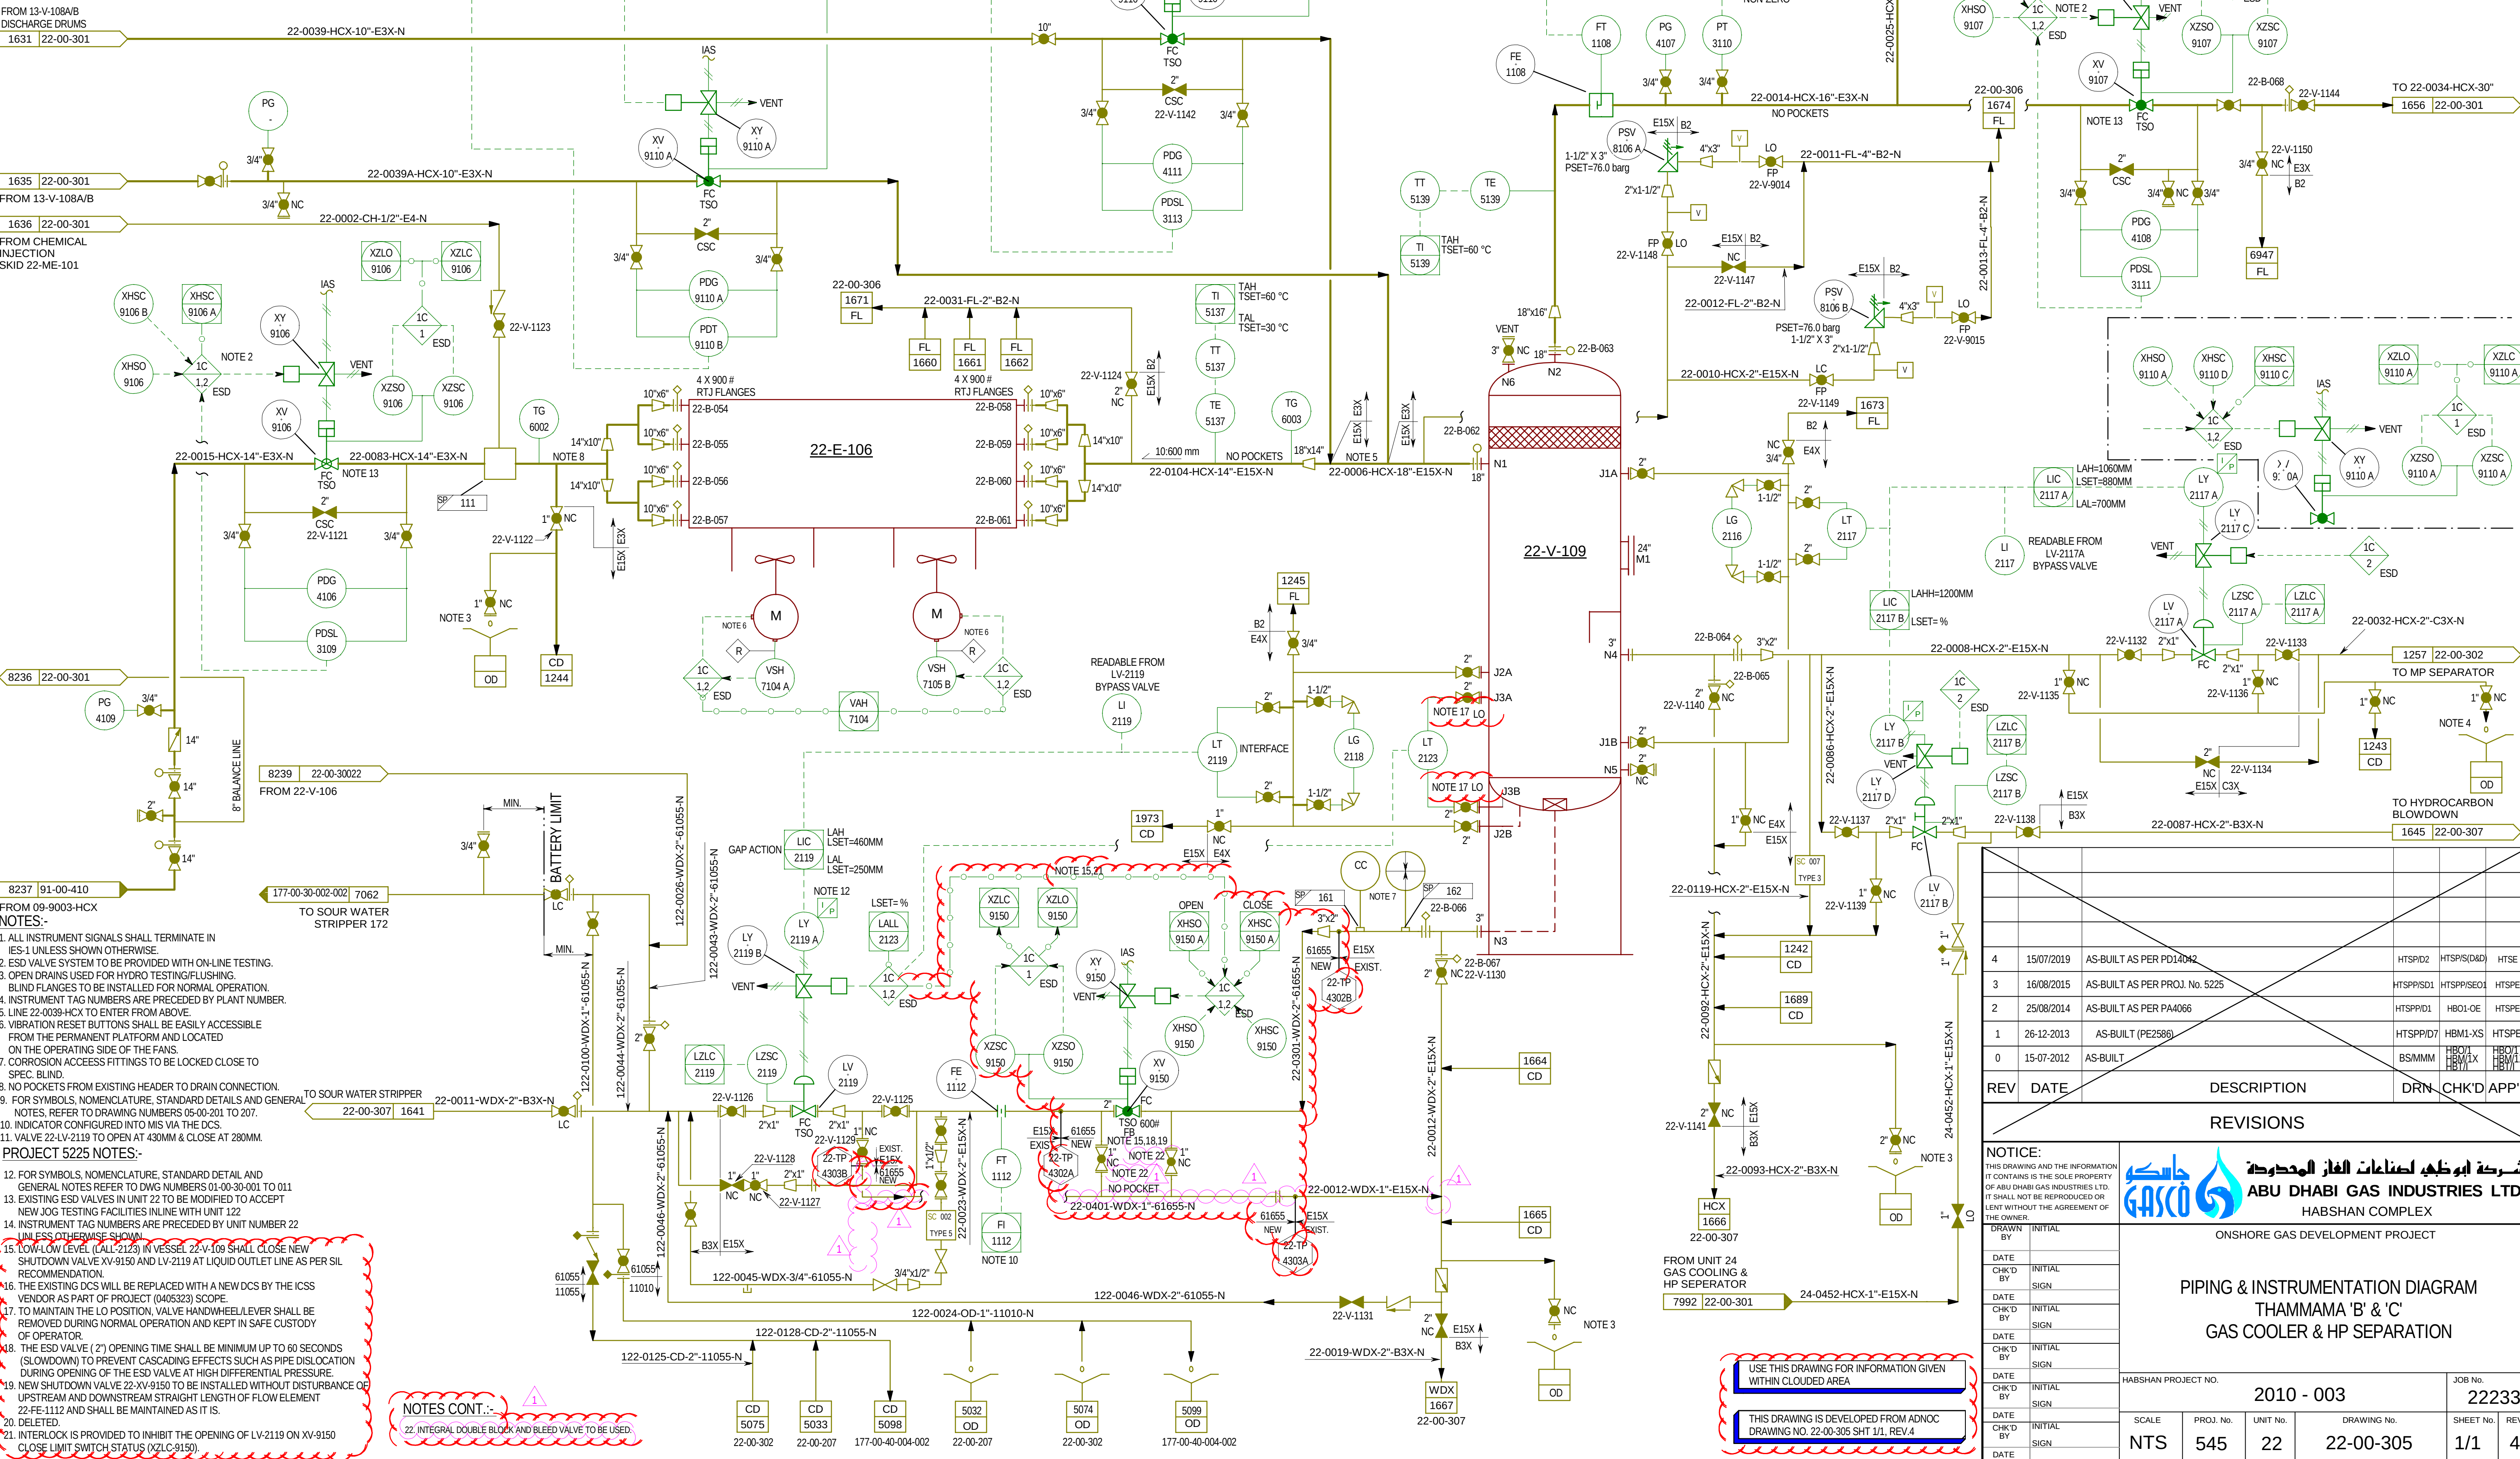

REVISIONS

DRAWN BY	INITIAL	ONSHORE GAS DEVELOPMENT PROJECT					
DATE		PIPING & INSTRUMENTATION DIAGRAM THAMMAMA 'B' & 'C' GAS COOLER & HP SEPARATION					
CHK'D BY	INITIAL						
	SIGN						
DATE							
CHK'D BY	INITIAL						
	SIGN	HABSHAN PROJECT NO. 2010 - 003 JOB No. 22233					
DATE							
CHK'D BY	INITIAL						
	SIGN						
DATE							
CHK'D BY	INITIAL	SCALE	PROJ. No.	UNIT No.	DRAWING No.	SHEET No.	REV.
	SIGN	NTS	545	22	22-00-305	1/1	4
DATE							