


			ADNOC GAS HABSHAN & BAB CONTROL SYSTEMS UPGRADE (PACKAGE 1) PROJECT NO. 0405323									
			COMMENTS RESOLUTION SHEET									
Document Title:			PIPING AND INSTRUMENTATION DIAGRAM COMPRESSOR LUBE OIL SYSTEM FOR 13-C-101A/B/102				AGP Response Code			Prepared By:	VK	
Document No:			5323P1-H1-013-00-50-006		Revision No:	B	1. Revise and Re-submit	☐	3. Approved	Checked By:	DV	
AG Ref. No:			ADNOCGP-WTRAN-007250		Date:	6-Jun-2024	2. Approved with comments	☒	4. For Information only	Approved By:	YVR	
SN	Reference		COMPANY Comments				CONSULTANT Response			COMPANY Resolution		
	Page No.	Clause No.										
1	1	Process Comment	Hold shall be removed before submitting the next revision of the documents.				Noted and hold is removed from P&ID.					
2	1	-	-				Following changes are made in P&ID w.r.t. Rev.B submission as per piping/instrumentation inputs: 1. Note 14 and 19 updated. 2. Hold 2 is deleted from P&ID. 3. Note 23 added. 4. Table to mention instruments in project scope for 13-C-101A, 13-C-101B and 13-C-102 is added. Refer detail "B". 5. TP Location for TCV-5541 and PCV-3543 updated as per piping input. 6. Instrument manifold valves for all PT and DPT are included in project scope cloud based on instrument input.					

NOTICE: THIS DRAWING AND THE INFORMATION IT CONTAINS IS THE SOLE PROPERTY OF ADNOC GAS PROCESSING. IT SHALL NOT BE REPRODUCED OR LENT WITHOUT THE AGREEMENT OF THE OWNER

MASTER COPY

12-Aug-2024 idm260310

TEBODIN M.E. LTD.

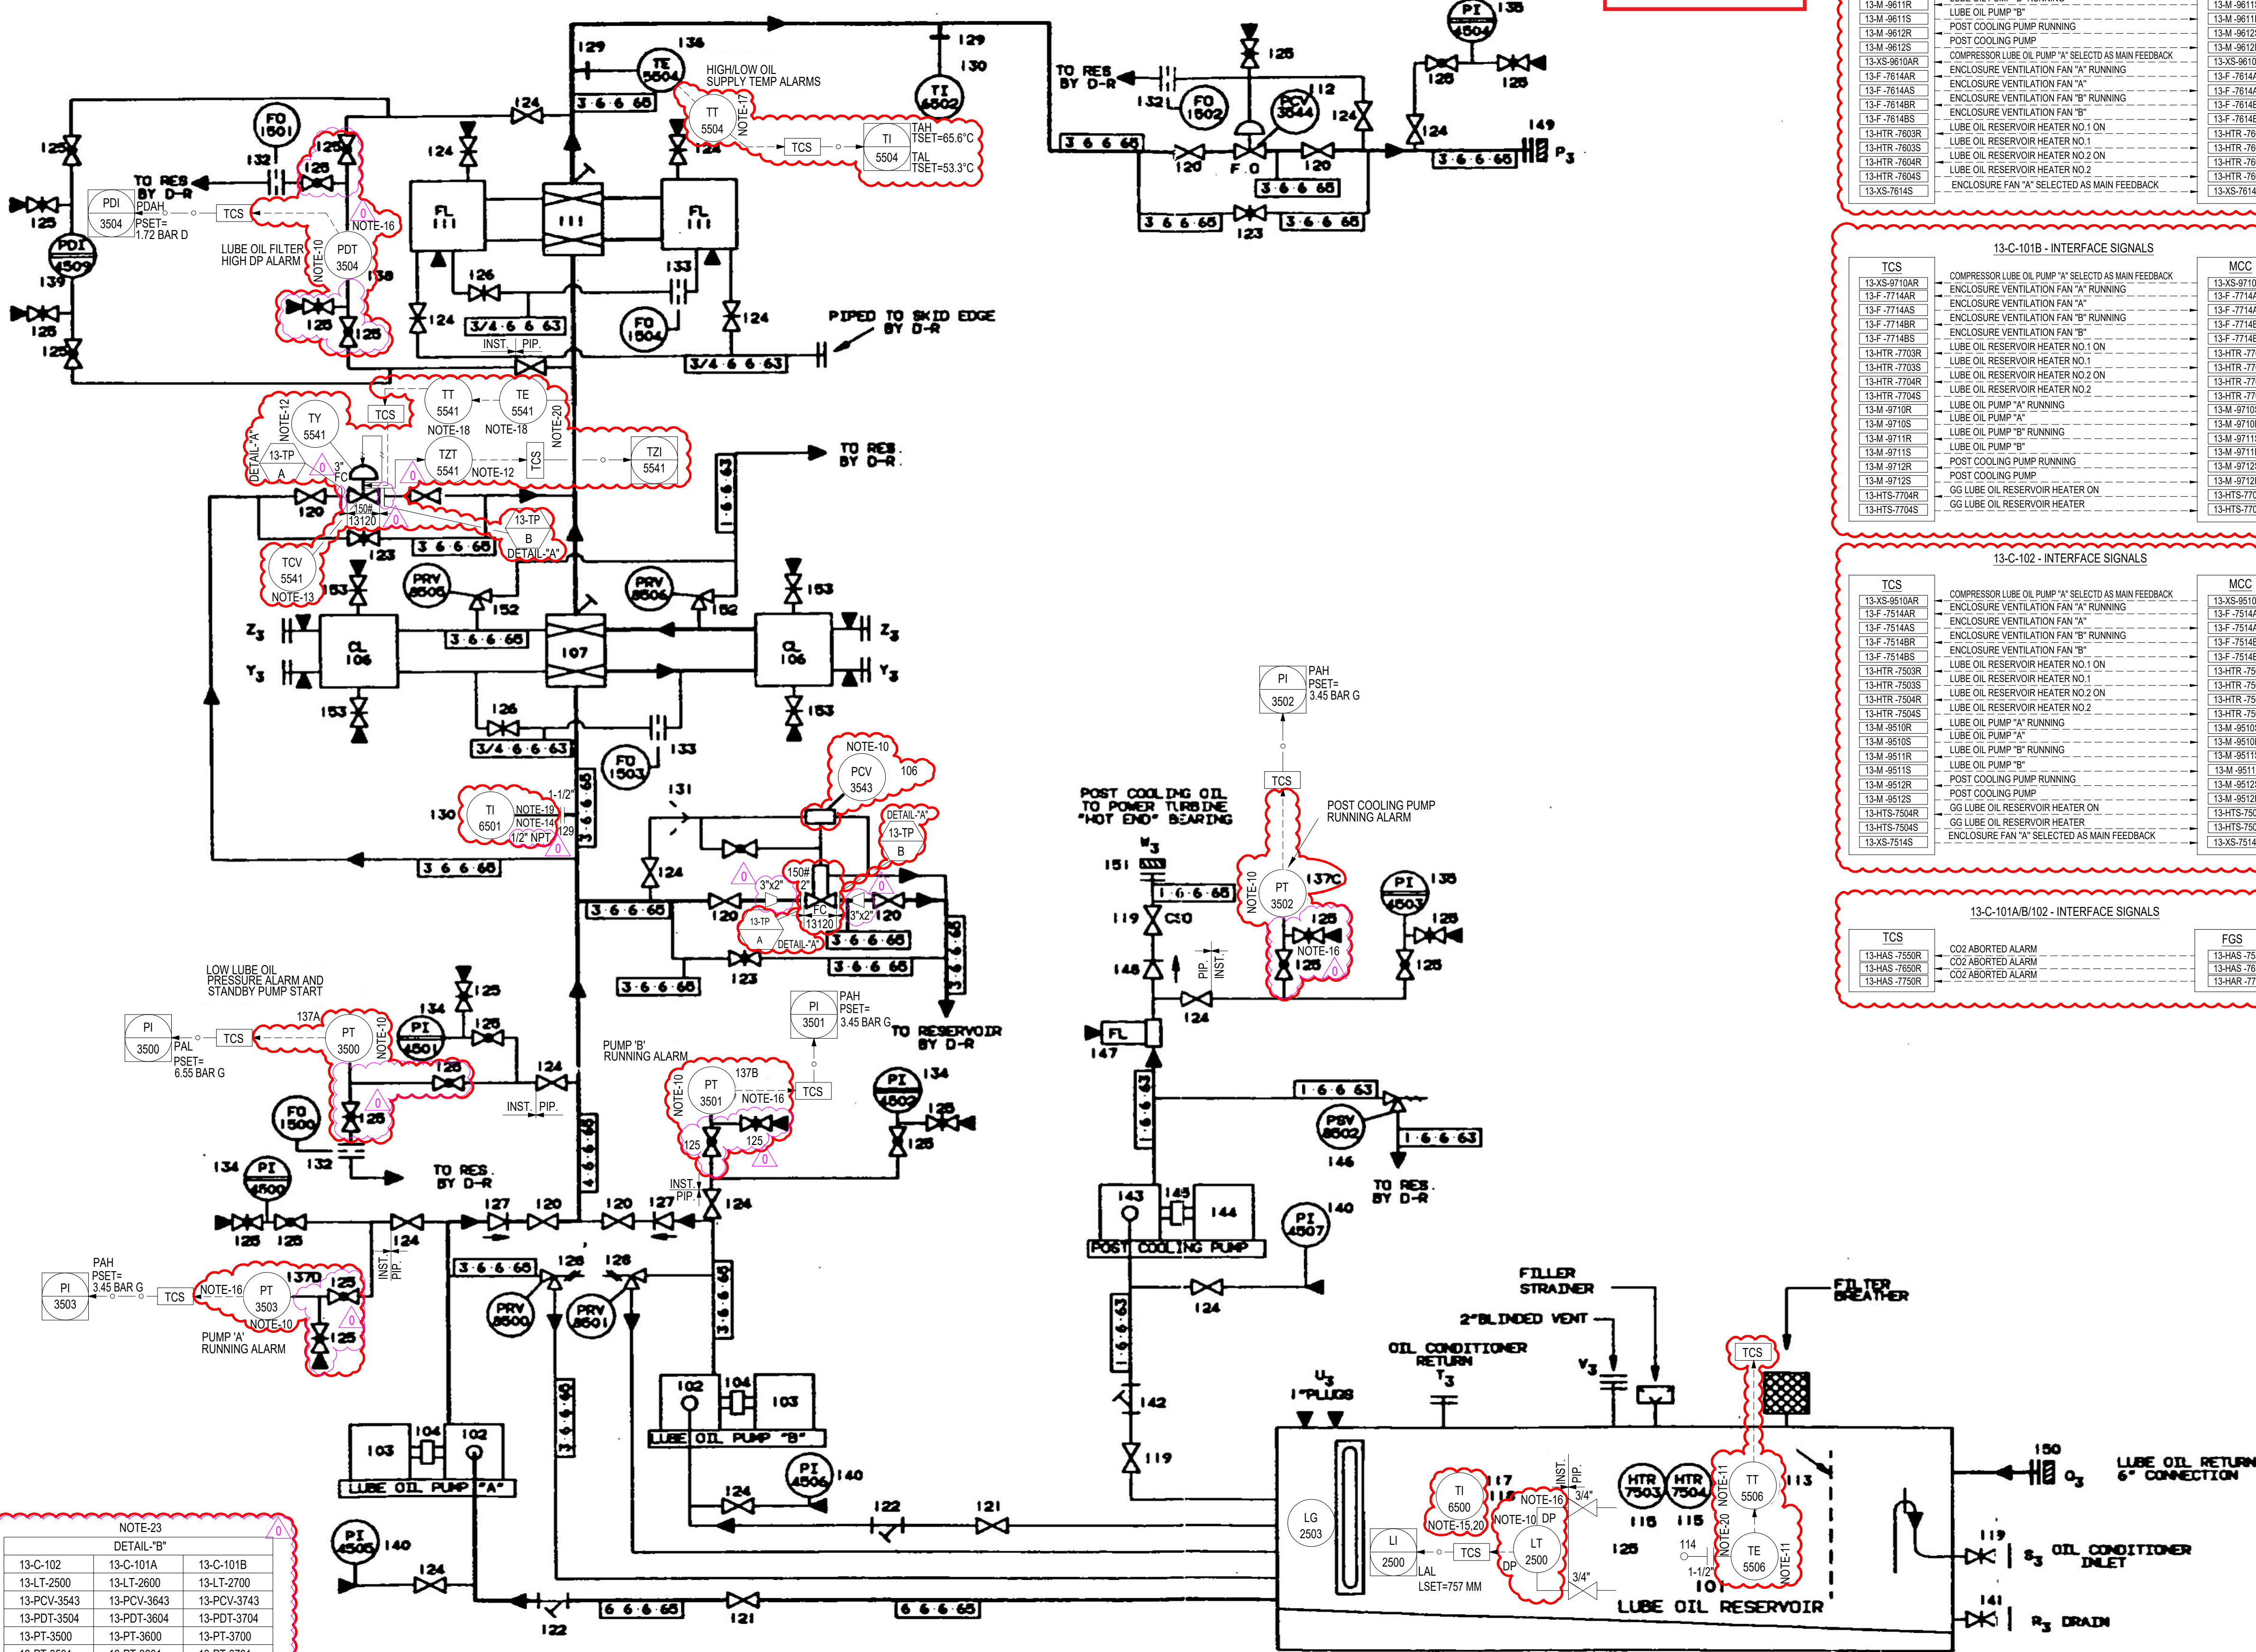

13-C-101A- INTERFACE SIGNALS	
TCS	MCC
13-HTS-7604R	GG LUBE OIL RESERVOIR HEATER ON
13-HTS-7604S	GG LUBE OIL RESERVOIR HEATER OFF
13-M-9610R	LUBE OIL PUMP "A" RUNNING
13-M-9610S	LUBE OIL PUMP "A" STOP
13-M-9611R	LUBE OIL PUMP "B" RUNNING
13-M-9611S	LUBE OIL PUMP "B" STOP
13-M-9612R	POST COOLING PUMP RUNNING
13-M-9612S	POST COOLING PUMP STOP
13-M-9612S	COMPRESSOR LUBE OIL PUMP "A" SELECTED AS MAIN FEEDBACK
13-XS-9610AR	ENCLOSURE VENTILATION FAN "A" RUNNING
13-F-7614AR	ENCLOSURE VENTILATION FAN "A" STOP
13-F-7614BR	ENCLOSURE VENTILATION FAN "B" RUNNING
13-F-7614BS	ENCLOSURE VENTILATION FAN "B" STOP
13-HTR-7603R	LUBE OIL RESERVOIR HEATER NO.1 ON
13-HTR-7603S	LUBE OIL RESERVOIR HEATER NO.1 OFF
13-HTR-7604R	LUBE OIL RESERVOIR HEATER NO.2 ON
13-HTR-7604S	LUBE OIL RESERVOIR HEATER NO.2 OFF
13-XS-7614AS	ENCLOSURE FAN "A" SELECTED AS MAIN FEEDBACK

13-C-101B- INTERFACE SIGNALS	
TCS	MCC
13-XS-9710AR	COMPRESSOR LUBE OIL PUMP "A" SELECTED AS MAIN FEEDBACK
13-F-7714AR	ENCLOSURE VENTILATION FAN "A" RUNNING
13-F-7714AS	ENCLOSURE VENTILATION FAN "A" STOP
13-F-7714BR	ENCLOSURE VENTILATION FAN "B" RUNNING
13-F-7714BS	ENCLOSURE VENTILATION FAN "B" STOP
13-HTR-7703R	LUBE OIL RESERVOIR HEATER NO.1 ON
13-HTR-7703S	LUBE OIL RESERVOIR HEATER NO.1 OFF
13-HTR-7704R	LUBE OIL RESERVOIR HEATER NO.2 ON
13-HTR-7704S	LUBE OIL RESERVOIR HEATER NO.2 OFF
13-M-9710R	LUBE OIL PUMP "A" RUNNING
13-M-9710S	LUBE OIL PUMP "A" STOP
13-M-9711R	LUBE OIL PUMP "B" RUNNING
13-M-9711S	LUBE OIL PUMP "B" STOP
13-M-9712R	POST COOLING PUMP RUNNING
13-M-9712S	POST COOLING PUMP STOP
13-HTS-7704R	GG LUBE OIL RESERVOIR HEATER ON
13-XS-7704AS	ENCLOSURE FAN "A" SELECTED AS MAIN FEEDBACK

13-C-102- INTERFACE SIGNALS	
TCS	MCC
13-XS-9510AR	COMPRESSOR LUBE OIL PUMP "A" SELECTED AS MAIN FEEDBACK
13-F-7514AR	ENCLOSURE VENTILATION FAN "A" RUNNING
13-F-7514AS	ENCLOSURE VENTILATION FAN "A" STOP
13-F-7514BR	ENCLOSURE VENTILATION FAN "B" RUNNING
13-F-7514BS	ENCLOSURE VENTILATION FAN "B" STOP
13-HTR-7503R	LUBE OIL RESERVOIR HEATER NO.1 ON
13-HTR-7503S	LUBE OIL RESERVOIR HEATER NO.1 OFF
13-HTR-7504R	LUBE OIL RESERVOIR HEATER NO.2 ON
13-HTR-7504S	LUBE OIL RESERVOIR HEATER NO.2 OFF
13-M-9510R	LUBE OIL PUMP "A" RUNNING
13-M-9510S	LUBE OIL PUMP "A" STOP
13-M-9511R	LUBE OIL PUMP "B" RUNNING
13-M-9511S	LUBE OIL PUMP "B" STOP
13-M-9512R	POST COOLING PUMP RUNNING
13-M-9512S	POST COOLING PUMP STOP
13-HTS-7504R	GG LUBE OIL RESERVOIR HEATER ON
13-XS-7504AS	ENCLOSURE FAN "A" SELECTED AS MAIN FEEDBACK

13-C-101A/B102- INTERFACE SIGNALS	
TCS	FGS
13-HAS-7550R	CO2 ABORTED ALARM
13-HAS-7550S	CO2 ABORTED ALARM
13-HAS-7550S	CO2 ABORTED ALARM

NOTES:-

- SEE DRAWING 478-373-601 FOR COMPONENT SYMBOLS AND LETTER DESIGNATIONS.
- SEE DRAWING 003-152-001 FOR PIPING LINE CODE EXPLANATION.
- SEE DETACHED LIST OF MATERIALS 317-200-201. FOR COMPONENT DESCRIPTIONS.
- SEE DETACHED CUSTOMER CONNECTION LIST 478-145-601. FOR CUSTOMER CONNECTION DESCRIPTIONS.
- SEE DRAWING 478-135-201 FOR MINERAL OIL CONSOLE WIRING DETAILS.
- HEAT TRACING IS REQUIRED, BY THE CUSTOMER ON STATIC OIL LINES FOR AMBIENT TEMPERATURES BELOW 70°F (21°C) FOR ISO 46 OIL.
- FLUSHING STRAINERS ARE TO BE REMOVED ONLY AFTER FLUSHING IS COMPLETE.
- ALL INSTRUMENT TAG NUMBERS SHOULD BE PREFIXED WITH THE AREA DESIGNATIONS-13.
- INSTRUMENT TAG NUMBERS SHOWN ARE FOR THE MP COMPRESSOR TRAIN. FOR FEED GAS COMPRESSOR TRAIN INSTRUMENT TAG NUMBERS ADD 100 FOR THE A-TRAIN & 200 FOR THE B-TRAIN.
- EXISTING INSTRUMENT/VALVES ARE REPLACED WITH NEW INSTRUMENT/VALVES AS PER PROJECT (0405323) SCOPE.
- FOR 13-C-101A, 13-C-101B, 13-C-102, TEMPERATURE CONTROL SWITCH TO BE REPLACED WITH NEW TEMPERATURE ELEMENT AND TEMPERATURE TRANSMITTER AS PER PROJECT (0405323) SCOPE.
- NEW INSTRUMENT/VALVES ARE INSTALLED AS PER PROJECT (0405323) SCOPE.
- FOR 13-C-101A, CORRESPONDING EXISTING INSTRUMENT/VALVES ARE REPLACED WITH NEW INSTRUMENT/VALVES AS PER PROJECT (0405323) SCOPE.
- FOR 13-C-101B, CORRESPONDING EXISTING INSTRUMENT/VALVES ARE REPLACED WITH NEW INSTRUMENT/VALVES AS PER PROJECT (0405323) SCOPE. HOWEVER FOR TRAIN-A (13-C-101A AND 13-C-102), EXISTING INSTRUMENT 13-TI-6501 AND 6601 IS RETAINED.
- FOR 13-C-102, CORRESPONDING EXISTING INSTRUMENT/VALVES ARE REPLACED WITH NEW INSTRUMENT/VALVES AS PER PROJECT (0405323) SCOPE.
- ALL PIPING INSTRUMENT INTERFACE CONNECTION WILL BE AS PER HOOK-UP DIAGRAM (5323P1-H1-01-15-38-001 & 5323P1-H1-01-15-38-002).
- NEW TEMPERATURE TRANSMITTER NEEDS TO BE INSTALLED FOR THE CORRESPONDING TEMPERATURE ELEMENT.
- FOR 13-C-101A, 13-C-101B, 13-C-102, TEMPERATURE CONTROLLER TO BE REPLACED WITH NEW TEMPERATURE ELEMENT & TRANSMITTER.
- FOR 13-C-101B, CORRESPONDING EXISTING THERMOWELL TO BE REUSED. HOWEVER FOR TRAIN-A (13-C-101A AND 13-C-102) EXISTING THERMOWELL IS RETAINED.
- EXISTING THERMOWELL TO BE RE-USED.
- THE TURBINE CONTROL SYSTEM (TCS) SHALL BE INTERFACED TO DCS THROUGH REDUNDANT MODBUS TCP/IP COMMUNICATION.
- THE EXISTING UNIT CONTROL PANEL (UCP) RELATED TO GE RX 3I AND WOODWARD IS REPLACED WITH NEW TURBINE CONTROL SYSTEM.
- REFER DETAIL "B" FOR LIST OF INSTRUMENTS/VALVES, WHICH ARE REPLACED OR ADDED AS PER PROJECT (0405323) SCOPE.

HOLDS:-

- DELETED.
- DELETED.
- DELETED.

LEGENDS:-

SCOPE CLOUD	LOCAL MOUNTED
TCS	DCS
REVISION CLOUD	VALVE - INST. OR GLOBE - NOR. OPEN
XX-TP	VALVE - INST. OR GLOBE - NOR. CLOSED
YYY	
XX - UNIT NUMBER	
TP - TIE-IN POINT	
YYY - SERIAL NUMBER	

REFERENCE:-

1. NM-5323P1-H1-013-15-21-001 - INSTRUMENT INDEX - UNIT 13
2. 03-00-30001 TO 007 - LEGEND FOR HABSHAN-1
3. NM-5323P1-H1-01-00-40-002 - ALARM AND TRIP SETTINGS LIST - HABSHAN 1

USE THIS DRAWING FOR INFORMATION GIVEN WITHIN CLOUDED AREA

THIS DRAWING IS DEVELOPED FROM ADNOC DRAWING NO. 317-200 SHT 1/1 REV 03 (PACKAGE / VENDOR DRAWING)

NOTE-23		
DETAIL-"B"		
13-C-102	13-C-101A	13-C-101B
13-LT-2500	13-LT-2600	13-LT-2700
13-PCV-3543	13-PCV-3643	13-PCV-3743
13-PDT-3504	13-PDT-3604	13-PDT-3704
13-PT-3500	13-PT-3600	13-PT-3700
13-PT-3501	13-PT-3601	13-PT-3701
13-PT-3502	13-PT-3602	13-PT-3702
13-PT-3503	13-PT-3603	13-PT-3703
13-TI-6500	13-TI-6600	13-TI-6700
13-TY-5541	13-TY-5641	13-TY-5741
13-TZ-5541	13-TZ-5641	13-TZ-5741
13-TE-5506	13-TE-5606	13-TE-5706
13-TE-5541	13-TE-5641	13-TE-5741
13-TI-6500	13-TI-6600	13-TI-6700
13-TT-5504	13-TT-5604	13-TT-5704
13-TT-5506	13-TT-5606	13-TT-5706
13-TT-5541	13-TT-5641	13-TT-5741

DETAIL-"A"		
PACKAGE	INSTRUMENT TAG	TIE-IN NO
13-C-102	13-PCV-3543	13-TP-813 A/B
13-C-101A	13-PCV-3643	13-TP-4017 A/B
13-C-101B	13-PCV-3743	13-TP-4018 A/B
13-C-102	13-TCV-5541	13-TP-812 A/B
13-C-101A	13-TCV-5641	13-TP-4019 A/B
13-C-101B	13-TCV-5741	13-TP-4020 A/B

CONTRACT NO. 217i2BCD BY		DATE	DIAGRAM
TYPE	SYSTEM	DRAWN	JMP
SCALE	NONE	CHECKED	JMJ
DEPT.	63/81	REDRAW	
DRAFTING APPROVAL		DJL	04/13/92
CONTRACT APPROVAL		JAB	04/13/92
SYSTEM APPROVAL		JMJ	04/13/92
DRP	HCS	LICENSEE	
317-200		SHT. 1	REV. 03

CONTRACTOR:		ENGINEERING SUBCONTRACTOR:	
TARGET		BILFINGER	
PROJECT TITLE:		DRAWING TITLE:	
HABSHAN & BAB CONTROL SYSTEMS UPGRADE PACKAGE 1		PIPING AND INSTRUMENTATION DIAGRAM COMPRESSOR LUBE OIL SYSTEM FOR 13-C-101A/B/102	
UNIT:	13	PLANT:	HABSHAN-1
CONTR. PROJ. No.:	AET01074.00	CONTR. DWG. No.:	3143226
ADNOC GAS PROJ. No.:	0405323	ADNOC GAS DWG. No.:	5323P1-H1-01-00-50-006
SHEET No.:	01/01	REV.:	0

CAD NO.: 5323P1-H1-01-00-50-006.DWG