


			ADNOC GAS HABSHAN & BAB CONTROL SYSTEMS UPGRADE (PACKAGE 1) PROJECT NO. 0405323						  				
			COMMENTS RESOLUTION SHEET										
Document Title:			PIPING AND INSTRUMENTATION DIAGRAM ANTI SURGE PROCESS CONTROL FOR 13-C-102				AGP Response Code			Prepared By:	VK		
Document No:			5323P1-H1-013-00-50-021		Revision No:	B	1. Revise and Re-submit		3. Approved	✓	Checked By:	DV	
AG Ref. No:			ADNOCGP-WTRAN-007148		Date:	3-Jun-2024	2. Approved with comments		4. For Information only		Approved By:	YVR	
SN	Reference		COMPANY Comments				CONSULTANT Response			COMPANY Resolution			
	Page No.	Clause No.											
1	1	-	No Comments.				-						
2	1 & 2	-	-				Following changes are made in P&ID w.r.t. Rev.B submission as per piping/instrumentation inputs: 1. Existing thermowell 13-TW-5006 / 5009 / 5011 / 5014 are shown in sheet 1 of 2 as per instrument input. 2. Existing themowell 13-TW-5015 / 5017 / 5021 / 5023 / 5115 / 5117/ 5121 / 5123 are shown in sheet 2 of 2 as per instrument input. 3. Note-9 and 10 updated in sheet 1 and 2. 4. Existing Isolation valve is shown for PT-3650 in sheet 2 of 2 as per piping input.						

NOTICE: THIS DRAWING AND THE INFORMATION IT CONTAINS IS THE SOLE PROPERTY OF ADNOC GAS PROCESSING. IT SHALL NOT BE REPRODUCED OR LENT WITHOUT THE AGREEMENT OF THE OWNER

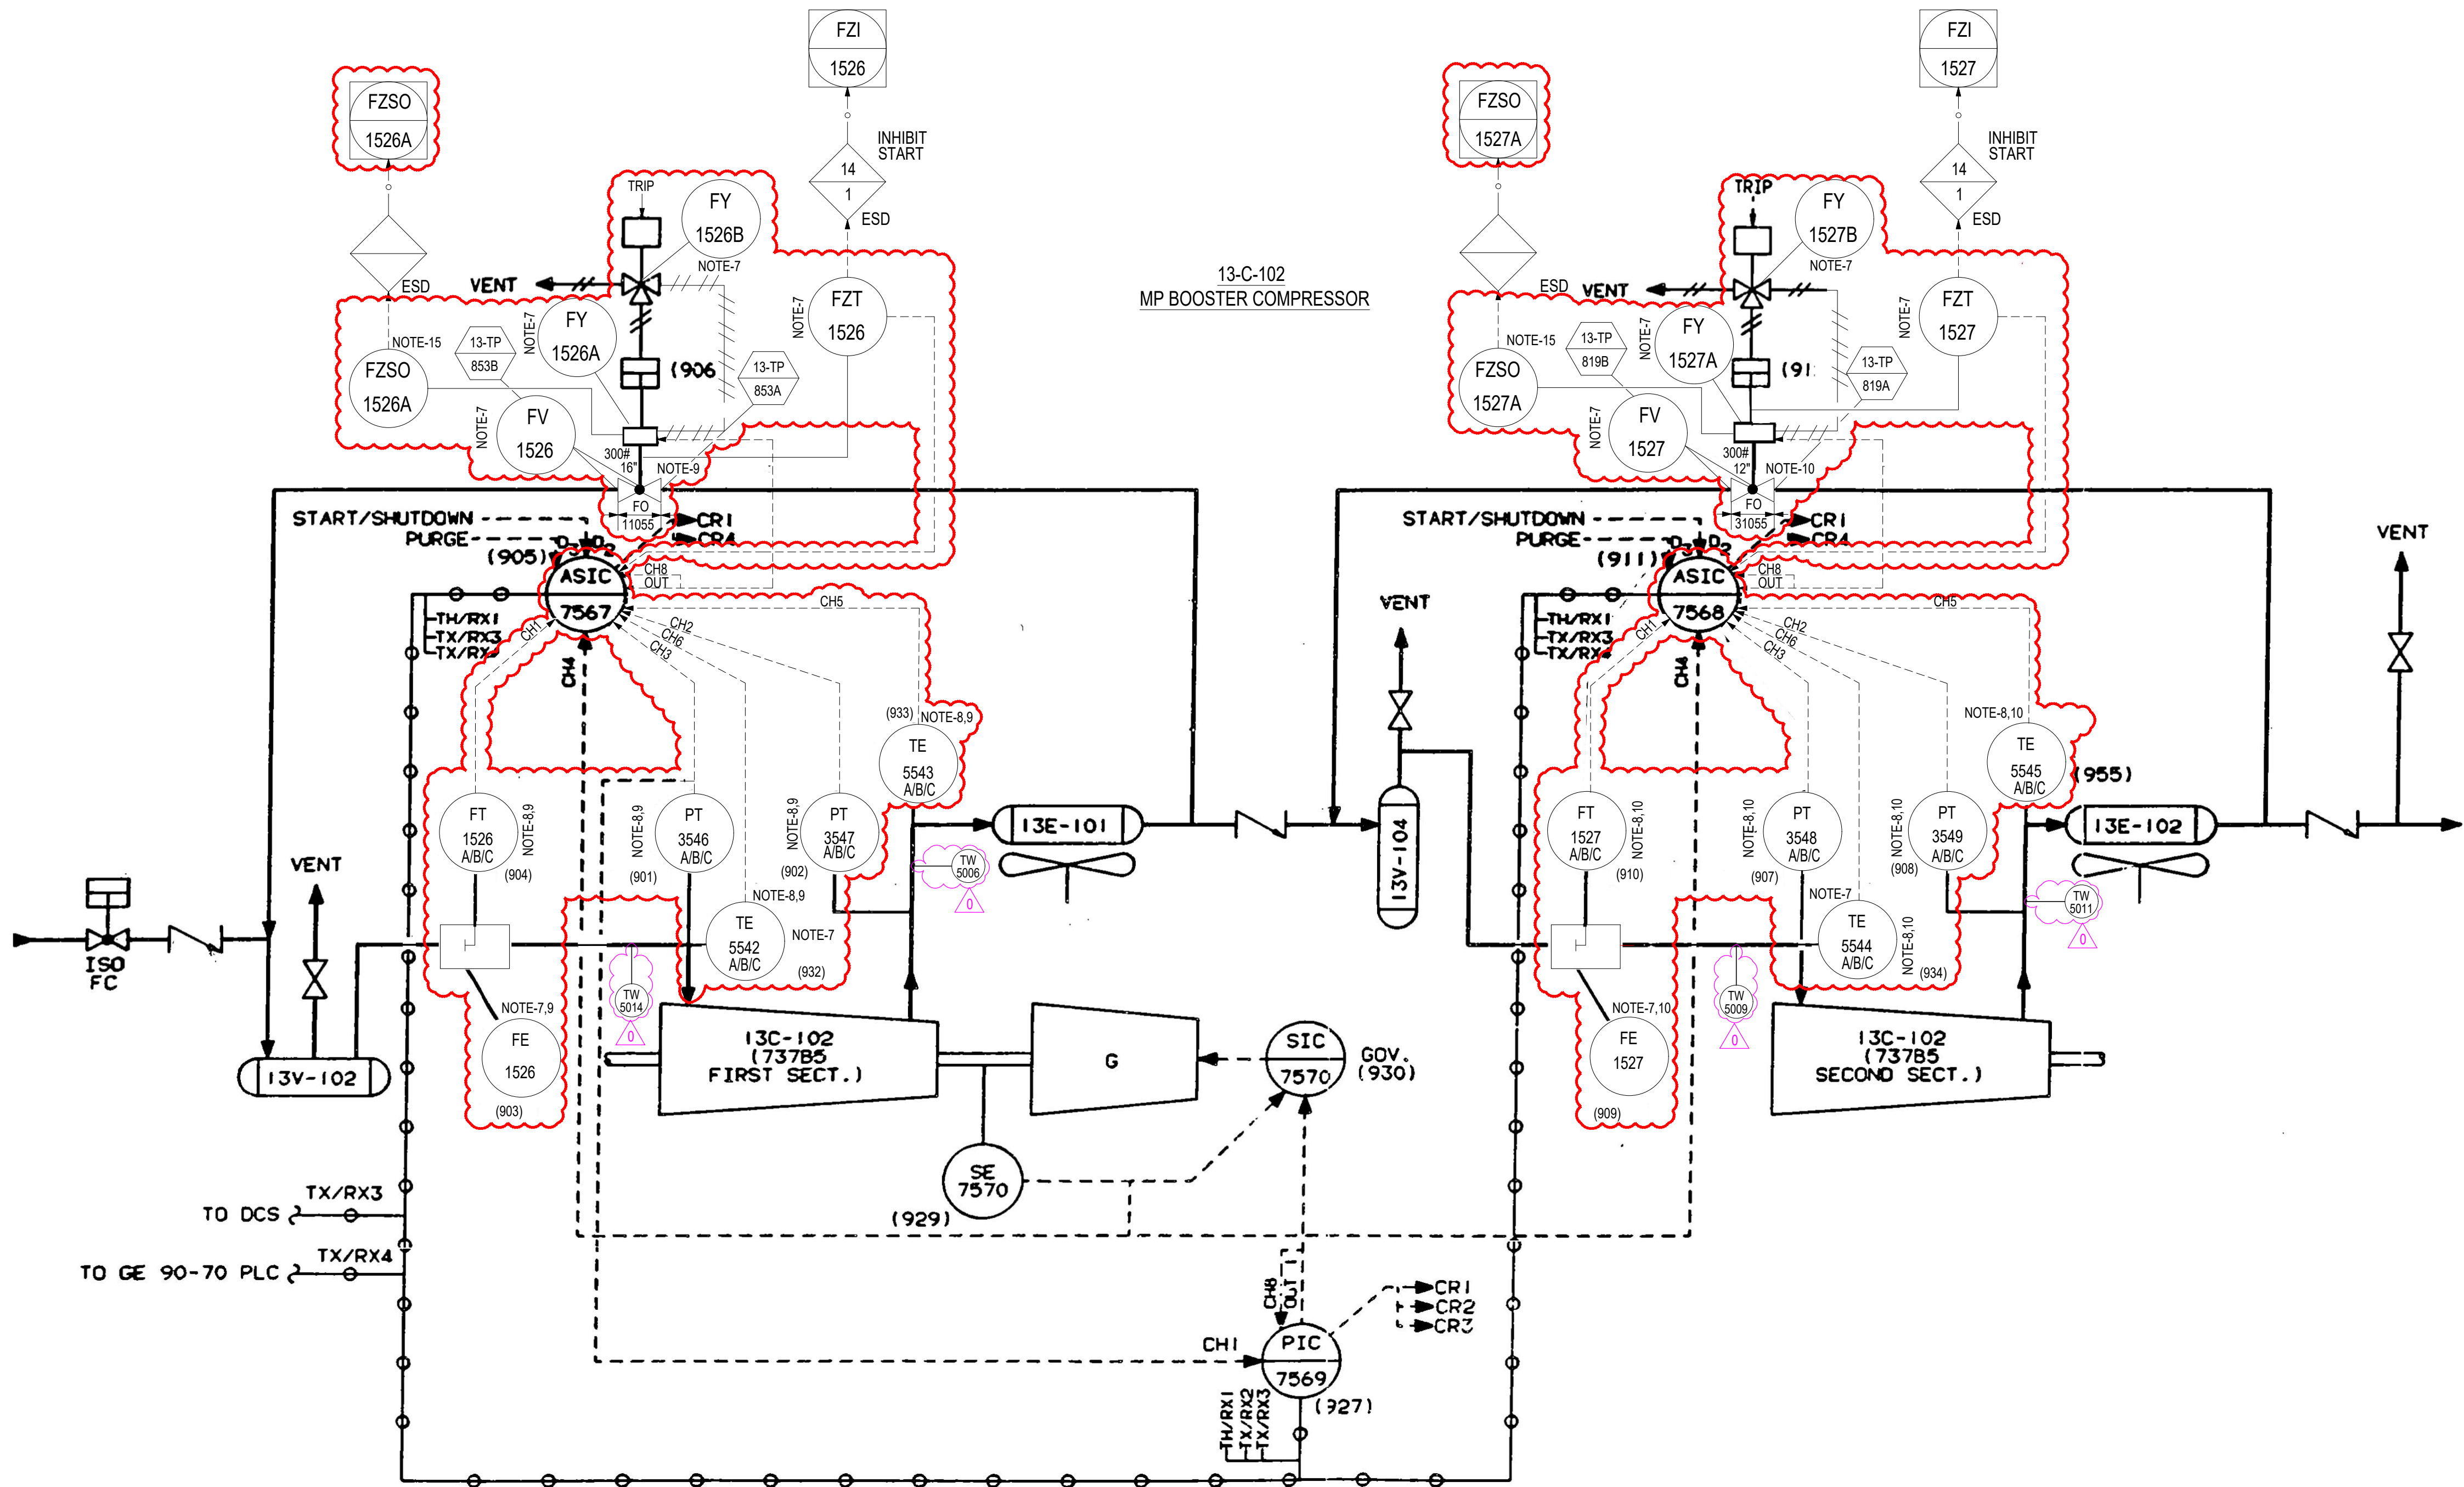

MASTER COPY

15-Aug-2024 IDM26031C

TEBODIN M.E. LTD.


NOTES:-

- FOR COMPONENT SYMBOLS AND LETTER DESCRIPTION SEE DRAWING 478-373-601.
- ITEMS IN PARENTHESIS REFER TO ITEM NUMBERS ON DETACHED LIST OF MATERIAL 478-447-201. I.E. (901)
- DASHED LINES ARE ANALOG ELECTRIC SIGNALS (I.E. 4-20MA). LINES WITH BUBBLES ARE DIGITAL ELECTRONICS SIGNALS (I.E. SERIAL COMMUNICATIONS). DISCRETE INPUTS / OUTPUTS ARE ALL SO DASHED LINES (D2, D3, CR1, CR2, ETC).
- ASIC-IS ANTI-SURGE INDICATING CONTROLLER. LSIC-IS LOAD SHARING INDICATING CONTROLLER. MPIC-IS MASTER PRESSURE INDICATOR CONTROLLER. SIC-IS TURBINE SPEED GOVERNOR. PIC-IS PRESSURE INDICATING CONTROLLER.
- ANTI-SURGE / PROCESS CONTROL SYSTEM IS TO BE INTRINSICALLY SAFE. THEREFORE, ALL TRANSMITTERS ARE TO BE EX1. I.S. BARRIERS ARE TO BE INSTALLED IN LOCAL CONTROL PANEL CONTAINING THE CONTROLLERS.
- ALL INSTRUMENT TAG NUMBERS ARE PREFIXED BY 13-.(EX(13-PT-3546). FOR INSTRUMENT TAG NUMBERS ON FEED GAS TRAIN "B" ADD "100" TO TAG NUMBERS ON TRAIN "A". (EX TRAIN "A" 13-PT-3546). TRAIN "B" 13-PT-3746).
- EXISTING INSTRUMENT/VALVES ARE REPLACED WITH NEW INSTRUMENT/VALVES AS PER PROJECT (0405323) SCOPE.
- INSTRUMENTS FOR ANTISURGE CONTROL ARE TRIPlicated AS DETAILED IN CORRESPONDING PROCESS P&ID 13-00-216 & 13-00-204.
- FOR DETAIL REPRESENTATION AND TIE IN POINT INFORMATION OF 13-C-102 1ST STAGE REFER P&ID 13-00-216.
- FOR DETAIL REPRESENTATION AND TIE IN POINT INFORMATION OF 13-C-102 2ND STAGE REFER P&ID 13-00-204.
- DELETED.
- DELETED.
- DELETED.
- DELETED.
- NEW INSTRUMENT/VALVES ARE INSTALLED AS PER PROJECT(0405323) SCOPE.
- ALL PIPING /INSTRUMENT INTERFACE CONNECTION WILL BE AS PER HOOK-UP DIAGRAM (5323P1-H1-01-15-38-002).
- HE ASC/PC CONTROLLERS SHALL BE INTERFACED TO DCS THROUGH REDUNDANT MODBUS TCP/IP COMMUNICATION AND ALL ASC/PC IOS SHALL BE DUPLICATED AT MCR HMI.
- THE TURBINE CONTROL SYSTEM (TCS) SHALL BE INTERFACED TO DCS THROUGH REDUNDANT MODBUS TCP/IP COMMUNICATION.
- THE EXISTING UNIT CONTROL PANEL (UCP) RELATED TO GE RX 3I AND WOODWARD IS REPLACED WITH NEW TURBINE CONTROL SYSTEM.

HOLDS:-

- DELETED.

LEGENDS:-

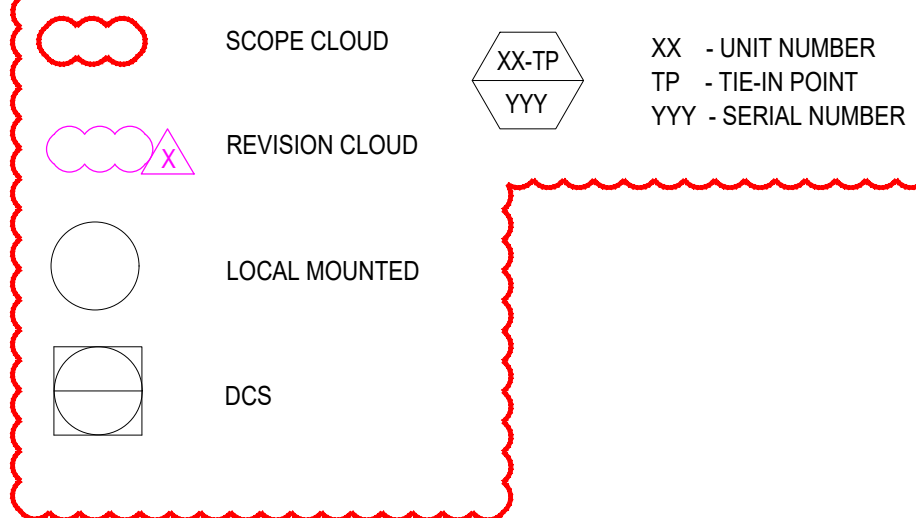

REFERENCE:-

- NM-5323P1-H1-013-15-21-001 - INSTRUMENT INDEX (UNIT-13)
- 03-00-30001 TO 007 - LEGEND FOR HABSHAN-1

USE THIS DRAWING FOR INFORMATION GIVEN WITHIN CLOUDED AREA

THIS DRAWING IS DEVELOPED FROM ADNOC DRAWING NO. 478-447 SHT 1/2 REV 01 (PACKAGE / VENDOR DRAWING)

REV	DATE	DESCRIPTION	DRAWN	CHKD	APPRD	APPRD (TARGET)
0	14.08.2024	ISSUED FOR CONSTRUCTION (IFC)	PRA	VK/DV	YVR	WAM
B	27.05.2024	ISSUED FOR APPROVAL (IFA)	PRA	KG/DV	YVR	WAM
A	13.01.2024	ISSUED FOR COMPANY REVIEW (ICR)	PT	KG/TS	YVR	WAM

CONTRACTOR:	ADNOC GAS	ENGINEERING SUBCONTRACTOR:	BILFINGER
PROJECT TITLE:	HABSHAN & BAB CONTROL SYSTEMS UPGRADE PACKAGE 1		
DRAWING TITLE:	PIPING AND INSTRUMENTATION DIAGRAM ANTI SURGE PROCESS CONTROL FOR 13-C-102		

UNIT:	13	PLANT:	HABSHAN-1
CONTR. PROJ. No.:	AET01074.00	CONTR. DWG. No.:	3143241
ADNOC GAS PROJ. No.:	0405323	ADNOC GAS DWG. No.:	5323P1-H1-013-00-50-021
SHEET No.:	01/02	REV:	0

CONTRACT NO.	21712CD	BY	DATE	SURGE-PROCESS CONTROL DIAGRAM	
TYPE	INST	DRAWN	KRW	08/13/92	
SCALE	NONE	CHECKED			
DEPT.	63.81	REDRAW			
DRAFTING APPROVAL	DJL	08/13/92		DRESSER-RAND	
CONTRACT APPROVAL	JAB	08/13/92		TURBO PRODUCTS DIVISION	
SYSTEM APPROVAL	GMW	08/13/92		CLEAN, N.Y. USA	
LICENSEE				478-447	SHT. 1/2 REV. 01

CAD NO.: 5323P1-H1-013-00-50-021.DWG

SHEET SIZE : A1

