


			ADNOC GAS HABSHAN & BAB CONTROL SYSTEMS UPGRADE (PACKAGE 1) PROJECT NO. 0405323						  				
			COMMENTS RESOLUTION SHEET										
Document Title:			PIPING AND INSTRUMENTATION DIAGRAM MP GAS COMPRESSOR LUBE OIL DIAGRAM FOR 13-C-102			AGP Response Code			Prepared By:	VK			
Document No:			5323P1-H1-013-00-50-022		Revision No:	B	1. Revise and Re-submit		3. Approved	✓	Checked By:	DV	
AG Ref. No:			ADNOCGP-WTRAN-007148		Date:	3-Jun-2024	2. Approved with comments		4. For Information only		Approved By:	YVR	
SN	Reference		COMPANY Comments				CONSULTANT Response			COMPANY Resolution			
	Page No.	Clause No.											
1	-	-	No Comments.				-						
2	1	1	-				Following changes are made in P&ID w.r.t. Rev.B submission as per piping/instrumentation inputs: 1. LT-2502 vent valve type and size updated based on piping input. 2. LT-2502 process connection size and rating updated based on piping input 3. LT-2501 Tie-in no are deleted from detail "A" as per piping input 4. TI-6507 connection is updated as flange connection as per piping input. 5. Instrument manifold valves on tubing for all PT are shown in project scope cloud based on instrument input.						

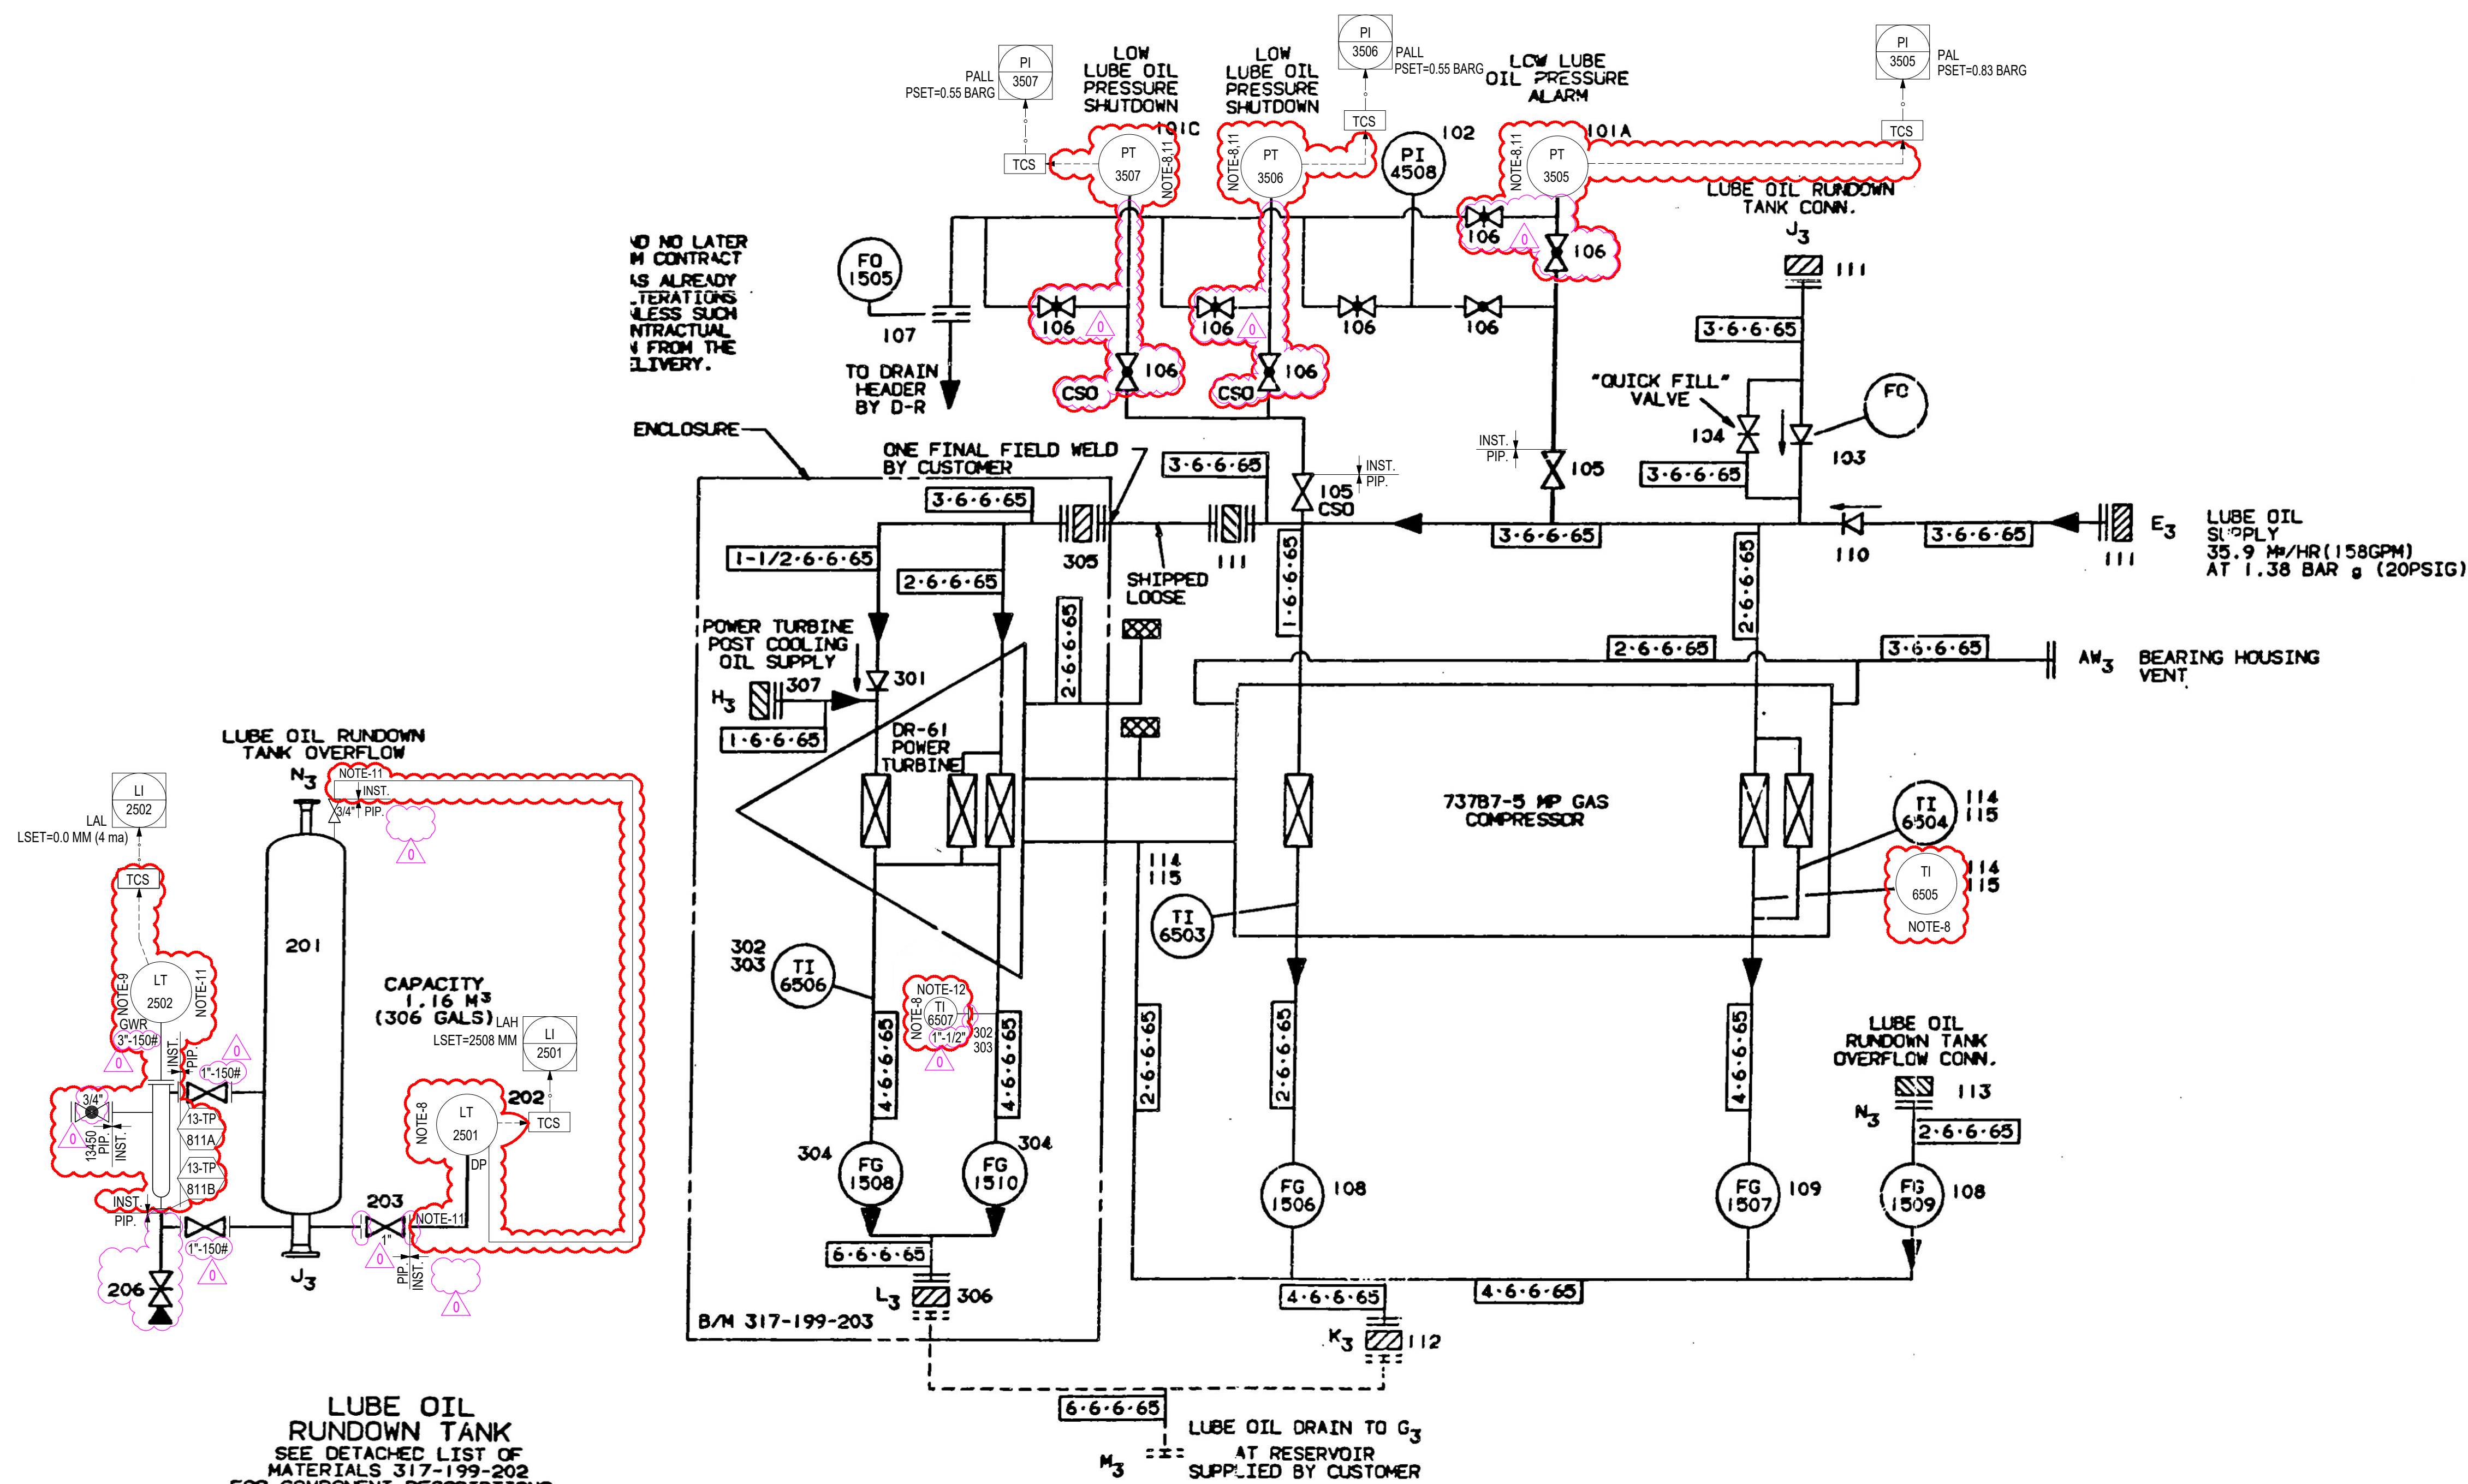

LUBE OIL
RUNDOWN TANK
SEE DETACHED LIST OF
MATERIALS 317-199-202
FOR COMPONENT DESCRIPTIONS.

MASTER COPY

15-Aug-2024 IDM260310

TEBODIN M.E. LTD.


NOTES:-

1. SEE DRAWING 478-373-601 FOR COMPONENT SYMBOLS AND LETTER DESIGNATIONS.
2. SEE DRAWING 003-152-001 FOR PIPING LINE COLORE EXPLANATION.
3. SEE DETACHED LIST OF MATERIALS 317-199-201 202. OR 203 FOR COMPONENT DESCRIPTIONS.
4. SEE DETACHED CUSTOMER CONNECTION LIST 478-145-601. FOR CUSTOMER CONNECTION DESCRIPTIONS.
5. SEE DRAWING 478-110 FOR WIRING DETAILS.
6. FLUSHING STRAINERS ARE TO BE REMOVED ONLY AFTER FLUSHING IS COMPLETE.
7. ALL INSTRUMENT TAG NUMBERS SHOULD BE PREFIXED WITH THE AREA DESIGNATIONS: "13".
8. EXISTING INSTRUMENT ARE REPLACED WITH NEW INSTRUMENT AS PER PROJECT (0405323) SCOPE.
9. EXISTING SWITCH IS REPLACED WITH NEW TRANSMITTER AS PER THE PROJECT(0405323) SCOPE.
10. DELETED.
11. ALL PIPING /INSTRUMENT INTERFACE CONNECTION WILL BE AS PER HOOK-UP DIAGRAM (5323P1-H1-01-15-38-001).
12. EXISTING THERMOWELL TO BE RE-USED.
13. THE TURBINE CONTROL SYSTEM (TCS) SHALL BE INTERFACED TO DCS THROUGH REDUNDANT MODBUS TCP/IP COMMUNICATION.
14. THE EXISTING UNIT CONTROL PANEL (UCP) RELATED TO GE RX 31 AND WOODWARD IS REPLACED WITH NEW TURBINE CONTROL SYSTEM.

HOLDS:-

1. DELETED.

LEGENDS:-

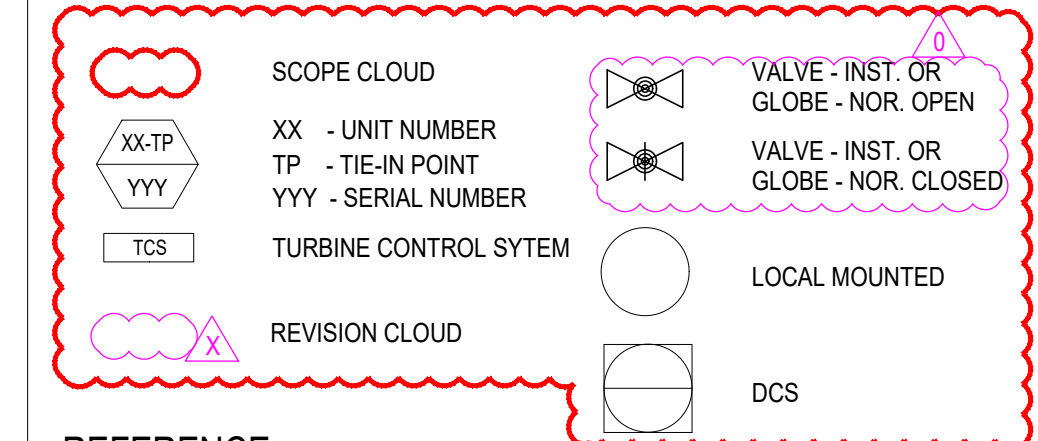

REFERENCE:-

1. NM-5323P1-H1-013-15-21-001 - INSTRUMENT INDEX - UNIT 13
2. 03-00-30001 TO 007 - LEGEND FOR HABSHAN-1
3. NM-5323P1-H1-01-00-40-002 - ALARM AND TRIP SETTINGS LIST - HABSHAN 1

USE THIS DRAWING FOR INFORMATION GIVEN WITHIN
CLOUDED AREA

THIS DRAWING IS DEVELOPED FROM ADNOC DRAWING NO.
317-199 SHT 1/1 REV 03 (PACKAGE / VENDOR DRAWING)

[illegible]

أدنوك للغاز
ADNOC Gas



CONTRACTOR:

TARGET

ENGINEERING
SUBCONTRACTOR:

PROJECT TITLE: HABSHAN & BAB CONTROL SYSTEMS UPGRADE
PACKAGE 1

DRAWING TITLE: PIPING AND INSTRUMENTATION DIAGRAM
MP GAS COMPRESSOR LUBE OIL DIAGRAM
FOR 13 C 103

UNIT:	13	PLANT:	HABSHAN-1
CONTR. PROJ. No.:	AET01074.00	CONTR. DWG. No.:	3143242
ADNOC GAS AGREEMENT No.:	47000416747		

ADNOC GAS PROJ. No.:	ADNOC GAS DWG. No.:	SHEET No.:	REV.
0405323	5323P1-H1-013-00-50-022	01/01	0

CONTRACT NO. 217128				BY	DATE	MP GAS COMPRESSOR			
TYPE INST		DRAWN		DLM	03/26/92	LUBE OIL DIAGRAM			
SCALE NONE		CHECKED		JMJ	04/01/92	DRESSER-RAND			
DEPT. 6381		REDRAW				TURBO PRODUCTS DIVISION			
DRAFTING APPROVAL				DJL	04/01/92	CLEAN, N.Y. USA			
CONTRACT APPROVAL				JAB	04/01/92	317-199 SHT. REV. 101 03			
SYSTEM APPROVAL				JMJ	04/01/92				
--- -- -- -- -- -- -- -- HCS LICENSEE									

CAD NO.: 5323P1-H1-013-00-50-022.DWG

SHEET SIZE : A1

NOTICE: THIS DRAWING AND THE INFORMATION IT CONTAINS IS THE SOLE PROPERTY OF ADNOC GAS PROCESSING. IT SHALL NOT BE REPRODUCED OR LENT WITHOUT THE AGREEMENT OF THE OWNER.