






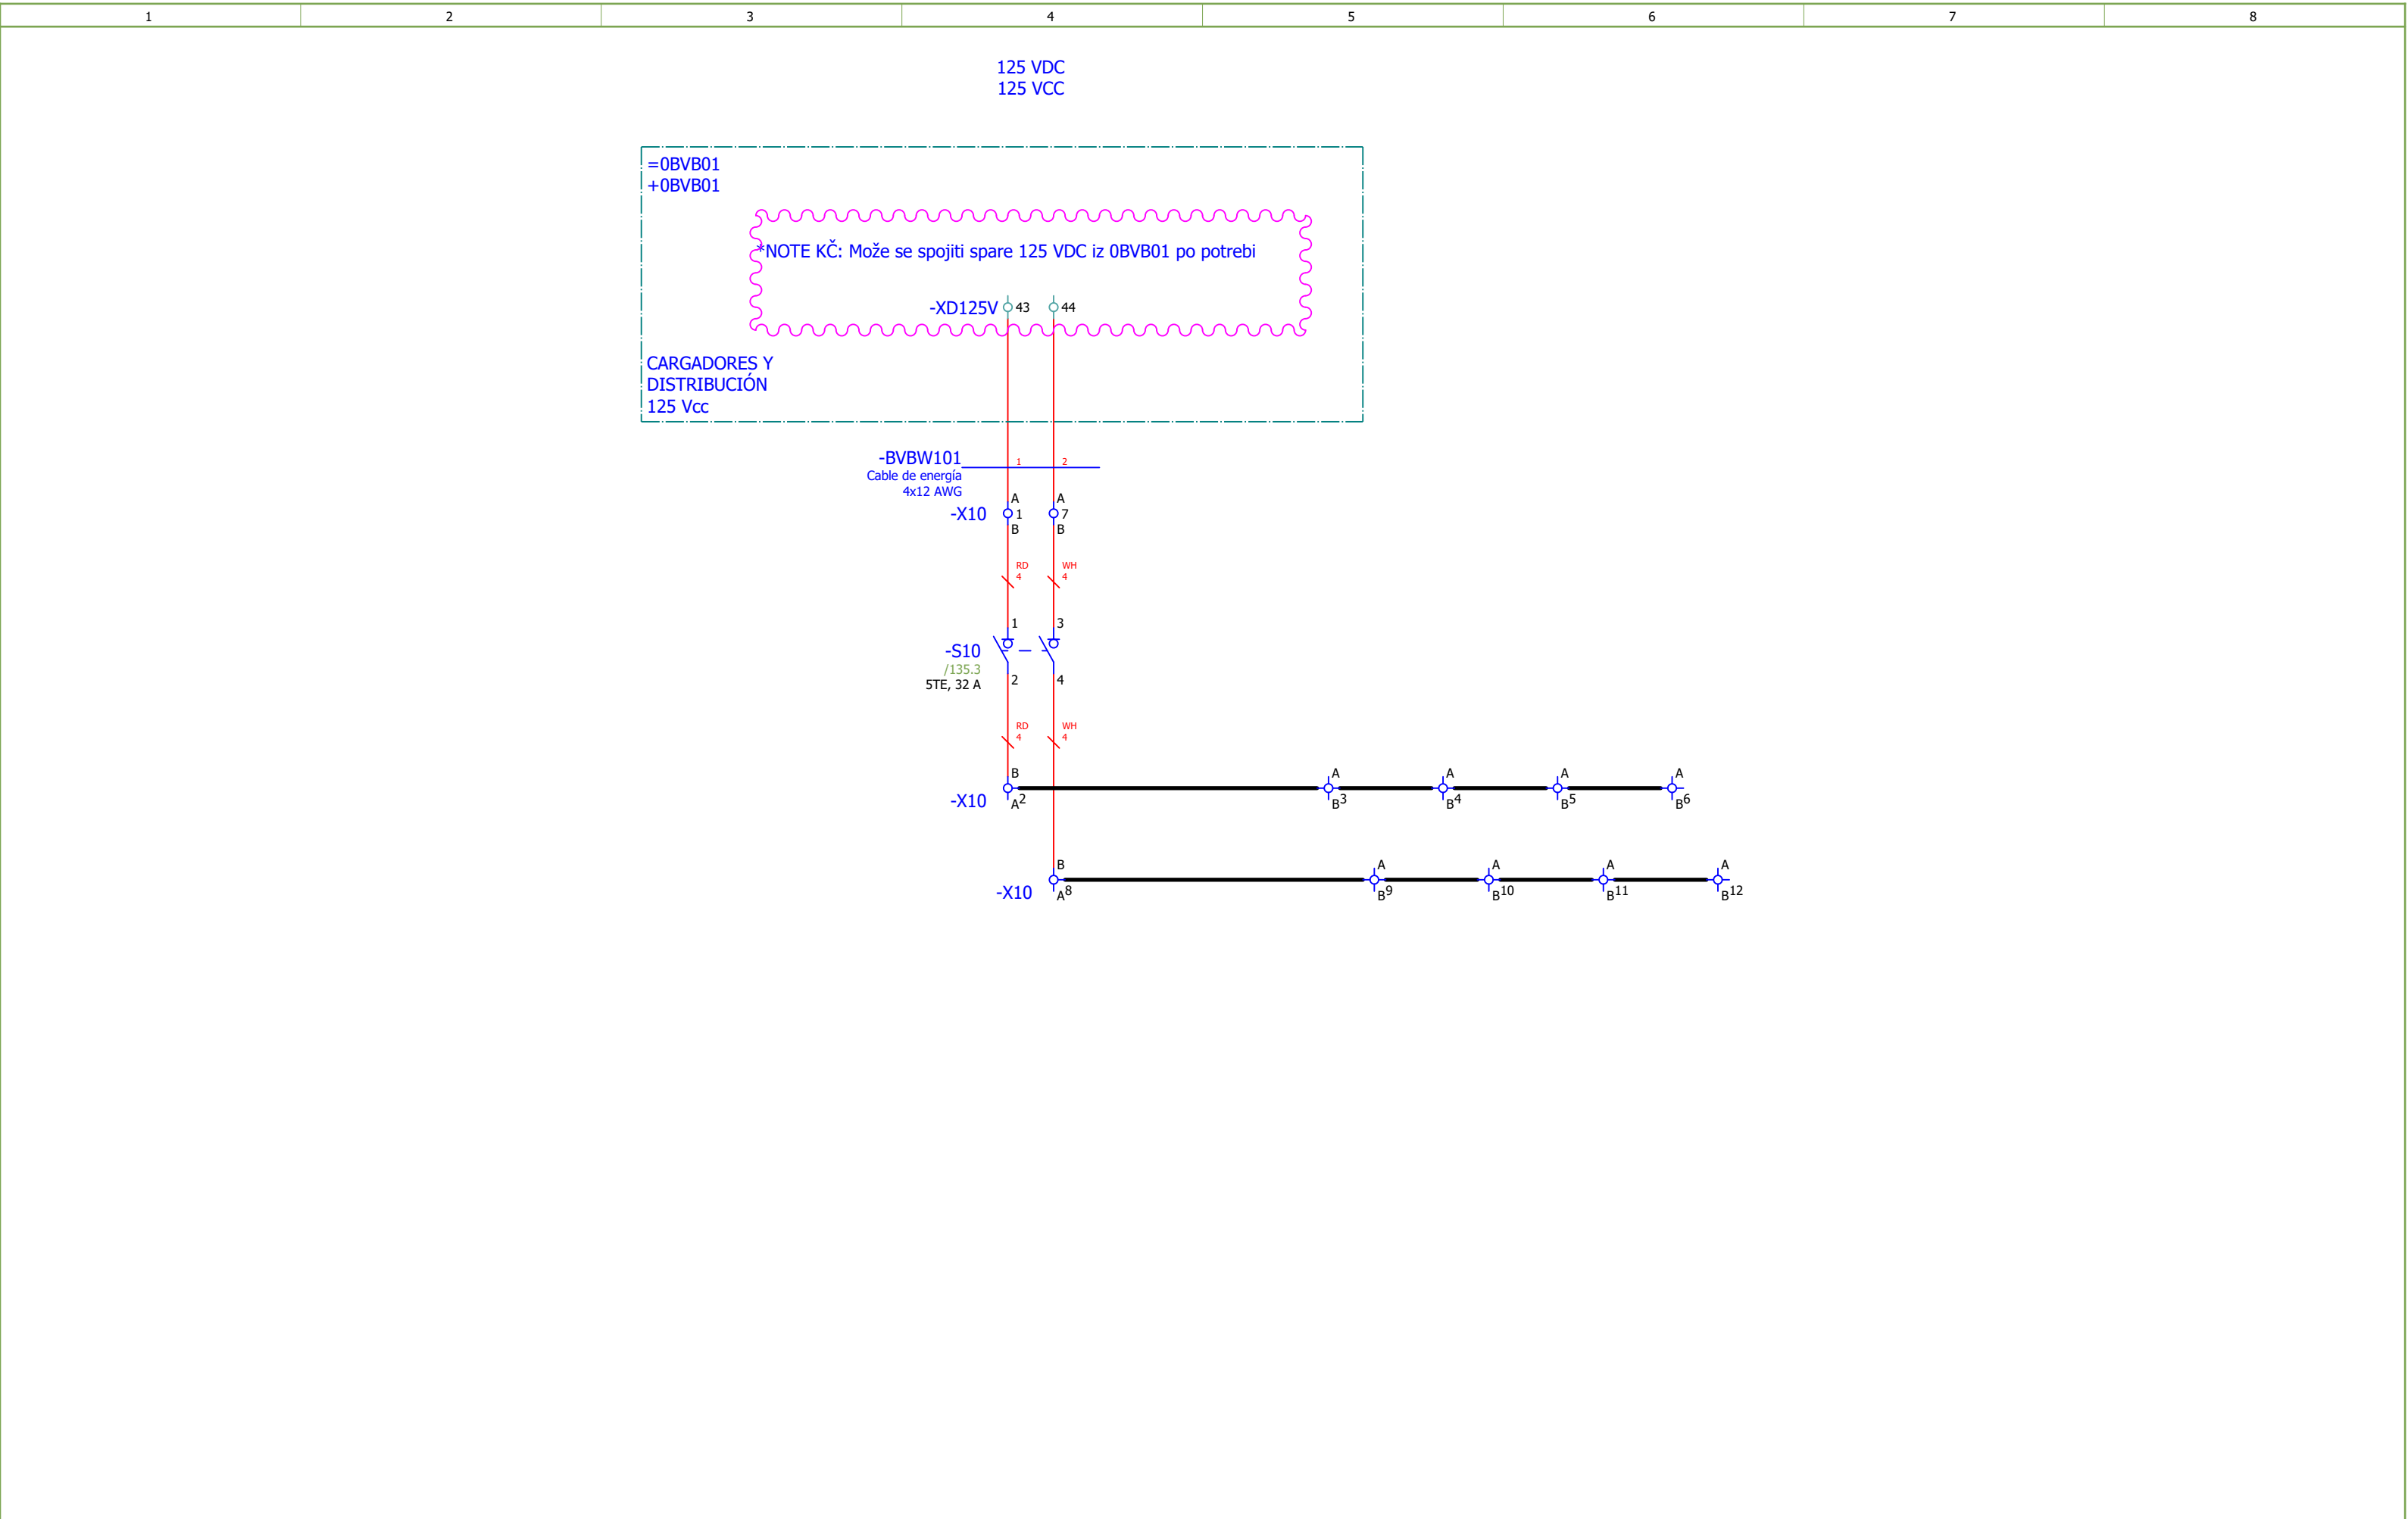


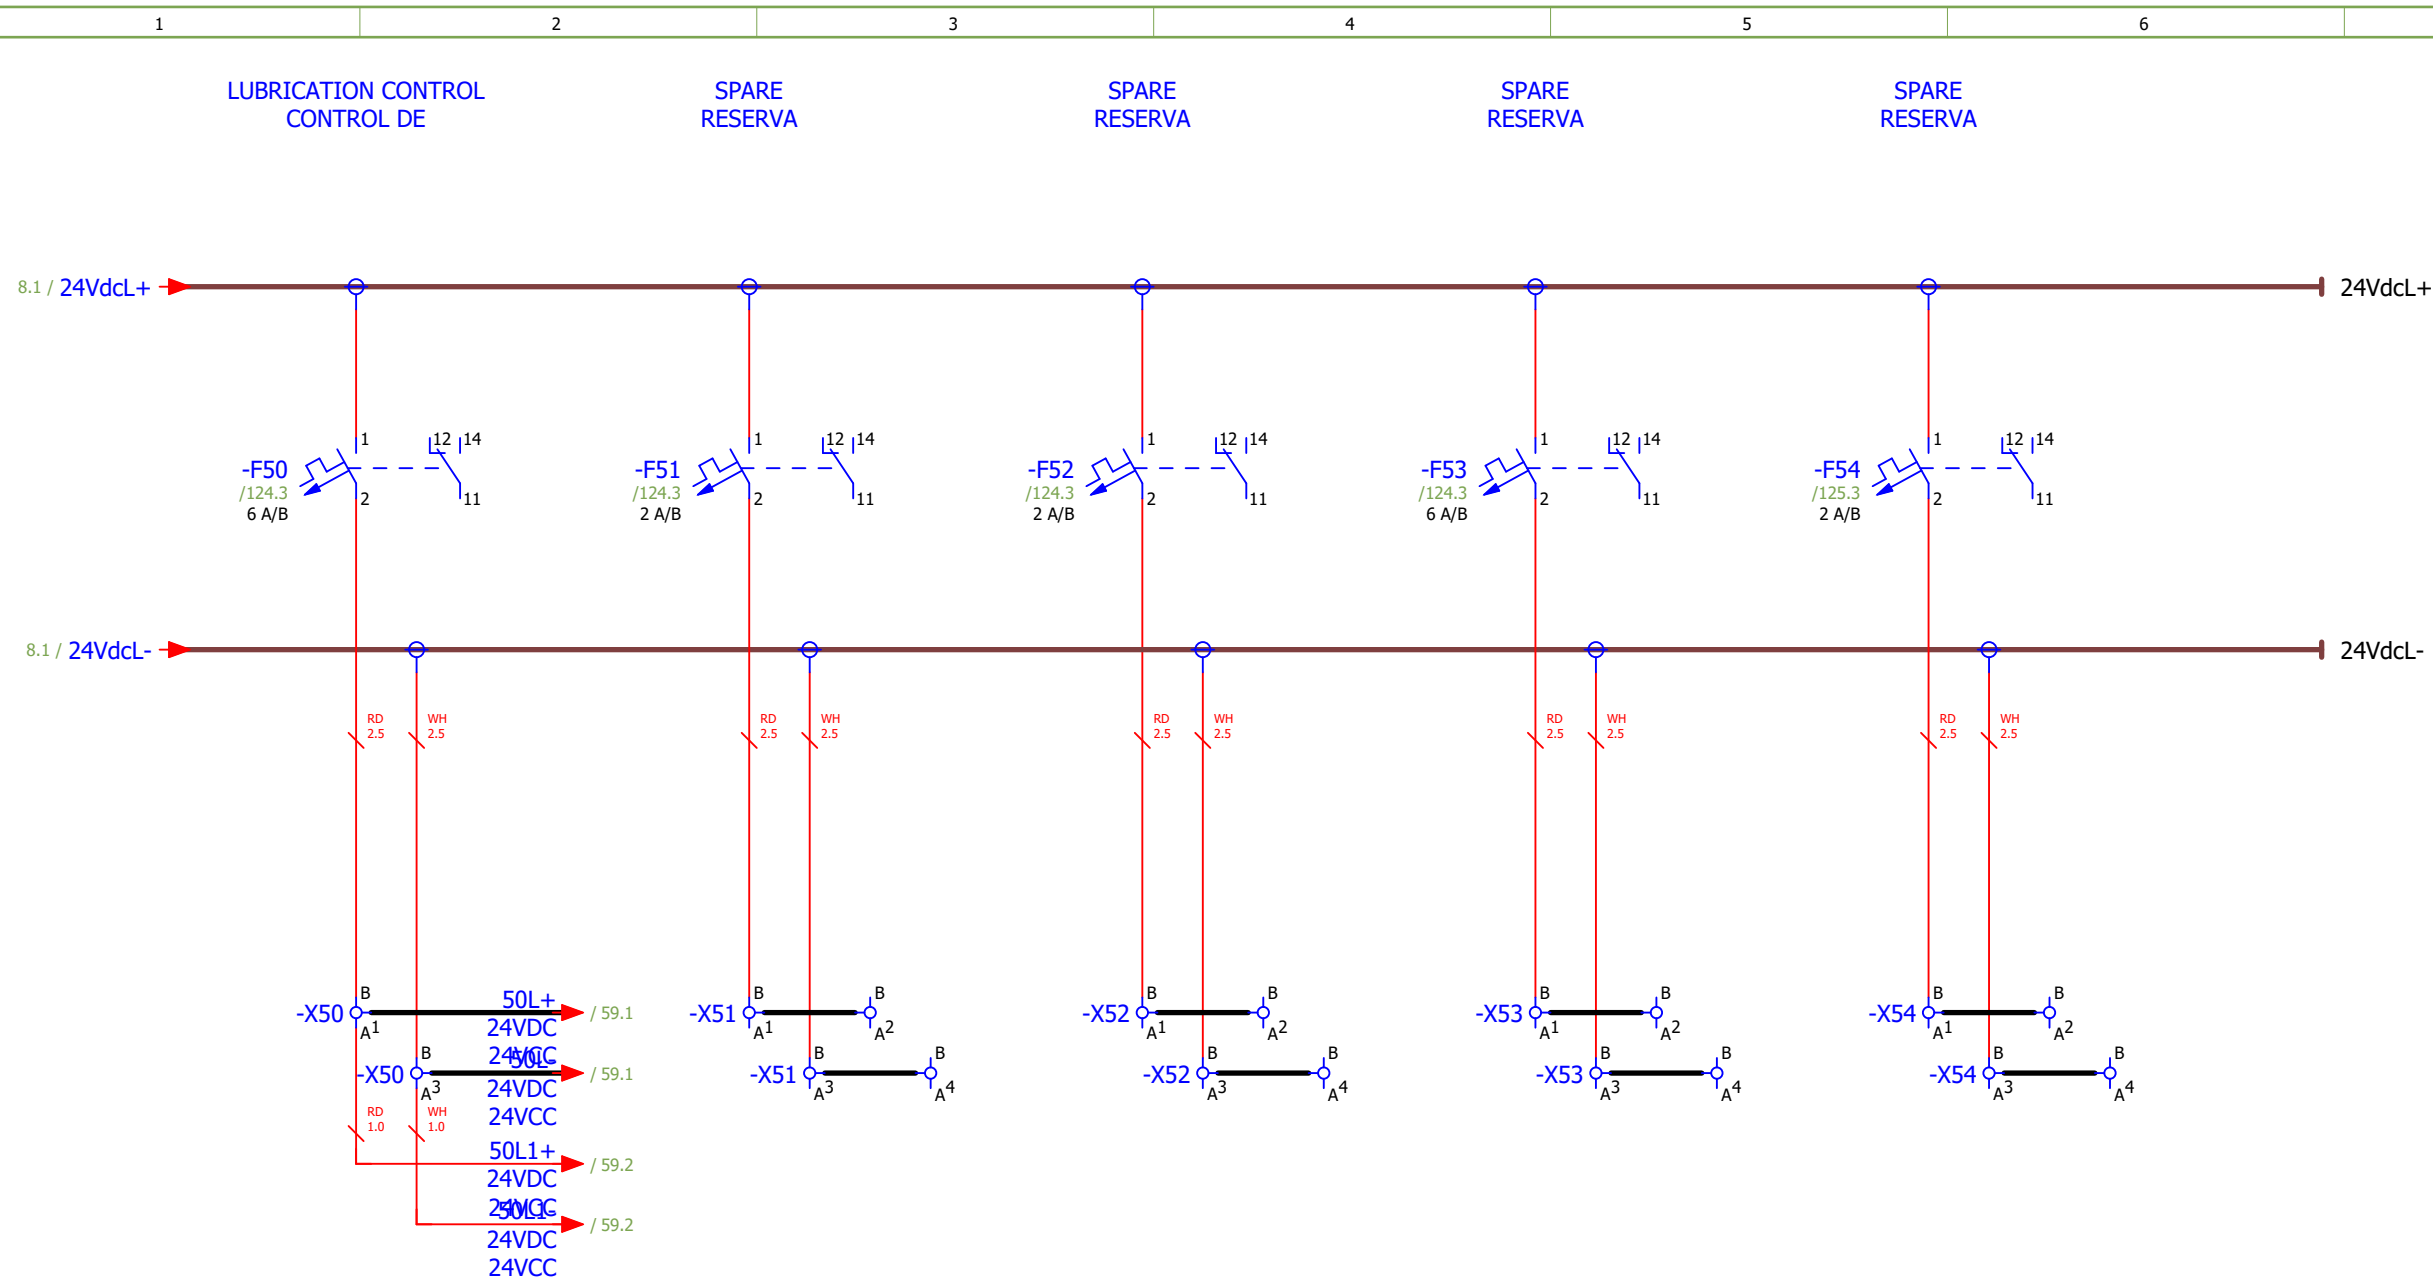


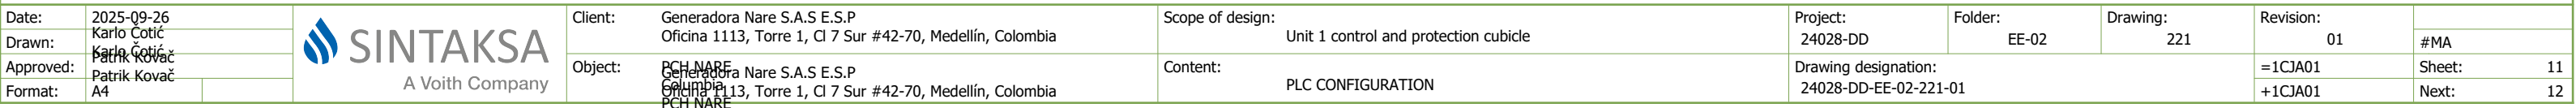


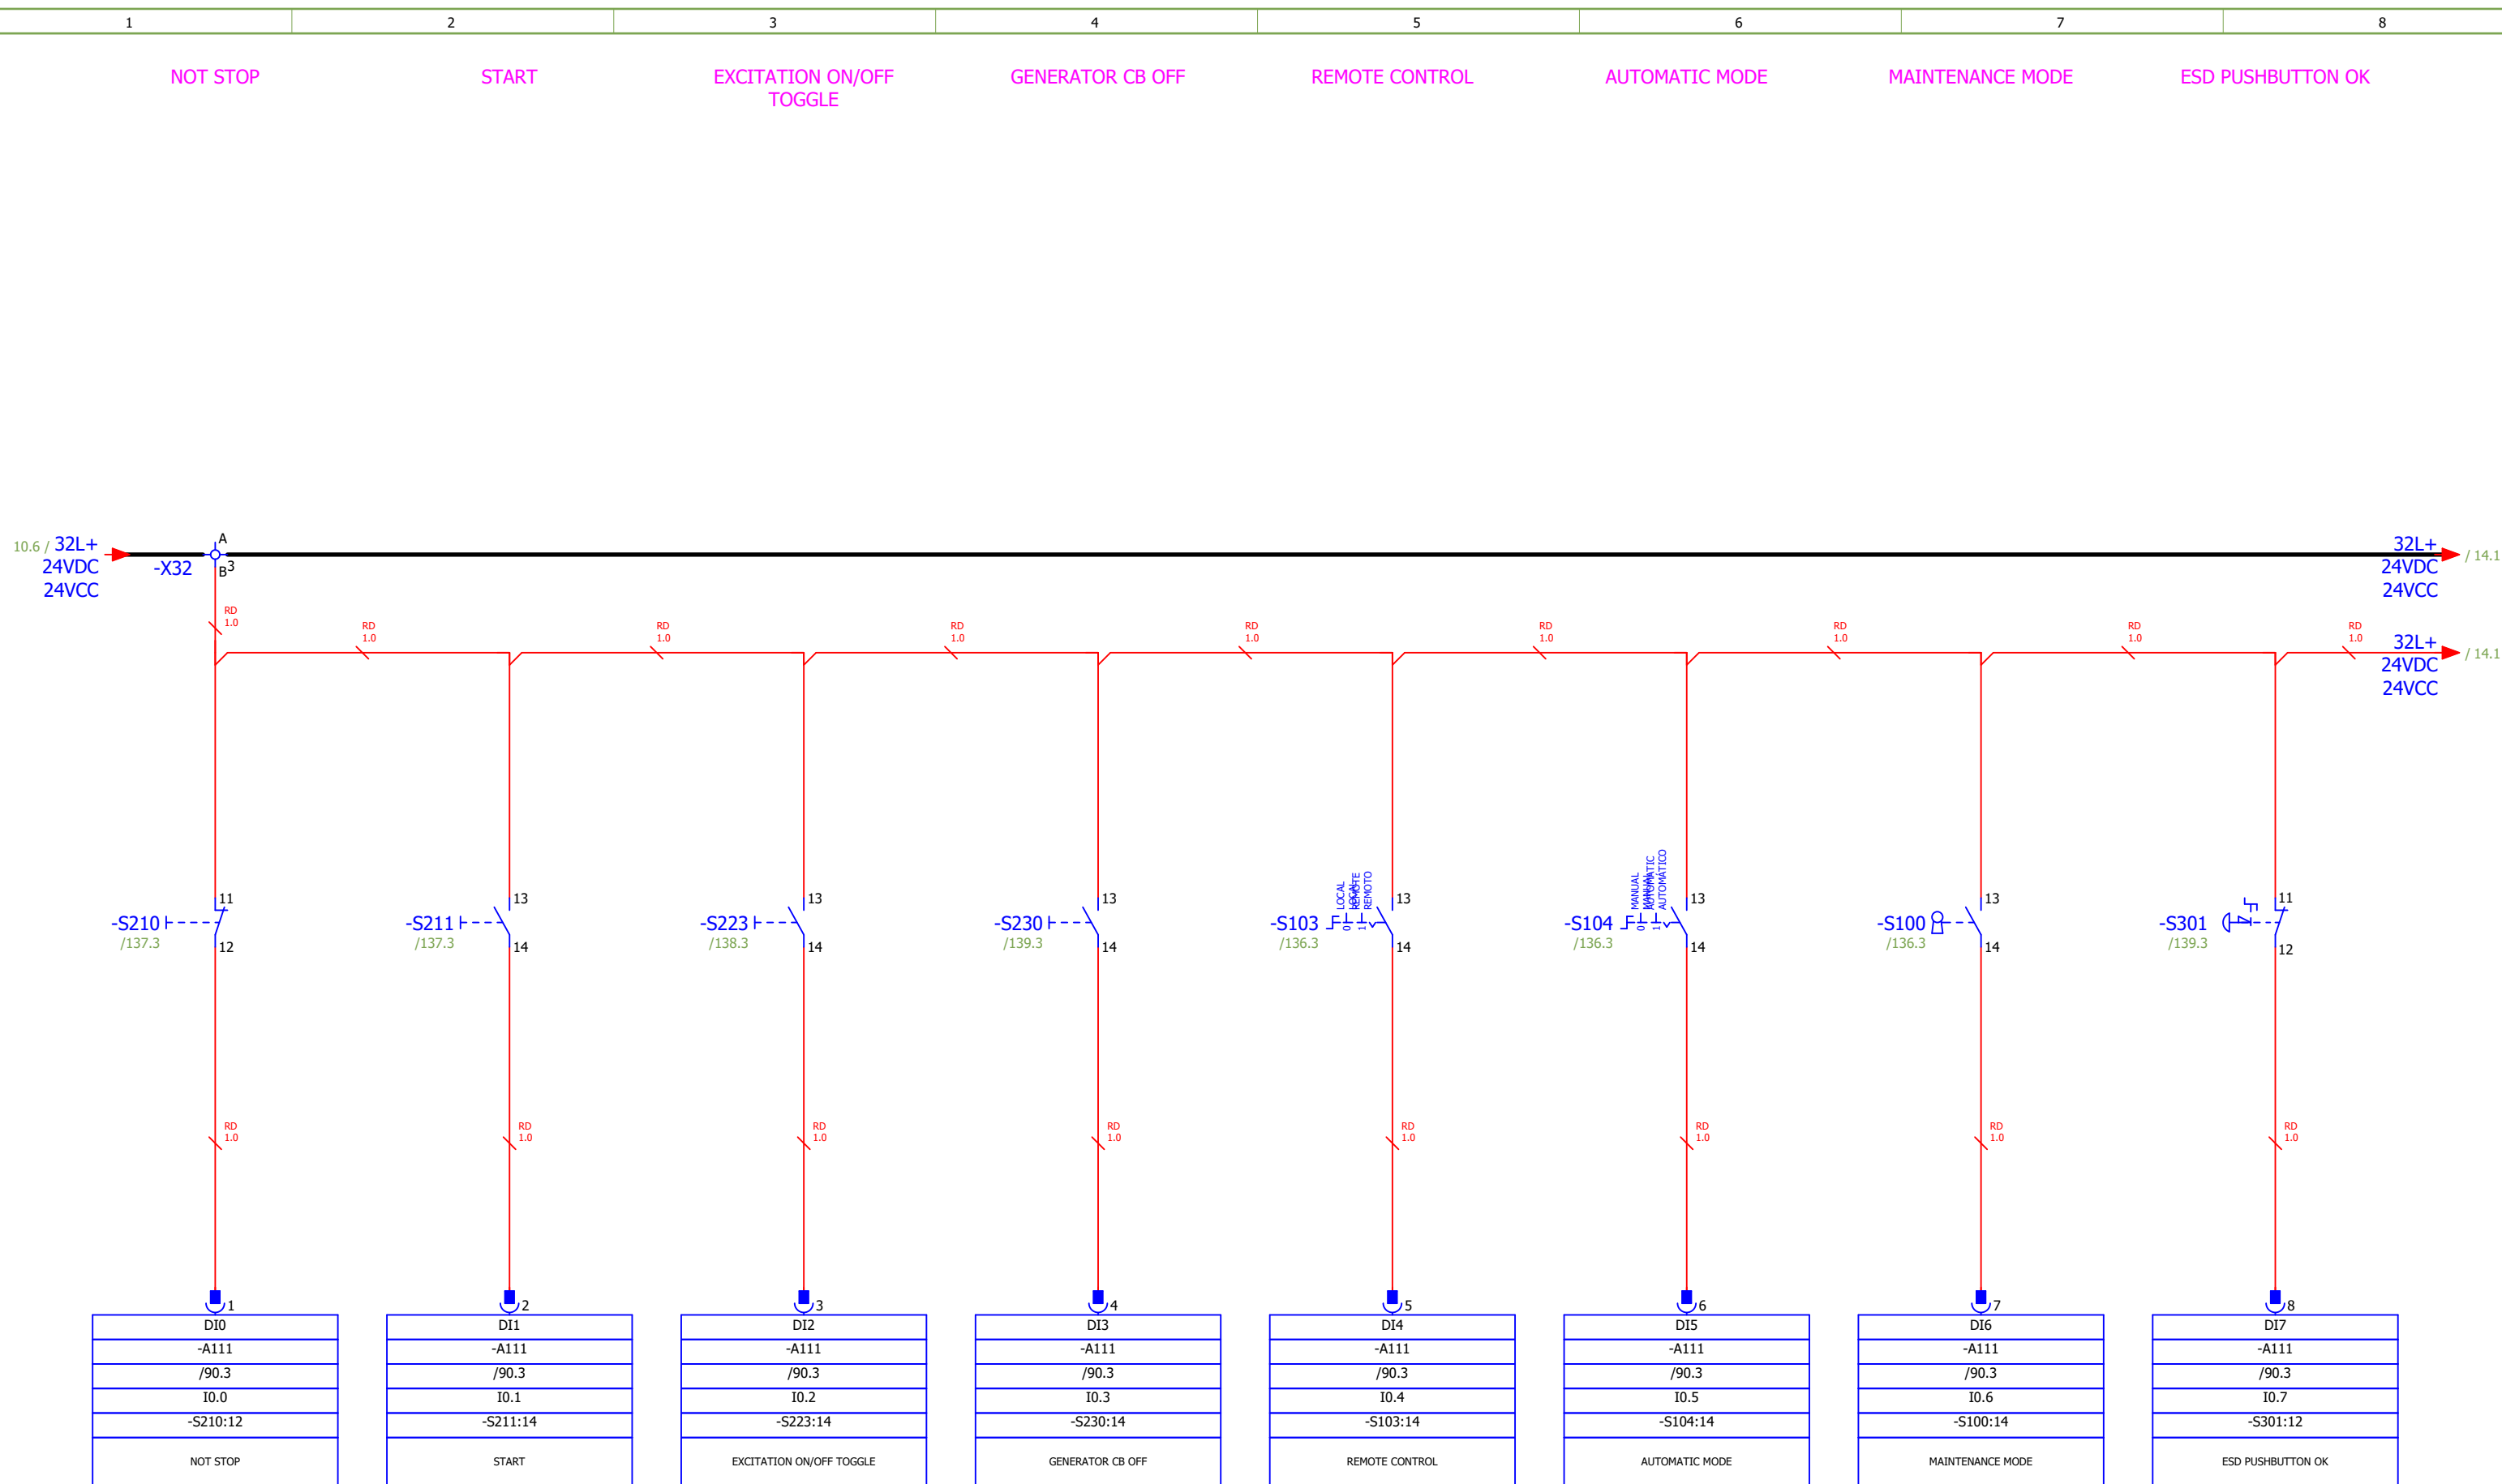


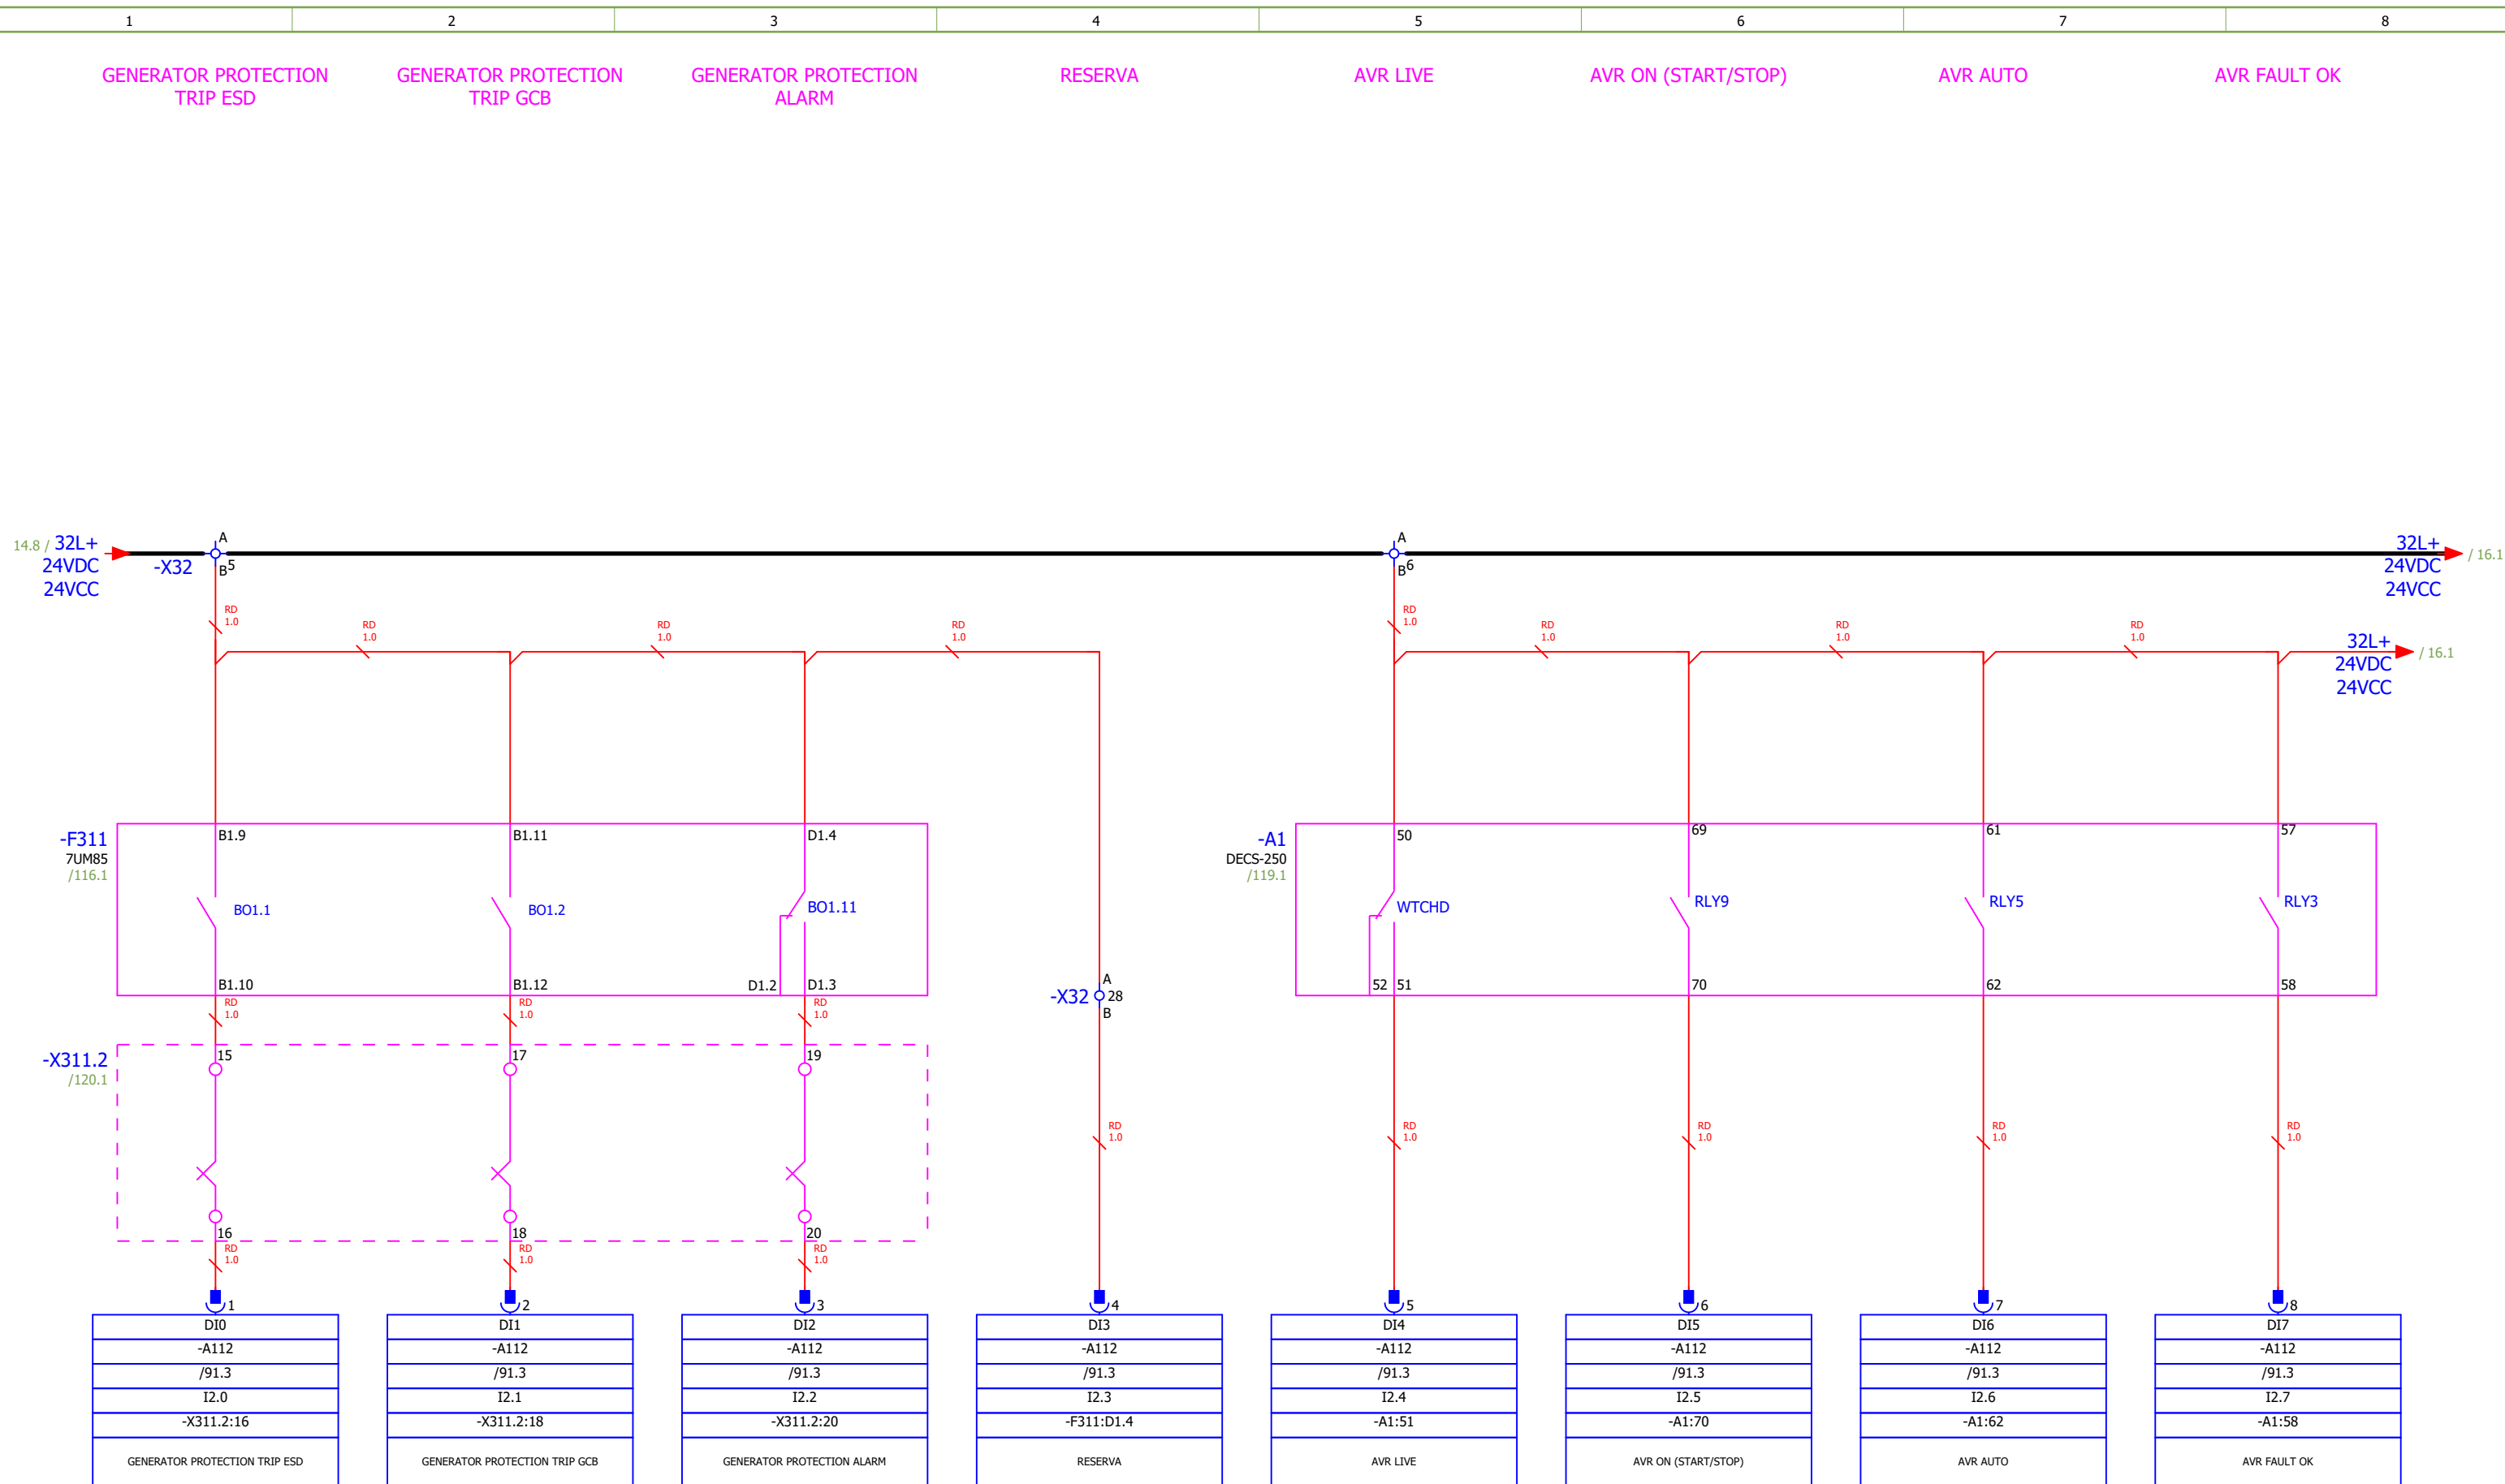


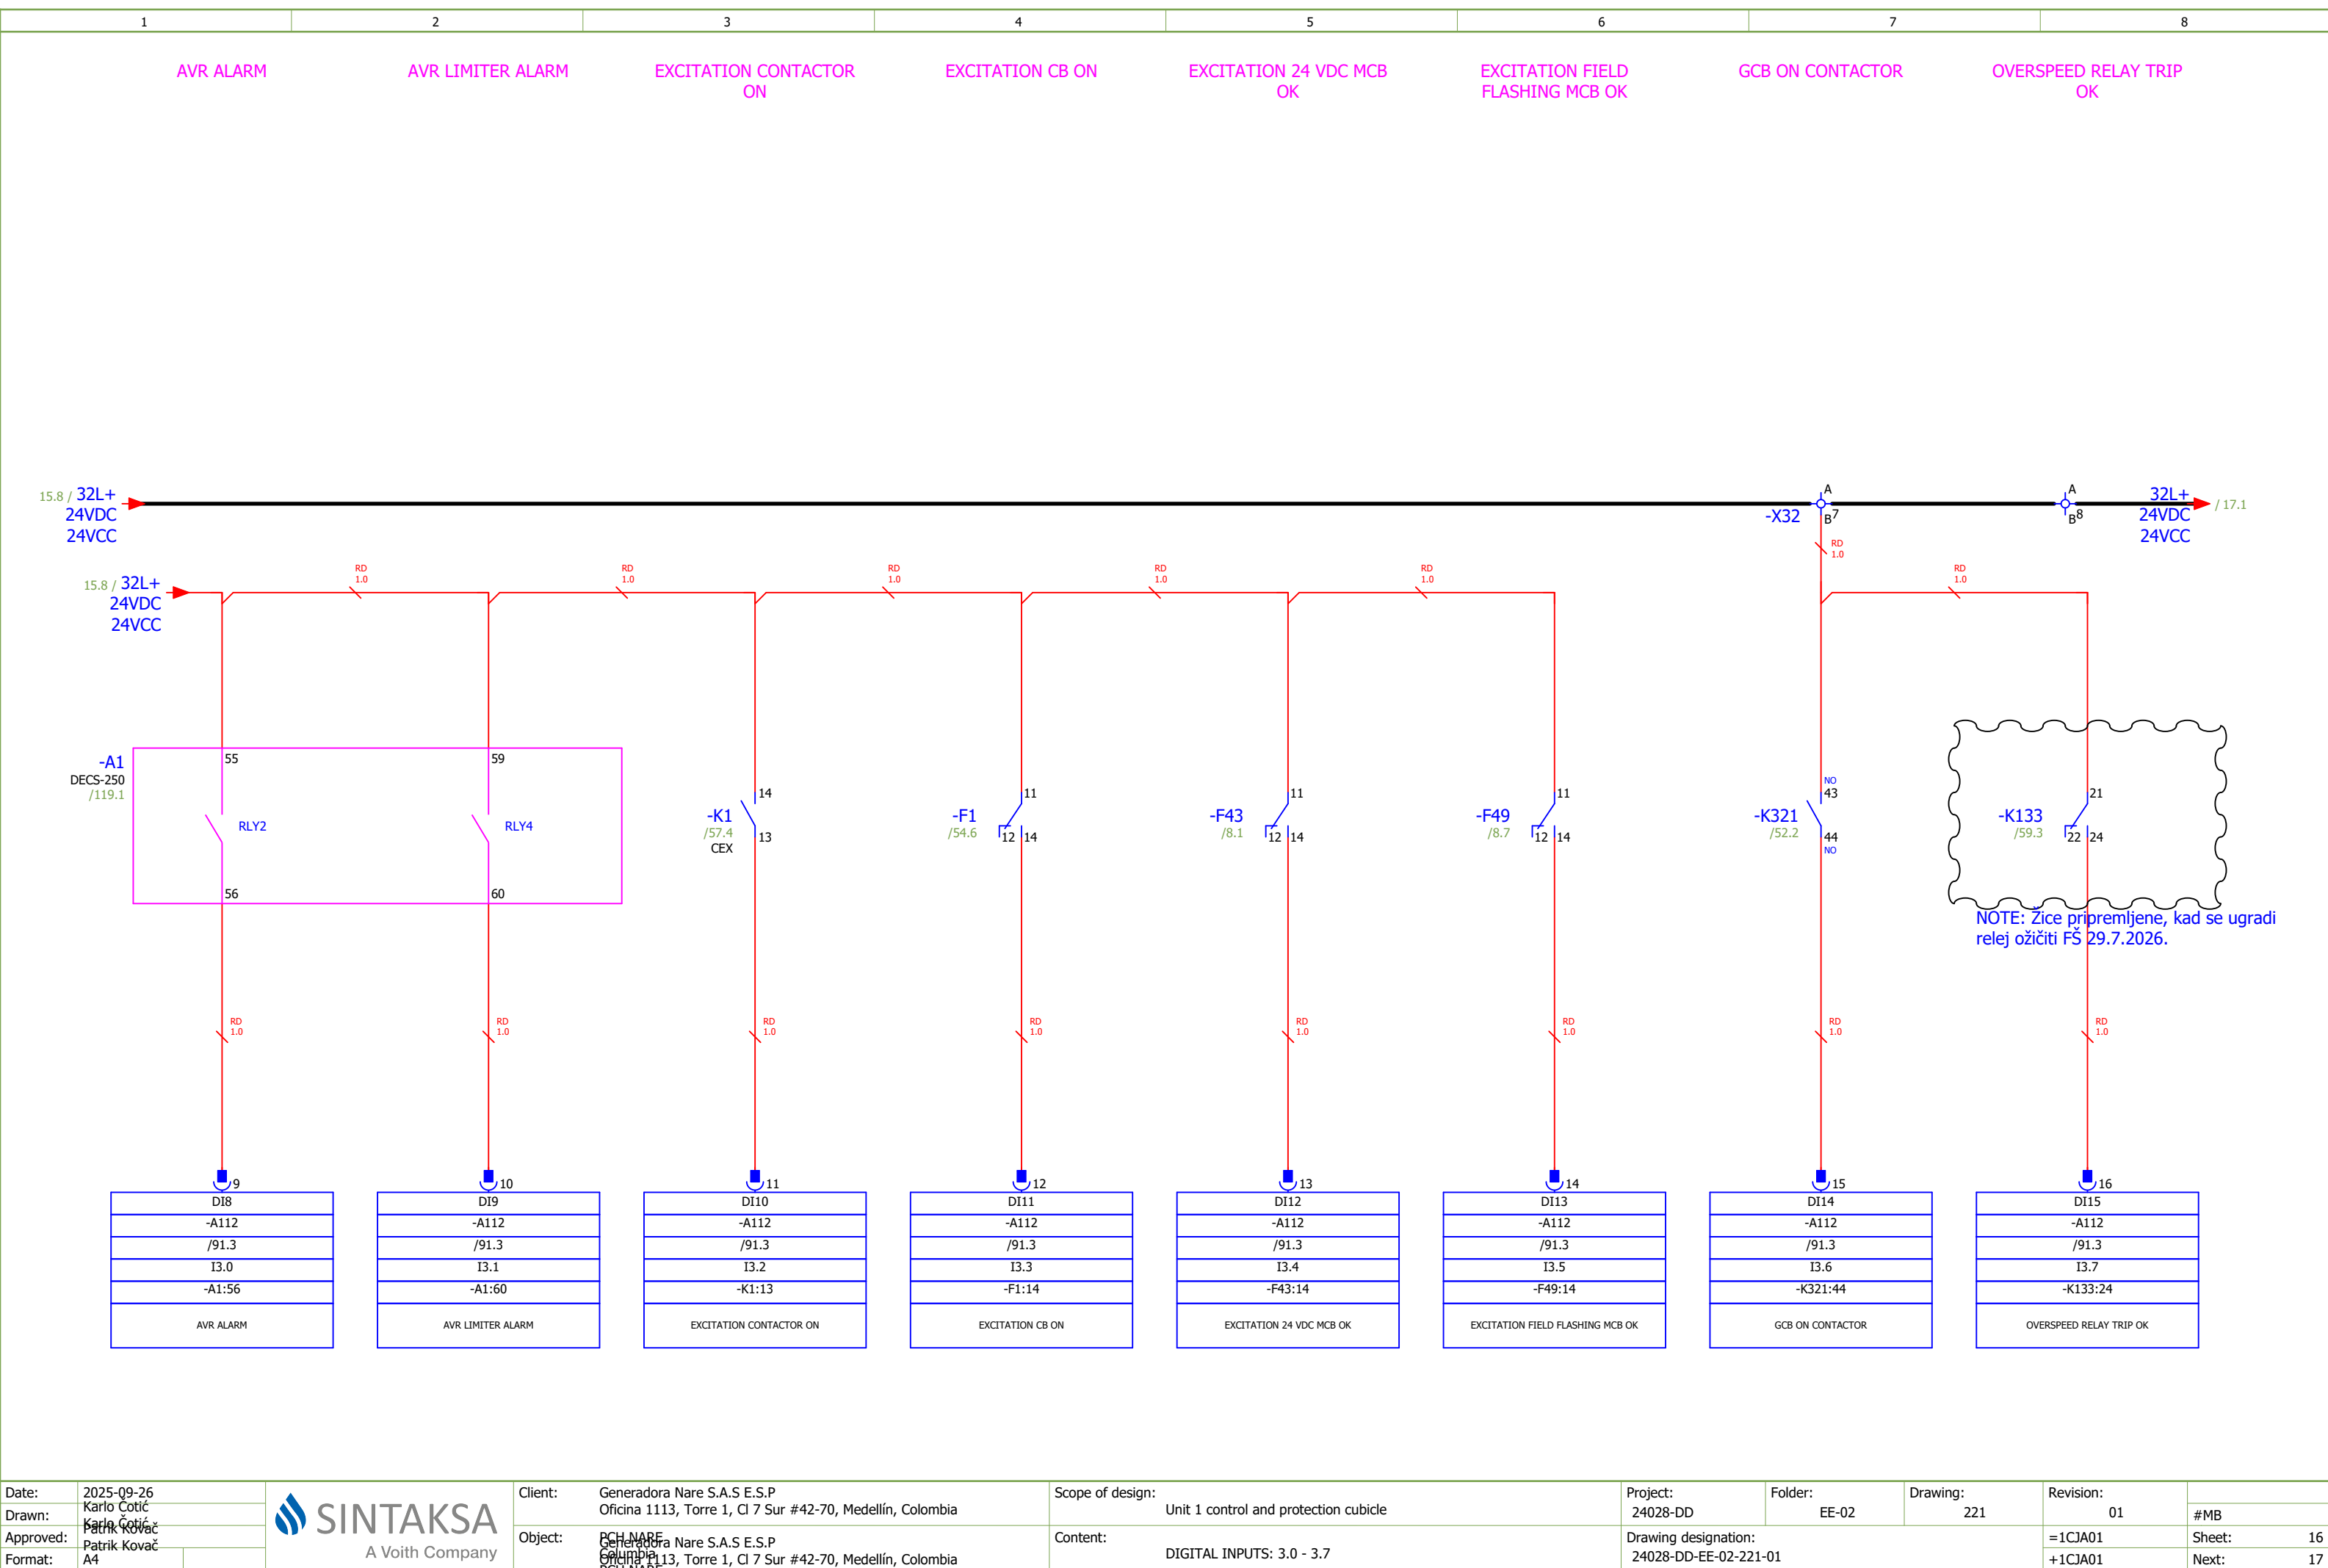





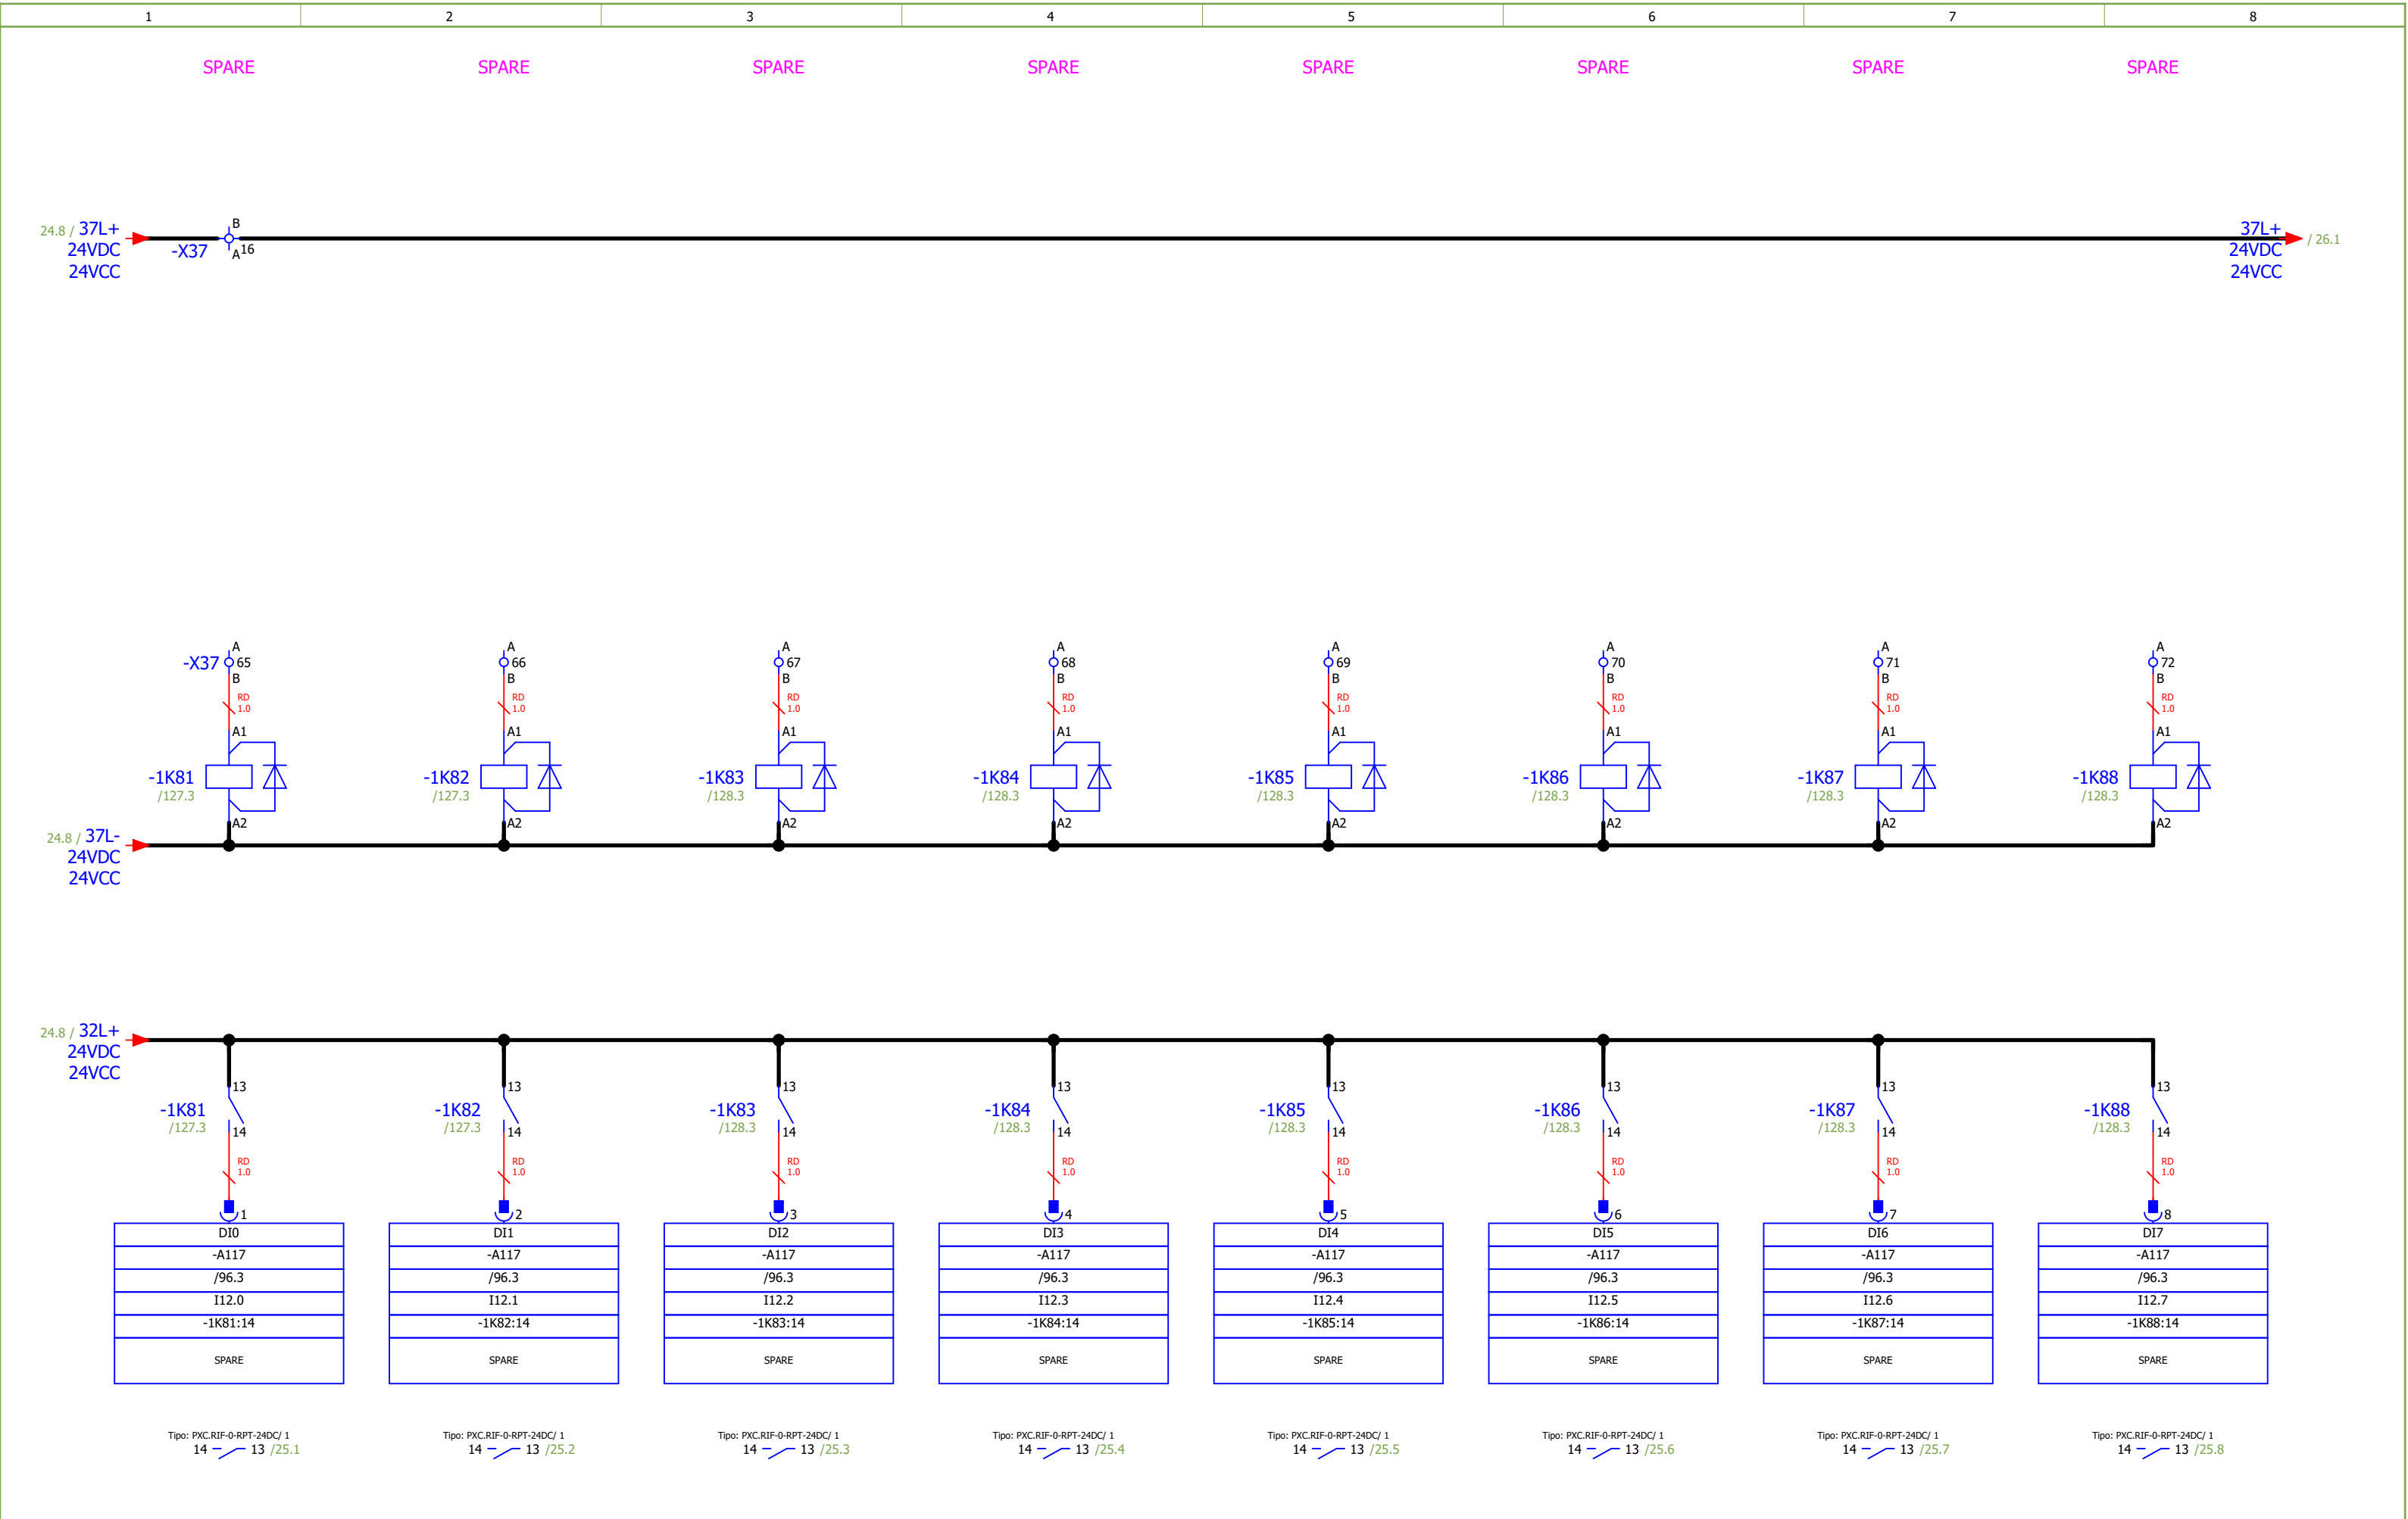


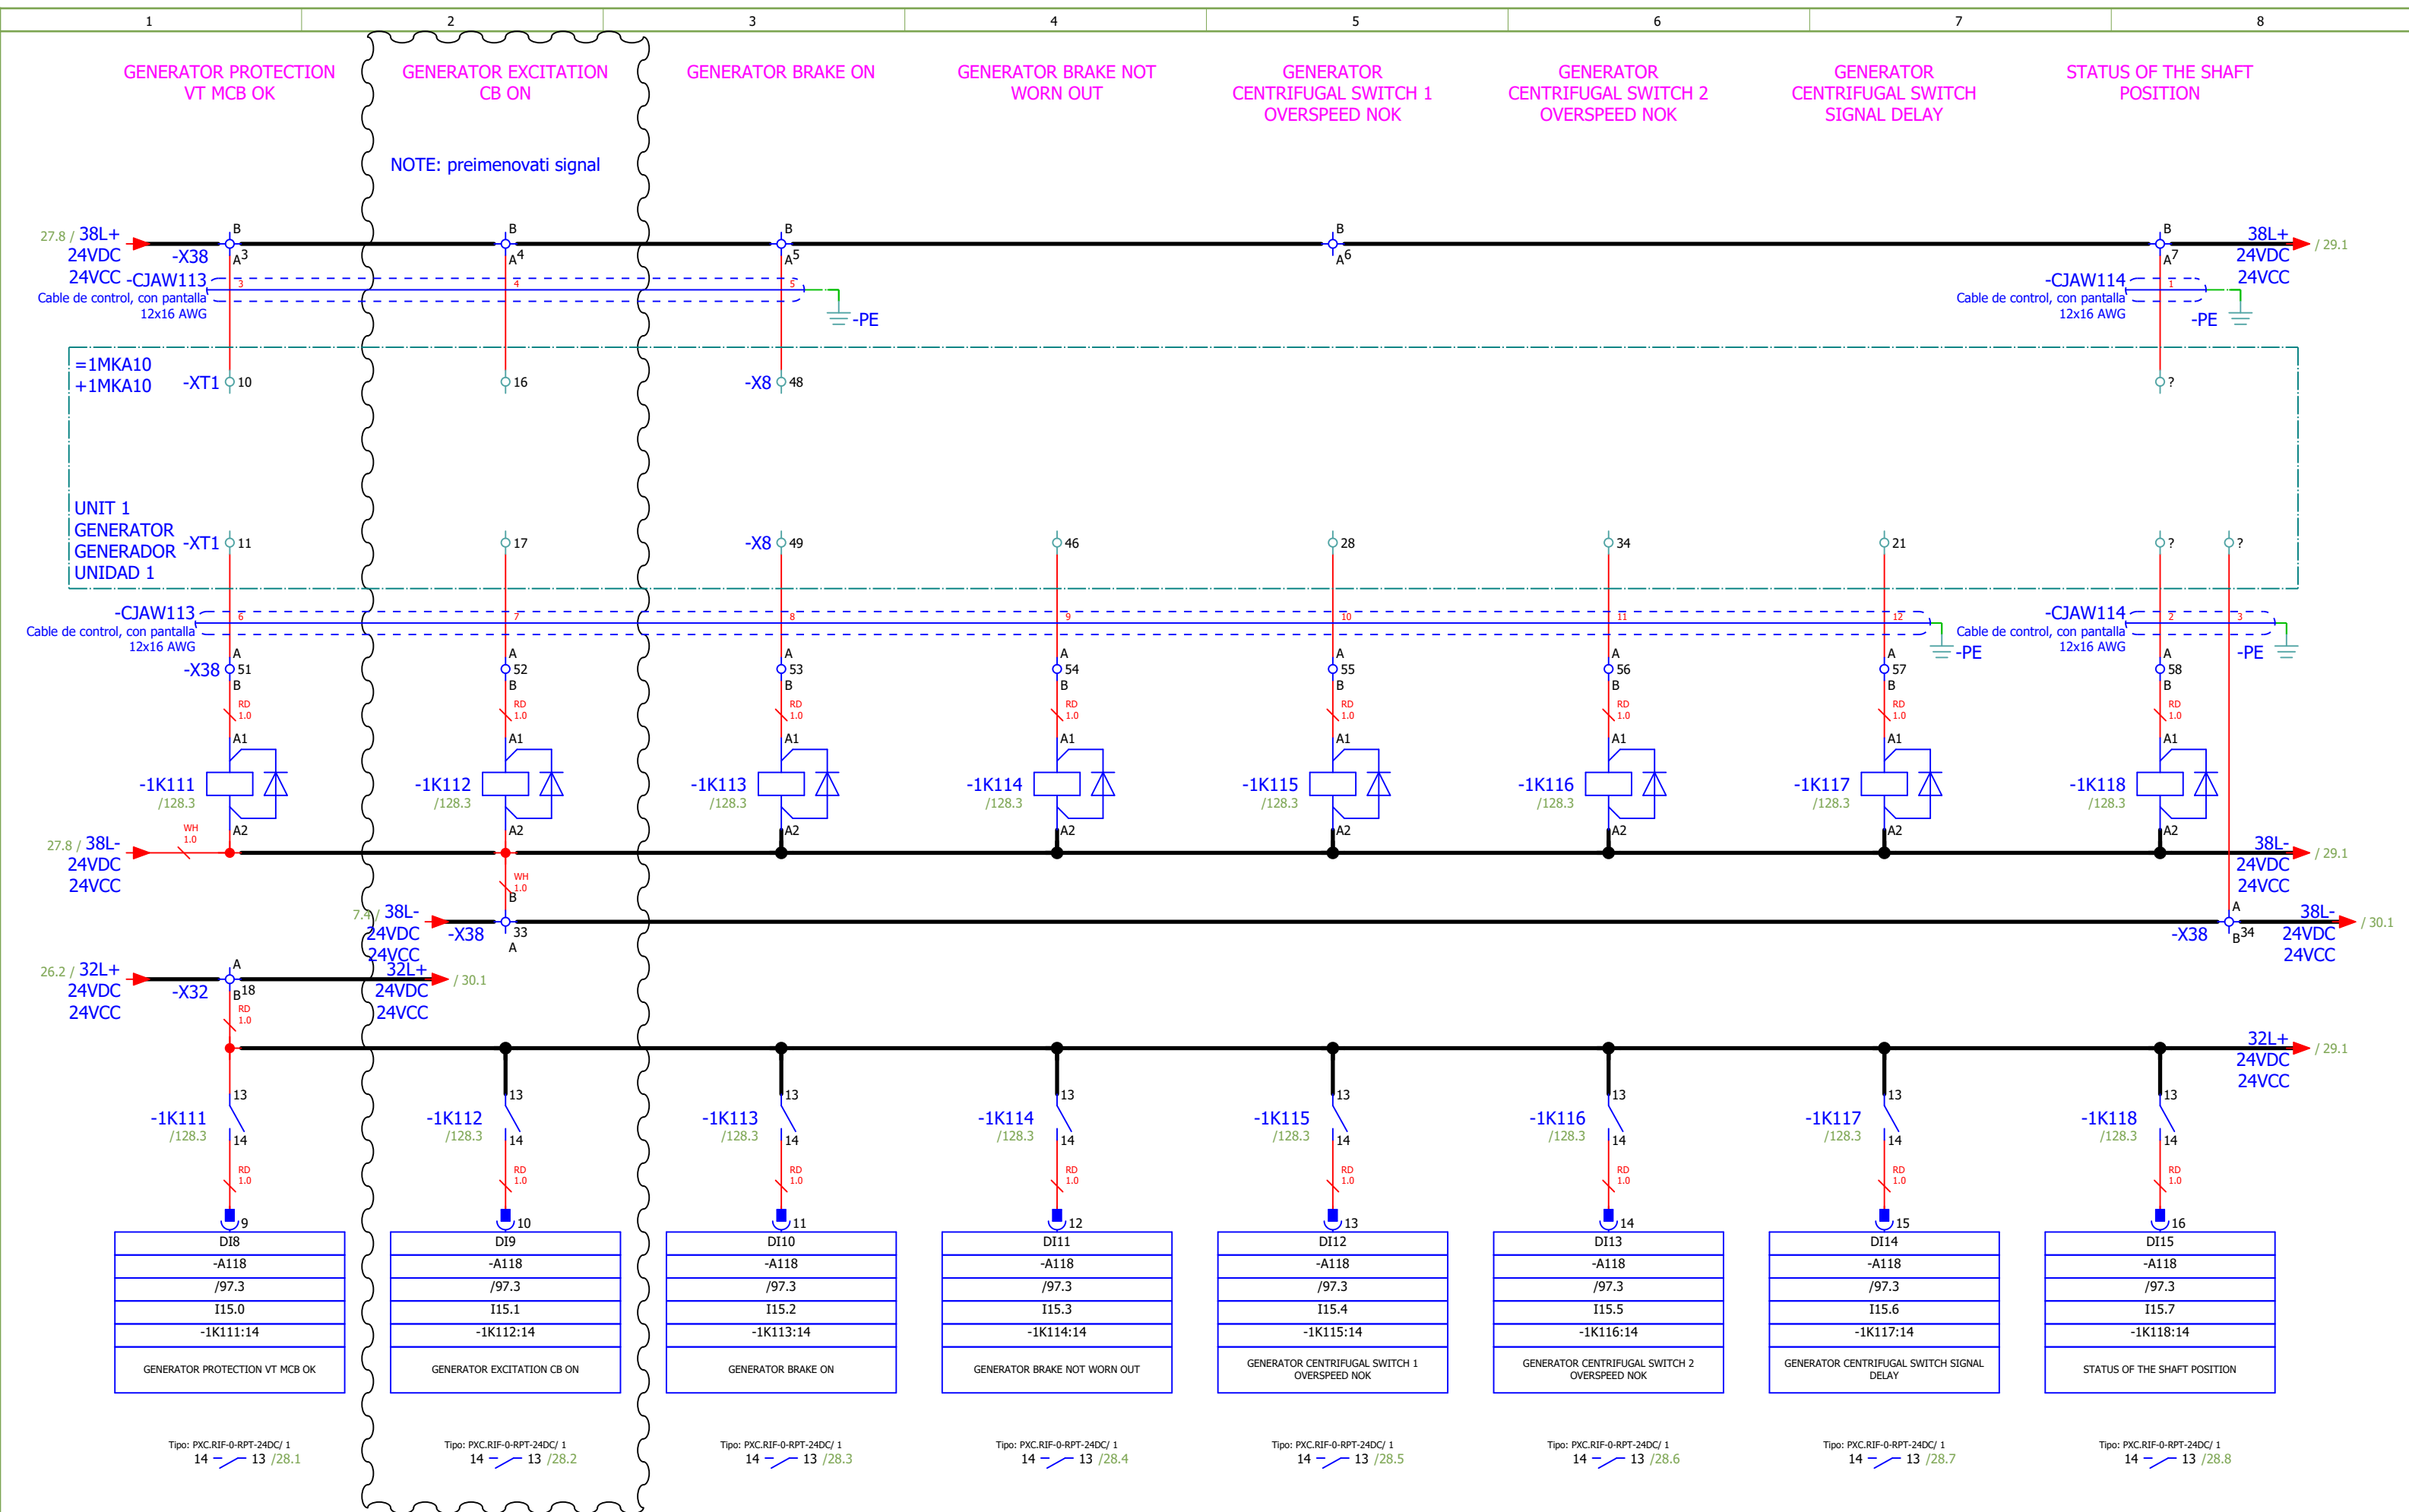

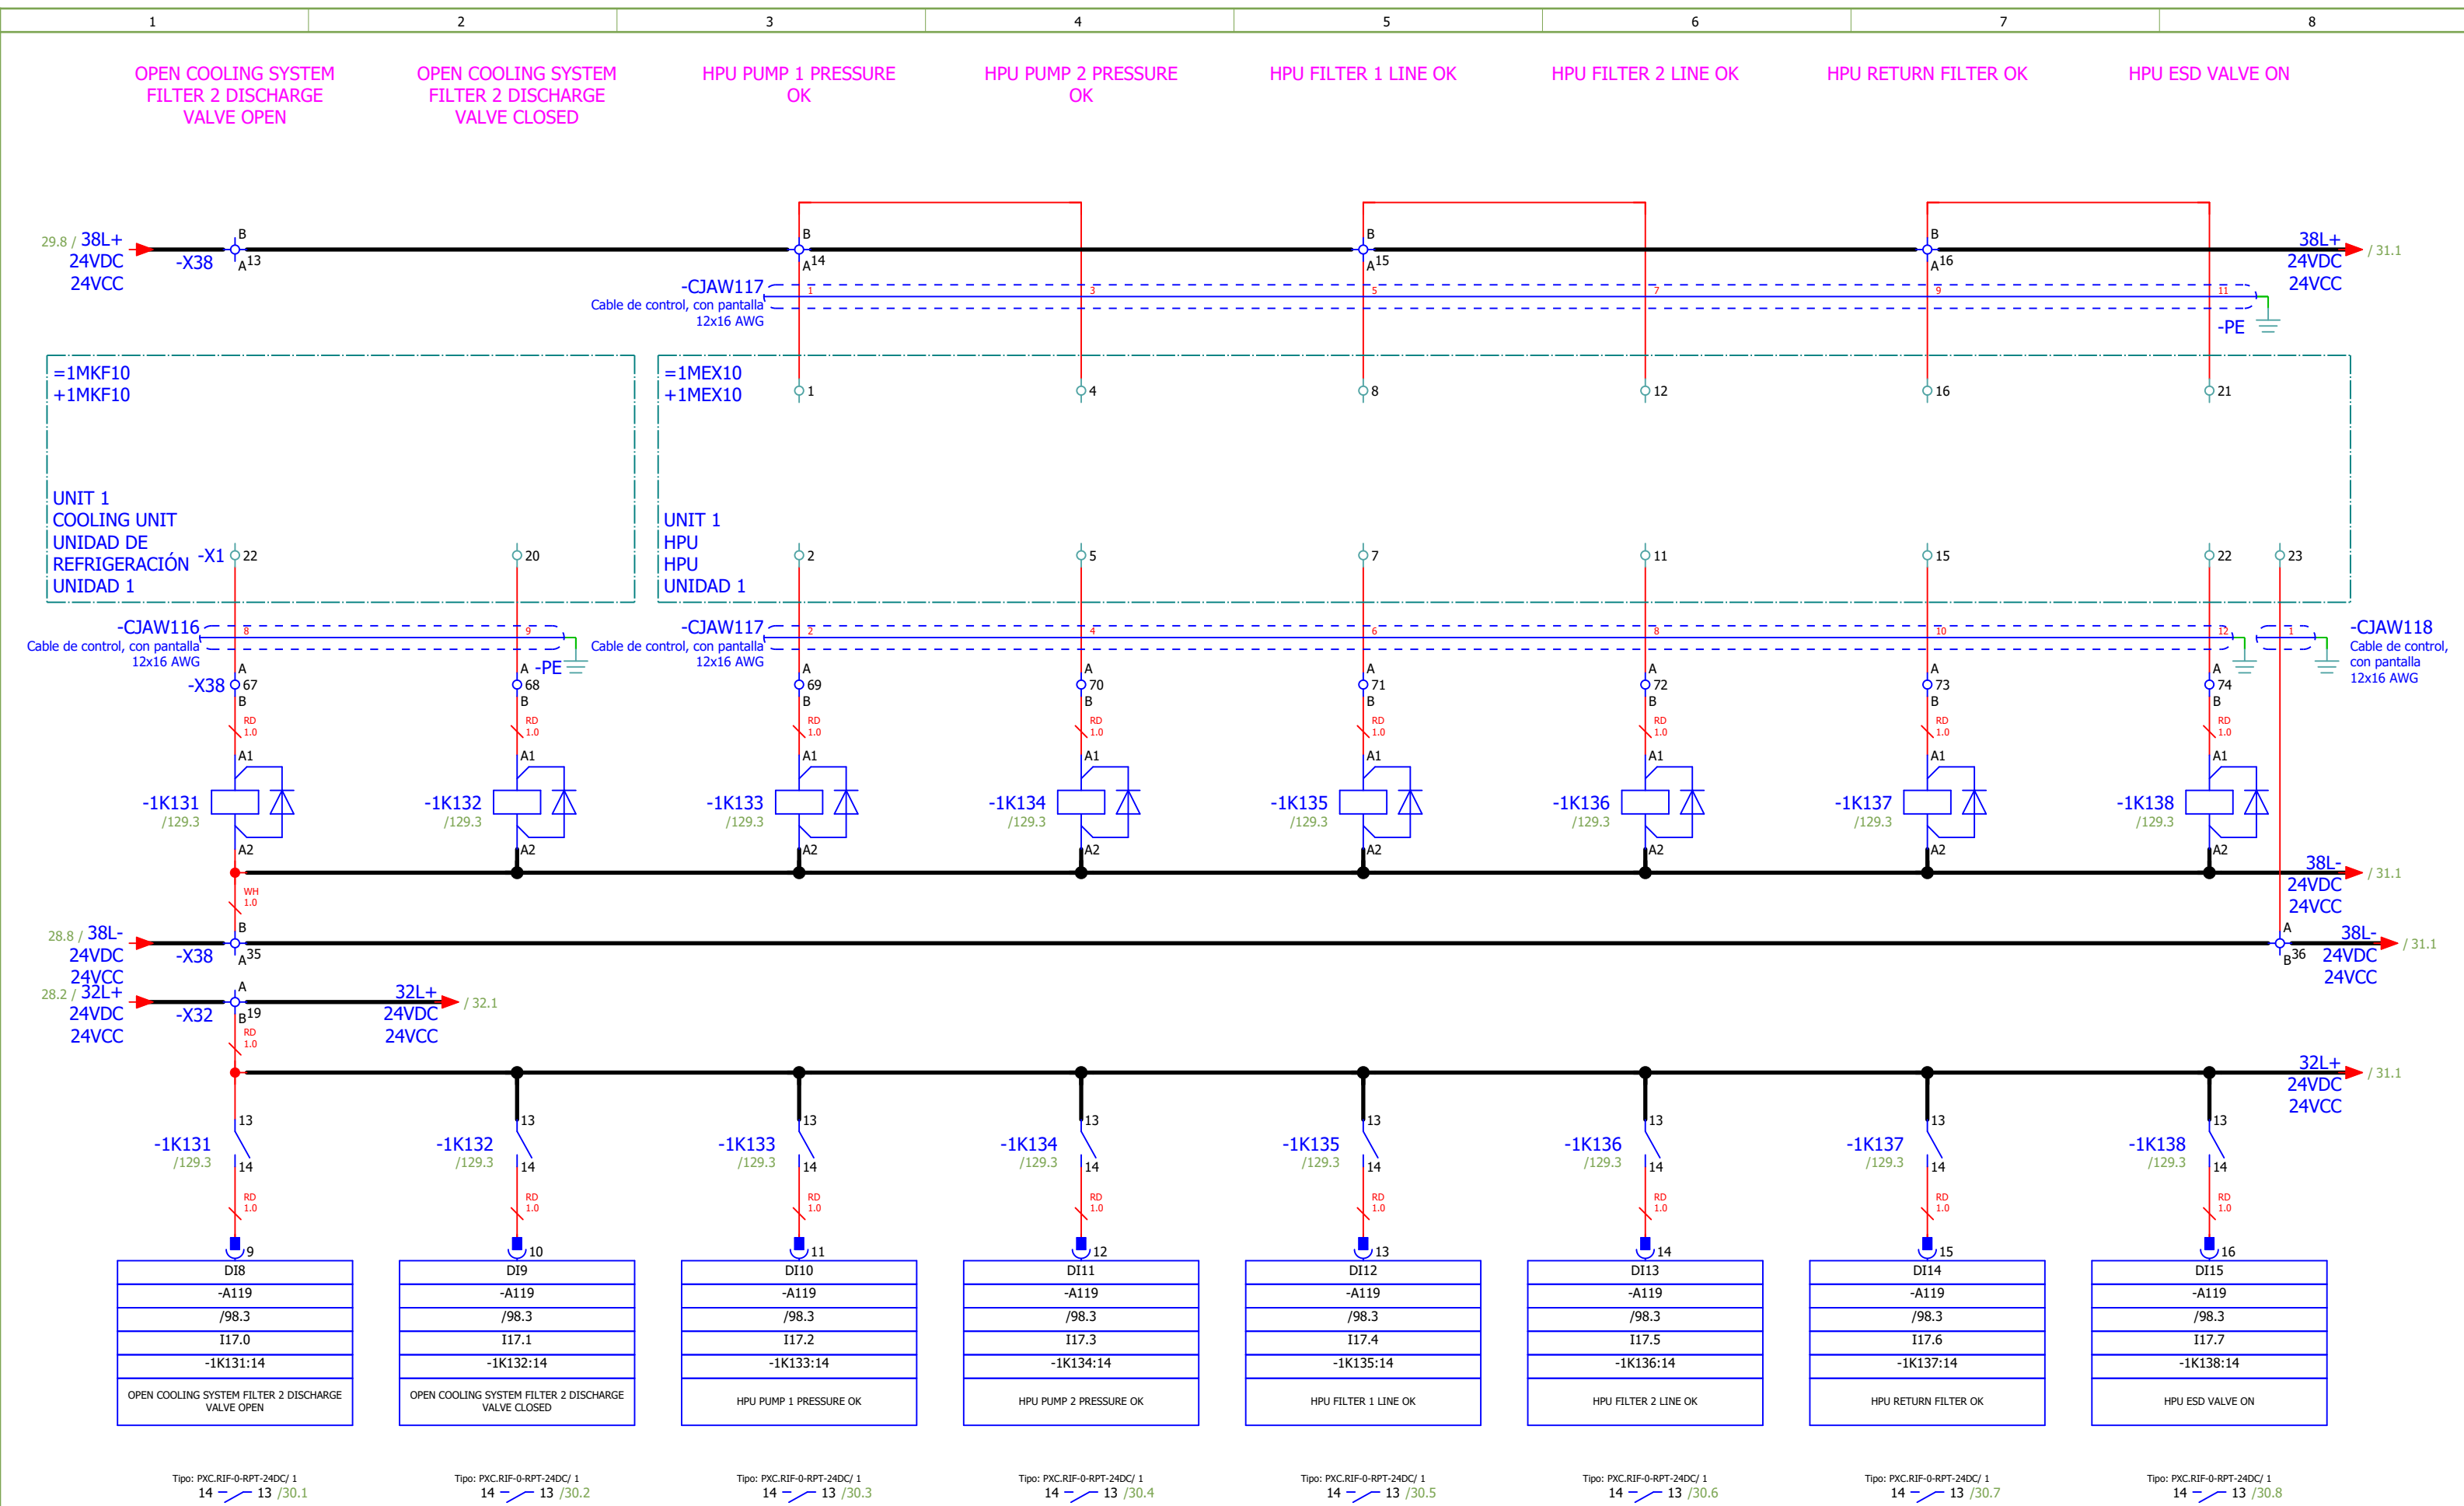

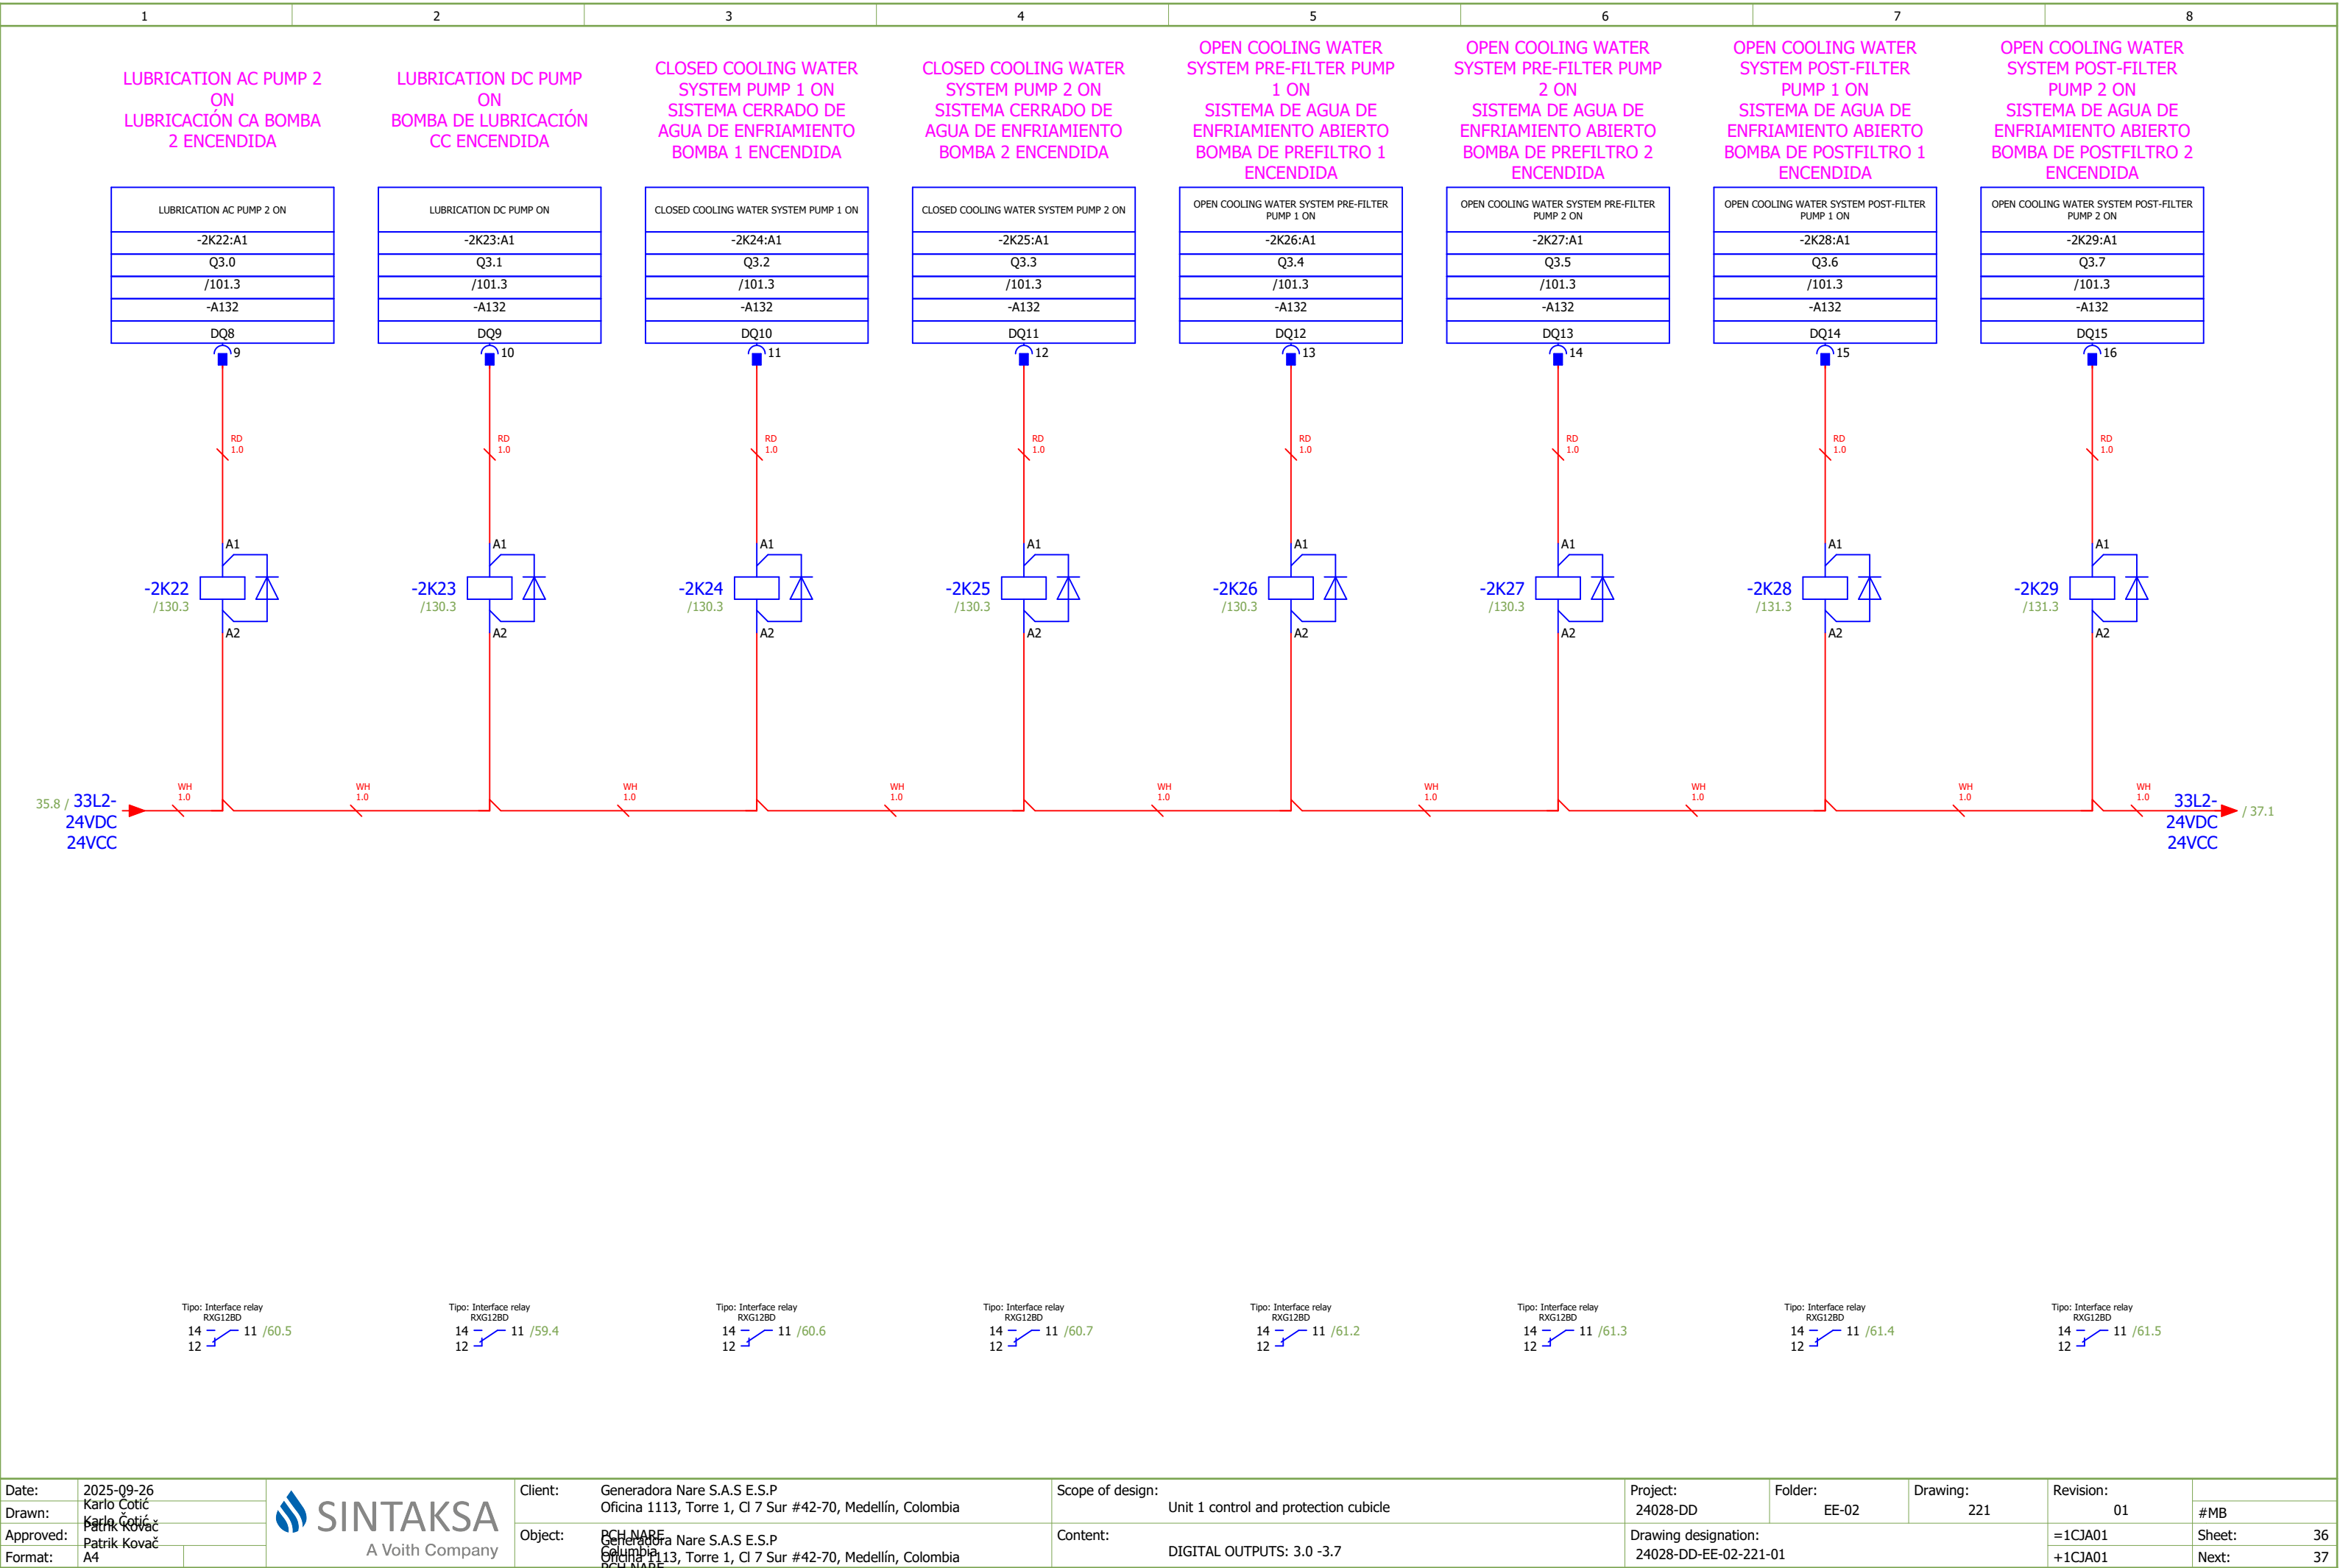

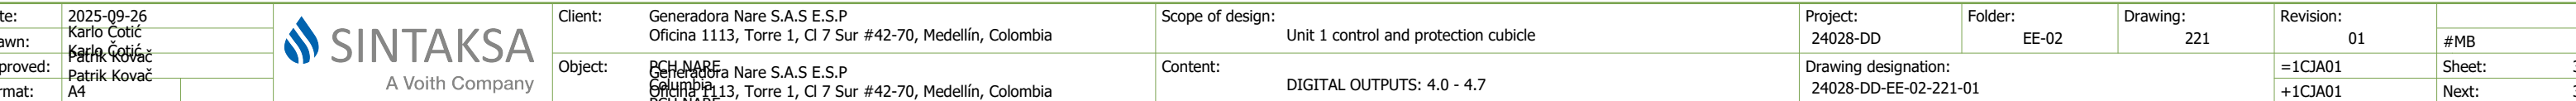

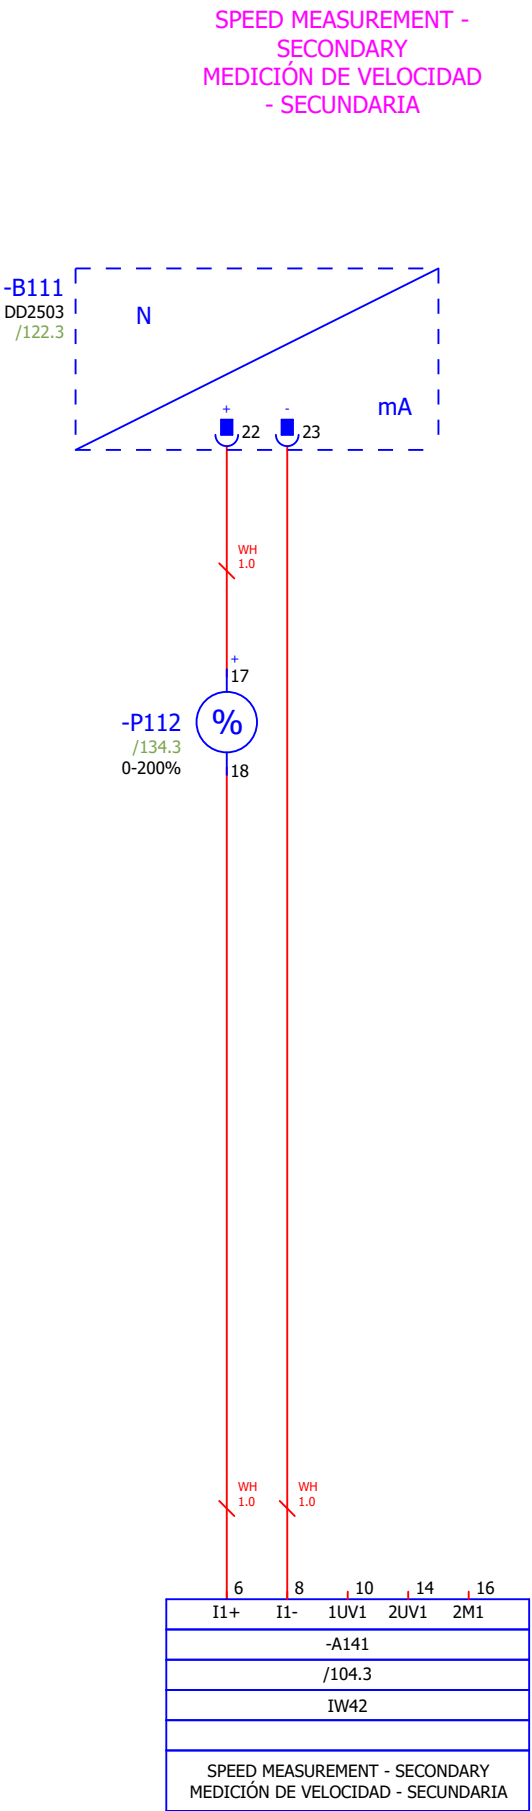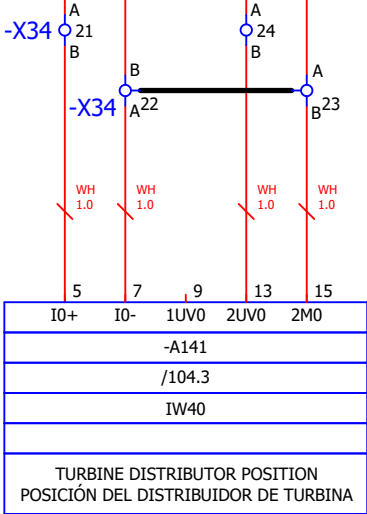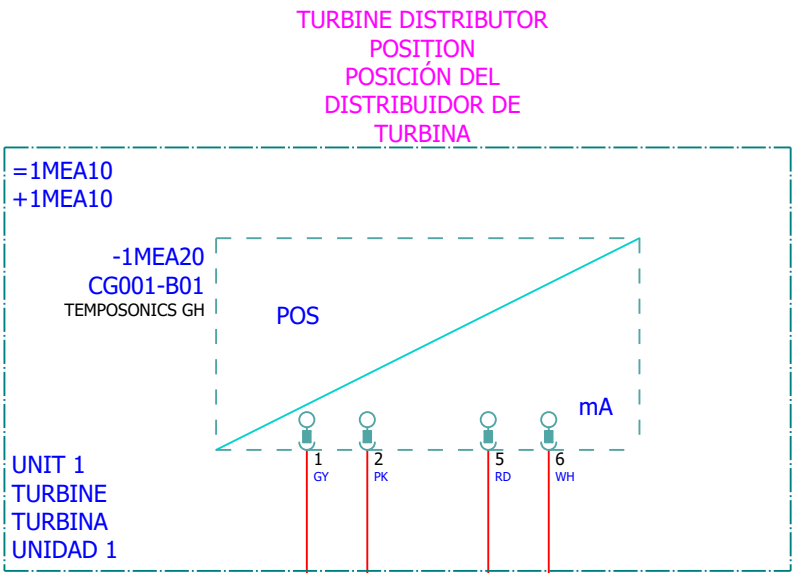


BEARING N.D.E. RADIAL
TEMPERATURE
TEMPERATURA DEL COJINETE

BEARING D.E. RADIAL
TEMPERATURE
TEMPERATURA DEL COJINETE

BEARING D.E. AXIAL
TEMPERATURE
TEMPERATURA DEL COJINETE


BEARING D.E. COUNTER-AXIAL
TEMPERATURE
TEMPERATURA DEL COJINETE

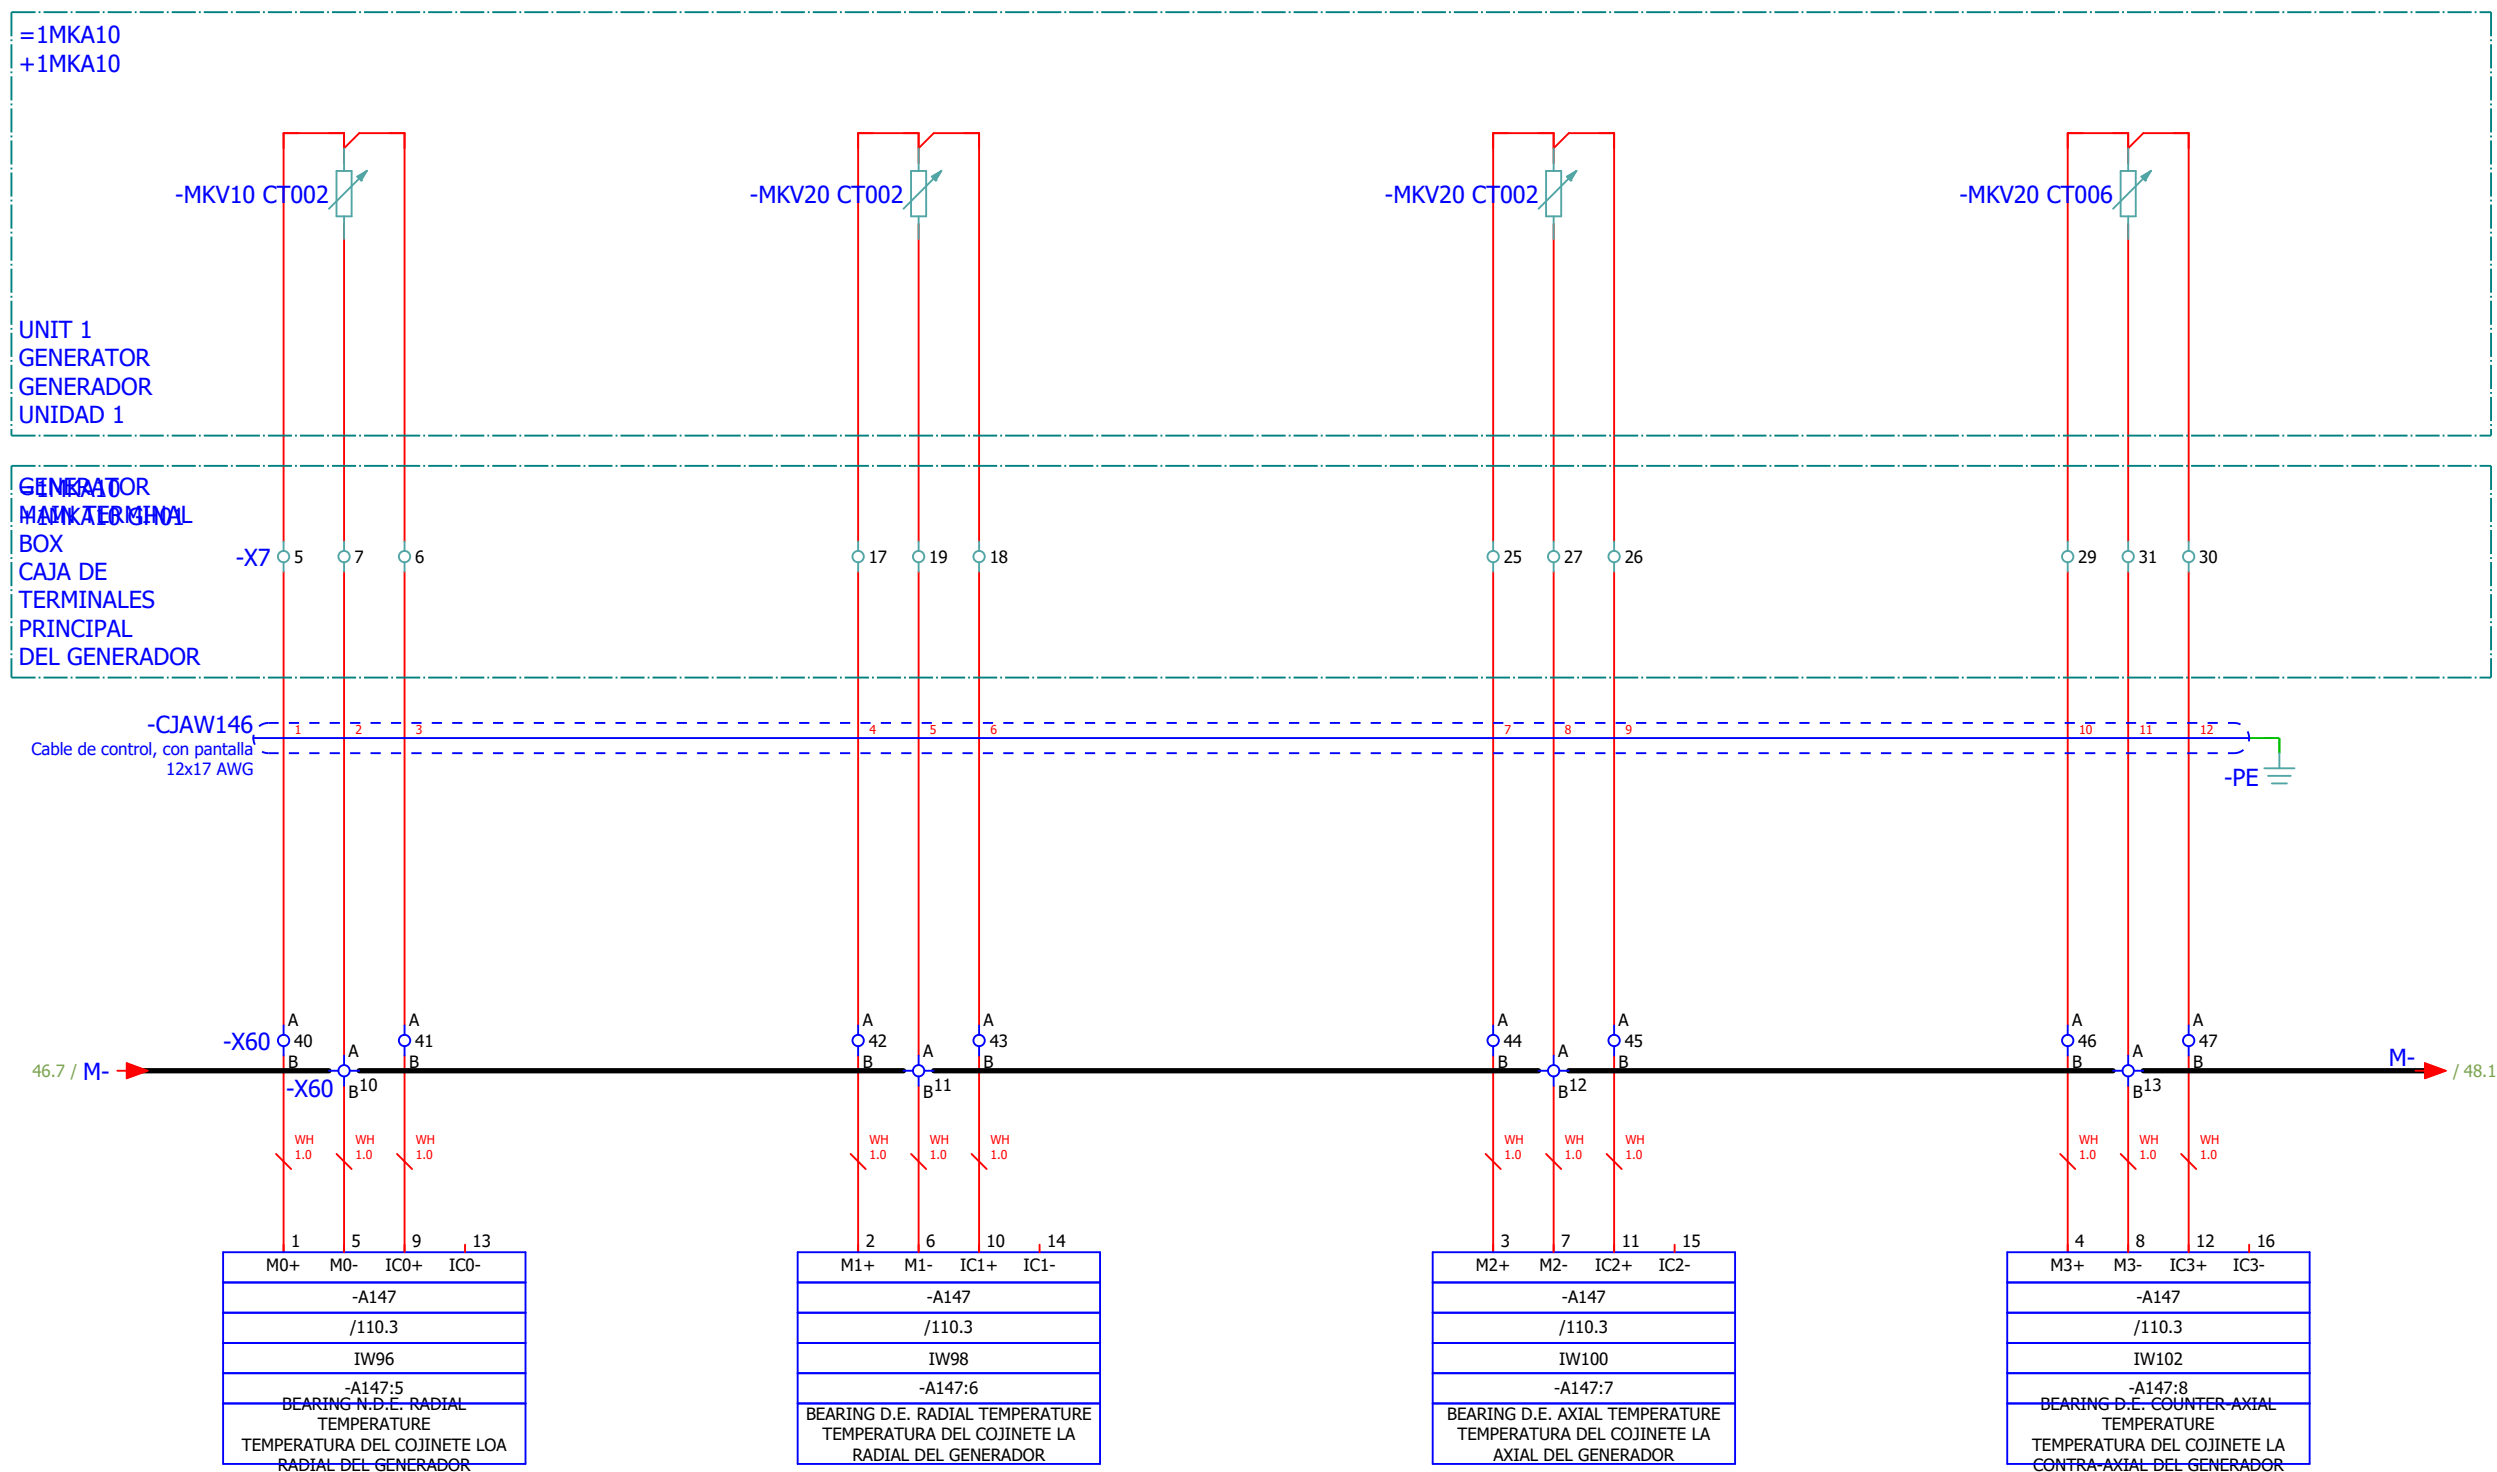

FIELD FLASHING INTERMITENTE DE CAMPO


FIELD OUTPUT
SALIDA CAMPO


AVR OUTPUT
SALIDA AVR

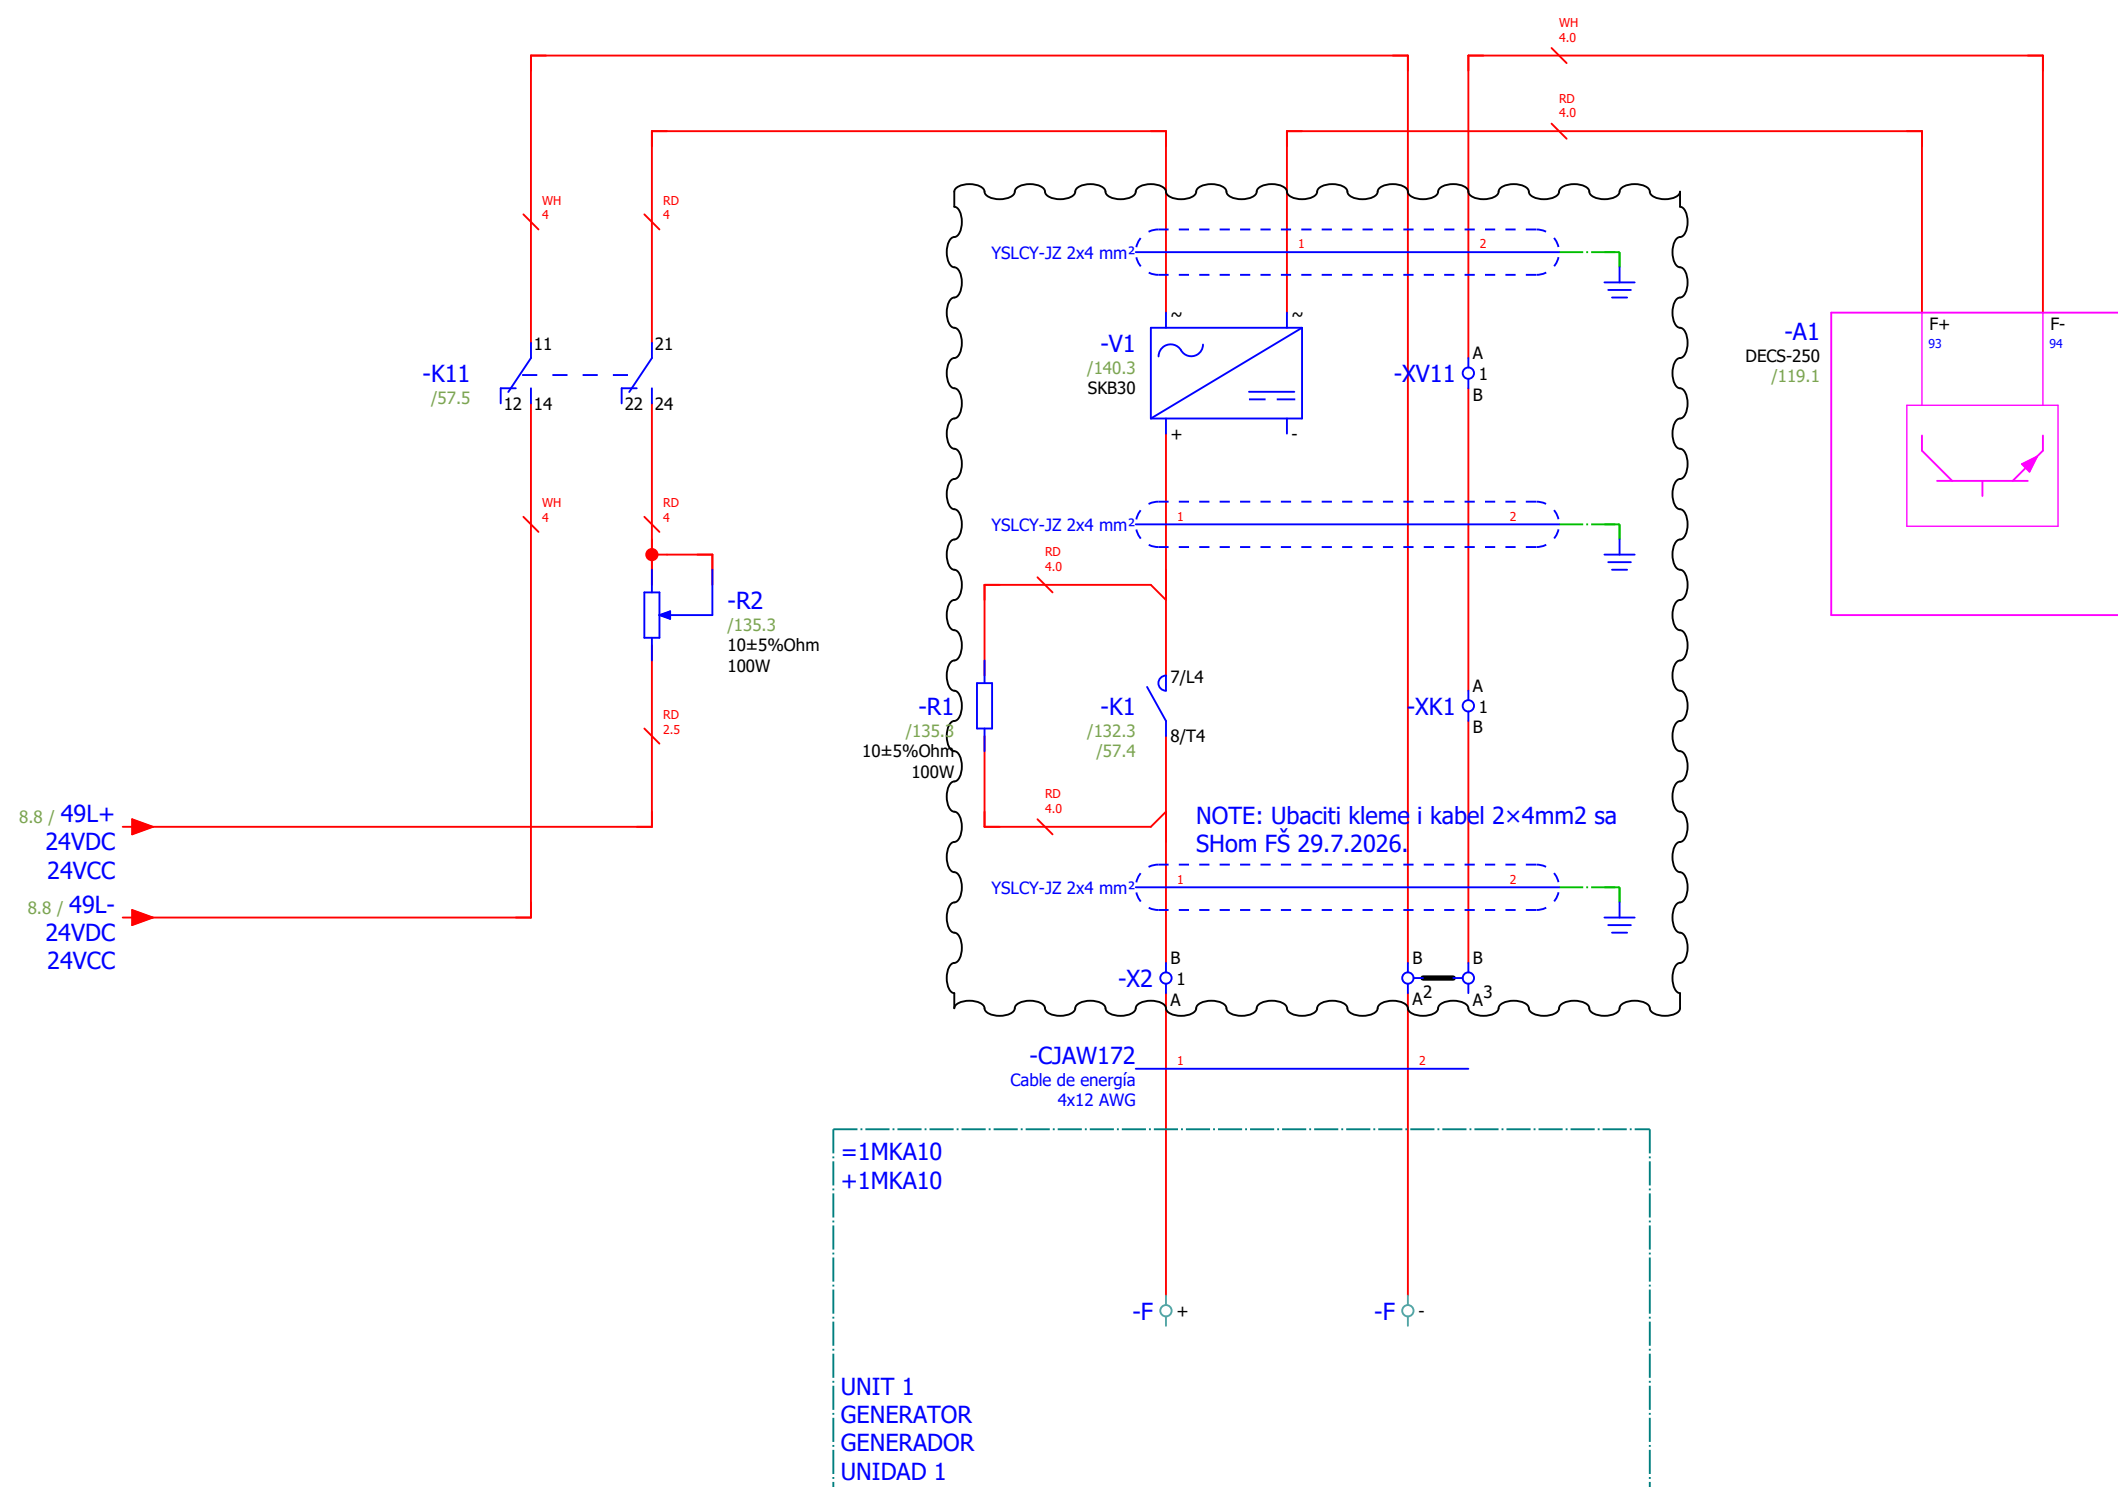


[illegible]

Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	
Drawn:	Karlo Čotić		Object:	BCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	EXCITATION CONTROL	Drawing designation:	24028-DD-EE-02-221-01			=1CJA01	Sheet:	57		
Approved:	Patrik Kovač						+1CJA01	Next:	58						
Format:	A4														

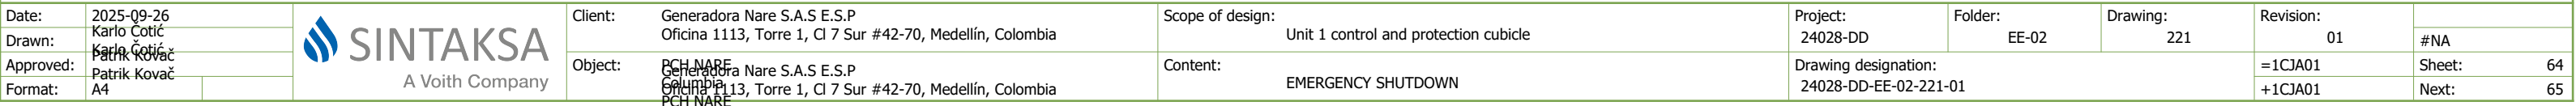



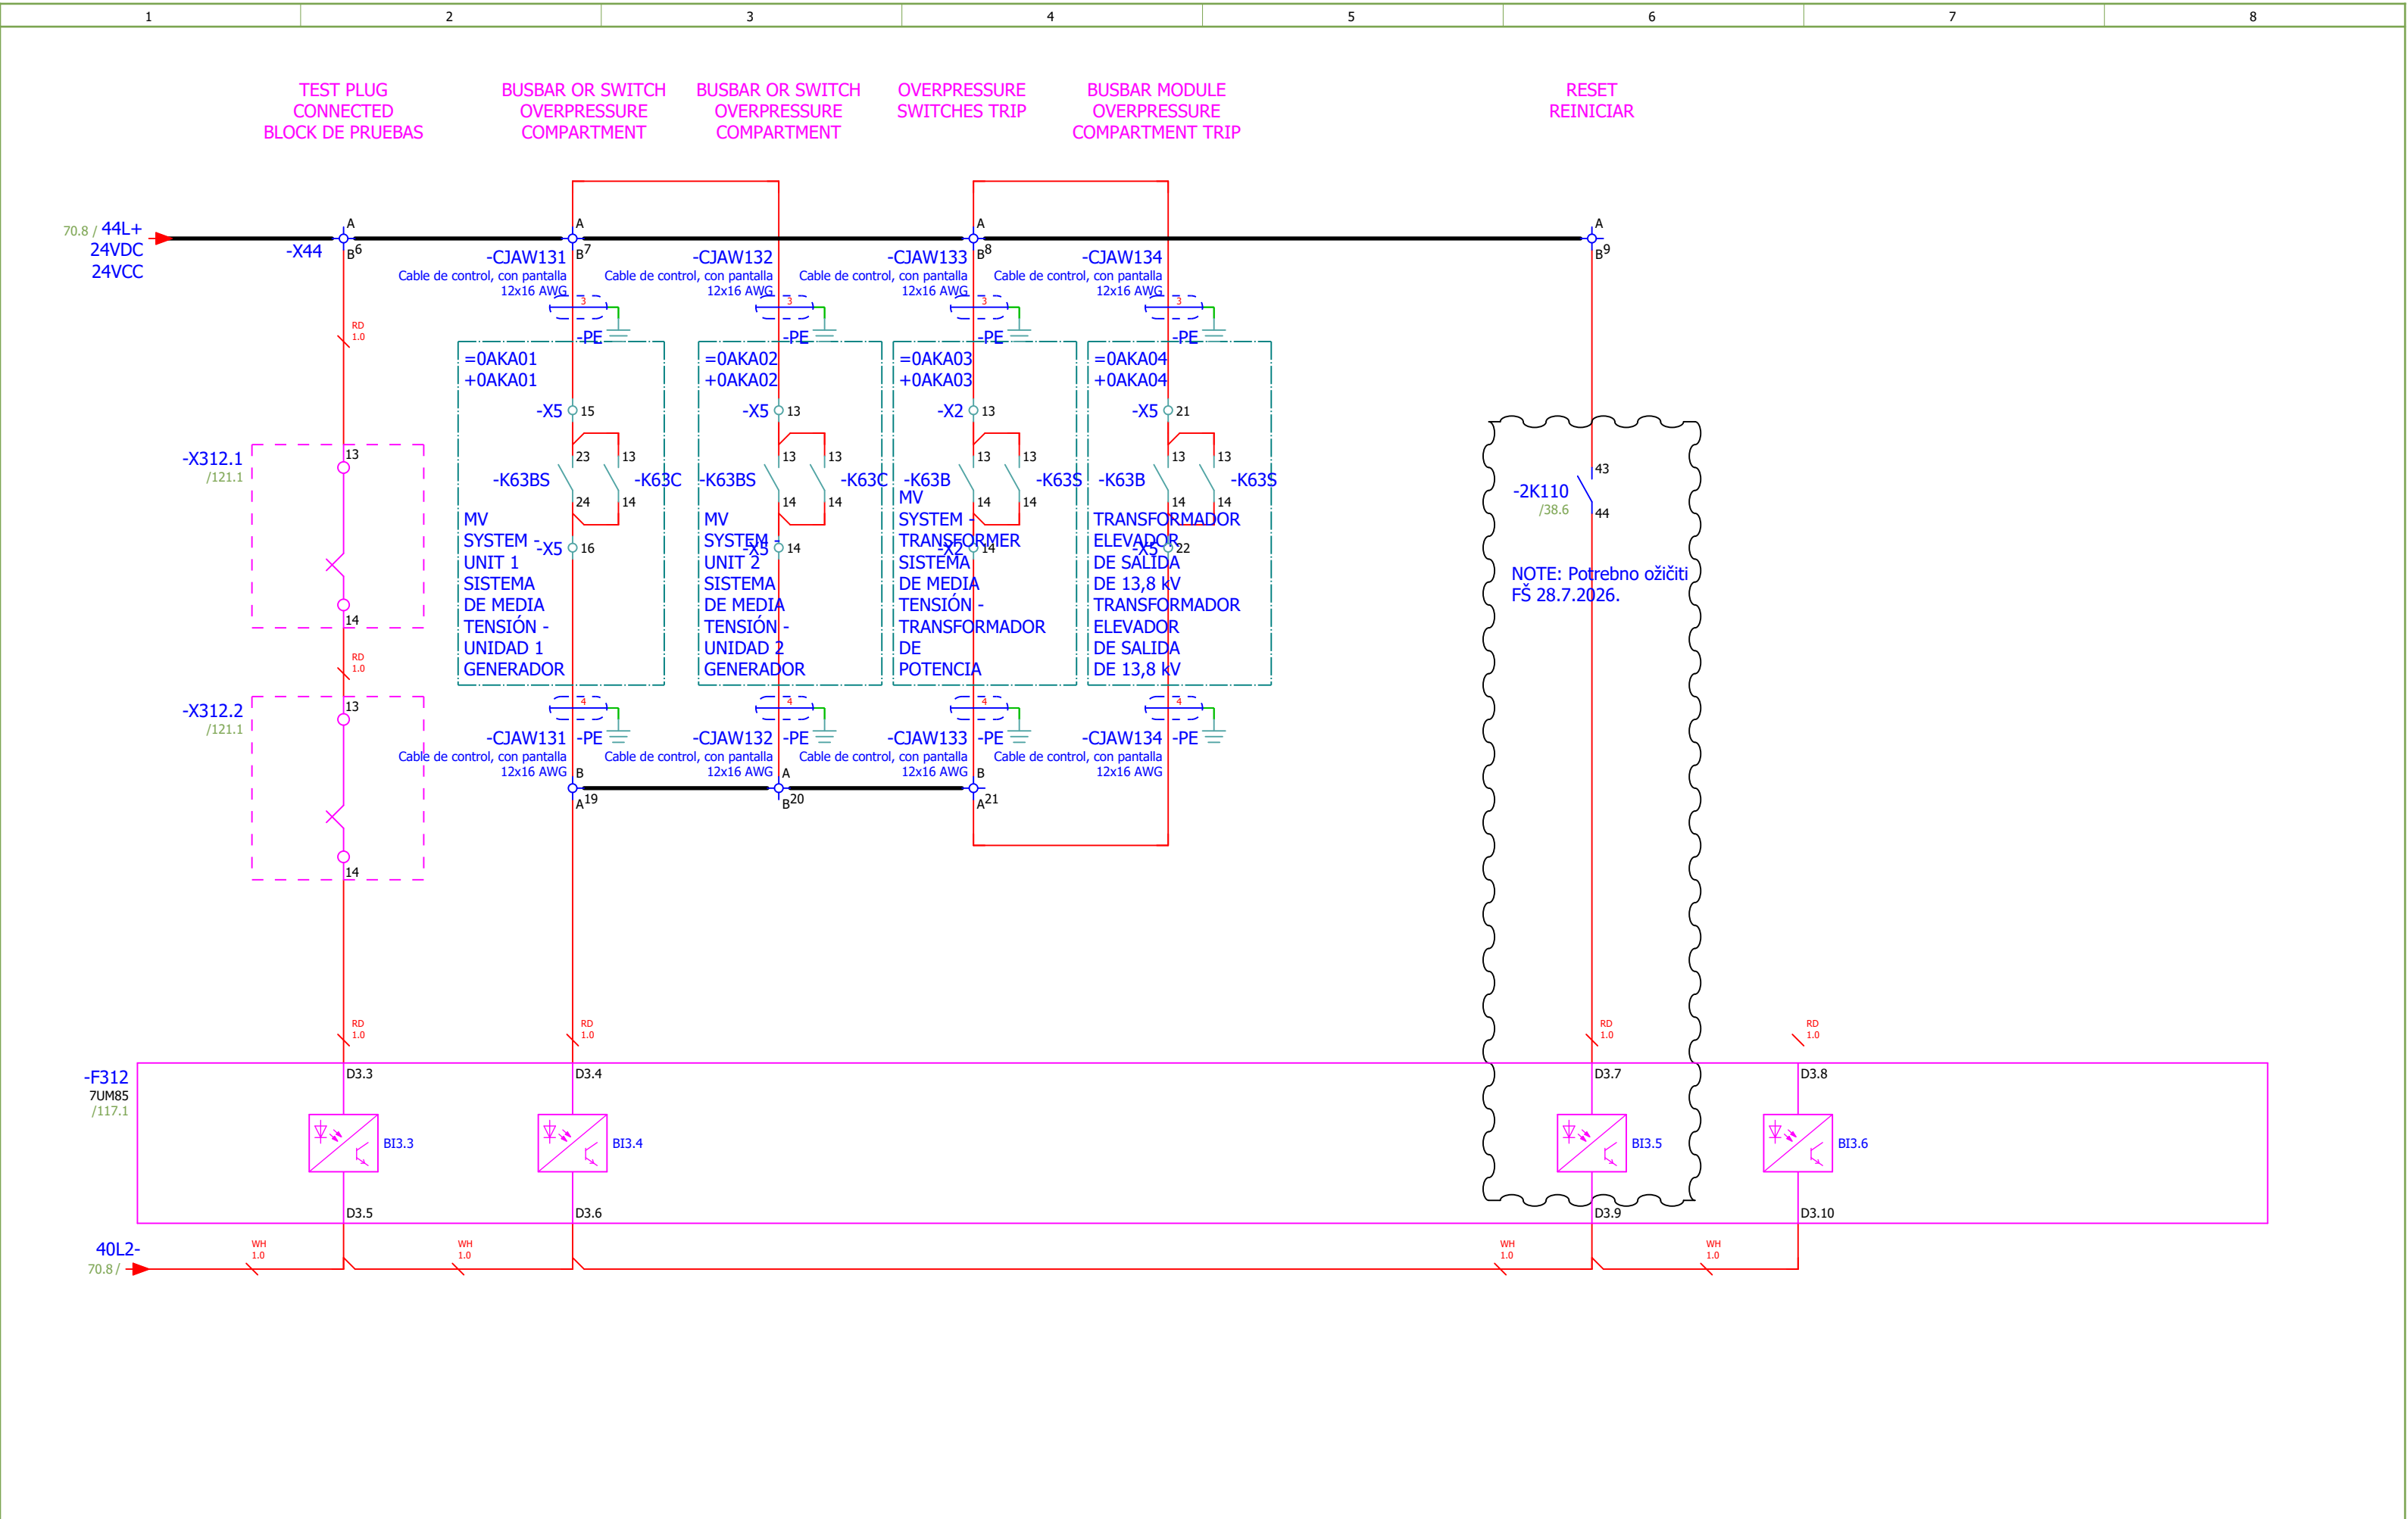


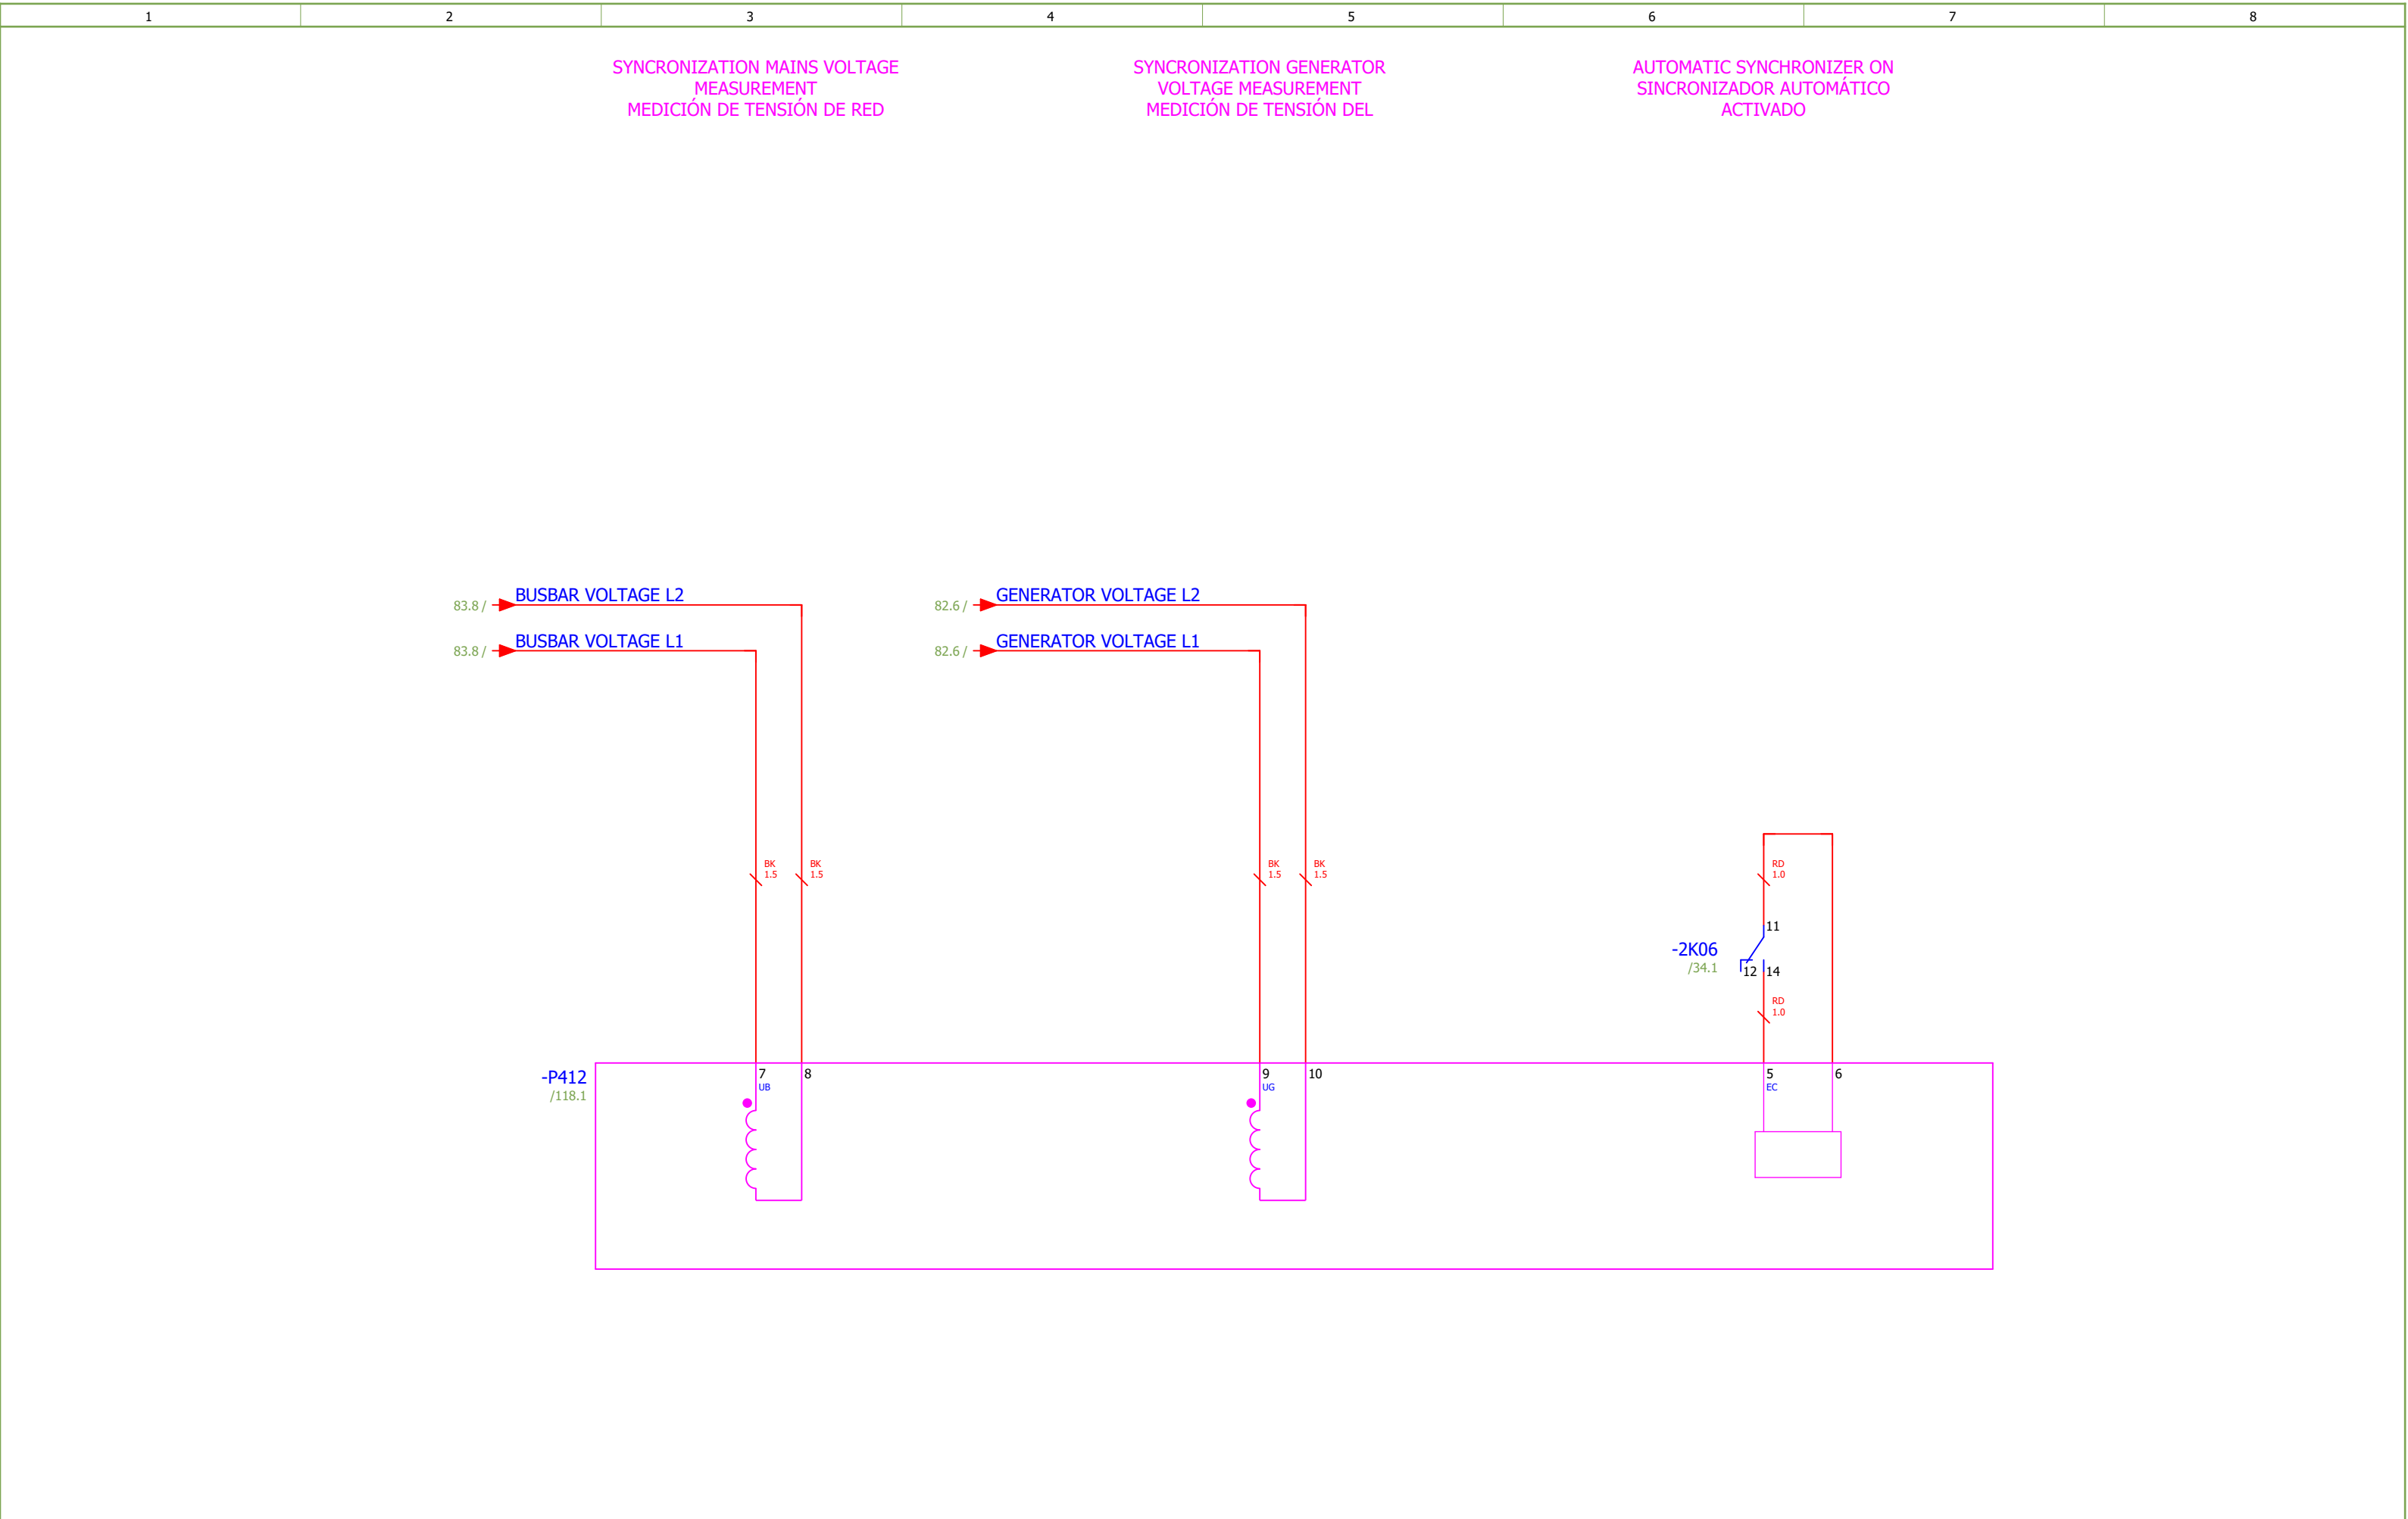


[illegible]

GENERATOR BACKUP PROTECTION
RELAY GENERATOR CURRENT
MEASUREMENT

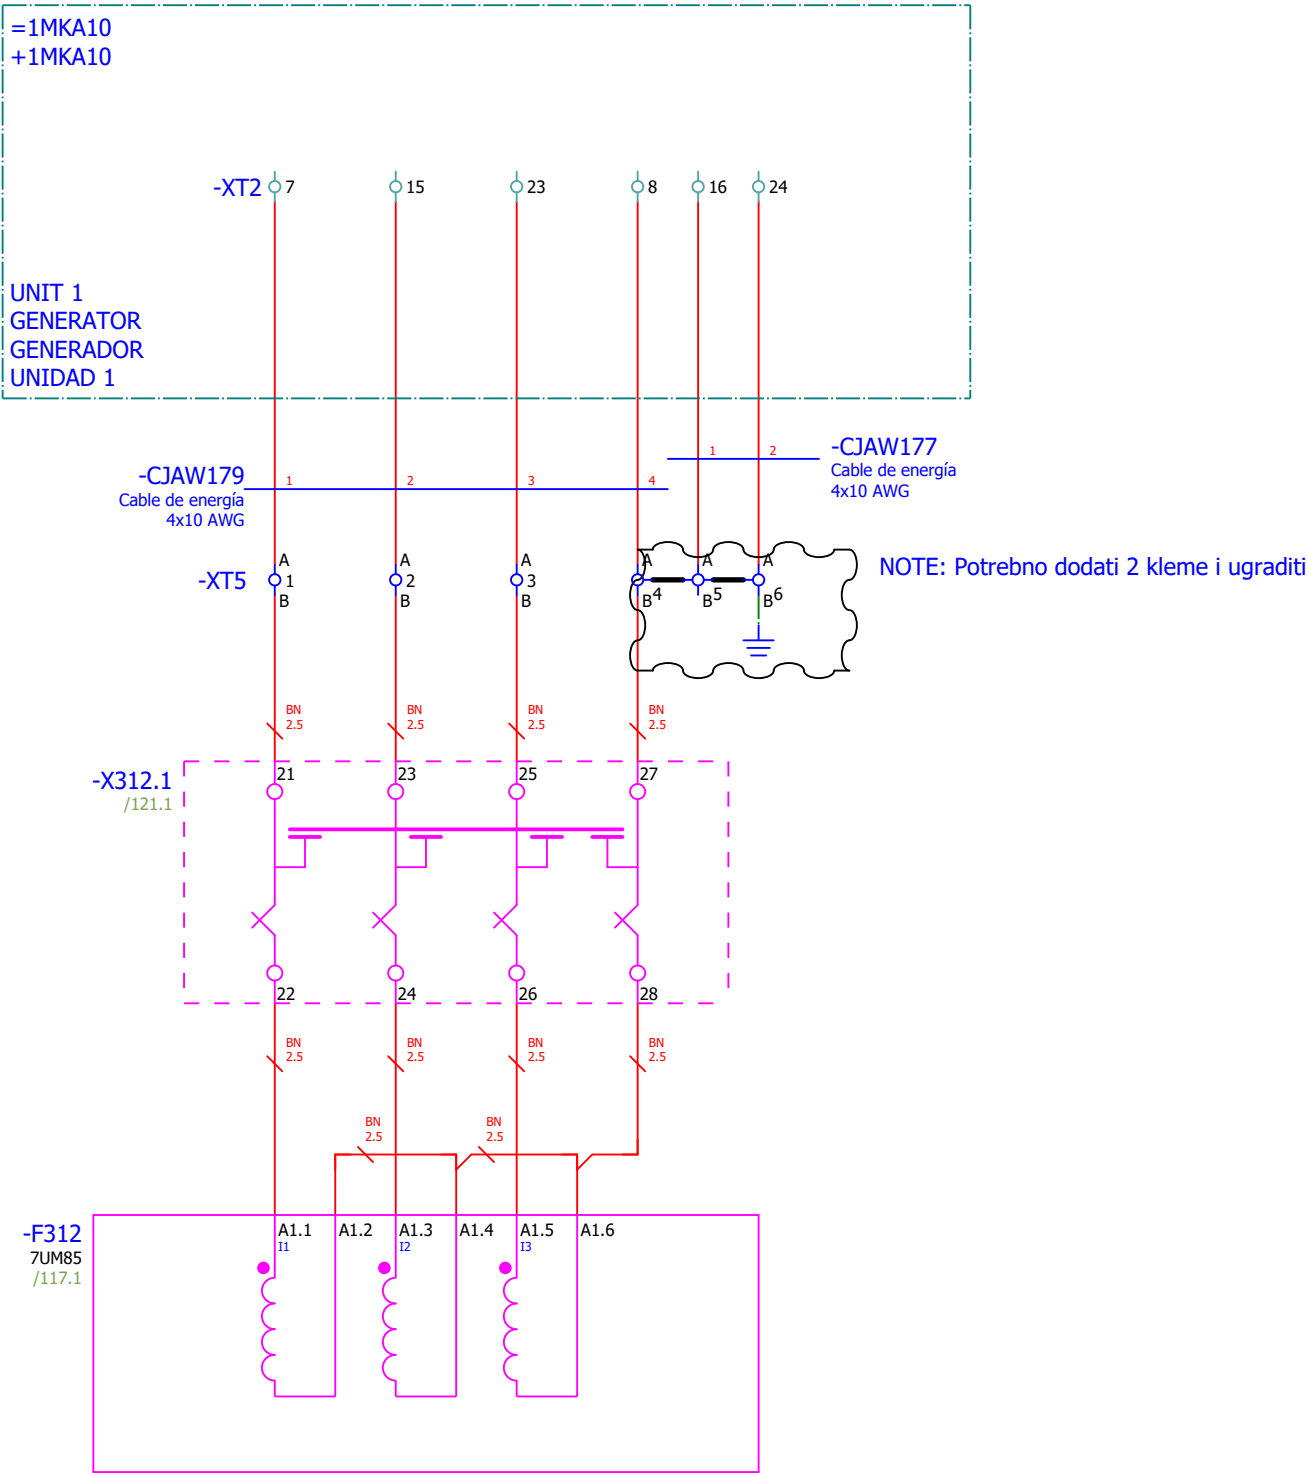

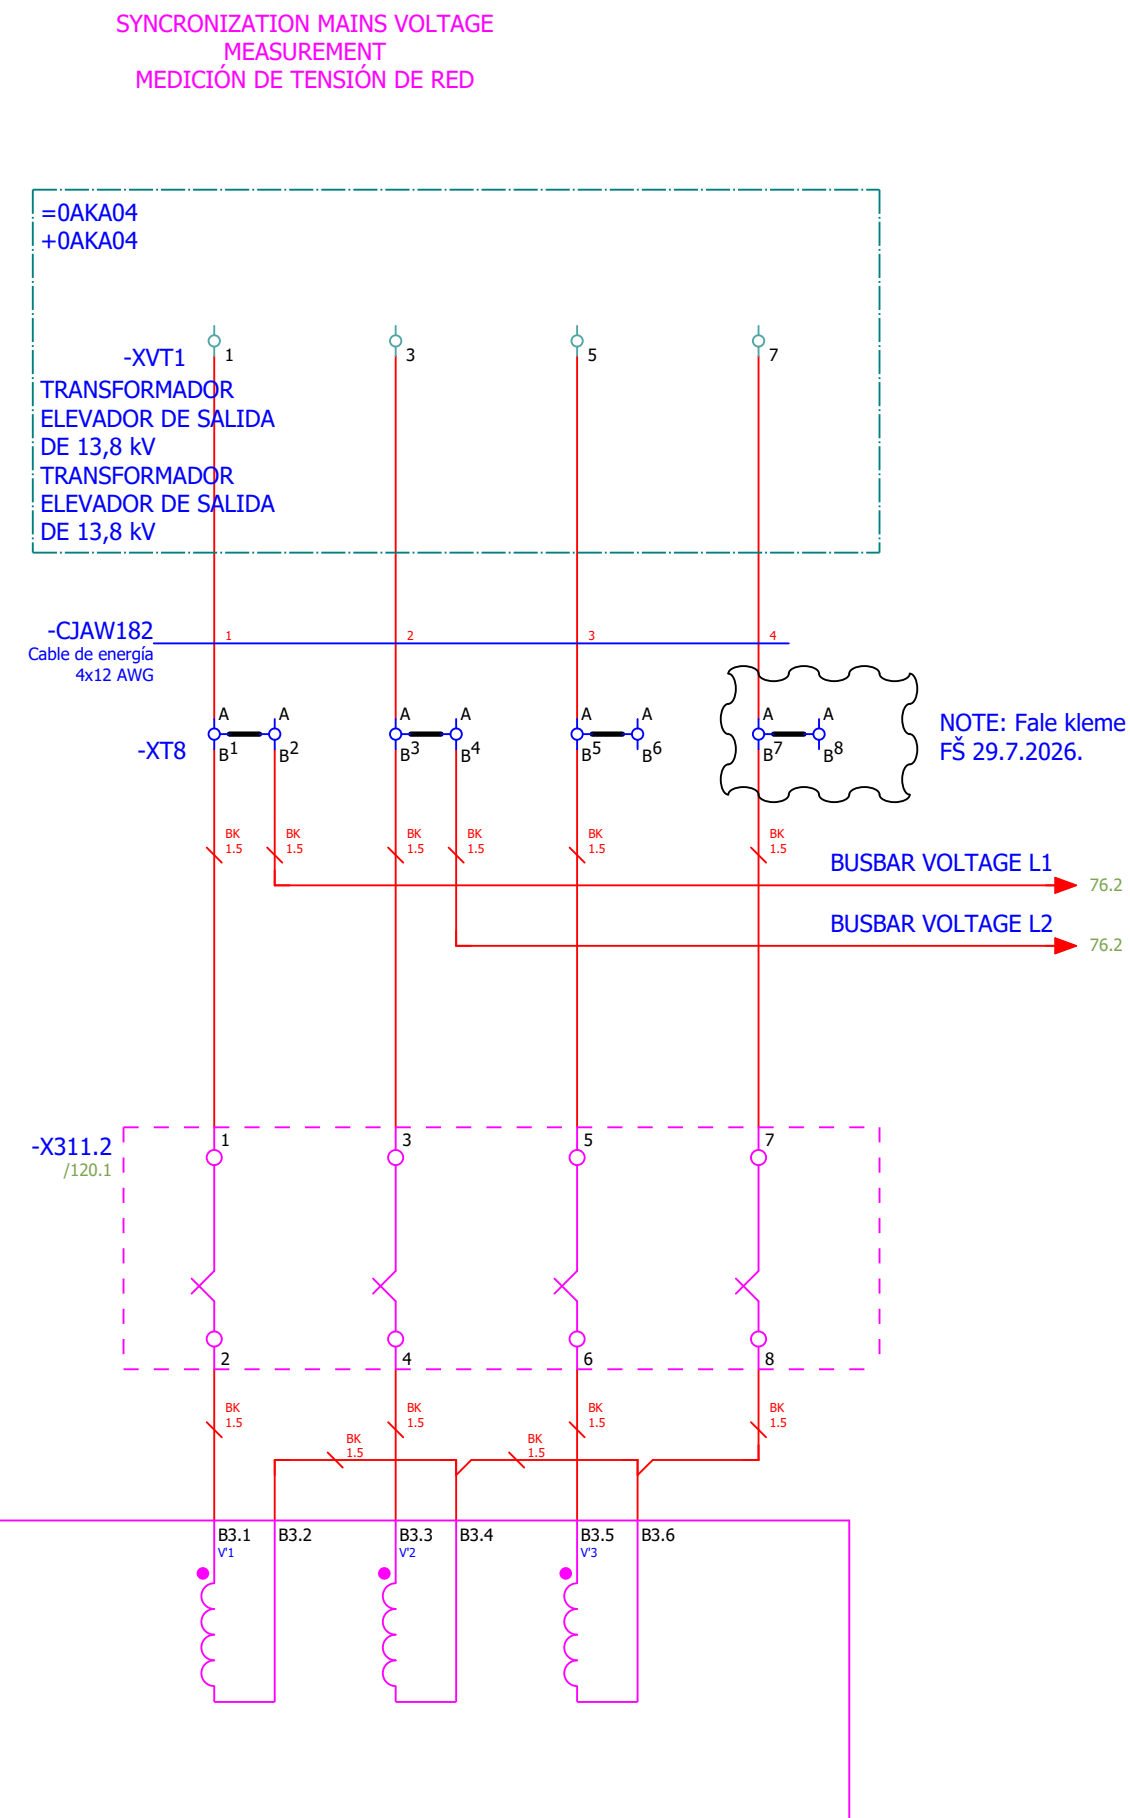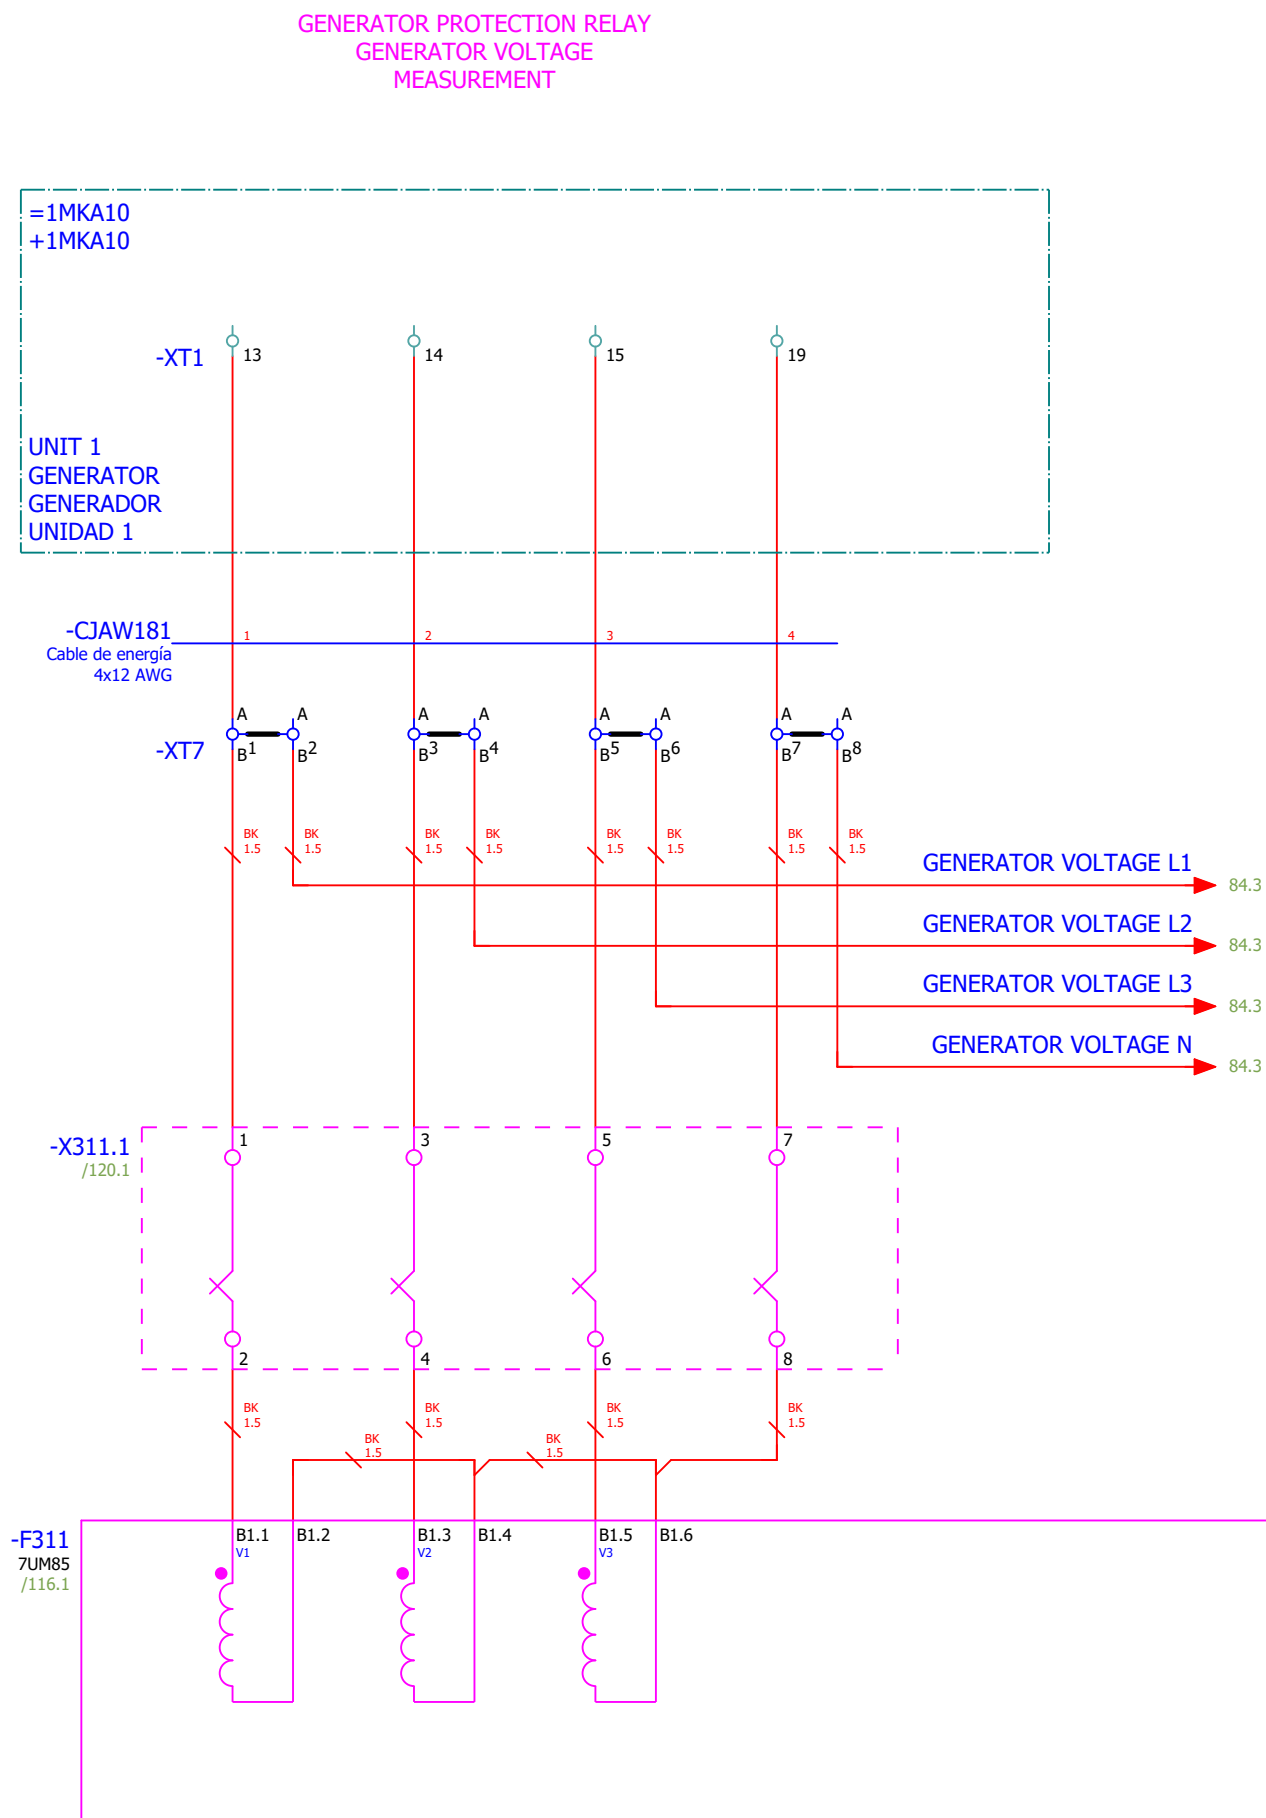

GENERATOR BACKUP PROTECTION
RELAY GENERATOR VOLTAGE
MEASUREMENT

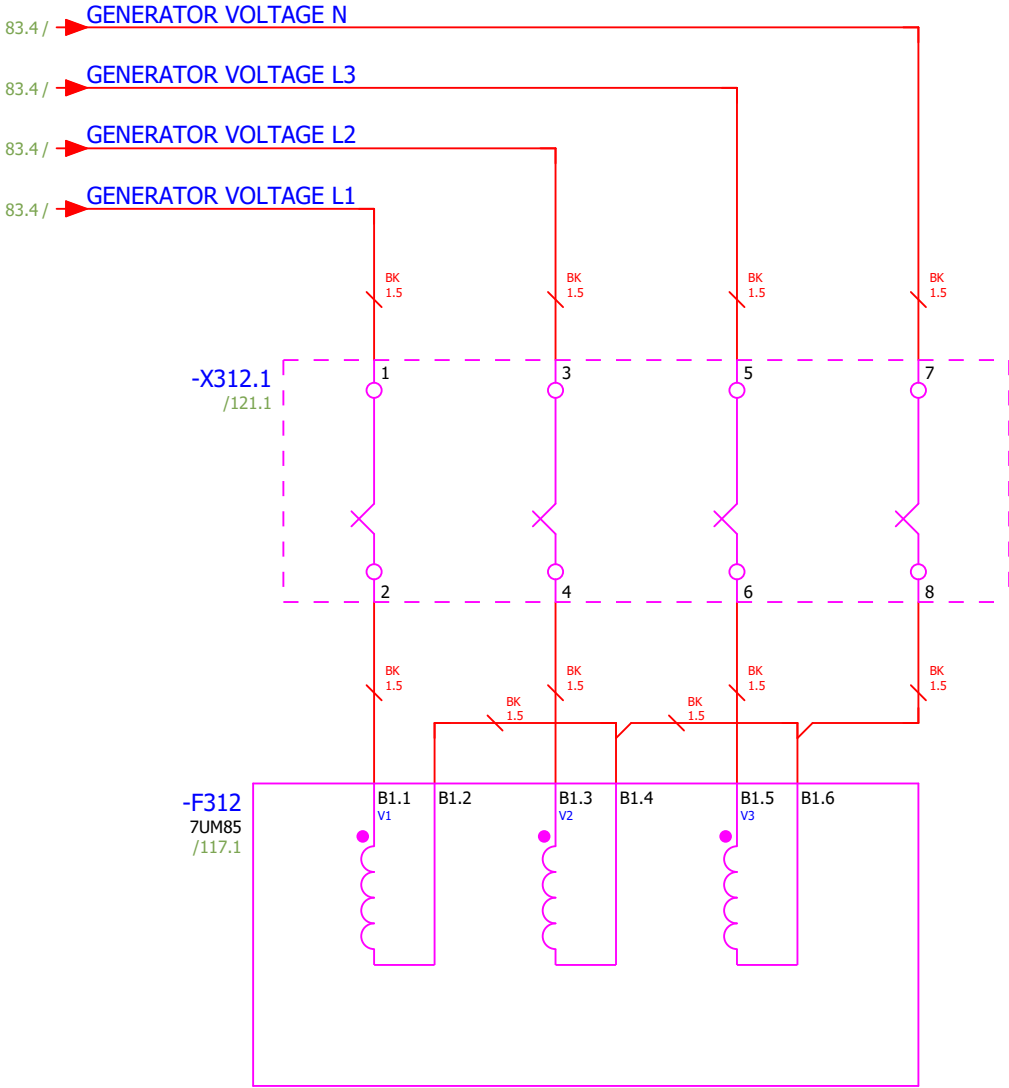


	1	2	3	4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)			
1 1	SIMATIC HMI MTP1900 Unified Comfort SIMATIC HMI MTP1900, Unified Comfort Panel, touch operation, 18.5" widescreen TFT display, 16 million colors, PROFINET interface, configurable as of WinCC Unified Comfort V16, contains open-source software, which is provided free of charge see enclosed DVD 6AV2128-3UB06-0AX1	Siemens	+1CJA01	-A100				

Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	HMI - TOUCH PANEL	Drawing designation:	24028-DD-EE-02-221-01				=1CJA01	Sheet:	87	
Approved:	Patrik Kovač											+1CJA01	Next:	88	
Format:	A4														


[illegible]

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description		Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)									
1 1	1 channel for 24V incremental encoder or pulse encoder Type: TM count 1x 24 V Counter module Order No.: 6ES7138-6AA01-0BA0		Siemens	+1CJA01	-A102										
	Baseunit Type A0, BU15-P16+A0+2D Unidad base Tipo A0, BU15-P16+A0+2D Número de pedido: 6ES7193-6BP00-0DA0														

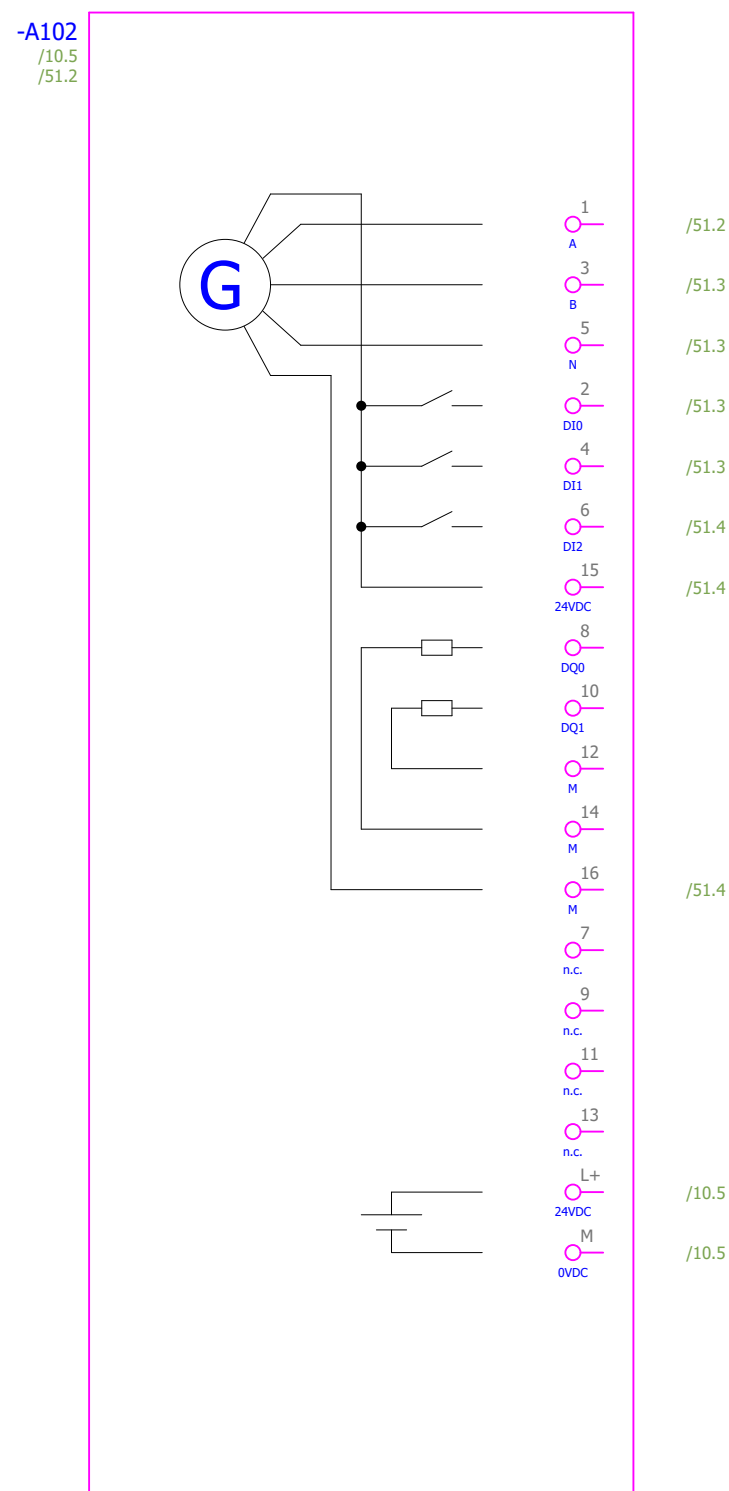


Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	#Z
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01				=1CJA01	Sheet:	89	
Approved:	Patric Kovač											+1CJA01	Next:	90	
Format:	A4														

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: DI 16X24V DC Standard Order No.: 6ES7131-6BH01-0BA0 Número de pedido: 6ES7131-6BH01-0BA0			Siemens	+1CJA01	-A111									
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7131-6BH01-0BA0														

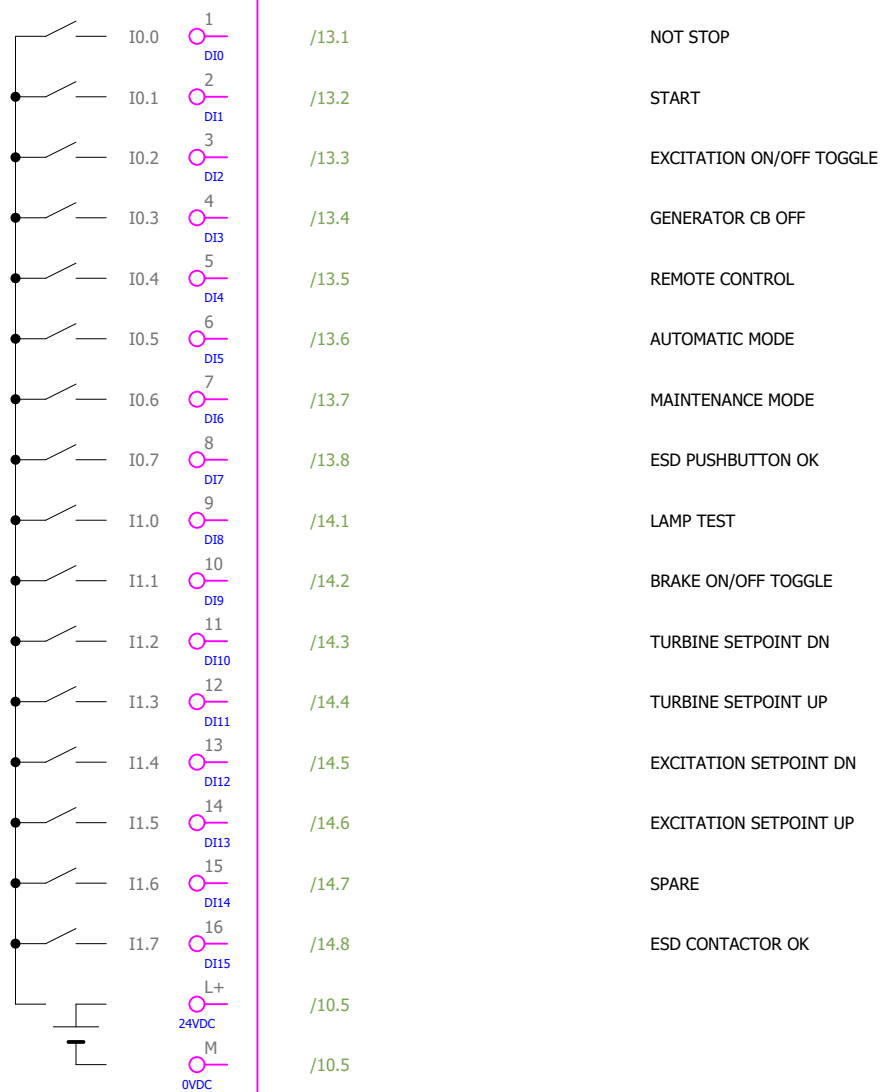

Date:	2025-09-26		Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01		
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01						=1CJA01	Sheet:	90
Approved:	Patrik Kovač													+1CJA01	Next:	91
Format:	A4															

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: DI 16X24V DC Standard Order No.: 6ES7131-6BH01-0BA0 Número de pedido: 6ES7131-6BH01-0BA0			Siemens	+1CJA01	-A114									
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7131-6BH01-0BA0														

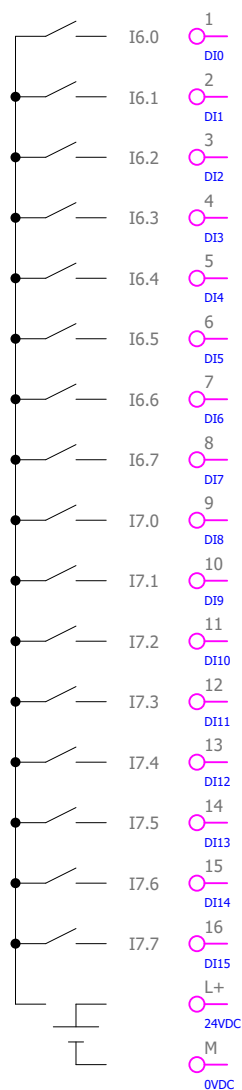

/19.1

/19.2

/19.3

/19.4

/19.5

/19.6

/19.7

/19.8

/20.1

/20.2

/20.3

/20.4

/20.5

/20.6

/20.7

/20.8

/10.7

/10.7

13,8 kV GENERATOR INCOMING EARTHING SWITCH ON

13,8 kV GENERATOR INCOMING EARTHING SWITCH OFF

13,8 kV GENERATOR INCOMING EARTHING SWITCH ON

13,8 kV GENERATOR INCOMING VOLTAGE PRESENT RELAY 1 OK

13,8 kV GENERATOR INCOMING VOLTAGE PRESENT RELAY 2 OK

13,8 kV GENERATOR INCOMING PRESS MODULE COMPARTMENT OK

13,8 kV GENERATOR INCOMING PRESS BUSBAR COMPARTMENT OK

13,8 kV GENERATOR INCOMING PRESS CABLE COMPARTMENT OK

GENERATOR NGR VT MCB OK

GENERATOR NGR MCB GROUP OK - ALARM

SPARE

UNIT MCC AC MAIN SUPPLY SWITCH CLOSED

UNIT MCC AC VOLTAGE OK

UNIT MCC VOLTAGE MEASUREMENT OK

UNIT MCC AC SURGE ARRESTER OK


HPU PUMP 1 RDY

Date:	2025-09-26		 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellin, Colombia		Scope of design:	Unit 1 control and protection cubicle		Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	#Z	
Drawn:	Karlo Cotic			Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellin, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01								=1CJA01	Sheet:	93
Approved:	Patrik Kovač																+1CJA01	Next:	94
Format:	A4																		




1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: DI 16X24V DC Standard Order No.: 6ES7131-6BH01-0BA0 Número de pedido: 6ES7131-6BH01-0BA0			Siemens	+1CJA01	-A115									
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7193-6BP00-0BA0														

-A115
/10.7

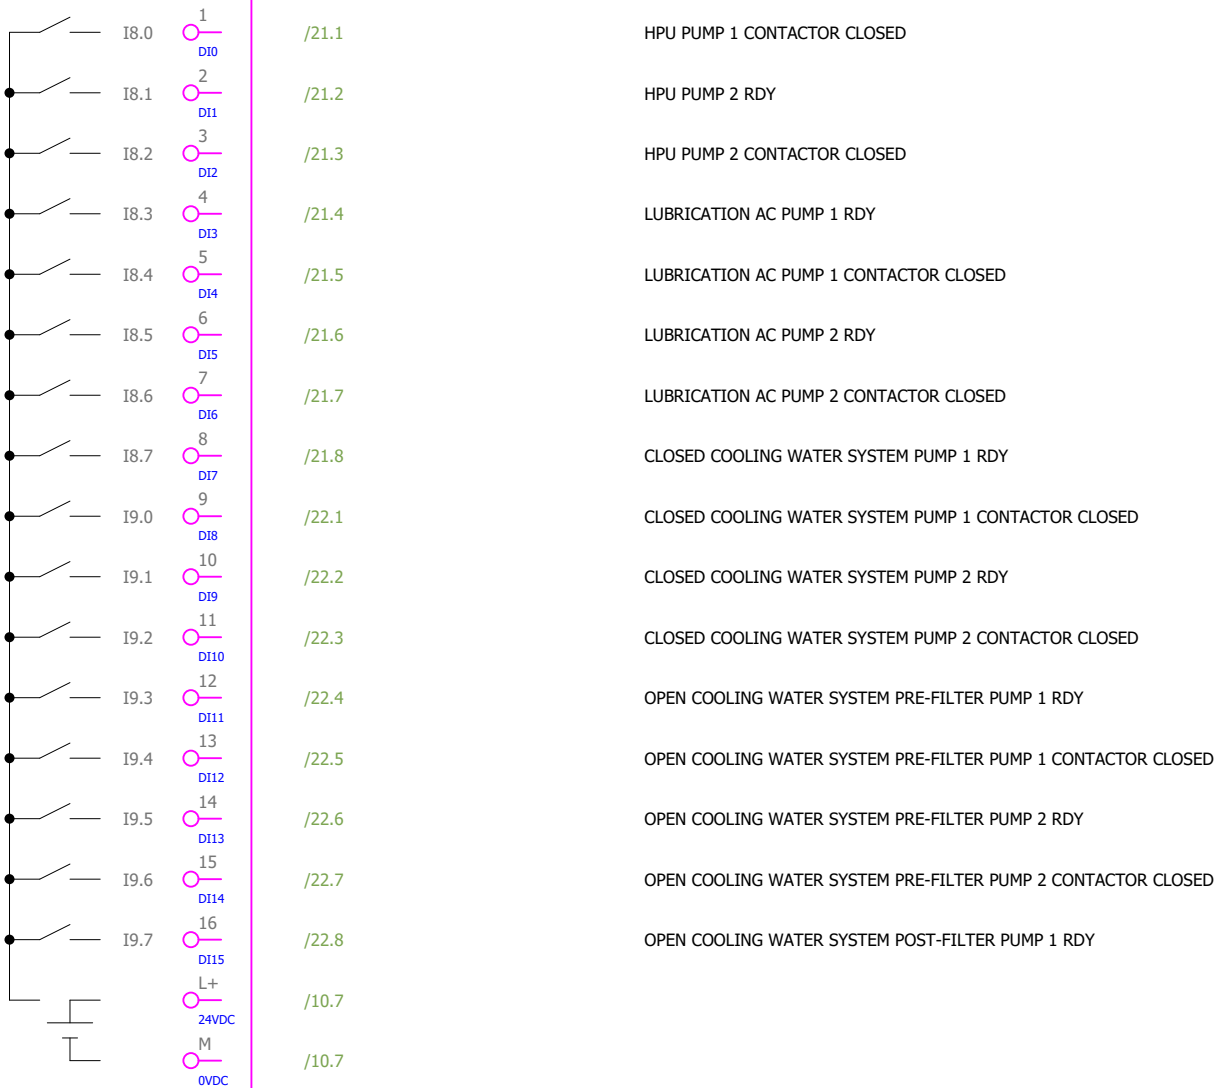


1		2	3	4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)			
1 1	Type: DI 16X24V DC Standard Order No.: 6ES7131-6BH01-0BA0 Número de pedido: 6ES7131-6BH01-0BA0 Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7193-6BP00-0BA0	Siemens	+1CJA01	-A117				

-A117
/11.1

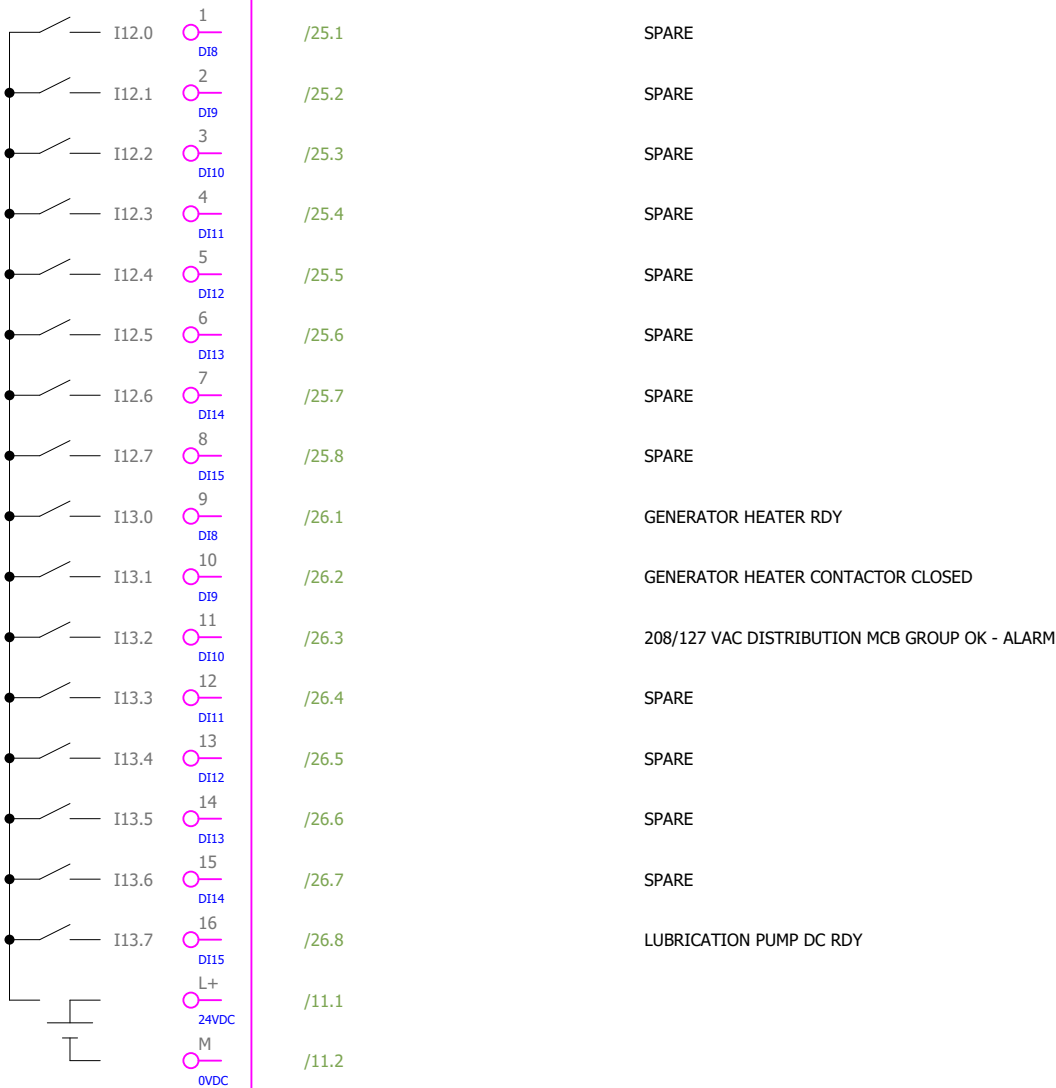

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: DI 16X24V DC Standard Order No.: 6ES7131-6BH01-0BA0 Número de pedido: 6ES7131-6BH01-0BA0			Siemens	+1CJA01	-A118									
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7131-6BH01-0BA0														

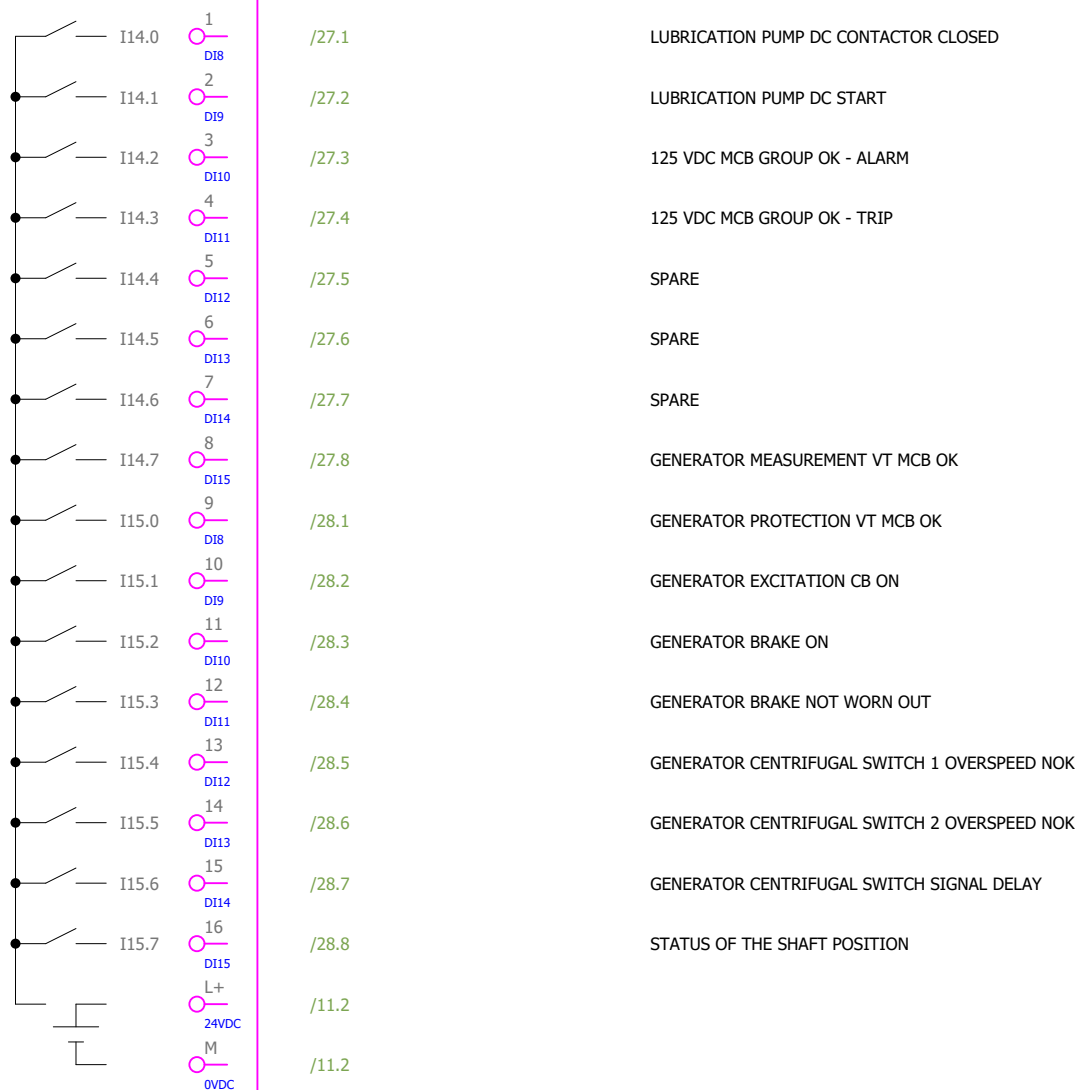

Date:	2025-09-26
Drawn:	Karlo Čotić
Approved:	Patrik Kovač
Format:	A4
SINTAKSA A Voith Company	
Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia
Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia
Scope of design:	Unit 1 control and protection cubicle
Content:	PLC OVERVIEW
Project:	24028-DD
Folder:	EE-02
Drawing:	221
Revision:	01
#Z	
=1CJA01	Sheet: 97
+1CJA01	Next: 98

-A120
/11.3

Channel	Signal	Address
1	I18.0	/31.1
2	I18.1	/31.2
3	I18.2	/31.3
4	I18.3	/31.4
5	I18.4	/31.5
6	I18.5	/31.6
7	I18.6	/31.7
8	I18.7	/31.8
9	I19.0	/32.1
10	I19.1	/32.2
11	I19.2	/32.3
12	I19.3	/32.4
13	I19.4	/32.5
14	I19.5	/32.6
15	I19.6	/32.7
16	I19.7	/32.8
L+	24VDC	/11.3
M	0VDC	/11.3

[illegible]

1	2	3	4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)		
1 1	Type: DQ 16x 24V DC/0,5A	Siemens					
	Número de pedido: 6ES7132-6BH01-0BA0		+1CJA01	-A131			
	Baseunit Type A0, BU15-P16+A0+2D						
	Unidad base Tipo A0, BU15-P16+A0+2D						
	Número de pedido: 6ES7132-6BH01-0BA0						

[illegible]

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)										
1 1	Type: DQ 16x 24V DC/0,5A	Siemens	+1CJA01	-A132											
	Número de pedido: 6ES7132-6BH01-0BA0														
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7132-6BH01-0BA0														

Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01				=1CJA01	Sheet:	101	
Approved:	Patrik Kovač											+1CJA01	Next:	102	
Format:	A4														

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)										
1 1	Type: DQ 16x 24V DC/0,5A	Siemens	+1CJA01	-A133											
	Número de pedido: 6ES7132-6BH01-0BA0														
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7132-6BH01-0BA0														

Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01				= 1CJA01	Sheet:	102	
Approved:	Patrik Kovač											+ 1CJA01	Next:	103	
Format:	A4														


1	2	3	4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)		
1 1	Type: DQ 16x 24V DC/0,5A	Siemens					
	Número de pedido: 6ES7132-6BH01-0BA0		+1CJA01	-A134			
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7132-6BH01-0BA0						

Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	#Z
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01				=1CJA01	Sheet:	103	
Approved:	Patrik Kovač											+1CJA01	Next:	104	
Format:	A4														

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: AI 4XI 2-/4-WIRE Standard			Siemens	+1CJA01	-A142									
	Número de pedido: 6ES7134-6GD01-0BA1														
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7134-6GD01-0BA1														

Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	#Z
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01				=1CJA01	Sheet:	105	
Approved:	Patrik Kovač											+1CJA01	Next:	106	
Format:	A4														

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: AI 4XI 2-/4-WIRE Standard			Siemens	+1CJA01	-A143									
	Número de pedido: 6ES7134-6GD01-0BA1														
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7134-6GD01-0BA1														

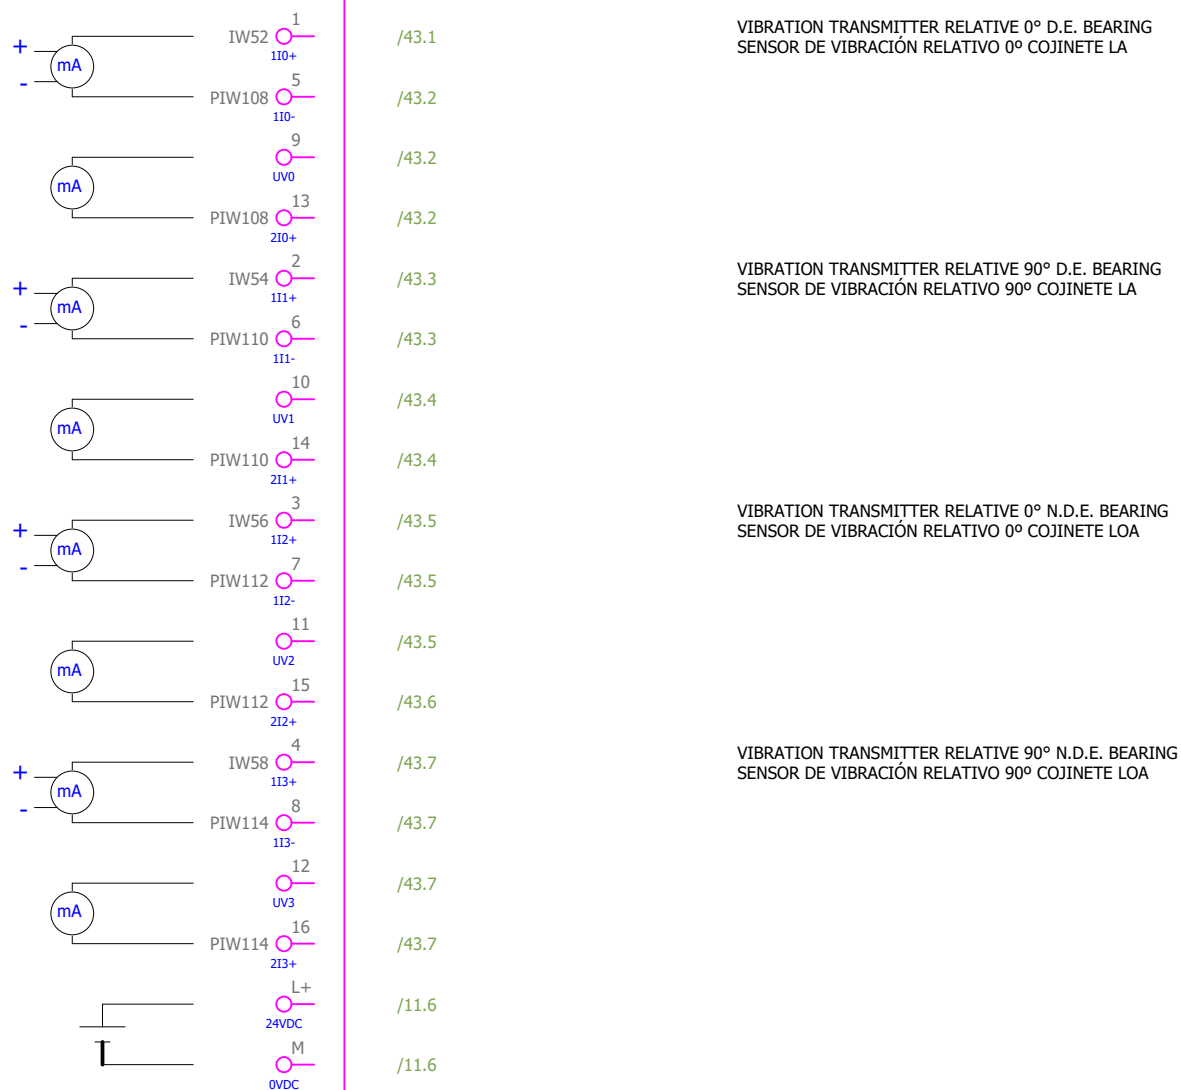


Date:	2025-09-26
Drawn:	Karlo Čotić Patrik Kovač
Approved:	Patrik Kovač
Format:	A4

SINTAKSA

A Voith Company

Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design: Unit 1 control and protection cubicle	Project: 24028-DD	Folder: EE-02	Drawing: 221	Revision: 01	#Z
Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content: PLC OVERVIEW	Drawing designation: 24028-DD-EE-02-221-01	= 1CJA01	+ 1CJA01	Sheet: Next:	106 107

1	2	3	4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)		
1 1	Type: AI 4XI 2-/4-WIRE Standard	Siemens					
	Número de pedido: 6ES7134-6GD01-0BA1		+1CJA01	-A144			
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7134-6GD01-0BA1						

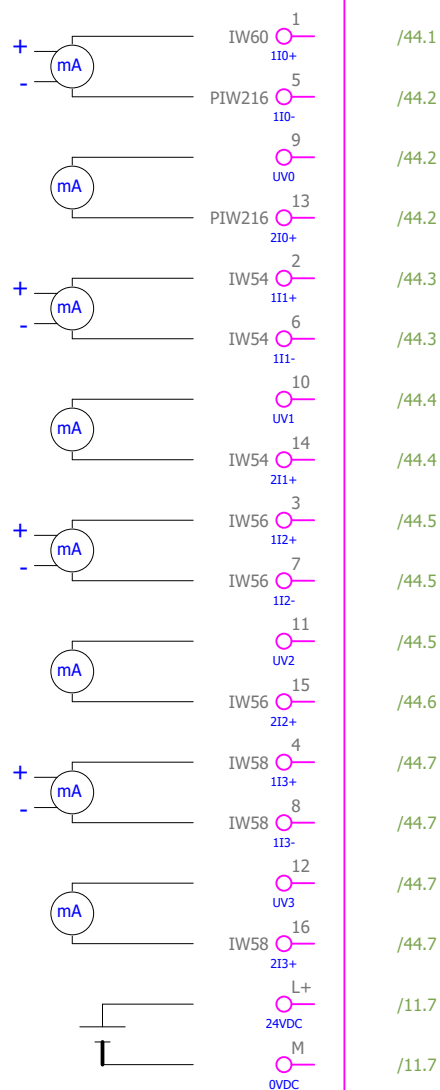


Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	PLC OVERVIEW	Drawing designation:	24028-DD-EE-02-221-01			=1CJA01	Sheet:	107		
Approved:	Patric Kovač						+1CJA01	Next:	108						
Format:	A4														

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: AI 4xRTD/TC High Feature Order No.: 6ES7134-6JD00-0CA1 6ES7134-6JD00-0CA1 Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7193-6BP00-0BA0			Siemens	+1CJA01	-A145									
-A145 /11.7															


[illegible]

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer		Location (= / +)		Designation (-)		Symbol Position in schematics (Page, column)					
1 1	Type: AI 4xRTD/TC High Feature Order No.: 6ES7134-6JD00-0CA1 6ES7134-6JD00-0CA1 Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7193-6BP00-0BA0			Siemens		+1CJA01		-A147							
-A147 /12.1															

1		2		3	4	5	6	7	8
Qty. (pcs)	Equipment technical description		Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)			
1 1	Type: AI 4xRTD/TC High Feature Order No.: 6ES7134-6JD00-0CA1 6ES7134-6JD00-0CA1		Siemens	+1CJA01	-A148				
	Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7193-6BP00-0BA0								
-A148 /12.2 The diagram shows a terminal block with 17 terminals. The connections are as follows: - Terminal 1: IW104, M0+, /48.2, BEARING D.E. OIL TEMPERATURE - Terminal 5: M0-, /48.2 - Terminal 9: IC0+, /48.2 - Terminal 13: IC0-, /48.2 - Terminal 2: IW106, M1+, /48.3, BEARING N.D.E. OIL TEMPERATURE - Terminal 6: M1-, /48.3 - Terminal 10: IC1+, /48.3 - Terminal 14: IC1-, /48.4 - Terminal 3: IW108, M2+, /48.5, COLD AIR TEMPERATURE TEMPERATURA DEL AIRE FRÍO - Terminal 7: M2-, /48.5 - Terminal 11: IC2+, /48.5 - Terminal 15: IC2-, /48.5 - Terminal 4: IW110, M3+, /48.6, HOT AIR TEMPERATURE TEMPERATURA DEL AIRE CALIENTE - Terminal 8: M3-, /48.6 - Terminal 12: IC3+, /48.6 - Terminal 16: IC3-, /48.7 - Terminal L+: 24VDC, /12.2 - Terminal M: 0VDC, /12.2									

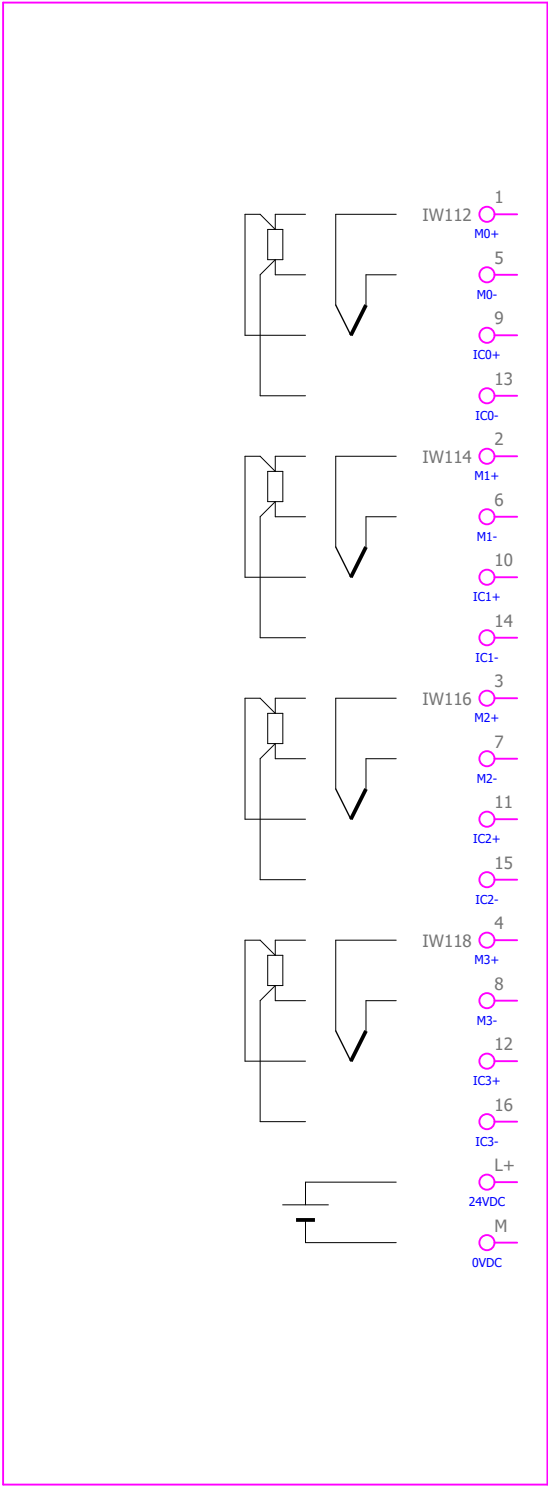
1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Type: AI 4xRTD/TC High Feature Order No.: 6ES7134-6JD00-0CA1 6ES7134-6JD00-0CA1 Baseunit Type A0, BU15-P16+A0+2B Unidad base Tipo A0, BU15-P16+A0+2B Número de pedido: 6ES7193-6BP00-0BA0			Siemens	+1CJA01	-A149									
-A149 /12.2 															

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Power supply: 24 ... 60 VDC LCD 96x96mm Type: SENTRON PAC3220			Siemens	+1CJA01	-P101									
	Order No.: 7KM3220-1BA01-1EA0														

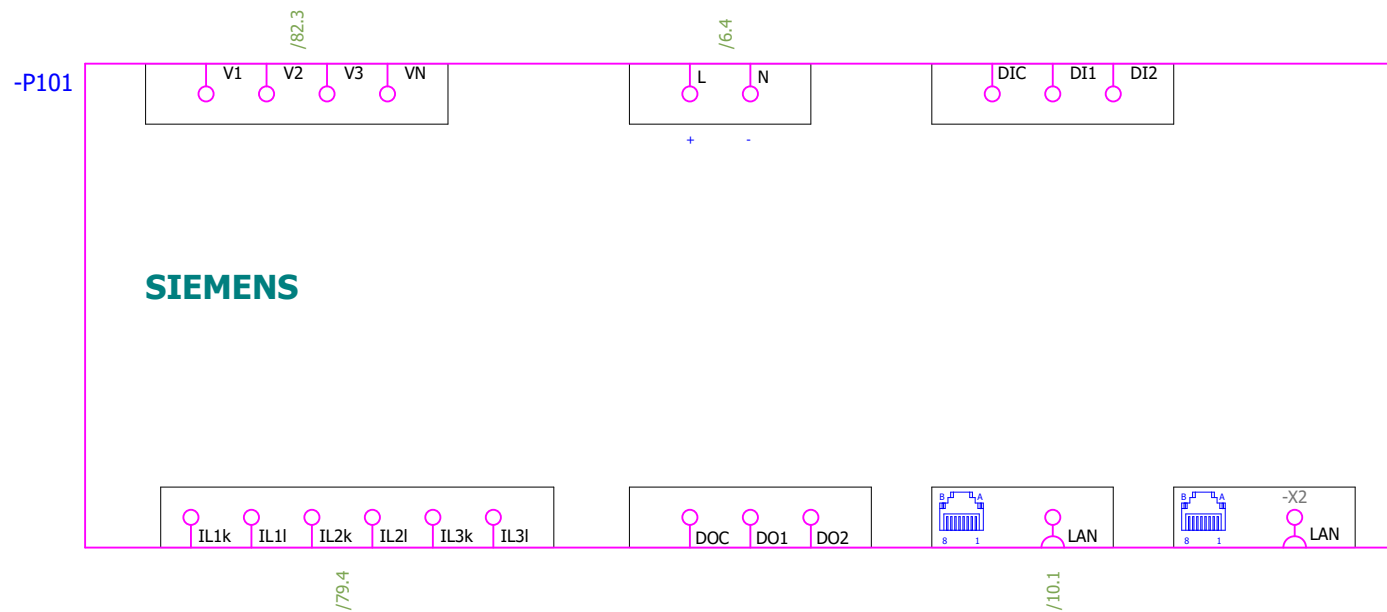


Date:	2025-09-26		 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia		Scope of design:	Unit 1 control and protection cubicle		Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01		
Drawn:	Karlo Čotić			Object:	BCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia		Content:	MULTIMETER		Drawing designation:	24028-DD-EE-02-221-01							#Z	
Approved:	Patrik Kovač																=1CJA01	Sheet:	115
Format:	A4																+1CJA01	Next:	116

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	7UM85 Generator Protection Modules in 19" row 1: IO208, PS201, IO202			Siemens	+1CJA01	-F312									
	Order No.: P1L346665														

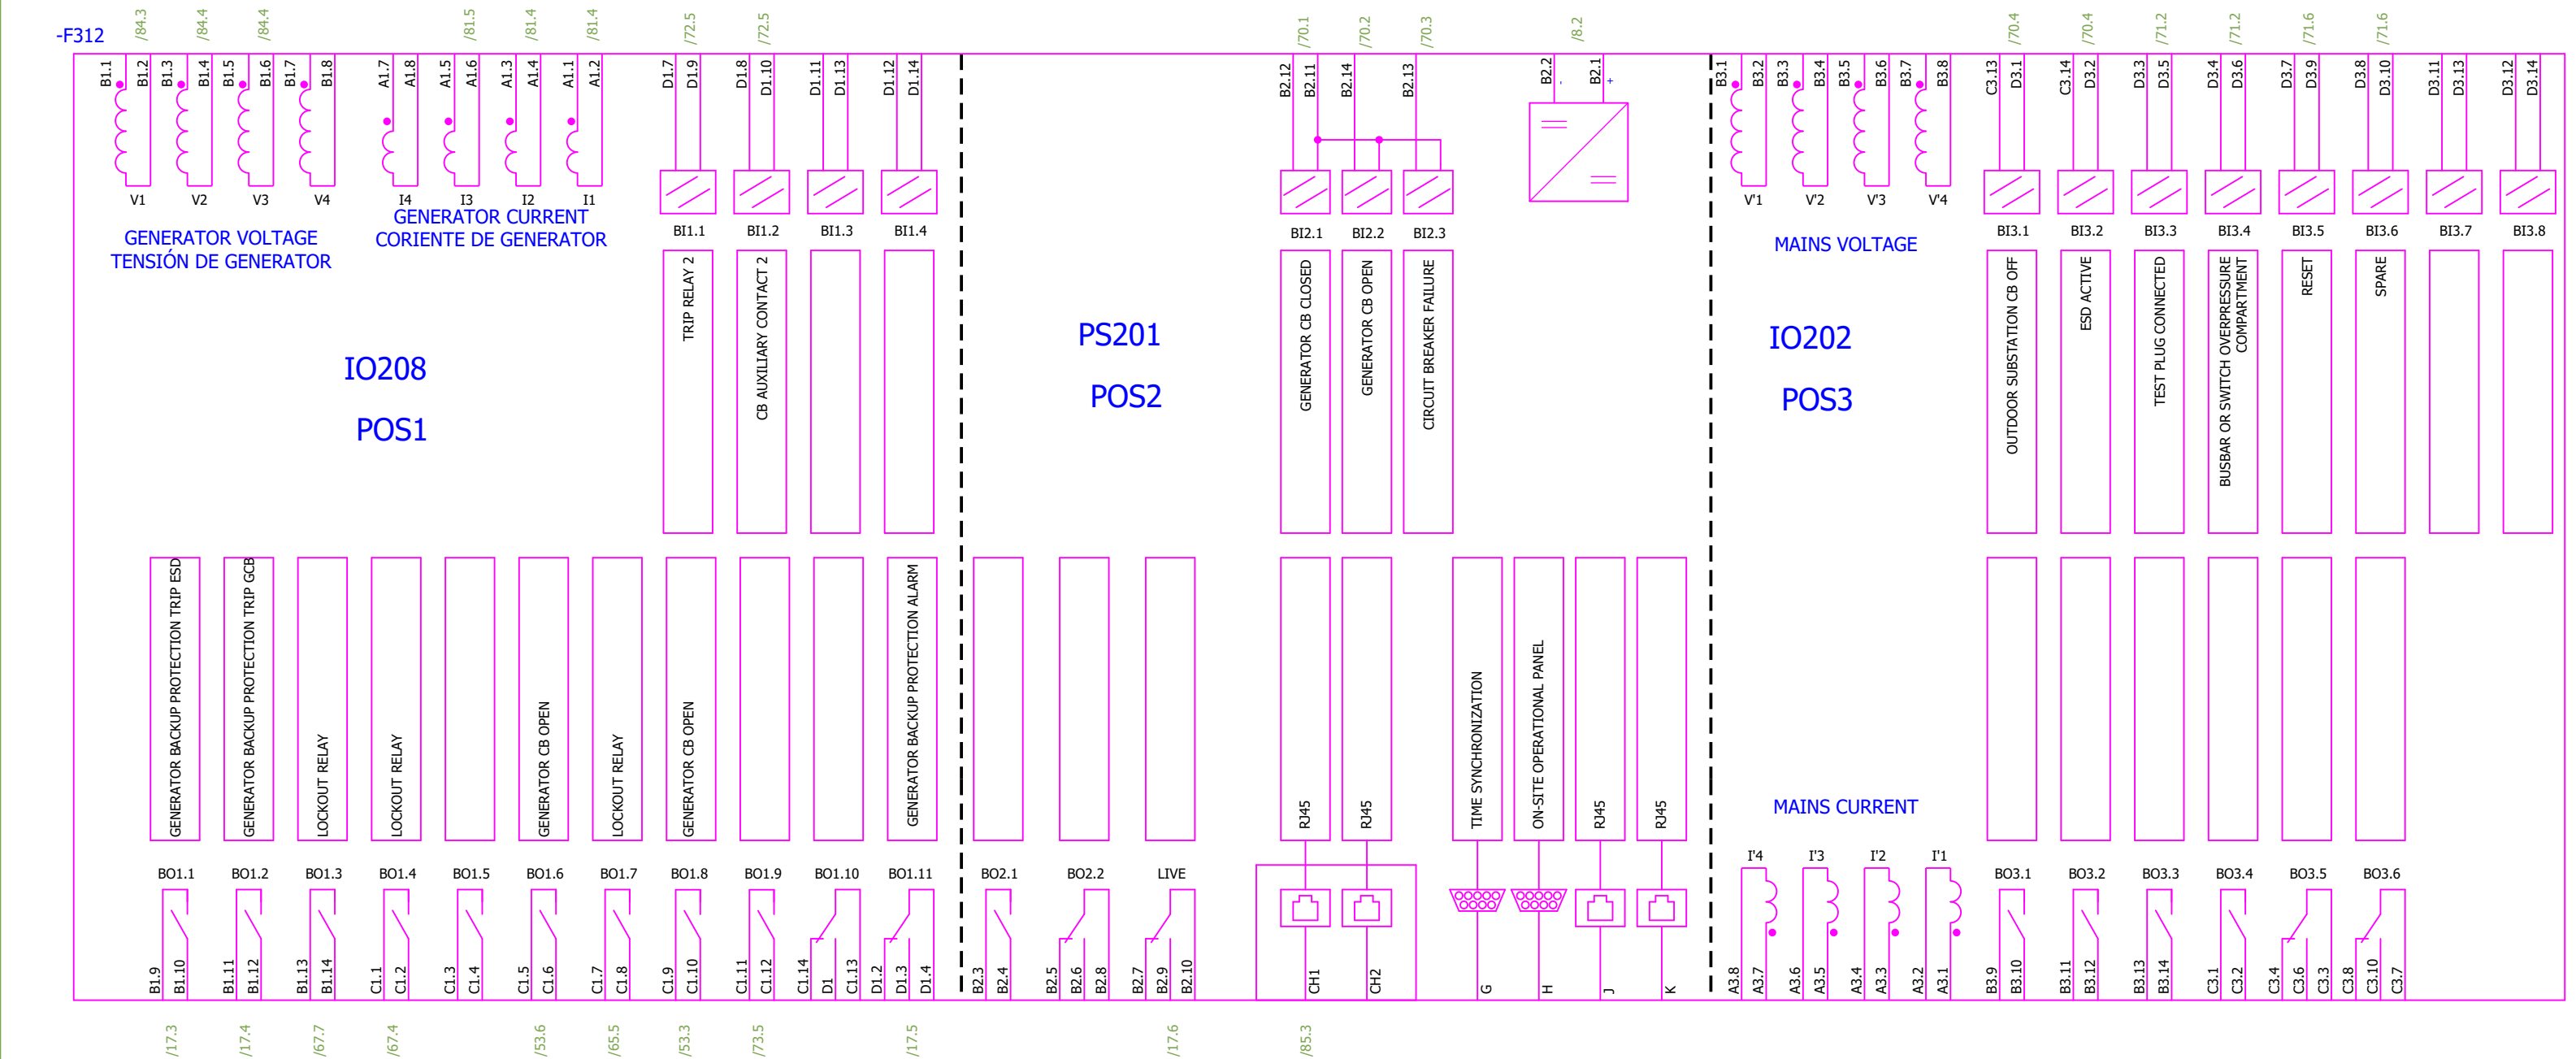


Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellin, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	#Z
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellin, Colombia	Content:	BACKUP GENERATOR PROTECTION RELAY - 7UM85	Drawing designation:	24028-DD-EE-02-221-01	=1CJA01	Sheet:	117				
Approved:	Patrik Kovač		+1CJA01	Next:	118										
Format:	A4														


1		2	3	4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)			
1 1	Sincronoscope for manual sincronization Scale: 360° Displayed voltage: 380V Measured voltage: 380V Aux power supply: 24VDC Type: Synchro 96C Order number: ANTJ11	IME	+1CJA01	-P412				

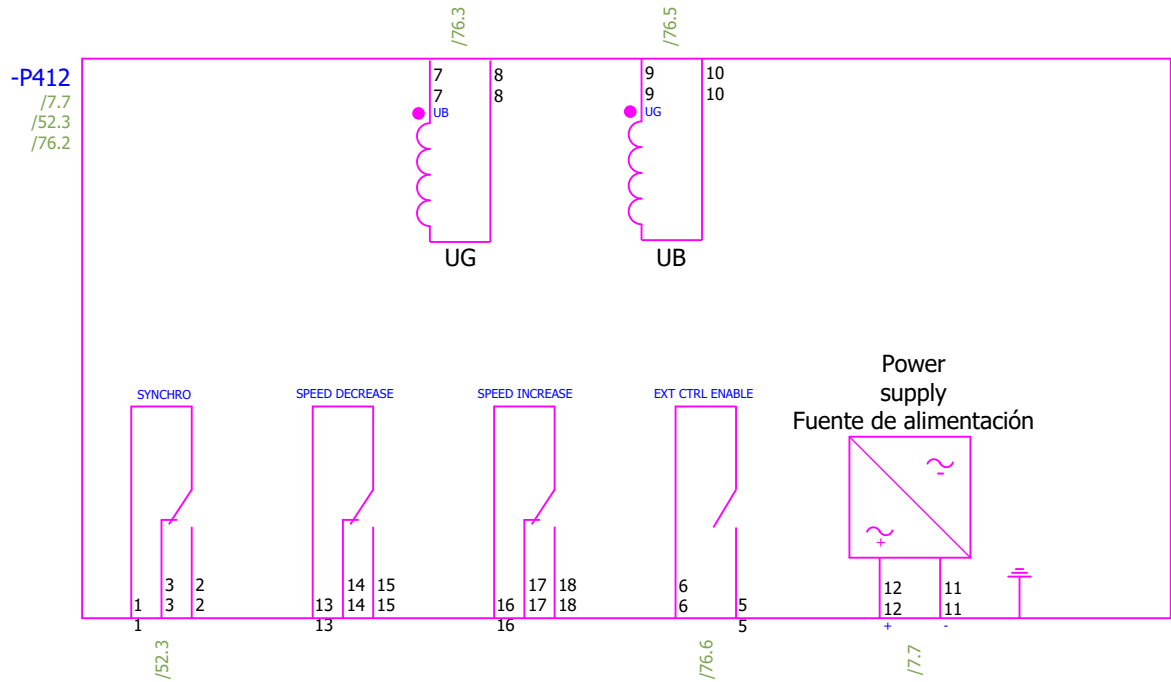


1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer		Location (= / +)		Designation (-)		Symbol Position in schematics (Page, column)					
11	Siemens Reyrolle test block Part no.: 7XG2220-1AA00-0AA0 Size E2 case (2RMLG01) Vertical mounting			Siemens		+1CJA01		-X311.1							

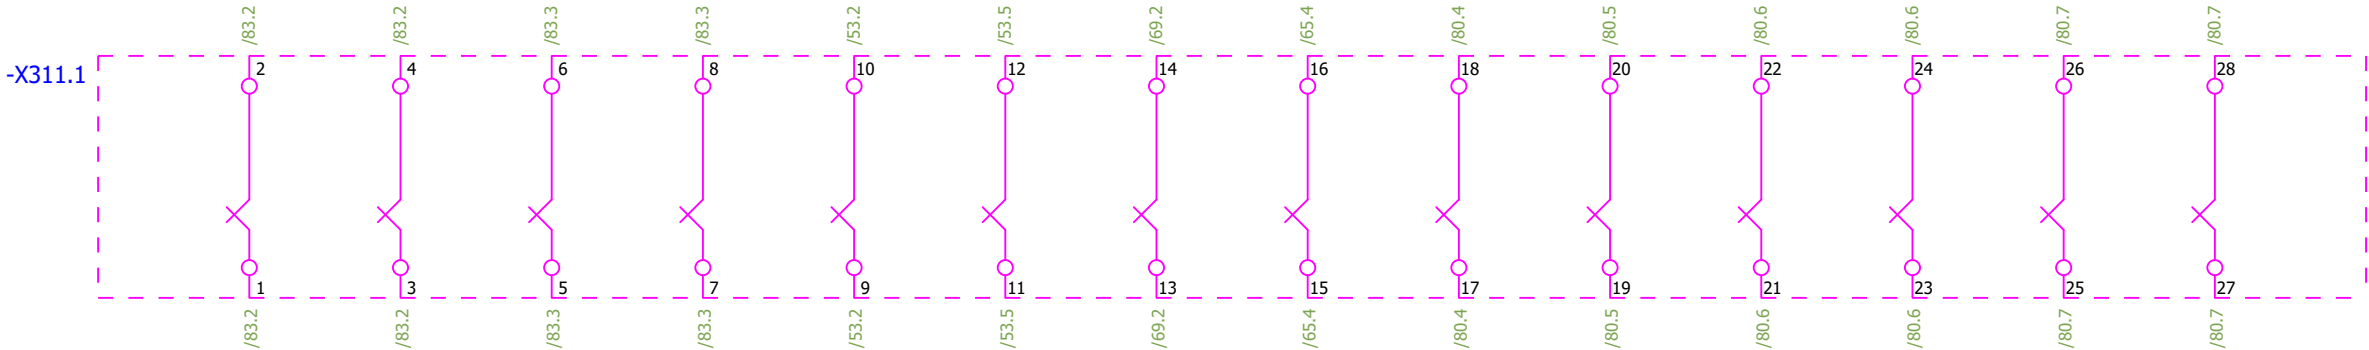


Qty. (pcs)	Equipment technical description	Manufacturer		Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)							
1 1	Siemens Reyrolle test block Part no.: 7XG2220-1AA00-0AA0 Size E2 case (2RMLG01) Vertical mounting	Siemens		+1CJA01	-X311.2								

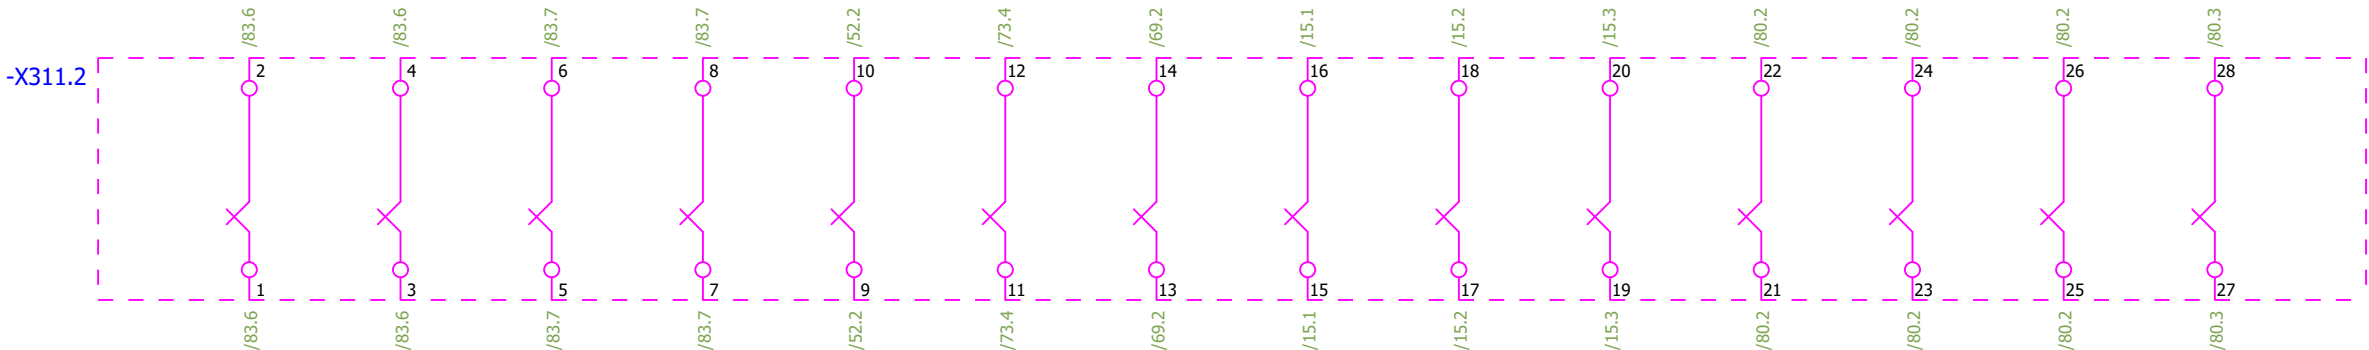






1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)								
1 1	Siemens Reyrolle test block			Siemens	+1CJA01	-X312.1									
	Part no.: 7XG2220-1AA00-0AA0 Size E2 case (2RMLG01) Vertical mounting														

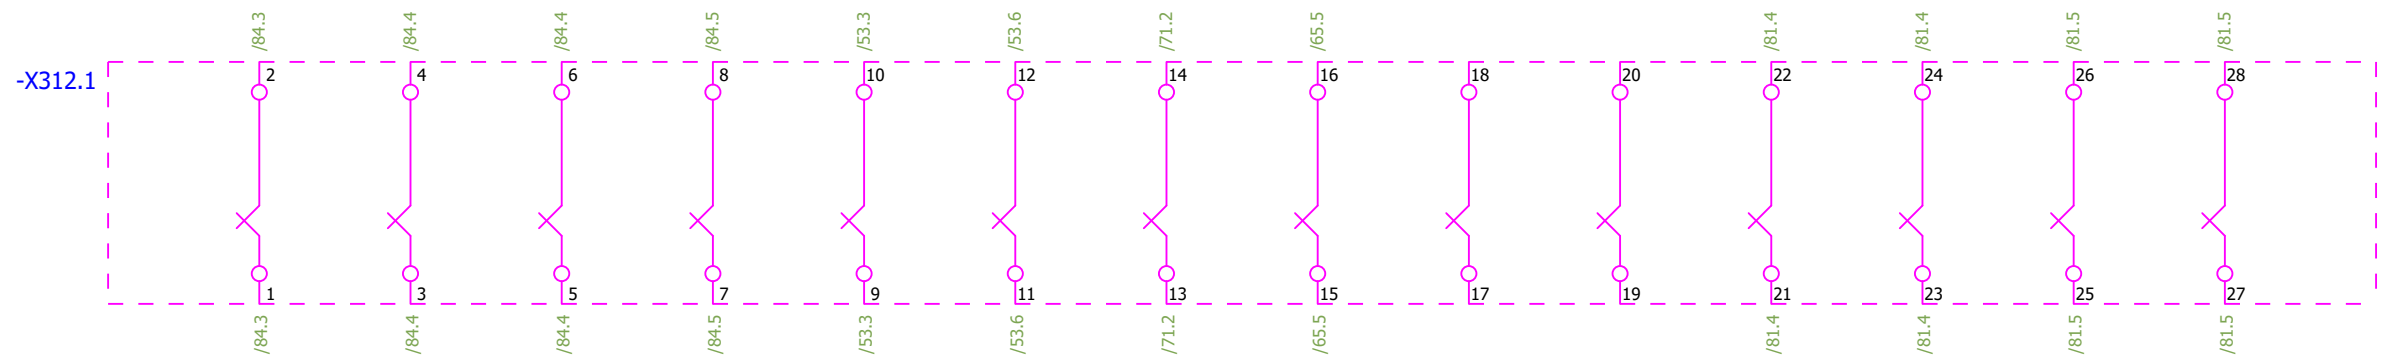



Qty. (pcs)	Equipment technical description	Manufacturer	Location (= / +)	Designation (-)	Symbol Position in schematics (Page, column)
1 1	Siemens Reyrolle test block Part no.: 7XG2220-1AA00-0AA0 Size E2 case (2RMLG01) Vertical mounting	Siemens	+1CJA01	-X312.2	

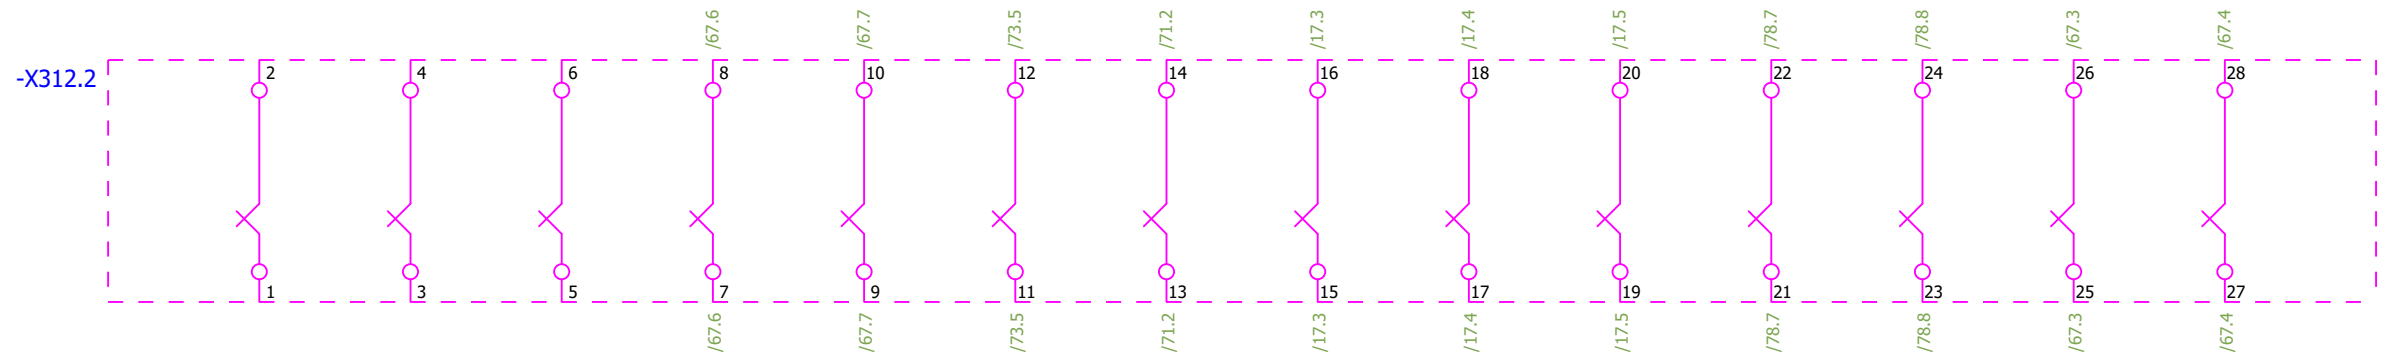


Date:	2025-09-26	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	EE-02	Drawing:	221	Revision:	01	
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	TEST SWITCH	Drawing designation:	24028-DD-EE-02-221-01			=1CJA01	Sheet:	121		
Approved:	Patric Kovač						+1CJA01	Next:	122						
Format:	A4														

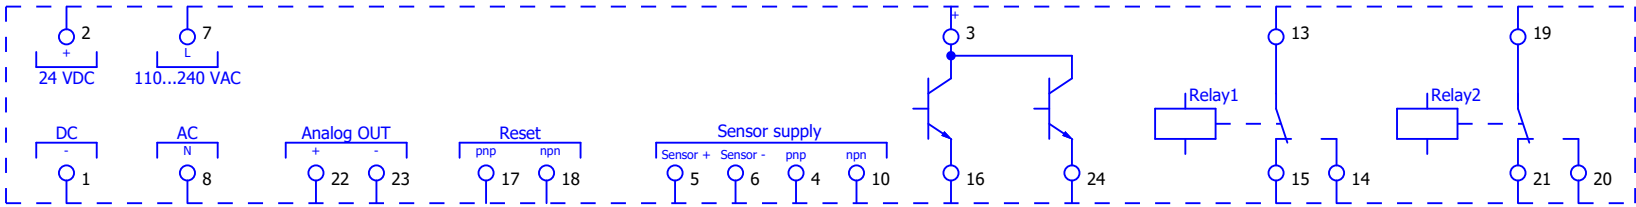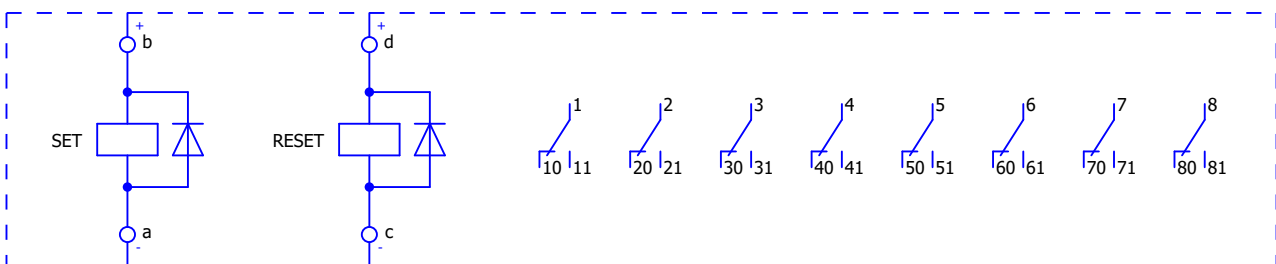
1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)										
1	Thermostat	Alfa Electric													
	Thermostat, NC contact 0...+60°C Type: THR02 Order No.: THR02		+1CJA01	-B101	/4.6										
1	Hygrostat, Rated Voltage 120-240 V AC, Rated Current 10-5A 10-90 %RF	Fanndis													
	Order No.: IGR35F		+1CJA01	-B102	/4.6										
1	Speed monitoring relay	IFM													
	Nominal voltage: 110...240VAC (50...60Hz)/27Hz (tip. 24VDC) 2 relay outputs, 2 transistor outputs Analog output: 0/4...20mA Impuls inputs: pnp/npn, NAMUR (24V) Input frequency (max): 5kHz Setting range: 1...60000 imp/min (0.1...1000Hz)		+1CJA01	-B111	/6.5	/41.4		/51.7		/59.3		/59.2			
1	Fast lock-out relay	Siemens													
	FAST LOCK-OUT RELAY 8 CHANGE OVER CONTACTS OPERATING TIME 10MS AUXILIARY VOLTAGE: 24/30V DC WITH RESET PUSHBUTTON WITHOUT SOCKET Type: 7PA2211-0 Order No.: 7PA2211-0 Socket for surface mounting Type: 7XP9012-0 SOCKET FOR SURFACE MOUNTING FOR 7PA22, 7PA26 AND THREE-PHASE 7PA30, 7TS15 AND 7TS16 RELAY		+1CJA01	-86E	/65.4										
2	Cubicle lightning	Schneider Electric													
	LED Lamps - 120/230 V AC - 10W Order No.: Número de pedido: NSYLAMT5LD2		+1CJA01	-E101	/4.4										
			+1CJA01	-E102	/4.5										

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)										
1	CIRCUIT BREAKER 10KA 3POL D20	Siemens													
	Miniature circuit breaker 400 V 10kA, 3-pole, D, 20A, D=70 mm Order No.: 5SY4320-8 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable		+1CJA01	-F1	/54.6		/16.4								
3	Miniature circuit breaker, 10kA, 1-pole, B, 6A	Siemens													
	230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4106-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable		+1CJA01	-F31	/6.3										
			+1CJA01	-F32	/6.4										
			+1CJA01	-F33	/6.5		/17.2								
5	Disyuntor miniatura 10 kA, 1 polo, B, 2 A	Siemens													
	230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4102-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable		+1CJA01	-F34	/6.6		/17.2								
			+1CJA01	-F35	/6.7										
			+1CJA01	-F36	/7.1		/17.2								
			+1CJA01	-F37	/7.2		/17.2								
			+1CJA01	-F38	/7.3		/17.2								
	Miniature circuit breaker, 10kA, 1-pole, B, 6A	Siemens													
	230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4106-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable		+1CJA01	-F39	/7.4		/17.2								
			+1CJA01	-F40	/7.5		/17.2								
			+1CJA01	-F41	/7.6		/17.1								

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)										
12	Miniature circuit breaker, 10kA, 1-pole, B, 6A 230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4106-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable	Siemens													
			+1CJA01	-F42	/7.7		/17.2								
			+1CJA01	-F43	/8.1		/16.5								
			+1CJA01	-F44	/8.2		/17.2								
			+1CJA01	-F45	/8.3		/17.2								
			+1CJA01	-F46	/8.4		/17.2								
			+1CJA01	-F47	/8.5		/17.2								
			+1CJA01	-F48	/8.6		/17.2								
			+1CJA01	-F49	/8.7		/16.6								
			+1CJA01	-F50	/9.1										
2	Disyuntor miniatura 10 kA, 1 polo, B, 2 A 230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4102-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable	Siemens													
			+1CJA01	-F51	/9.2										
			+1CJA01	-F52	/9.3										
1	Miniature circuit breaker, 10kA, 1-pole, B, 6A 230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4106-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable	Siemens													
			+1CJA01	-F53	/9.4										


1		2		3		4		5		6		7		8		
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol	Position in schematics (Page, column)										
1	Disyuntor miniatura 10 kA, 1 polo, B, 2 A 230/400 V 10kA, D=70 mm Order No.: Número de pedido: 5SY4102-6 Interruptor de corriente auxiliar Type: Número de pedido: 5ST3016 1 C/O Montable	Siemens														
			+1CJA01	-F54	/9.5											
2	Cartridge Fuses FSF 5X20 250V 100mA Order No.: 693-0034.1506 UT 4-HESI (5X20) Type: 3046032 Fuse modular terminal block, fuse type: Glass / ceramics / ..., fuse type: G / 5 x 20, nom. voltage: 500 V, nominal current: 6.3 A, connection method: Screw connection, Rated cross section: 4 mm2, cross section: 0.14 mm2- 6 mm2, mounting type: NS 35/7.5, NS 35/15, color: black															
			+1CJA01	-FS1	/51.3											
			+1CJA01	-FS2	/51.3											
1	INDICATOR LIGHT, RED Indicator lights, 22 mm, round, metal, shiny, red, lens, smooth, with holder, LED module with integrated LED 24 V AC/DC, screw terminal Order No.: 3SU1152-6AA20-1AA0 Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing	Siemens														
			+1CJA01	-H101	/39.7											
1	INDICATOR LIGHT, YELLOW Indicator lights, 22 mm, round, metal, shiny, yellow, lens, smooth, with holder, LED module with integrated LED 24 V AC/DC, screw terminal Order No.: 3SU1152-6AA30-1AA0 Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing	Siemens														
			+1CJA01	-H102	/39.8											



Date:	Karlo Čotić	 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:		Drawing:		Revision:		
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	Device tag List	Drawing designation:						#Z		
Approved:	Patrik Kovač													=1CJA01	Sheet: 126
Format:	A4													+1CJA01	Next: 127

1		2		3		4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)					
	Relé auxiliar Módulo de relé preensamblado con conexión push-in, compuesto por: Base de relé con expulsor y relé de contacto de potencia. Tipo de contacto: 1 contacto N/A. Tensión de entrada: 24 V DC. Order No.: Número de pedido: 2903361	Phoenix Contact								
			+1CJA01	-1K42	/21.2	/21.2				
			+1CJA01	-1K43	/21.3	/21.3				
			+1CJA01	-1K44	/21.4	/21.4				
			+1CJA01	-1K45	/21.5	/21.5				
			+1CJA01	-1K46	/21.6	/21.6				
			+1CJA01	-1K47	/21.7	/21.7				
			+1CJA01	-1K48	/21.8	/21.8				
			+1CJA01	-1K51	/22.1	/22.1				
			+1CJA01	-1K52	/22.2	/22.2				
			+1CJA01	-1K53	/22.3	/22.3				
			+1CJA01	-1K54	/22.4	/22.4				
			+1CJA01	-1K55	/22.5	/22.5				
			+1CJA01	-1K56	/22.6	/22.6				
			+1CJA01	-1K57	/22.7	/22.7				
			+1CJA01	-1K58	/22.8	/22.8				
			+1CJA01	-1K61	/23.1	/23.1				
			+1CJA01	-1K62	/23.2	/23.2				
			+1CJA01	-1K63	/23.3	/23.3				
			+1CJA01	-1K64	/23.4	/23.4				
			+1CJA01	-1K65	/23.5	/23.5				
			+1CJA01	-1K66	/23.6	/23.6				
			+1CJA01	-1K67	/23.7	/23.7				
			+1CJA01	-1K68	/23.8	/23.8				
			+1CJA01	-1K71	/24.1	/24.1				
			+1CJA01	-1K72	/24.2	/24.2				
			+1CJA01	-1K73	/24.3	/24.3				
			+1CJA01	-1K74	/24.4	/24.4				
			+1CJA01	-1K75	/24.5	/24.5				
			+1CJA01	-1K76	/24.6	/24.6				
			+1CJA01	-1K77	/24.7	/24.7				
			+1CJA01	-1K78	/24.8	/24.8				
			+1CJA01	-1K81	/25.1	/25.1				
			+1CJA01	-1K82	/25.2	/25.2				





Date:		 SINTAKSA A Voith Company	Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:		Drawing:	Revision:	
Drawn:	Karlo Čotić		Object:	PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia PCH NARE	Content:	Device tag List	Drawing designation:						#Z
Approved:	Patrik Kovač												
Format:	A4												
												=1CJA01	Sheet: 128
												+1CJA01	Next: 129





1		2		3		4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)					
119	Relé auxiliar Módulo de relé preensamblado con conexión push-in, compuesto por: Base de relé con expulsor y relé de contacto de potencia. Tipo de contacto: 1 contacto N/A. Tensión de entrada: 24 V DC. Order No.: Número de pedido: 2903361	Phoenix Contact								
			+1CJA01	-1K124	/29.4	/29.4				
			+1CJA01	-1K125	/29.5	/29.5				
			+1CJA01	-1K126	/29.6	/29.6				
			+1CJA01	-1K127	/29.7	/29.7				
			+1CJA01	-1K128	/29.8	/29.8				
			+1CJA01	-1K131	/30.1	/30.1				
			+1CJA01	-1K132	/30.2	/30.2				
			+1CJA01	-1K133	/30.3	/30.3				
			+1CJA01	-1K134	/30.4	/30.4				
			+1CJA01	-1K135	/30.5	/30.5				
			+1CJA01	-1K136	/30.6	/30.6				
			+1CJA01	-1K137	/30.7	/30.7				
			+1CJA01	-1K138	/30.8	/30.8				
			+1CJA01	-1K141	/31.1	/31.1				
			+1CJA01	-1K142	/31.2	/31.2				
			+1CJA01	-1K143	/31.3	/31.3				
			+1CJA01	-1K144	/31.4	/31.4				
			+1CJA01	-1K145	/31.5	/31.5				
			+1CJA01	-1K146	/31.6	/31.6				
			+1CJA01	-1K147	/31.7	/31.7				
			+1CJA01	-1K148	/31.8	/31.8				
			+1CJA01	-1K151	/32.1	/32.1				
			+1CJA01	-1K152	/32.2	/32.2				
			+1CJA01	-1K153	/32.3	/32.3				
			+1CJA01	-1K154	/32.4	/32.4				
			+1CJA01	-1K155	/32.5	/32.5				
			+1CJA01	-1K156	/32.6	/32.6				
			+1CJA01	-1K157	/32.7	/32.7				
			+1CJA01	-1K158	/32.8	/32.8				



1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)								
	Relé enchufable - Tensión de control nominal: 24 V CC, - Corriente de contacto nominal: 10 A, - Contactos: 1 C/O Order No.: Número de pedido: RXG12BD Harmony, módulo de protección Type: RXG12BD Harmony, diodo, para todos los conectores, 6...230 V CC Número de pedido: RZM040W Harmony, zócalo push-in con abrazadera Type: SE.RXG12BD+RZM040W+RGZE05P para relés RXG1, 10 A, terminales push-in, contacto separado Número de pedido: RGZE05P														
				+1CJA01	-2K01	/33.1	/63.3								
				+1CJA01	-2K03	/33.6	/57.4								
				+1CJA01	-2K04	/33.7									
				+1CJA01	-2K05	/33.8	/77.4								
				+1CJA01	-2K06	/34.1	/76.6								
				+1CJA01	-2K07	/34.2	/52.2								
				+1CJA01	-2K08	/34.3	/52.3								
				+1CJA01	-2K09	/34.4	/56.2								
				+1CJA01	-2K10	/34.5	/56.2								
				+1CJA01	-2K11	/34.6	/56.3								
				+1CJA01	-2K12	/34.7	/56.3								
				+1CJA01	-2K13	/34.8	/56.4								
				+1CJA01	-2K14	/35.1	/56.5								
				+1CJA01	-2K15	/35.2	/56.5								
				+1CJA01	-2K16	/35.3	/56.6								
				+1CJA01	-2K17	/35.4	/56.7								
				+1CJA01	-2K18	/35.5	/56.7								
				+1CJA01	-2K19	/35.6	/60.2								
				+1CJA01	-2K20	/35.7	/60.3								
				+1CJA01	-2K21	/35.8	/60.4								
				+1CJA01	-2K22	/36.1	/60.5								
				+1CJA01	-2K23	/36.2	/59.4								
				+1CJA01	-2K24	/36.3	/60.6								
				+1CJA01	-2K25	/36.4	/60.7								
				+1CJA01	-2K26	/36.5	/61.2								
				+1CJA01	-2K27	/36.6	/61.3								


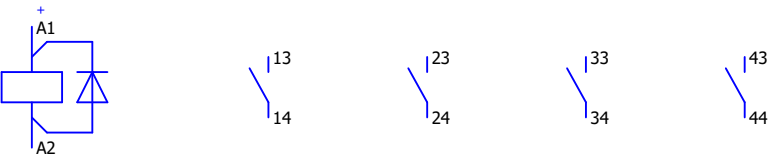
1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description			Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)								
41	Relé enchufable - Tensión de control nominal: 24 V CC, - Corriente de contacto nominal: 10 A, - Contactos: 1 C/O Order No.: Número de pedido: RXG12BD Harmony, módulo de protección Type: RXG12BD Harmony, diodo, para todos los conectores, 6...230 V CC Número de pedido: RZM040W Harmony, zócalo push-in con abrazadera Type: SE.RXG12BD+RZM040W+RGZE05P para relés RXG1, 10 A, terminales push-in, contacto separado Número de pedido: RGZE05P														
						+1CJA01-2K28/36.7/61.4									
						+1CJA01-2K29/36.8/61.5									
						+1CJA01-2K30/37.1/61.6									
						+1CJA01-2K31/37.2/61.6									
						+1CJA01-2K32/37.3/61.7									
						+1CJA01-2K33/37.4/62.2									
						+1CJA01-2K34/37.5/62.3									
						+1CJA01-2K35/37.6/62.4									
						+1CJA01-2K36/37.7/62.5									
						+1CJA01-2K37/39.1/66.4									
						+1CJA01-2K38/39.2									
						+1CJA01-2K39/39.3/59.5									
						+1CJA01-2K40/39.4/78.4									
						+1CJA01-2K41/39.5/78.5									
						+1CJA01-2K42/39.6/78.5									
	COUPL.CONT.RELAY,4NO,DC24V,DIODE COUPLING CONTACTOR RELAY, 4NO, DC 24V, 0.85...1.85*US, W/ INTEGRATED DIODE, SIZE S00, SCREW TERMINAL Order No.: Número de pedido: 3RH2140-1VB40			Siemens											
							+1CJA01-2K101/33.3/53.4/53.4/53.4								
							+1CJA01-2K102/33.4/53.7/53.7/53.7								
							+1CJA01-2K103/33.5/53.8/53.8/53.8								
							+1CJA01-2K104/37.8/58.2/58.2/58.2								
							+1CJA01-2K105/38.1/58.3/58.3/58.3								
							+1CJA01-2K106/38.2/58.4/58.4/58.4								



Date:	Karlo Čotić			Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design:	Unit 1 control and protection cubicle	Project:	24028-DD	Folder:	Drawing:	Revision:		
Drawn:	Patrik Kovač												#Z	
Approved:	Patrik Kovač												Sheet:	131
Format:	A4												Next:	132
				Object:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content:	Device tag List	Drawing designation:				=1CJA01		
										+1CJA01				




1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)										
12	COUPL.CONT.RELAY,4NO,DC24V,DIODE COUPLING CONTACTOR RELAY, 4NO, DC 24V, 0.85...1.85*US, W/ INTEGRATED DIODE, SIZE S00, SCREW TERMINAL Order No.: Número de pedido: 3RH2140-1VB40	Siemens													
			+1CJA01	-2K107	/38.3	/58.5	/58.5	/58.5	/50.1						
			+1CJA01	-2K108	/38.4	/58.6	/58.6	/58.6							
			+1CJA01	-2K109	/38.5	/58.7	/58.7	/58.7							
			+1CJA01	-2K110	/38.6	/65.6	/66.5	/69.5	/71.6						
			+1CJA01	-2K111	/38.7	/78.2	/78.2	/78.2							
			+1CJA01	-2K112	/38.8										
1	SIRIUS Auxiliary contactor 4NO Contactor, AC1: 35A DC 24V 4-pole, 4NO, Size: S0, Screw terminal 1NO+1NC integrated Order No.: 3RT2325-1BB40 SIRIUS Surge suppressor Type: 3RT2926-1ER00 Surge Suppressor, Diode Combination, DC 24 V, For Motor Contactors Size S0	Siemens													
			+1CJA01	-K1	/57.4	/54.6	/54.6	/54.6	/55.4	/16.3					
1	Plug-in relay -3 C/O 24 V DC Plug-in relay: Nominal coil voltage: 24VDC complete unit 3 W Order No.: LZS:PT3A5L24	Siemens													
			+1CJA01	-K11	/57.5	/55.3	/55.3								
1	Contactor relay Contactor relay, 62E, DIN EN 50011, 8NO, screw terminal DC operation 24 V DC Order No.: 3TH4280-0BB4	Siemens													
			+1CJA01	-K111	/73.4	/74.2	/74.4	/74.6	/74.8	/75.2	/75.4				
1	Multifunction Timer Relay - 24...240V AC/DC - 1 C/O time delay relay 10 functions - 1 s..100 h - 24..240 V AC - 1 OC Order No.: RE17RMMU	Schneider Electric													
			+1CJA01	-K113	/59.6	/59.7	/59.7	/59.7	/62.6						

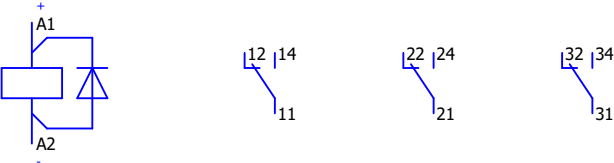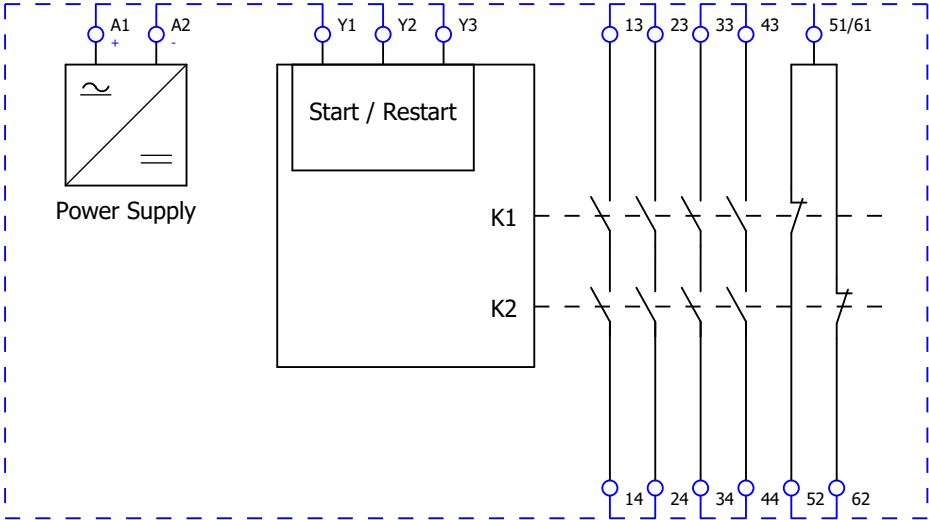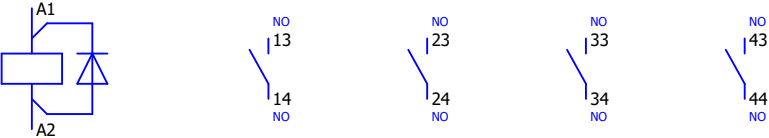1		2	3		4	5	6	7	8
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)				
3	Pomoćni relej -nazivni napon svitka: 24V DC, -nazivna struja kontakata: 10A, -kontakti: 3 x C/O Order No.: RXM3AB2BD								
			+1CJA01	-K131	/59.2 /59.5				
			+1CJA01	-K132	/59.4 /59.7 /60.6				
			+1CJA01	-K133	/59.3 /63.4 /16.8				
1	Harmony Safety Automation Estop or guard ,Harmony XPS, connected to supply terminals 24 V AC/DC , no inputs, spring Order No.: XPSBAC14AC	Schneider Electric							
			+1CJA01	-K301	/64.4				
1	Contactor relay Contactor relay, 53E, DIN EN 50011, 5NO + 3NC, screw terminal DC operation 24 V DC Order No.: 3TH4253-0B	Siemens							
			+1CJA01	-K302	/64.5 /65.3 /64.5				
1	SIRIUS contactor relay Contactor relay, 4NO, 24VDC, with integrated diode, size S00, screw terminal Order No.: 3RH2140-1FB40	Siemens							
			+1CJA01	-K321	/52.2 /52.7 /52.7 /52.7 /16.7				

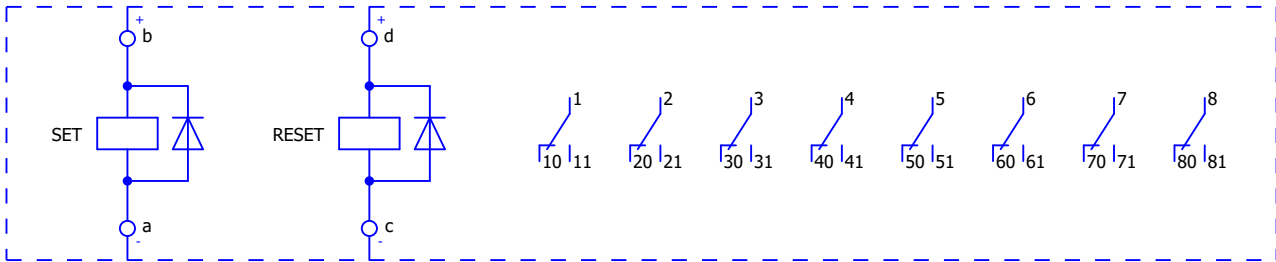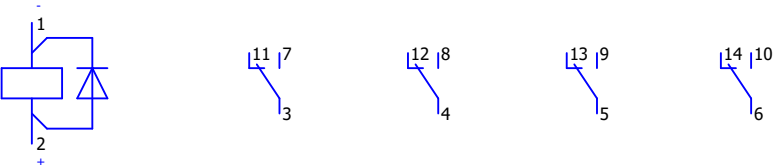	1	2	3	4	5	6	7	8		
Qty. (pcs)	Equipment technical description		Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)				
1	Fast lock-out relay FAST LOCK-OUT RELAY 8 CHANGE OVER CONTACTS OPERATING TIME 10MS AUXILIARY VOLTAGE: 24/30V DC WITH RESET PUSHBUTTON WITHOUT SOCKET Type: 7PA2211-0 Order No.: 7PA2211-0 Socket for surface mounting Type: 7XP9012-0 SOCKET FOR SURFACE MOUNTING FOR 7PA22, 7PA26 AND THREE-PHASE 7PA30, 7TS15 AND 7TS16 RELAY	Siemens								
			+1CJA01	-86M	/66.4					
2	Monostable fast trip relay -4 C/O 24 V DC FAST TRIP RELAY 4 CHANGE OVER CONTACTS OPERATING TIME 8MS AUXILIARY VOLTAGE: 24/30V DC RELAY WITHOUT SOCKET Order No.: 7PA2712-0AA00-0	Siemens								
			+1CJA01	-94P1	/67.3	/17.8	/52.7			
			+1CJA01	-94P2	/67.6	/18.1	/52.7	/53.4	/53.7	
1	analog panel meter Scale: 0-100% Input signal: 4-20mA Order No.: MA19LN A900K000008	LUMEL								
			+1CJA01	-P111	/50.3					
1	analog panel meter Scale: 0-200% Input signal: 4-20mA Order No.: MA19LN A900X000008	LUMEL								
			+1CJA01	-P112	/41.4					
Date:	SINTAKSA A Voith Company		Client: Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Scope of design: Unit 1 control and protection cubicle		Project: 24028-DD	Folder:	Drawing:	Revision:	
Drawn:										#Z
Approved:										Sheet: 134
Format:										Next: 135
			Object: PCH NARE Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia	Content: Device tag List		Drawing designation:		=1CJA01 +1CJA01		

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description	Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)										
1	KEY-OPERATED SWITCH RONIS, O-I RONIS key-operated switch, 22 mm, round, metal, shiny, lock number SB30, with 2 keys, 2 switch positions O-I, latching, actuating angle 90°, 10:30h/13:30h, key removal O+I, with holder, 1 NO+1 NC, screw terminal, possible special locks: 3SB31, 421, 455 Order No.: 3SU1150-4BF11-1FA0 CONTACT MODULE 1NO+1NC Type: 3SU1400-1AA10-1FA0 Contact module with 2 contact elements, 1 NO+1 NC, screw terminal, for front plate mounting Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing	Siemens													
			+1CJA01	-S100	/13.7										
2	Door contact Limit switch, Limit switches XC Standard, XCKN, metal end plunger, 1NC+1 NO, snap, Pg1 Order No.: Número de pedido: XCKN2110G11	Schneider Electric													
			+1CJA01	-S101	/4.4										
			+1CJA01	-S102	/4.5										
2	SELECTOR SWITCH, O-I, BLACK, WHITE Selector switch, illuminable, 22 mm, round, metal, shiny, white, selector switch, short, 2 switch positions O-I, latching, actuating angle 90°, 10:30h/13:30h, with holder, 1 NO, screw terminal Order No.: 3SU1150-2BF60-1BA0 Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing	Siemens													
			+1CJA01	-S103	/13.5										
			+1CJA01	-S104	/13.6										

1		2		3		4		5		6		7		8							
Qty. (pcs)	Equipment technical description			Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)														
2	SELECTOR SWITCH, I>O<II, WHITE Selector switch, illuminable, 22 mm, round, metal, shiny, white, selector switch, short, 3 switch positions I>O<II, momentary contact type, actuating angle 2x45°, 10:30h/12h/13:30h Order No.: 3SU1052-2BM60-0AA0 Contact module with 1 contact element, 1 NO Type: 3SU1400-1AA10-1BA0 Contact module with 1 contact element, 1 NO, screw terminal, for front plate mounting Contact module with 1 contact element, 1 NO Type: 3SU1400-1AA10-1BA0 Contact module with 1 contact element, 1 NO, screw terminal, for front plate mounting HOLDER Type: 3SU1550-0AA10-0AA0 Holder for 3 modules, universal, plastic/metal Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing			Siemens																	
					+1CJA01	-S221	/14.3		/14.4												
					+1CJA01	-S222	/14.5		/14.6												
2	ILLUMINATED PUSHBUTTON, WHITE Illuminated pushbutton, 22 mm, round, metal, shiny, white, pushbutton, flat, momentary contact type, with holder, 1 NO, LED module with integrated LED 24 V AC/DC, screw terminal Order No.: 3SU1152-0AB60-1BA0 Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing			Siemens																	
					+1CJA01	-S223	/13.3		/40.4												
					+1CJA01	-S224	/14.2		/40.8												
Date:				Client:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia			Scope of design:			Unit 1 control and protection cubicle			Project:	24028-DD	Folder:		Drawing:		Revision:	
Drawn:				Karlo Čotić	Object:	Generadora Nare S.A.S E.S.P Oficina 1113, Torre 1, Cl 7 Sur #42-70, Medellín, Colombia			Content:			Device tag List			Drawing designation:			=1CJA01			#Z
Approved:				Patrik Kovač																	
Format:				A4																	

1		2		3		4		5		6		7		8	
Qty. (pcs)	Equipment technical description		Manufacturer	Location (+)	Designation (-)	Symbol Position in schematics (Page, column)									
1	ILLUMINATED PUSHBUTTON, RED Illuminated pushbutton, 22 mm, round, metal, shiny, red, pushbutton, flat, momentary contact type, with holder, 1 NO+1 NC, LED module with integrated LED 24 V AC/DC, screw terminal Order No.: 3SU1152-0AB20-1FA0 Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing		Siemens												
				+1CJA01	-S230	/13.4		/40.5							
1	ILLUMINATED PUSHBUTTON, GREEN Illuminated pushbutton, 22 mm, round, metal, shiny, green, pushbutton, flat, momentary contact type, with holder, 1 NO, LED module with integrated LED 24 V AC/DC, screw terminal Order No.: 3SU1152-0AB40-1BA0 Label holder Type: 3SU1900-0AH10-0AA0 Label holder, 22mm, flat, Frame rounded off at the bottom black, for labeling plate 17.5 mm x 27 mm, for gluing		Siemens												
				+1CJA01	-S231	/52.2		/40.6							
1	ILL. EM. STOP MUSHR. PUSHBUTTON,40MM,RED EMERGENCY STOP mushroom pushbutton, illuminable, 22 mm, round, metal, shiny, red, 40 mm, positive latching, Rotate-to-unlatch Order No.: Número de pedido: 3SU1051-1HB20-0AA0 SOPORTE, MODULO DE CONTACTOS 1NC,1NC Type: 3SU1550-1AA10-1PA0 soporte para 3 módulos, metal, 1NC, 1NC, borne de tornillo Número de pedido: 3SU1550-1AA10-1PA0 LED-MODUL, ROJO Type: 3SU1401-1BB20-1AA0 MODULO LED CON LED 24V AC/DC INTEGRADO, ROJO, BORNES DE TORNILLO, PARA FIJACION EN PLACA FRONTAL Número de pedido: 3SU1401-1BB20-1AA0 COLLAR DE PROTECCION Type: 3SU1900-0DY30-0AA0 COLLAR DE PROTECCION PARA PULSADOR SETA DE PARO EMEG., SIN O CON CERRADURA RONIS, AMARILLO, PLASTICO Número de pedido: 3SU1900-0DY30-0AA0		Siemens												
				+1CJA01	-S301	/13.8		/40.7		/63.2					

