




COUNTY OF MAUI
DEPARTMENT OF ENVIRONMENTAL MANAGEMENT
WASTEWATER RECLAMATION DIVISION

CENTRAL MAUI RECYCLED WATER STATUS


BOARD of WATER SUPPLY

September 16, 2021

Central Maui Sewer Service Area

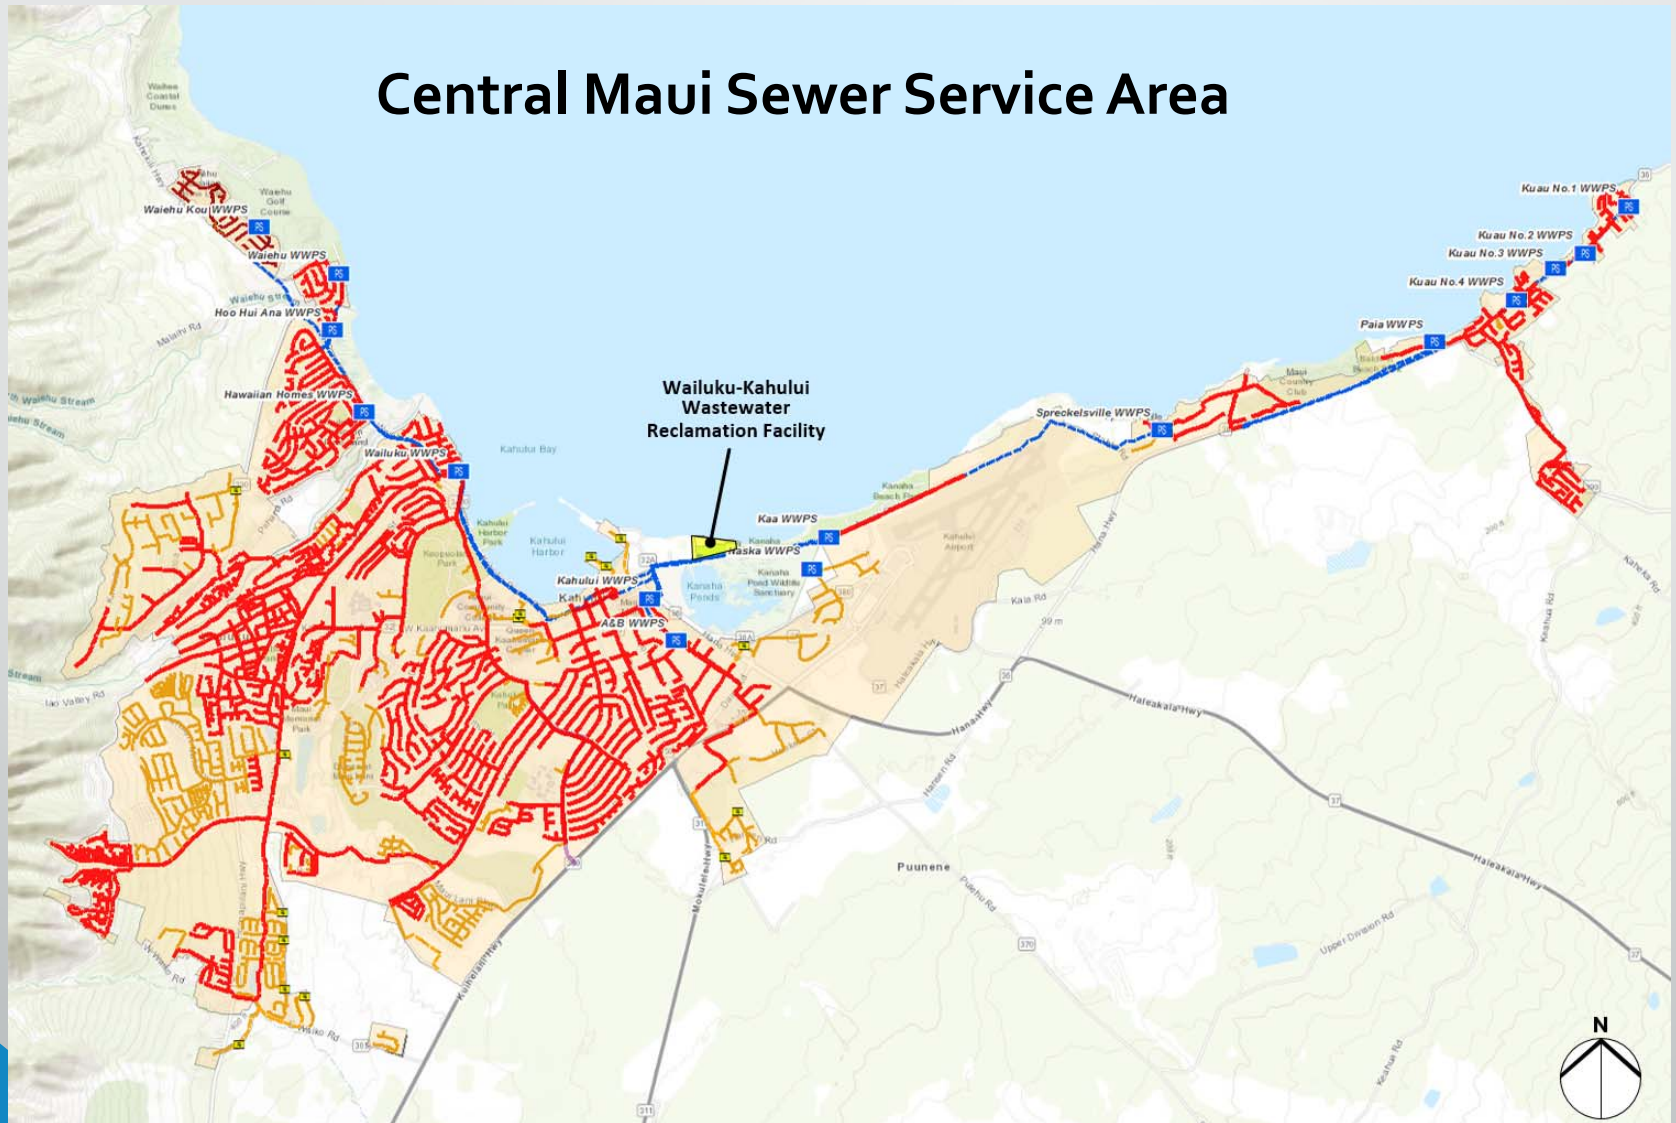

CENTRAL MAUI Reuse Expansion

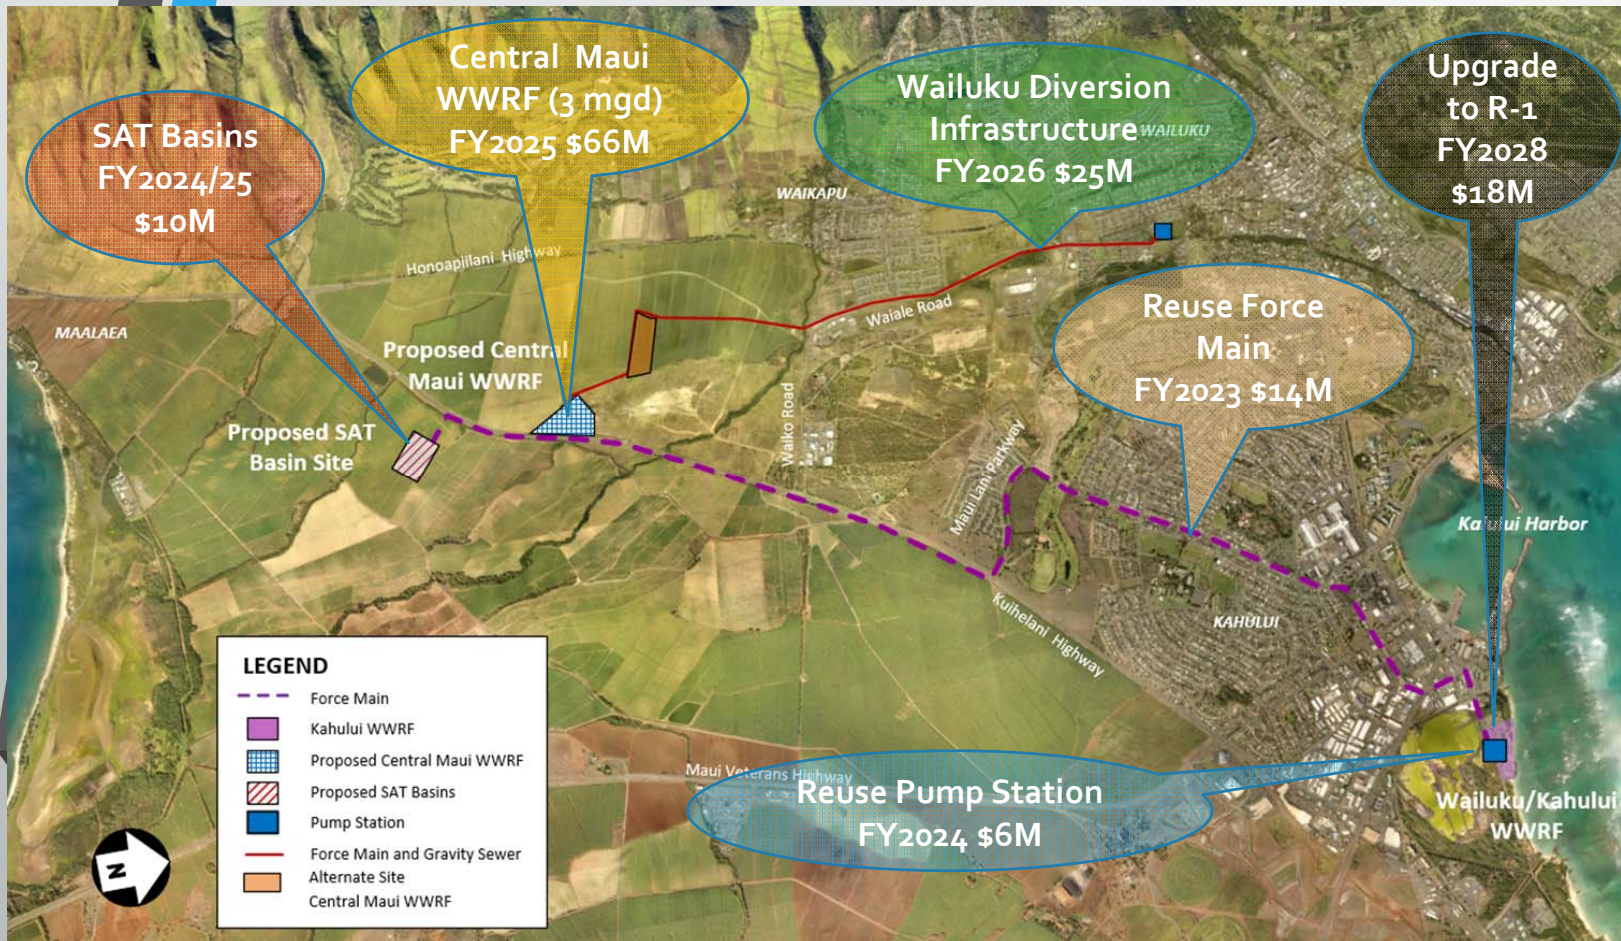

WAILUKU/KAHULUI WWRF:

Average Daily Plant Flow


5.6 mgd

Average Daily Reuse


500,000 gpd

9%

ANNUAL WWRD CIP COSTS

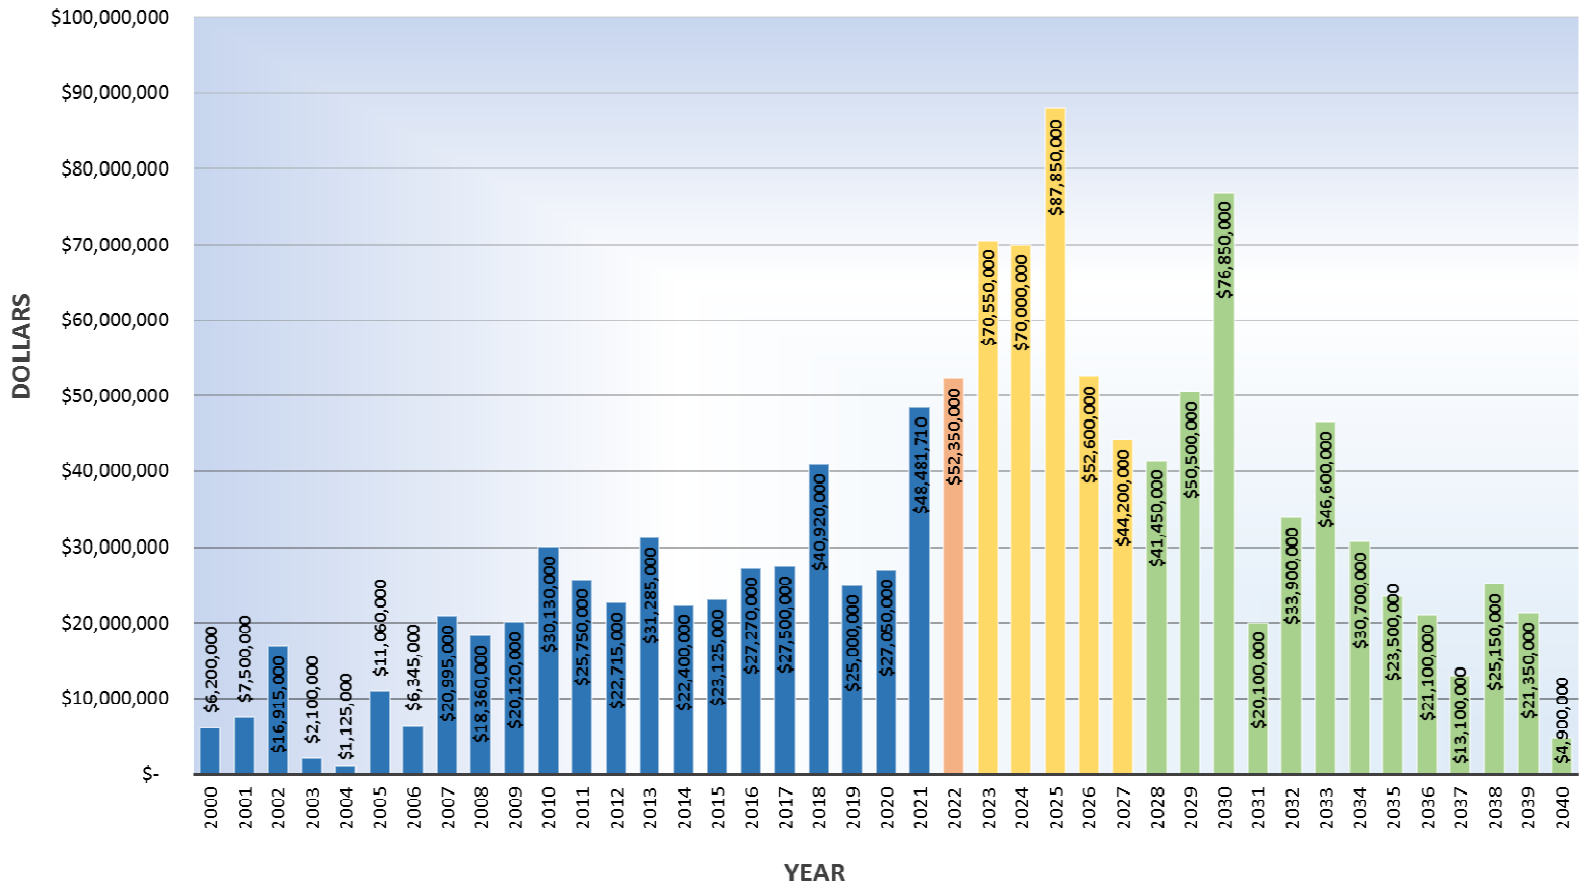

HISTORY OF MAUI SEWER RATES (Maximum Billing Single-Family Residence)

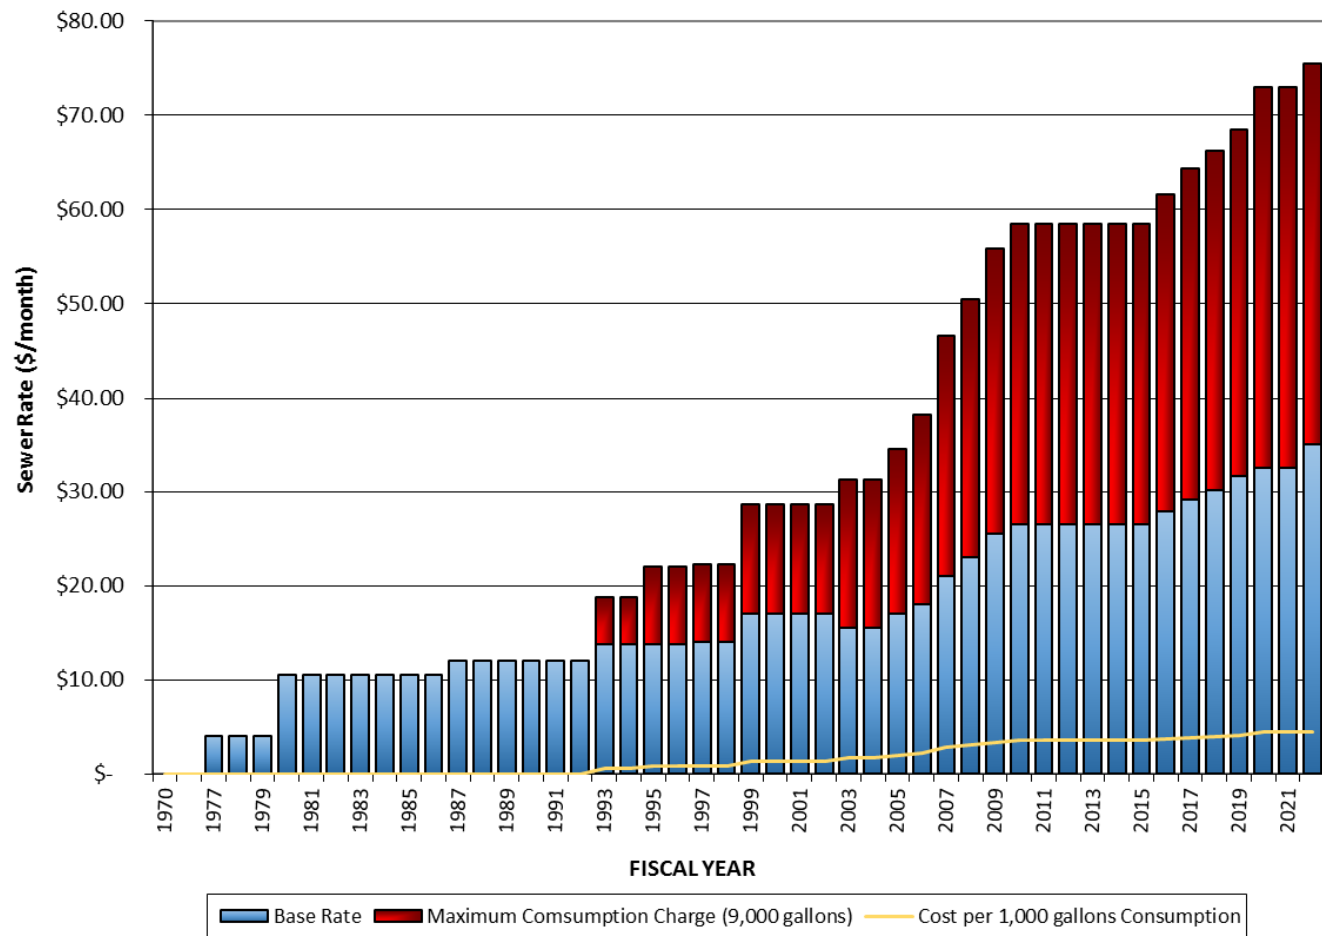



Thank you