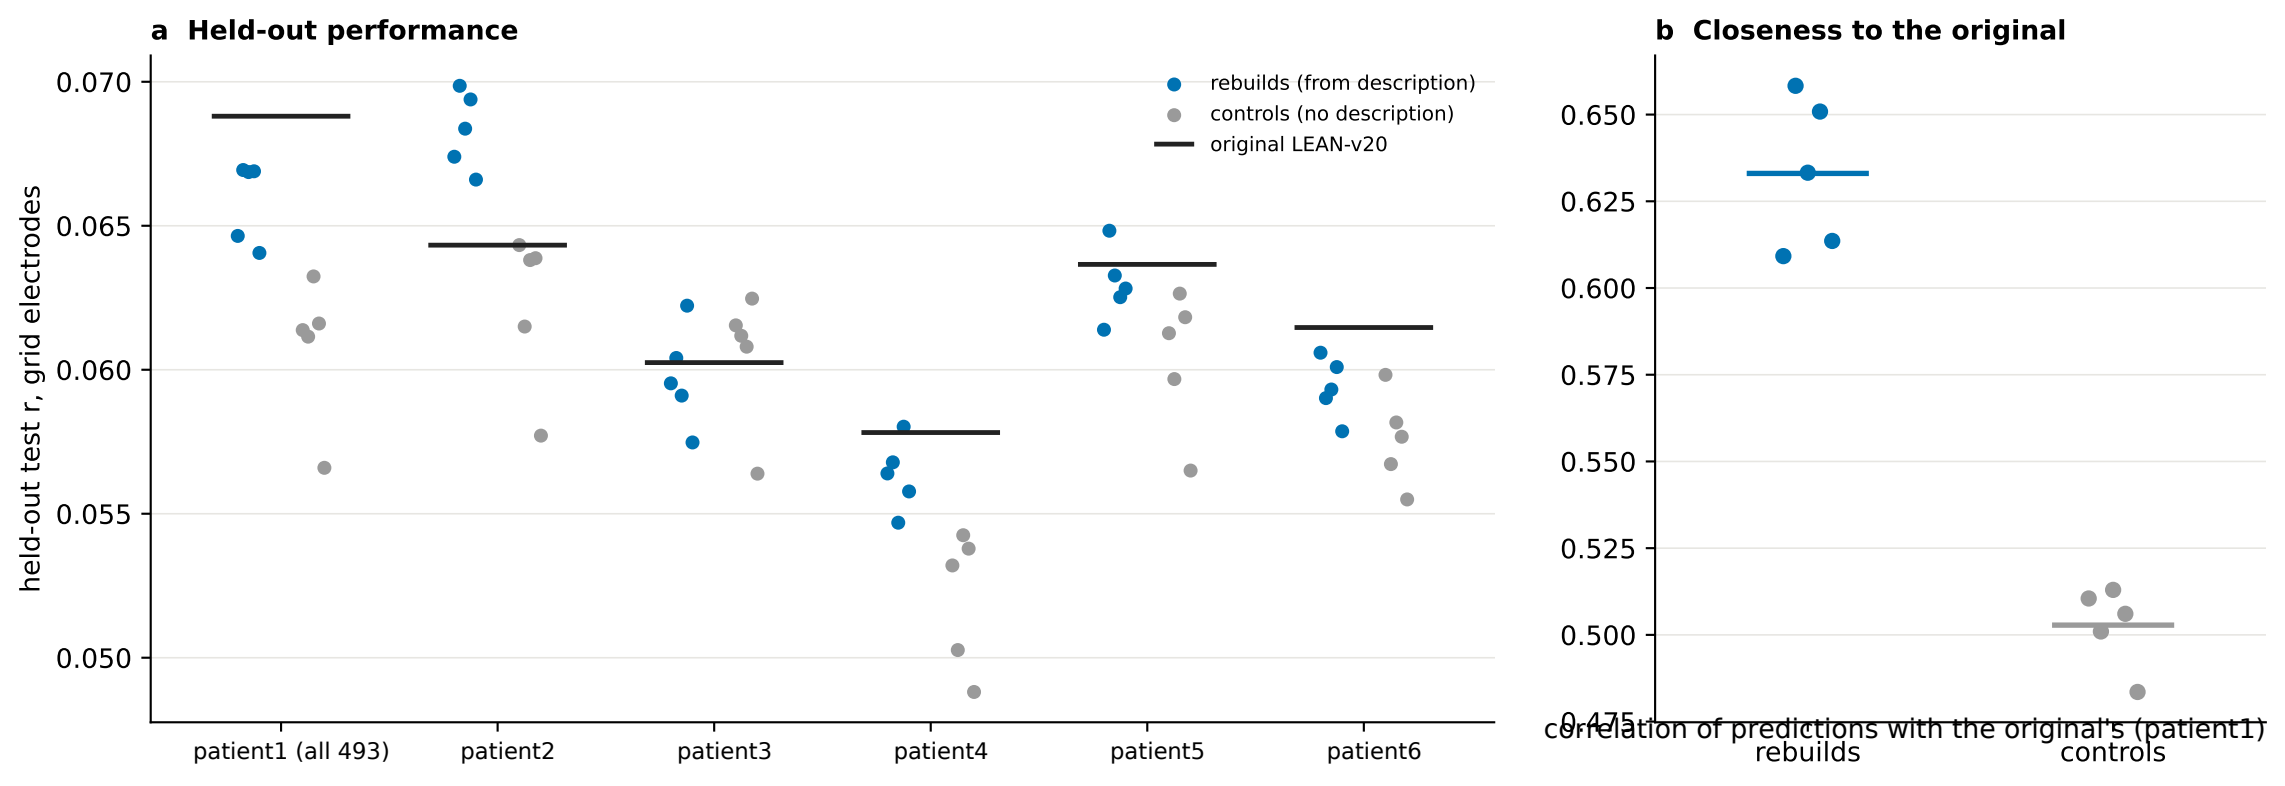

a Held-out performance
rebuilds (from description)
controls (no description)
original LEAN-v20
held-out test r, grid electrodes
0.070
0.065
0.060
0.055
0.050
patient1 (all 493)
patient2
patient3
patient4
patient5
patient6
b Closeness to the original
correlation of predictions with the original's (patient1)
0.650
0.625
0.600
0.575
0.550
0.525
0.500
0.475
rebuilds
controls