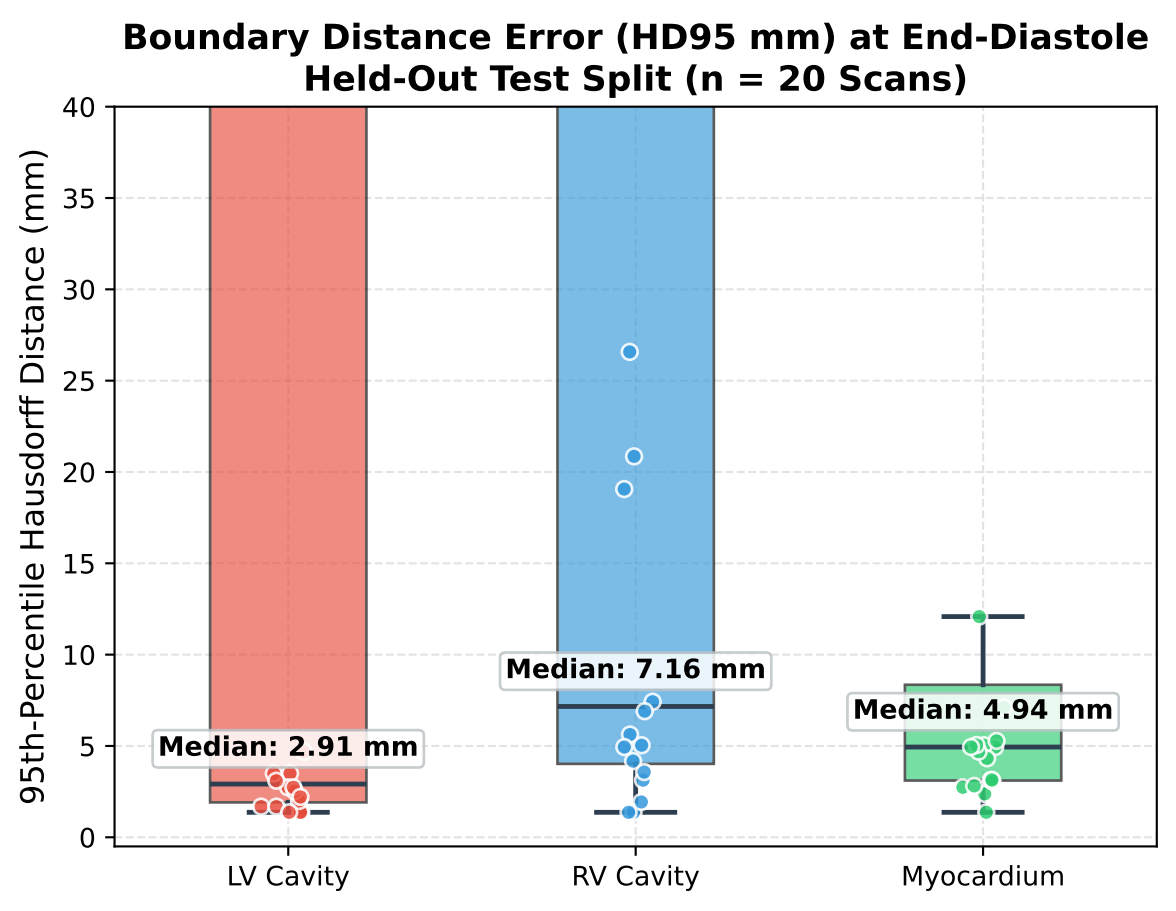
Boundary Distance Error (HD95 mm) at End-Diastole
Held-Out Test Split (n = 20 Scans)
95th-Percentile Hausdorff Distance (mm)
0
5
10
15
20
25
30
35
40
Median: 2.91 mm
Median: 7.16 mm
Median: 4.94 mm
LV Cavity
RV Cavity
Myocardium