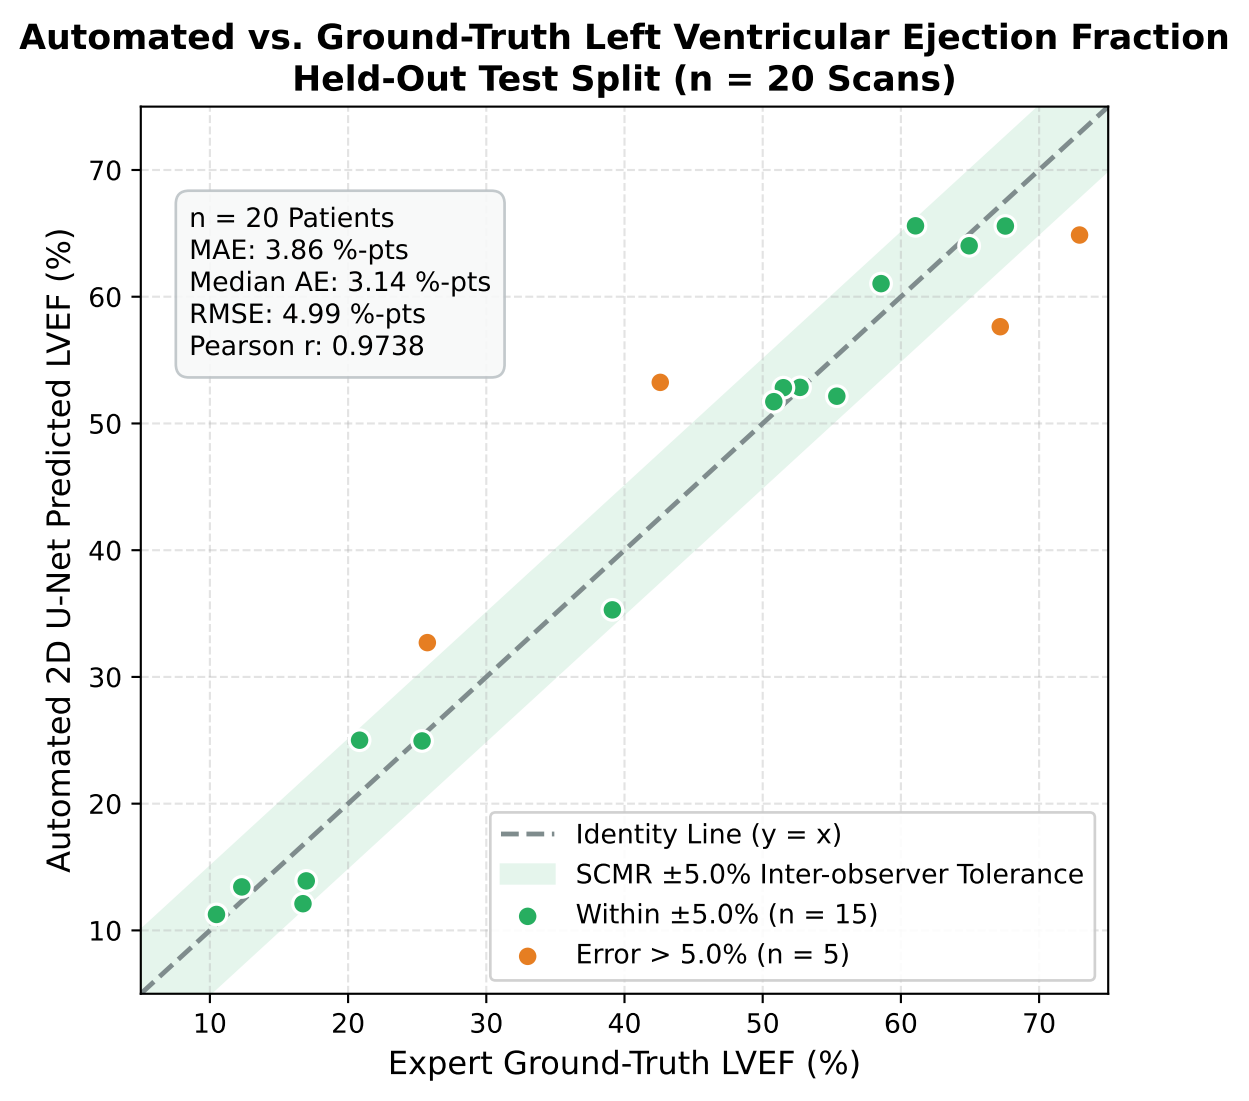
Automated vs. Ground-Truth Left Ventricular Ejection Fraction
Held-Out Test Split (n = 20 Scans)
n = 20 Patients
MAE: 3.86 %-pts
Median AE: 3.14 %-pts
RMSE: 4.99 %-pts
Pearson r: 0.9738
Identity Line (y = x)
SCMR ±5.0% Inter-observer Tolerance
Within ±5.0% (n = 15)
Error > 5.0% (n = 5)
Automated 2D U-Net Predicted LVEF (%)
Expert Ground-Truth LVEF (%)
10
20
30
40
50
60
70