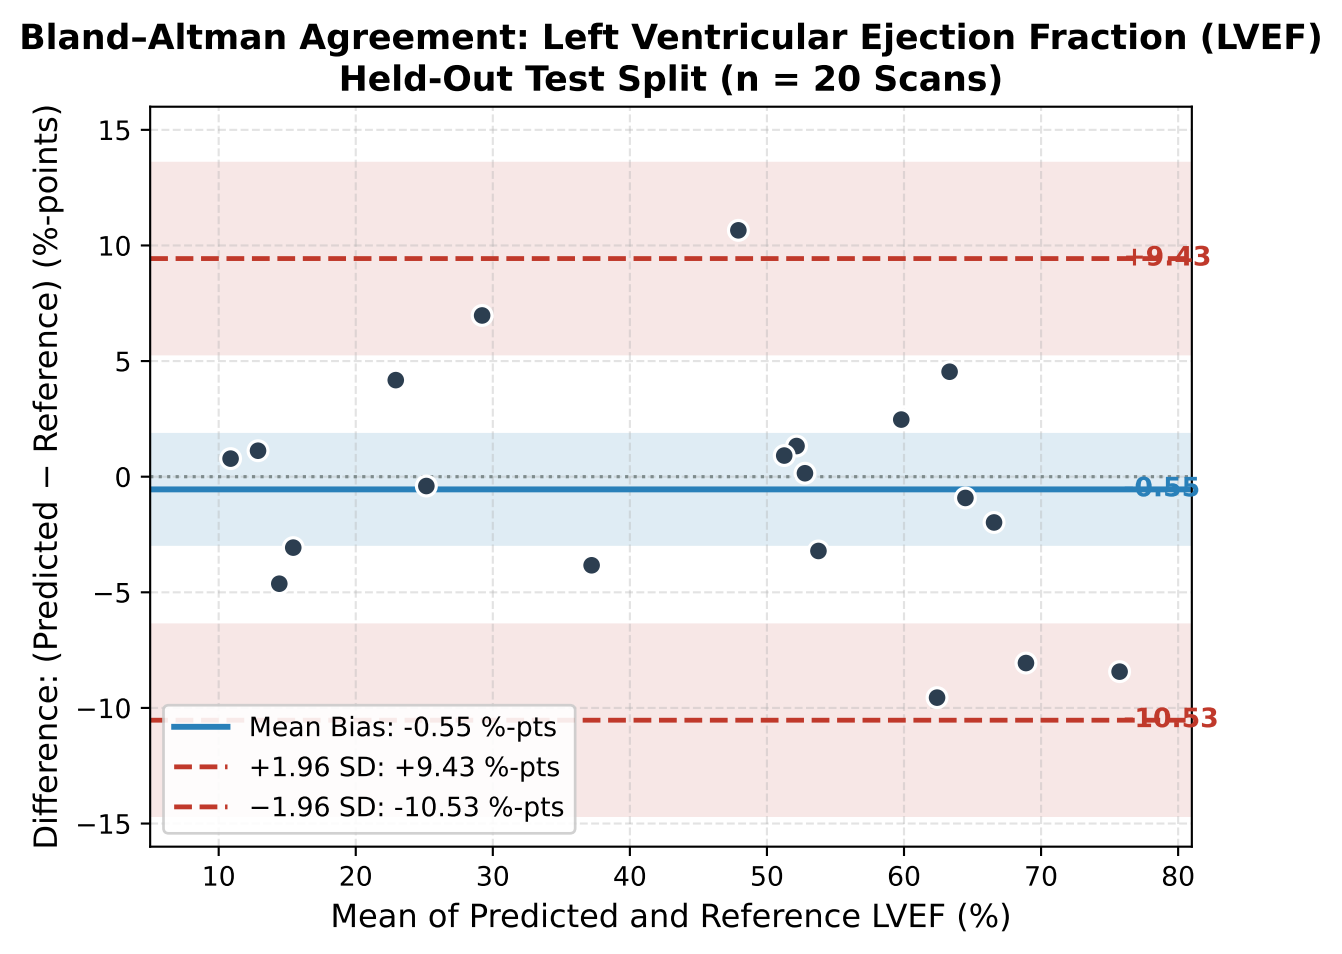
Bland–Altman Agreement: Left Ventricular Ejection Fraction (LVEF)
Held-Out Test Split (n = 20 Scans)
Difference: (Predicted − Reference) (%-points)
Mean of Predicted and Reference LVEF (%)
+9.43
0.55
−10.53
Mean Bias: -0.55 %-pts
+1.96 SD: +9.43 %-pts
−1.96 SD: -10.53 %-pts
15
10
5
0
−5
−10
−15
10
20
30
40
50
60
70
80