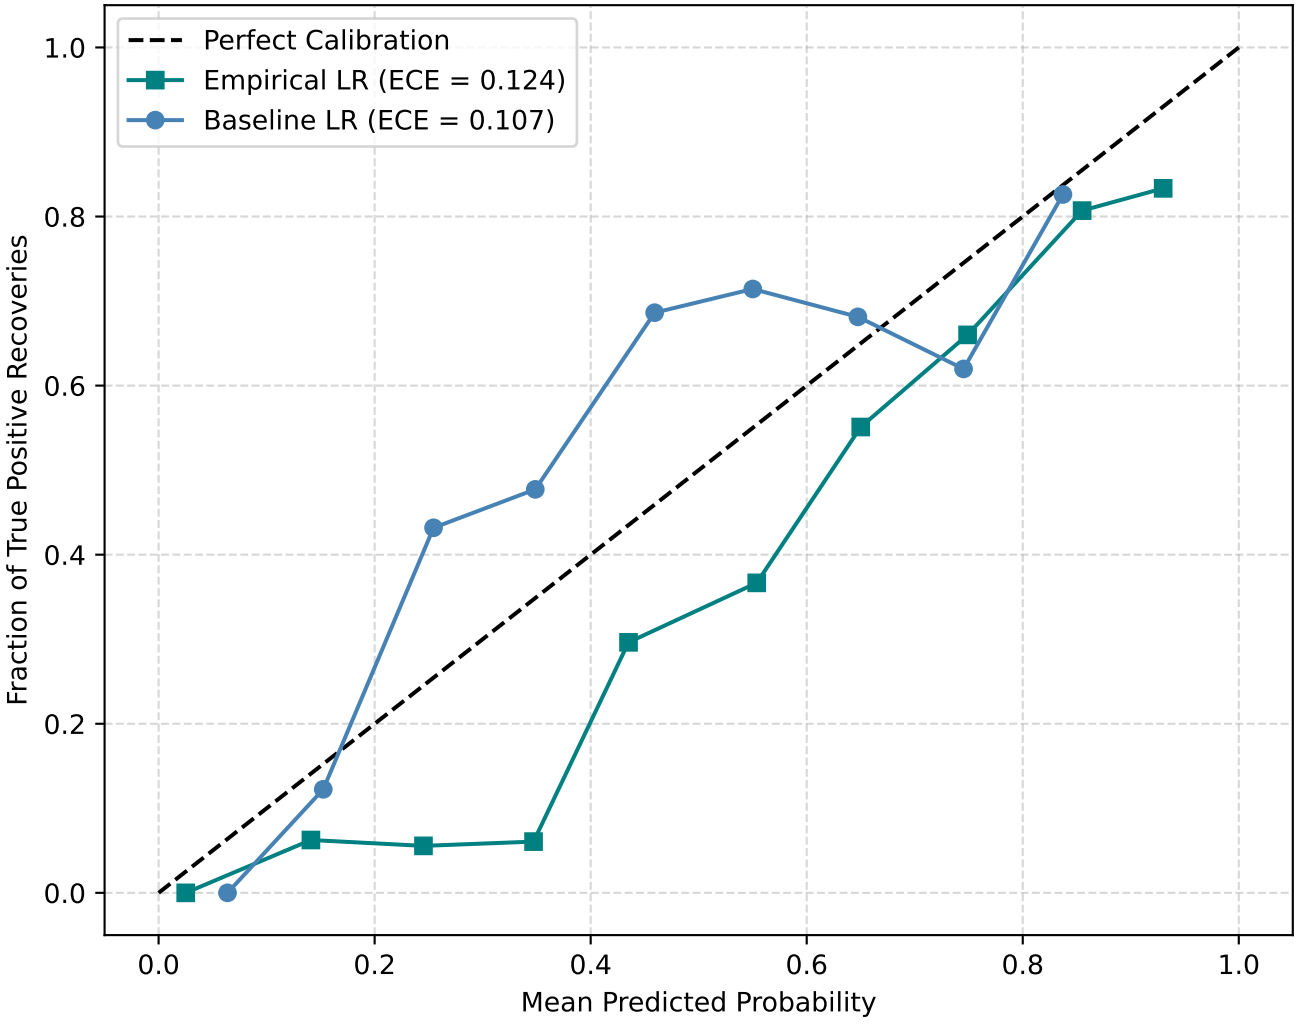
Figure 6: Model Calibration and Reliability Diagrams
(Evaluated on Held-Out All-Comers Synthetic Test Split N=450)
Perfect Calibration
Empirical LR (ECE = 0.124)
Baseline LR (ECE = 0.107)
Fraction of True Positive Recoveries
Mean Predicted Probability
0.0
0.2
0.4
0.6
0.8
1.0