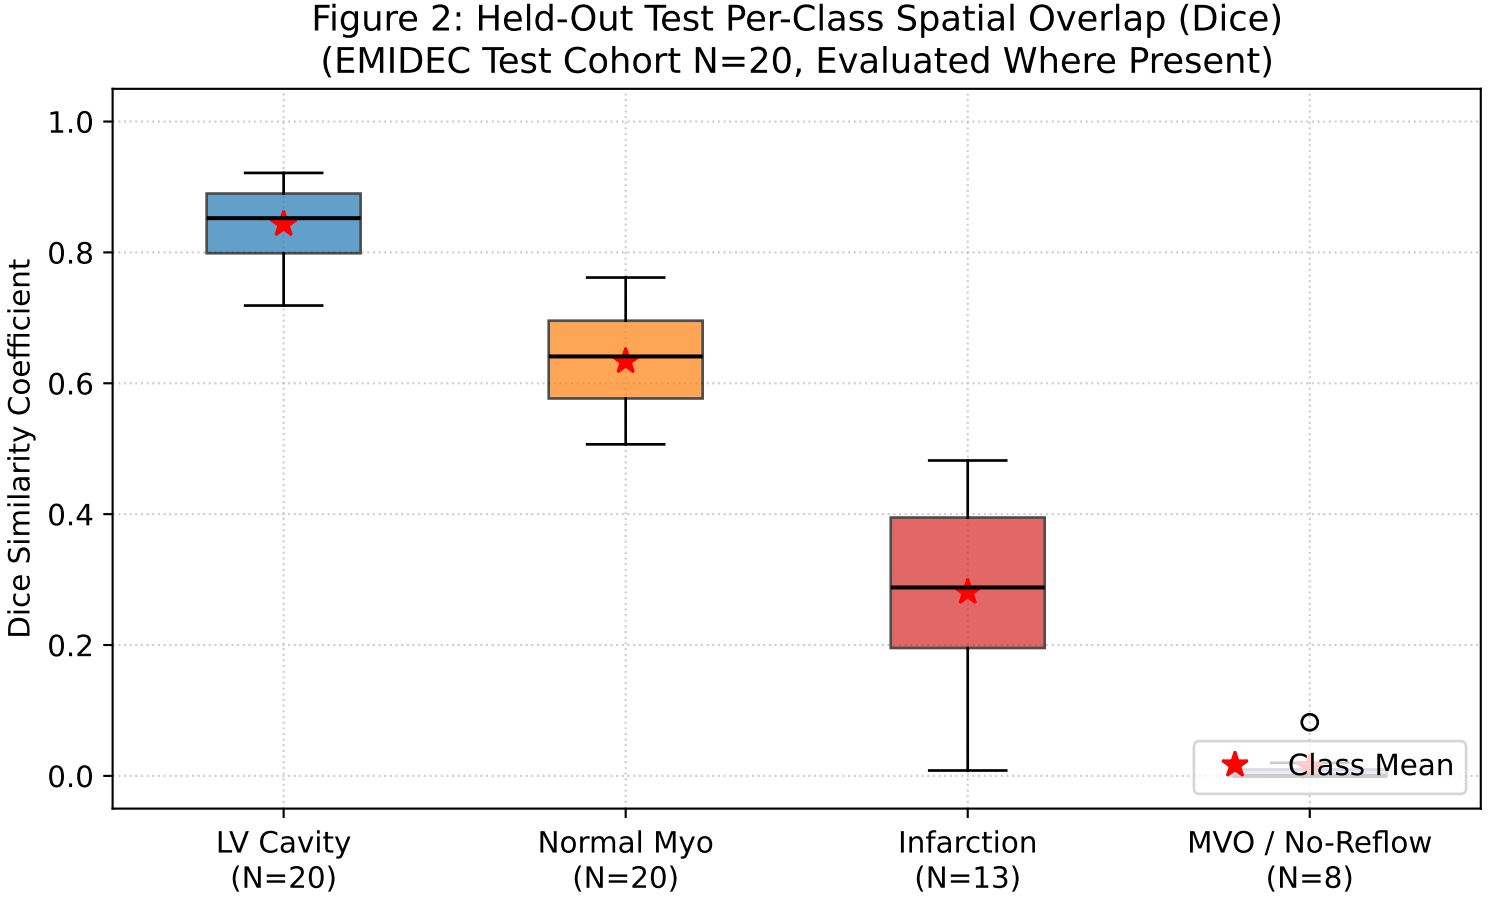
Figure 2: Held-Out Test Per-Class Spatial Overlap (Dice)
(EMIDEC Test Cohort N=20, Evaluated Where Present)
Dice Similarity Coefficient
1.0
0.8
0.6
0.4
0.2
0.0
Class Mean
LV Cavity
(N=20)
Normal Myo
(N=20)
Infarction
(N=13)
MVO / No-Reflow
(N=8)