

USAG DAEGU

STANDARD OPERATING PROCEDURE

WATER LINE BREAKS

2 January 2020

TABLE OF CONTENTS

	<u>PAGE</u>
1. PURPOSE	1
2. APPLICATION	2
3. GENERAL	2
4. REFERENCES	2
5. TASK SEQUENCE FOR WATER LINE BREAK	2
6. EMERGENCY WATER SAMPLING	3
7. POINT OF CONTACT	4
8. APPENDIX LISTING	4

1. PURPOSE.

- a. This SOP describes policies and procedures for all construction and maintenance activities at United States Army Garrison Daegu (USAG-Daegu) in response to water line breaks. This SOP reflects current Army doctrine to include Army Regulation, DA Pamphlets, Field Manuals, Technical Manuals, Circulars, and Bulletins.

2. APPLICATION.

- a. This standard operating procedure (SOP) supersedes previous guidance and applies to all construction and maintenance work at USAG Daegu and any tenant organizations whom are serviced by the USAG Daegu DPW.
- b. The scope of this SOP is to expedite water restoration to the community in the event of a water line break and ensure notification to the community and leadership. See Appendix A for a pictorial representation of this SOP.

3. GENERAL.

- a. Water line breaks impact mission and the community. They interrupt water flow to the community, create sources of possible cross contamination and impede fire safety missions.
- b. In the event of a water line break, the USAG-Daegu DPW will work to expedite water restoration to the community for firefighting and public use and drinking in accordance with this SOP.

4. REFERENCES.

- a. AR 420-1, Army Facilities Management, 24 Aug 12.
- b. AR 385-10, The Army Safety Program, 24 Feb 17.

5. TASK SEQUENCE FOR WATER LINE BREAK.

- a. After a water line break action must be taken immediately to expedite water restoration to the community for firefighting and public use and drinking.
- b. To expedite and standardize response, this SOP includes a flowchart for O&M Division personnel to follow to focus efforts, improve coordination, and standardize notifications to communicate clearly with the community.
- c. The following emergency response considerations will be considered.

- (1) Priority of effort is first on stopping the loss of water/damage, second to repair and restore water service, and third to flush and sample to verify potability. Public notification will follow each phase to keep the community and leadership informed.
- (2) All internal division communication and notification will be by telephone or in person. No communication will wait in an OMD 'inbox' or voicemail.
- (3) Overtime and compensatory hours will be tracked through the ESO process with the fire department communications operator to properly account for time.
- (4) Water treatment plant operators will perform initial sampling as an additional duty if the physical science technician is unavailable. Water treatment operators will be trained by a physical science technician and a training record roster will be maintained for records.
- (5) Safety is essential during emergency response.

6. EMERGENCY WATER SAMPLING.

- a. After a water main break, or other event of possible contamination, water must be sampled for potability as soon as possible after restoration. This provides expedited water restoration to the community and improves the response time in the event that non-potable water is detected to minimize the chance of inadvertent drinking by the community.
- b. To minimize response time, water treatment plant operators will perform sampling as an additional duty if the physical science technician is unavailable (Leave, TDY, odd hours, un-available to contact by phone). The following restrictions apply to this additional duty:
 - (1) Sampling will only be done as response to an emergent situation and is not a daily duty.
 - (2) Water treatment operators will be trained by a physical science technician and a training record roster will be maintained.

7. Point of Contact.

The point of contact for this SOP is Mr. Timothy L. Seifert, Mechanical Chief, DSN 763-5332 (Camp Walker VOIP).

SEAN M. TABONE.
O&M Division Chief, DPW

APPENDIX


A. Procedure Illustration

B. Standardized Notification Format

C. Emergency Water Outage Notice

Appendix A

Start

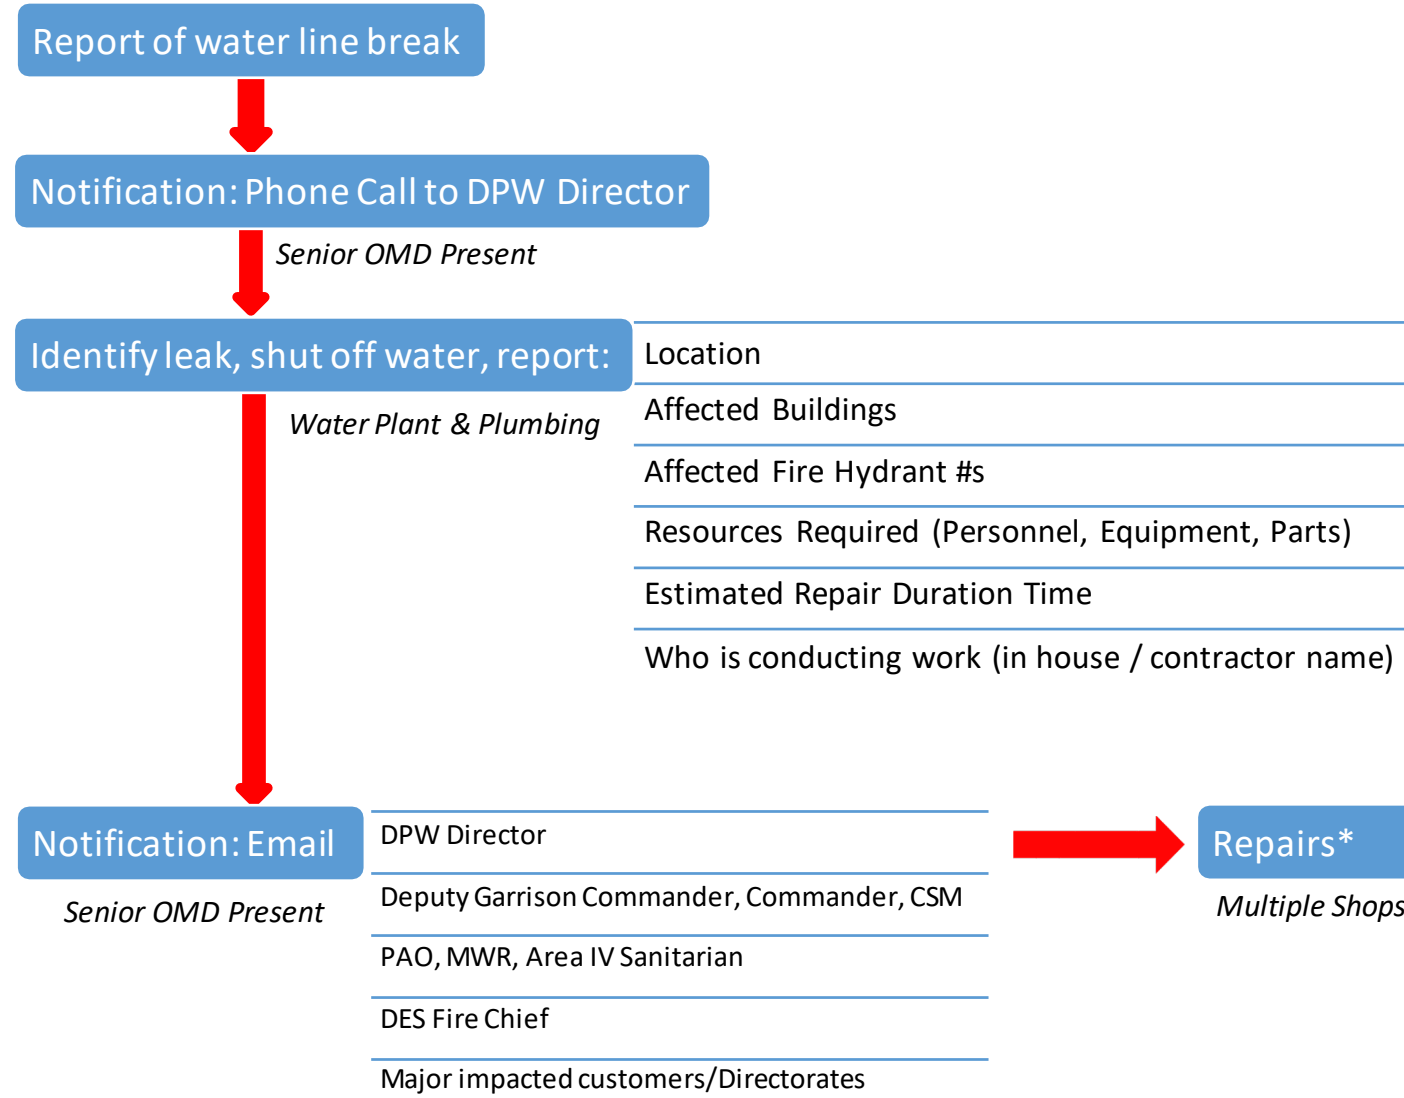

Repairs*

Multiple Shops

Post outage notices*
Conduct repairs*
Track L&E for AFJ SO/WO
Report to Fire Station for OT work
Flush
Sample
Notify complete

End

Notification: Email – Water Potable

Senior OMD Present

Analyze Sample, post notices*

Water Plant

Notification: Email – Water restored, do not drink for 24 hours

Senior OMD Present

** If leak is caused by contractor, contractor will post notices and perform repairs to restore dam*

Appendix B

Song, Ted Sung CIV USARMV IMCOM PACIFIC (USA)

From: Song, Ted Sung CIV USARMY IMCOM PACIFIC (USA)
Sent: Tuesday, May 21, 2019 12:07 PM
To: USARMY Camp Walker IMCOM List Daegu Outage Notice
Cc: Myers, Raymond S CIV USARMY IMCOM PACIFIC (USA); Tabone, Sean M CIV USARMY IMCOM PACIFIC (USA); Popovich, David L CIV USARMY IMCOM PACIFIC (USA); Chang, U Sok LN USARMY IMCOM PACIFIC (KOR); Flasphaler, Darryl J CIV USARMY MEDCOM KOR (US); Kim, So Haeng LN USARMY MEDCOM KOR (KOR); Song, Hyein LN USARMY IMCOM PACIFIC (KOR); Yi, Tong Chu LN USARMY IMCOM PACIFIC (KOR); Rogers, William CIV USARMY IMCOM PACIFIC (USA)
Subject: Closeout: EXSUM - Emergency Partial Water Outage and Repair Work near Bldg No. 20 (Permanently closed VMF, H-805 Area), Camp Walker, 1000 - 1400, 17 May 2019 (Friday)
Signed By: ted.s.song.civ@mail.mil

To ALL:

Closeout: Water test results have confirmed that water at Camp Walker facilities affected by Friday's (17 May 2019) water line break meets the USFK drinking water quality standards (USFK Regulation 201-1 Chapter 3).

Final closeout notification
that situation is resolved
and water is potable.

The water test results have been posted at the affected facilities.

If you have any questions or need more information, please let me know.

Thanks,

Very Respectfully,

M r. Ted S. Song
Chief of Mechanical Branch, O&M Division
DPW USAG Daegu, Unit# 15746,
Bldg No. 706, Camp Walker, Daegu, ROK
Desk: 763-5332
DSN: 315-763-5332
From U.S.A.: 011-82-503363-5332
Korea Cell: 010-8582-3053
ted.s.song.civ@mail.mil
We are the Army's Home, Serving the Rugged Professional

-----Original Message-----

From: Song, Ted Sung CIV USARMY IMCOM PACIFIC (USA)
Sent: Friday, May 17, 2019 1:33 PM
To: USARMY Camp Walker IMCOM List Daegu Outage Notice
<usarmy.walker.imcom.list.daegu-outage-notice@mail.mil>

Cc: Myers, Raymond S CIV USARMY IMCOM PACIFIC (USA)
<raymond.s.myers4.civ@mail.mil>; Tabone, Sean M CIV USARMY IMCOM PACIFIC
(USA) <sean.m.tabone.civ@mail.mil>; Popovich, David L CIV USARMY IMCOM
PACIFIC (USA) <david.1.popovich.civ@mail.mil>; Chang, U Sok LN USARMY IMCOM
PACIFIC (KOR) <usok.chang.ln@mail.mil>; Flasphaler, Darryl J CIV USARMY
MEDCOM KOR (US) <darryl.j.flasphaler.civ@mail.mil>; Kim, So Haeng LN USARMY
MEDCOM KOR (KOR) <sohaeng.kim.ln@mail.mil>; Song, Hyein LN USARMY IMCOM
PACIFIC (KOR) <hyein.song.ln@mail.mil>; Yi, Tong Chu LN USARMY IMCOM PACIFIC
(KOR) <tongchu.yi.ln@mail.mil>
Subject: Update: EXSUM - Emergency Partial Water Outage and Repair Work near
Bldg No. 20 (Permanently closed VMF, H-805 Area), Camp Walker, 1000 - 1400,
17 May 2019 (Friday)

To ALL:

Update: Water service is restored to Camp Walker facilities affected by
today's water line break.

Water Restoration notice
with warning not to drink
water until test results
confirmed

Water at the following facilities, Camp Walker must be boiled before
drinking:

- * Bldg# 450 (DPW O&MD),
- * Bldg# 706 (DPW O&MD),
- * Bldg No. 452 & 720 (Fire Station)

DPW is conducting water quality analysis testing and will notify affected
users when the water is safe to drink (approximately within 24 hours from
the time of restoration).

If you have any questions, please let me know.

Very Respectfully,

Mr. Ted S. Song
Chief of Mechanical Branch, O&M Division
DPW USAG Daegu, Unit# 15746,
Bldg No. 706, Camp Walker, Daegu, ROK
315-763-5332 (WK)
010-8582-3053 (Cell)
ted.s.song.civ@mail.mil
We are the Army's Home, Serving the Rugged Professional

-----Original Message-----

From: Song, Ted Sung CIV USARMY IMCOM PACIFIC (USA)
Sent: Friday, May 17, 2019 10:33 AM
To: USARMY Camp Walker IMCOM List Daegu Outage Notice
<usarmy.walker.imcom.list.daegu-outage-notice@mail.mil>
Cc: Myers, Raymond S CIV USARMY IMCOM PACIFIC (USA)
<raymond.s.myers4.civ@mail.mil>; Tabone, Sean M CIV USARMY IMCOM PACIFIC

Recipients: USAG Daegu
Outage Notice Members: CDR,
Deputy CDR, CSM, DPW, FED,
DES/Fire Chief, MWR, and PAO

CC'd: Impacted users/
directorates, Area IV
Sanitarian (MEDDAC-K)

{USA} <sean.m.tabone.civ@mail.mil>; Popovich, David L CIV USARMY IMCOM
PACIFIC {USA} <david.l.popovich.civ@mail.mil>; Chang, U Sok LN USARMY IMCOM
PACIFIC (KOR) <usok.chang.ln@mail.mil>; Flasphaler, Darryl J CIV USARMY
MEDCOM KOR (US) <darryl.j.flasphaler.civ@mail.mil>; Kim, So Haeng LN USARMY
MEDCOM KOR (KOR) <sohaeng.kim.ln@mail.mil>; Song, Hyein LN USARMY IMCOM
PACIFIC {KOR} <hyein.song.ln@mail.mil>; Yi, Tong Chu LN USARMY IMCOM PACIFIC
(KOR) <tongchu.yi.ln@mail.mil>

Subject: EXSUM - Emergency Partial Water Outage and Repair Work near Bldg
No. 20 (Permanently closed VMF, H-805 Area), Camp Walker, 1000 - 1400, 17
May 2019 (Friday)

Initial written
notification for water
line break

To ALL:

EXSUM: Emergency repairs to a water break near Bldg# 20 (Permanently closed
VMF, H-805 Area), Camp Walker is underway.

Executive summary:
5Ws, estimate when
water will be restored.

Anticipated duration: 1000 - 1400 (4 hrs), 17 May 2019

Affected Buildings

Affected Buildings(No water during the repairs): Bldg# 450 {DPW O&MD), Bldg
No. 706 (DPW O&MD), and Bldg No. 452 & 720 {Fire Station), Camp Walker

Affected Fire Hydrants: 1,2,3,4, and 7, Camp Walker

Impact on fire fighting
capability

Repair work will be accomplished by DPW, O&M Division.

POCs are Mr. Chang, U-Sok at (DSN) 765-8666/Cell) 010-6220-9267 and Ted Song,
(DSN) 764-5816/ Cell) 010-8582-3053.

Upon work completion water at the affected buildings should be boiled prior
to drinking until water quality test results are known.
Normally 24 hrs after sampling.

Notification is being posted at each affected facility.

If you have any questions or need more information, please let me know.

Very Respectfully,

Mr. Ted S. Song
Chief of Mechanical Branch, O&M Division
DPW USAG Daegu, Unit# 15746,
Bldg No. 706, Camp Walker, Daegu, ROK
315-763-5332 (WK)
010-8582-3053 (Cell)
ted.s.song.civ@mail.mil
We are the Army's Home, Serving the Rugged Professional

EMERGENCY WATER OUTAGE NOTICE

Date/Time: 17/MAY/2019 (Friday)
1000-1400 Alternate Date/Time: NONE

- We regret any inconvenience this outage may cause.
- Weather or unforeseeable issues may shift outage date.
- Concurrence of designated Bldg Managers/POCs on file.
- For more information contact Primary POCs.
- Date Posted on Buildings: 17 May 2019

1. Site: Camp Waker

**2. Affected Facilities: Bldg#450, 706(DPW O&MD)
#452,720(Fire Station) FH#1,2,3,4,7**

3. This outage is required to repair leaky 2" Water line near Bldg No. 20 (Permanently closed VMF, H-805 Area), Camp Walker.

4. Work by: DPW In-house, Plumbing Shop

5. Primary POCs: Mr. Chang, U Sok at 765-8666 or 010-6220-9267

**6. Approving Outage Project Manager/Originator: Timothy L. Seifert (Mechanical Branch Chief),O&M Division,
timothy.l.seifert.Civ@mail.mil, cell: 010-8582-3053 or 763-5332**

**7. Concurring USAG Daegu DPW Representative: James P. Johnson, USAG Daegu Utility Chief, james.p.johnson2.civ@mail.mil,
cell: 010-8582-0265 <Signature on file.>**