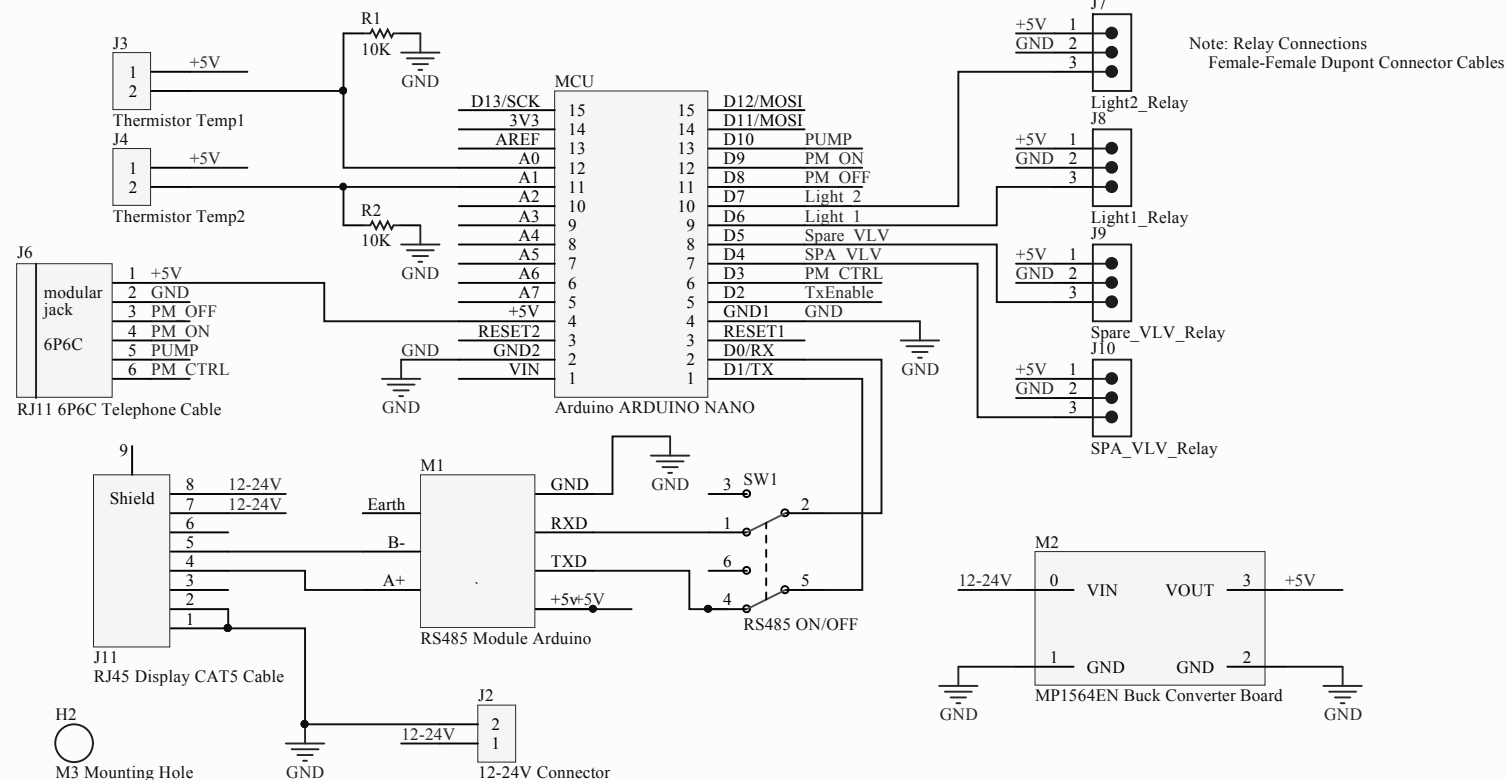


1

2

3

4

H1
M3 Mounting HoleH3
M3 Mounting HoleH4
M3 Mounting Hole


Title		
MODBUS SLAVE Control Board Rev3		
Size	Number	Revision
A4		
Date:	25/07/2018	Sheet of
File:	Sheet1.SchDoc	Drawn By:

1

2

3

4

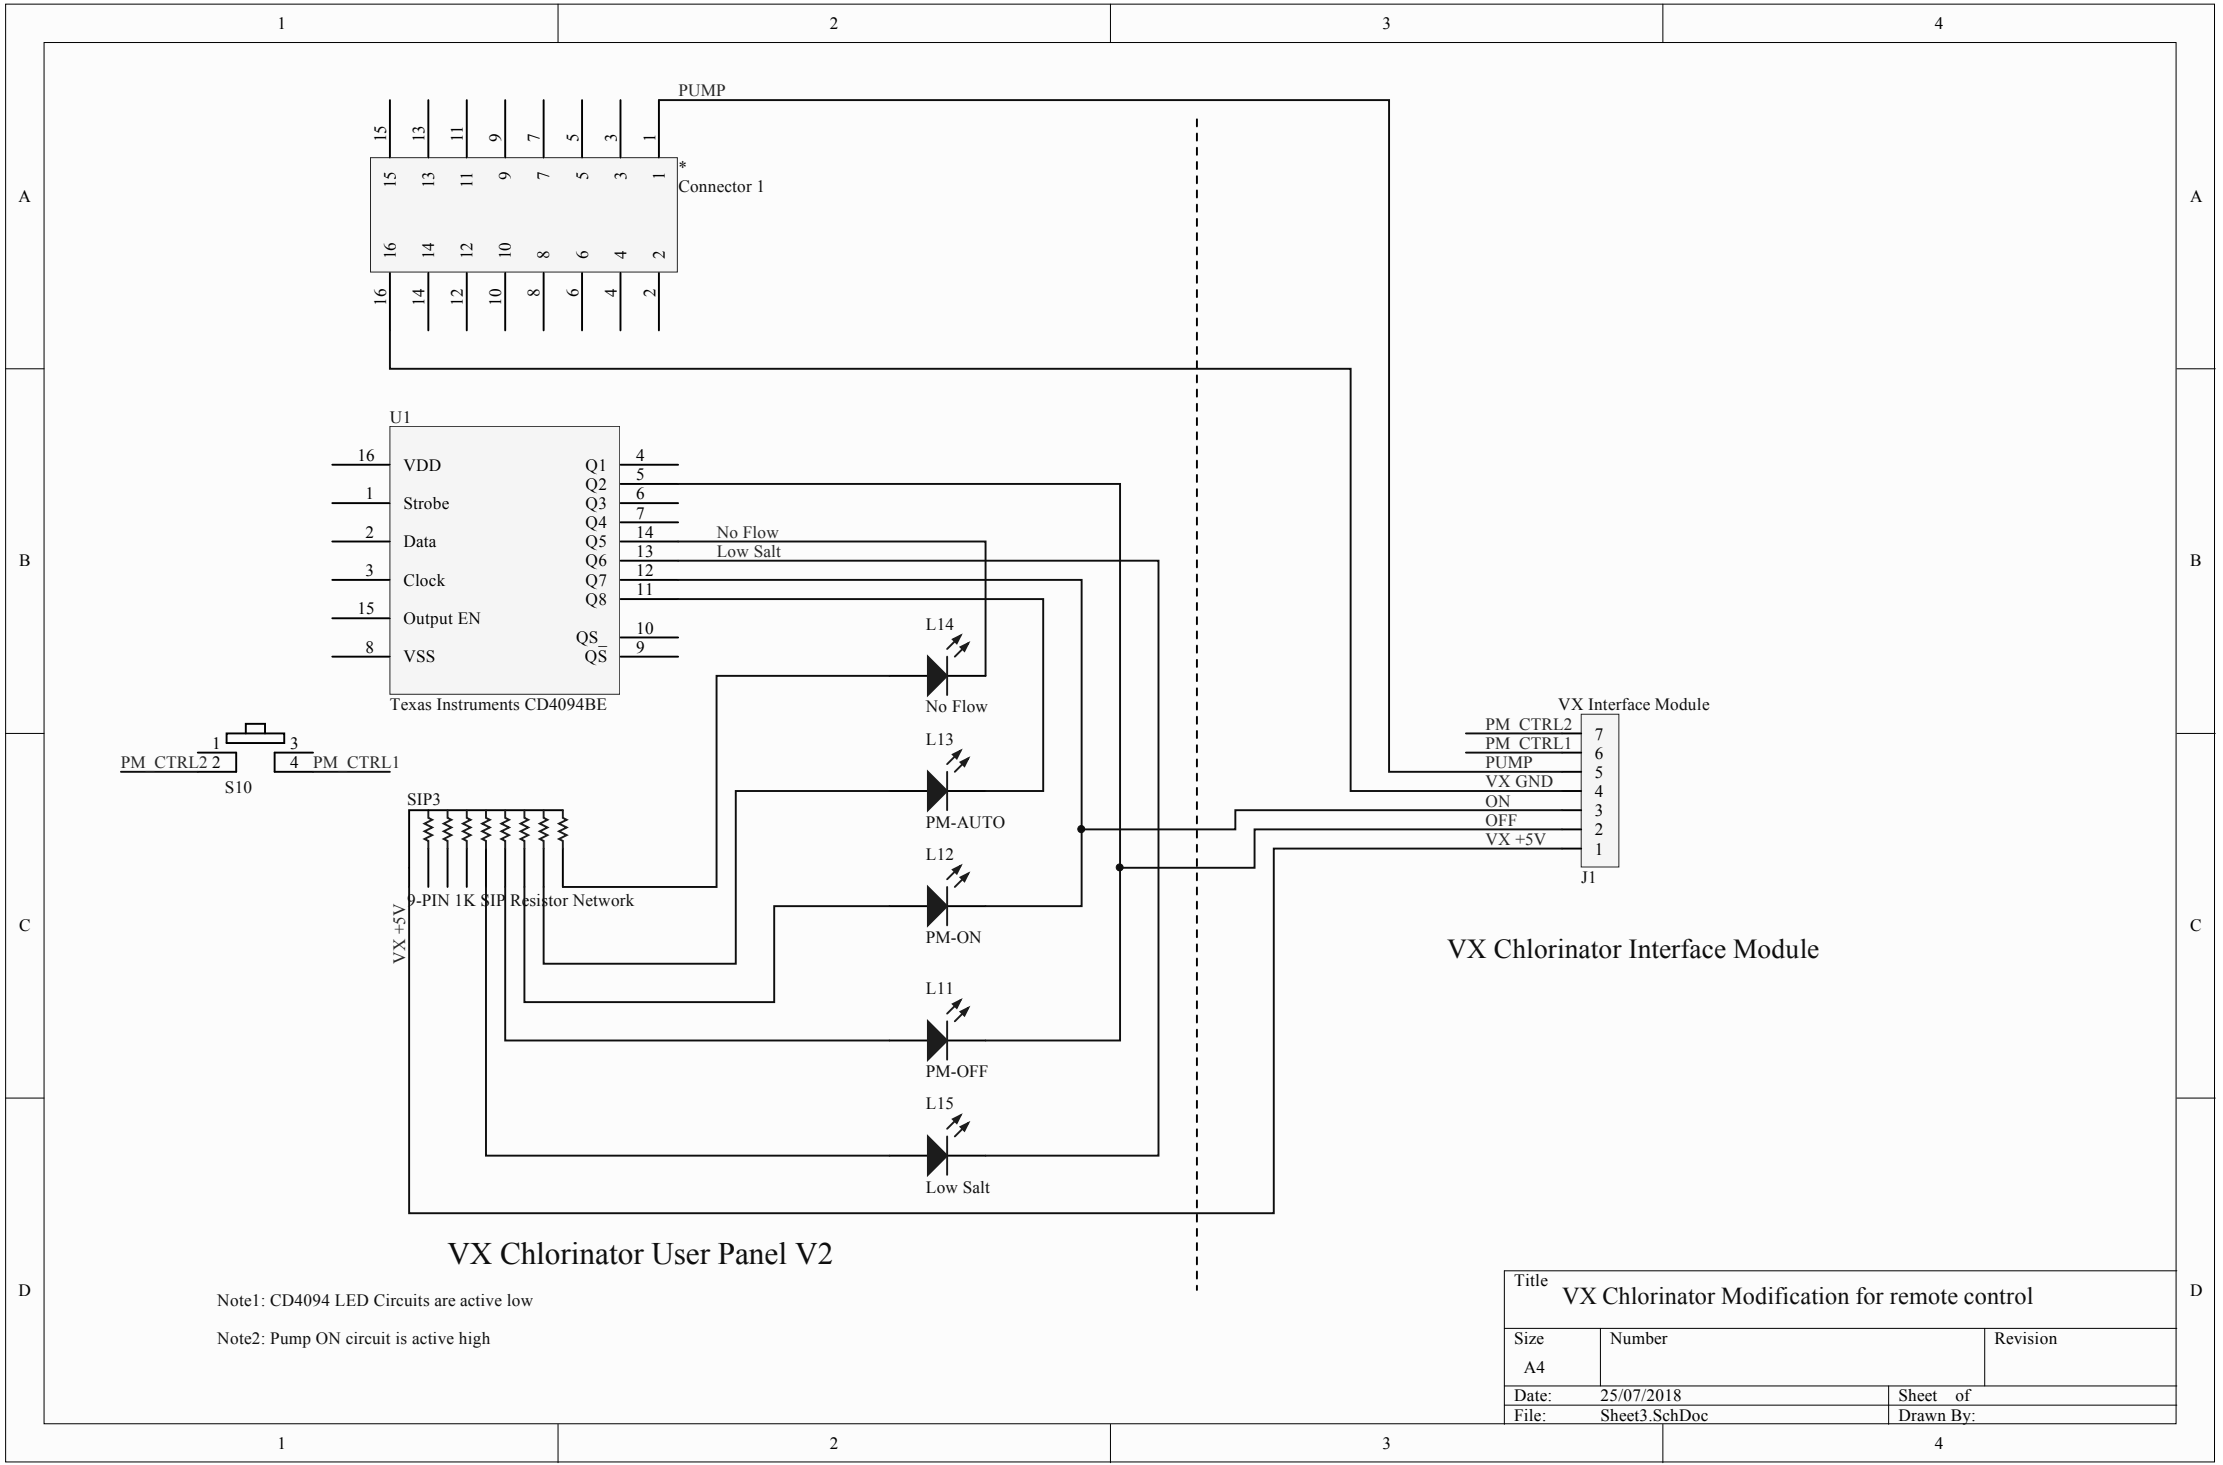


VX Chlorinator User Panel V2

VX Chlorinator Interface Module

Note1: CD4094 LED Circuits are active low

Note2: Pump ON circuit is active high

Title		
VX Chlorinator Modification for remote control		
Size	Number	Revision
A4		
Date:	25/07/2018	Sheet of
File:	Sheet3.SchDoc	Drawn By:

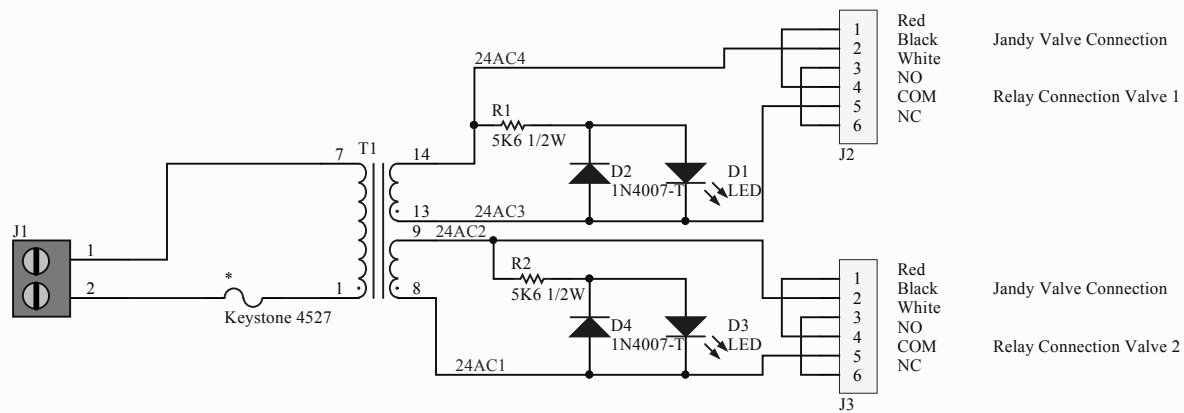

Title			
2x24VAC Jandy Valve Power Supply			
Size	Number		Revision
A4			
Date:	25/07/2018	Sheet of	
File:	Sheet5.SchDoc	Drawn By:	

H1
M3 Mounting Hole



H3
M3 Mounting Hole

J1
1 VX +5V
2 OFF
3 ON
4 VX GND
5 VX PUMP
6 PM_CTRL1
7 PM_CTRL2

J2
6 PM_CTRL
5 PUMP
4 PM_ON
3 PM_OFF
2 GND
1 VCC +5V
6P6C
jack
modular
6P6C Telephone Cable

H2
M3 Mounting Hole

H4
M3 Mounting Hole

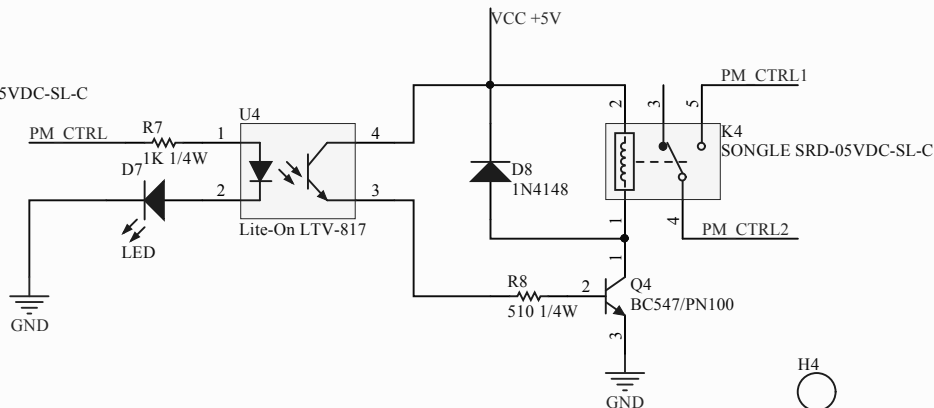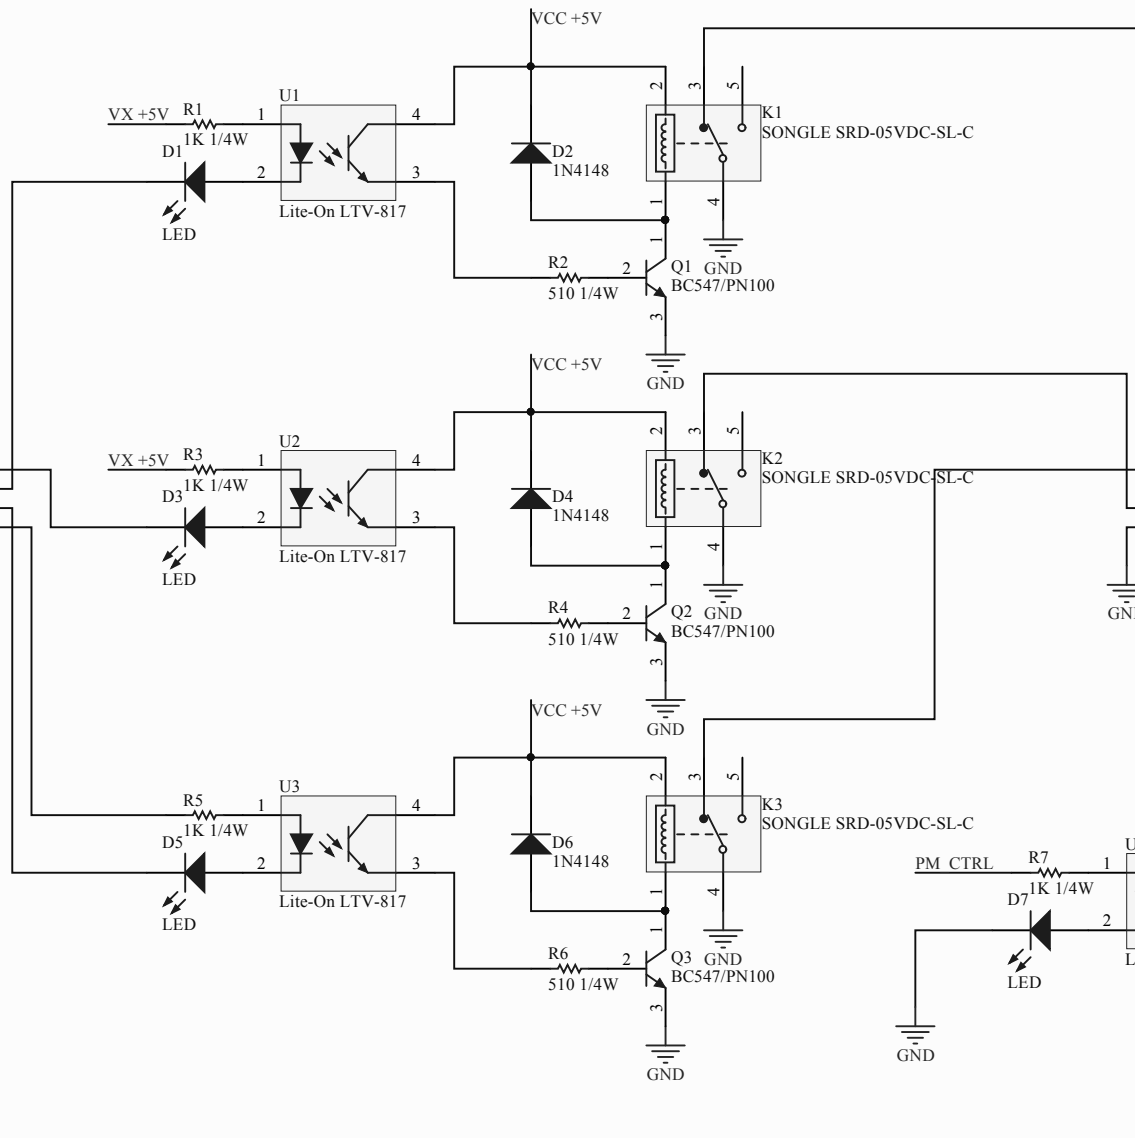

Title		
VX Chlorinator Interface Module		
Size	Number	Revision
A4		
Date:	25/07/2018	Sheet of
File:	Sheet6.SchDoc	Drawn By: