

UC BERKELEY CAPITAL PROJECTS
GATEWAY BUILDING - FL03
BERKELEY, CA 94720

HEADQUARTERS
2500 DE LA CRUZ BLVD.,
SANTA CLARA, CA 95050
P: 669.800.2500

SAN FRANCISCO
475 BRANNAN ST., STE 210,
SAN FRANCISCO, CA 94107
P: 415.357.2200

OAKLAND
7220 EDGEWATER DR.
OAKLAND, CA 94621
P: 510.729.7800

SACRAMENTO
1631 ALHAMBRA BLVD.,
SUITE 120,
SACRAMENTO, CA 95816
P: 916.553.5900

WWW.ONEWORKPLACE.COM

REV.	DESCRIPTION	OWN.	DATE
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

CLIENT _____ DATE _____
CONTACT _____

SHEET TITLE
FL03
OVERALL PLAN

SCALE _____ NTS

START DATE _____ 02.01.24

PROJECT NO. _____ 222313

PROJECT MGR. _____

PHONE NO. _____

ACCT. MGR. _____


PHONE NO. _____

DESIGNER NAME _____ S. LVI G. CANNON

PHONE NO. _____

SHEET NO.

F1

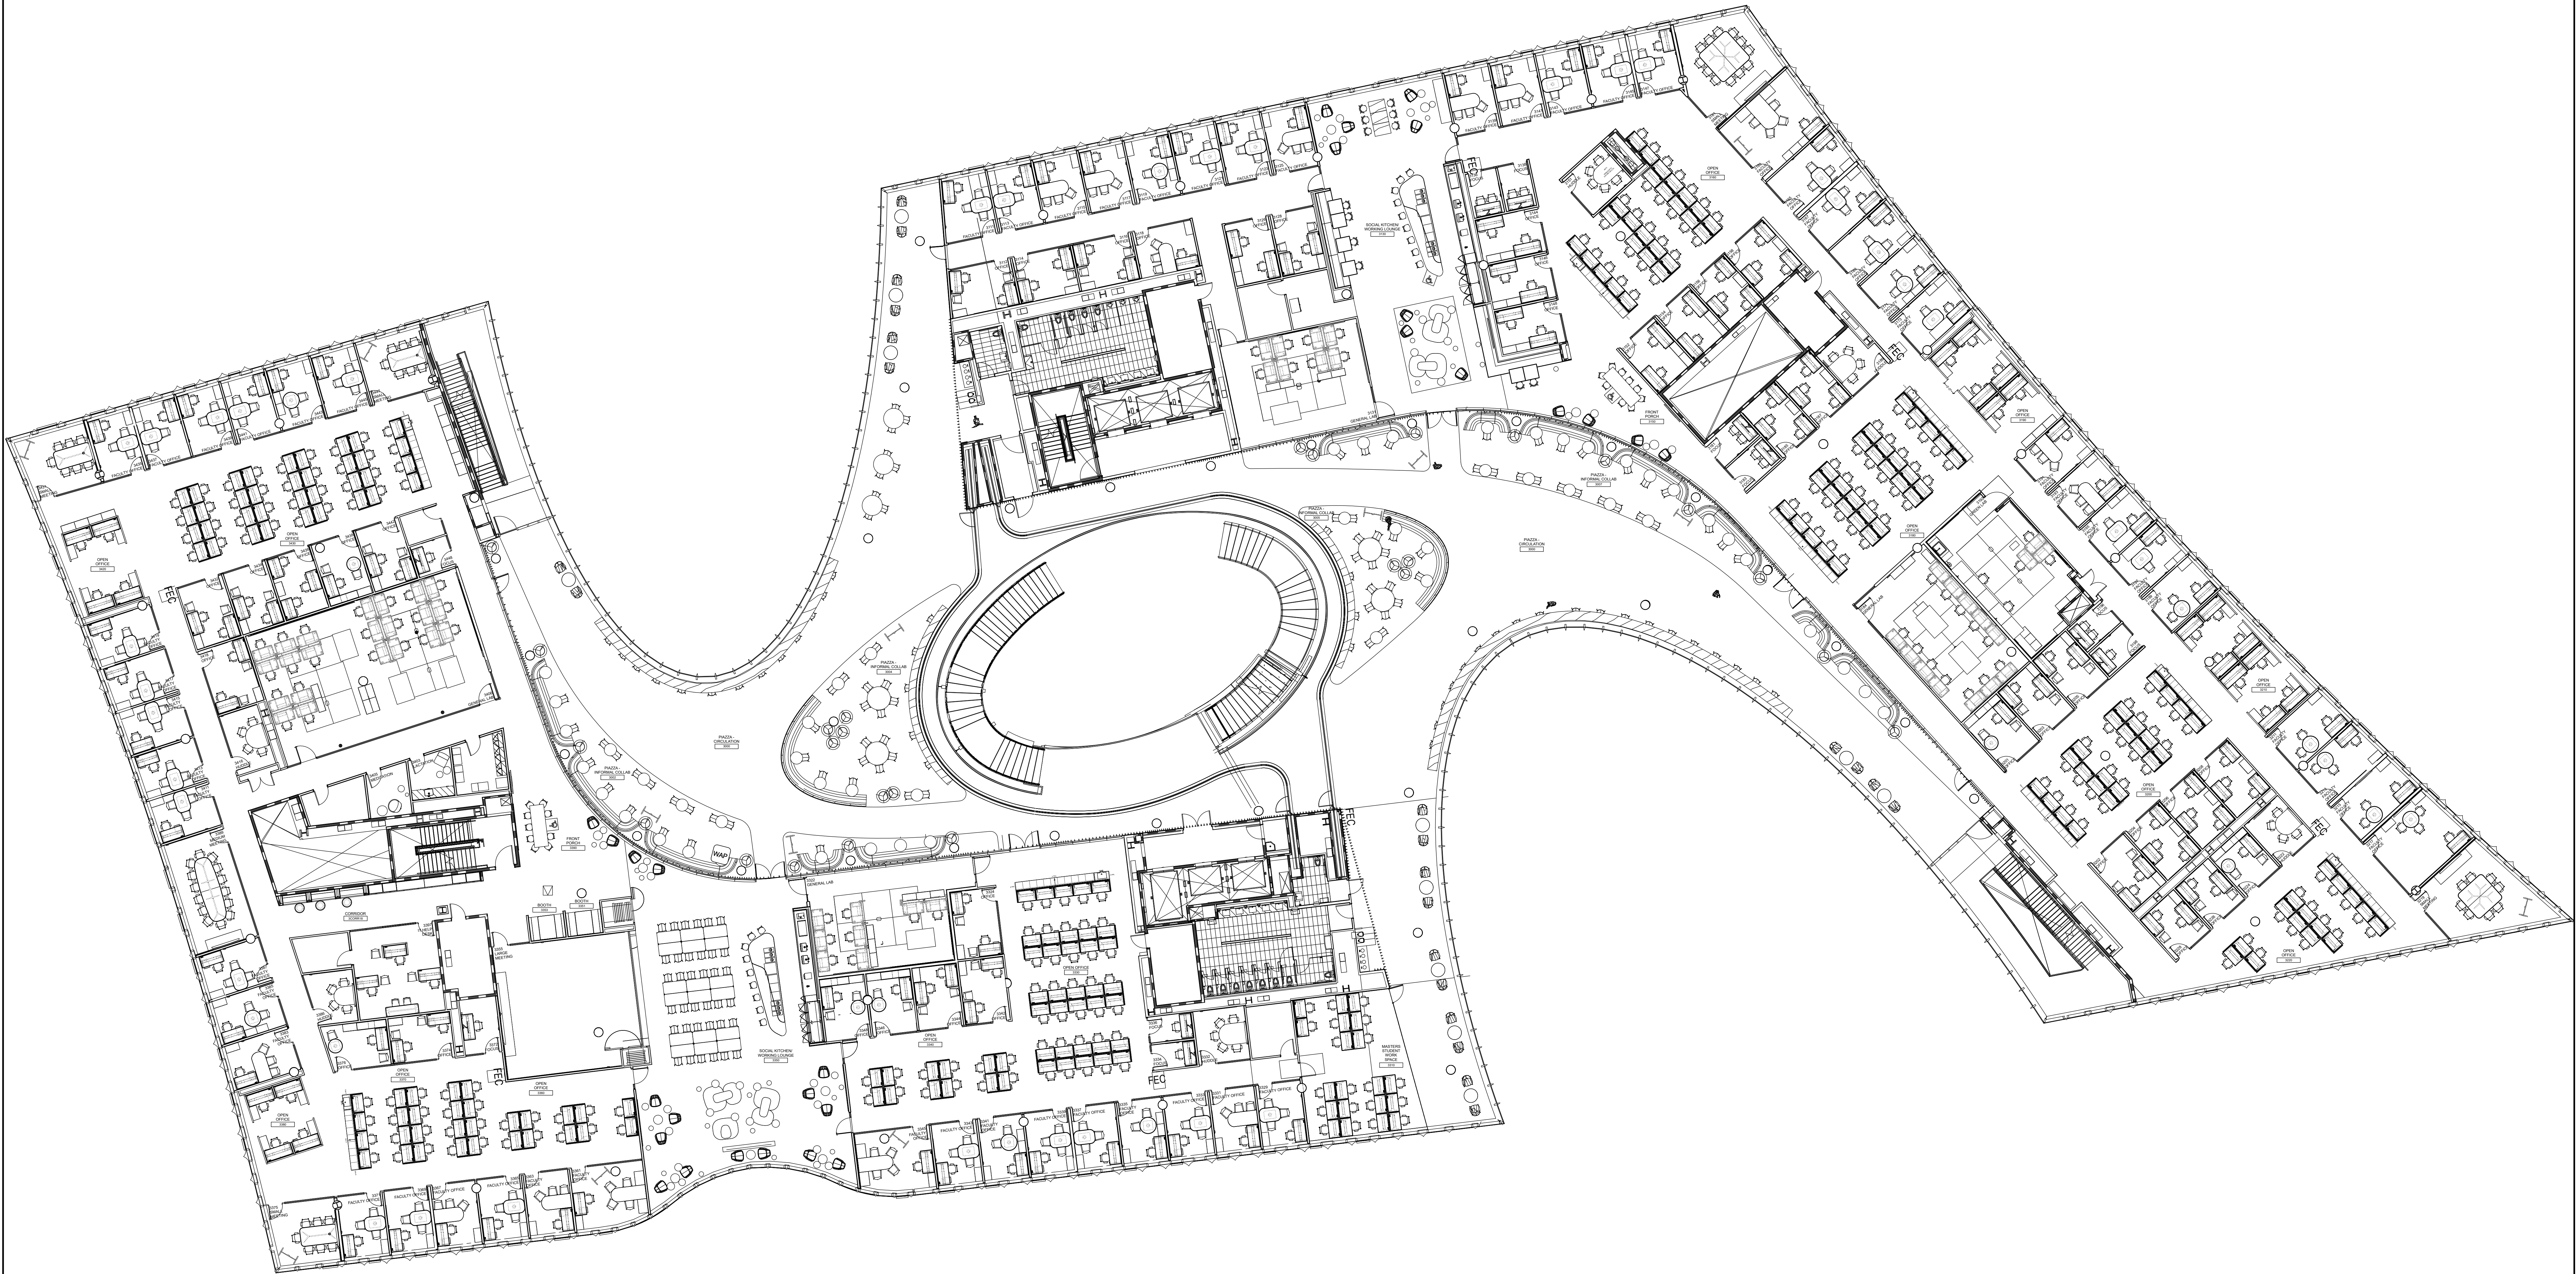

ELECTRICAL NOTES:

- ONE WORKPLACE STUDIO SHALL PROVIDE PLACEMENT INSTRUCTIONS FOR POWER & TELEDATA NECESSARY TO COMPLETE FURNITURE INSTALLATION.
- THE ARCHITECT, ELECTRICAL ENGINEER, AND GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR ADHERENCE TO LOCAL ELECTRICAL CODES.
- ALL AMPERAGE AND ELECTRICAL CIRCUIT REQUIREMENTS SHALL BE DETERMINED BY THE ELECTRICAL ENGINEER.
- ELECTRICAL ENGINEER AND/OR GENERAL CONTRACTOR SHALL COORDINATE ELECTRICAL WIRING SCHEMATICS WITH ONE WORKPLACE STUDIO.
- ONE WORKPLACE STUDIO TO BE NOTIFIED IN THE EVENT THAT PROPOSED POWER/DATA LOCATIONS CANNOT BE ACCOMMODATED.
- ALL ELECTRICAL HARDWARE CONNECTIONS OF FURNITURE AND THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR.
- REVISIONS AND/OR CHANGES TO THESE PLANS MUST BE SUBMITTED TO ONE WORKPLACE STUDIO FOR APPROVAL.

GENERAL NOTES:

- THE CALIFORNIA BUILDING CODE HAS BESEAC DESIGN REQUIREMENTS FOR OBJECTS GREATER THAN 6 FEET IN HEIGHT. THESE OBJECTS ARE REQUIRED TO BE ADEQUATELY BRACED AND/OR ANCHORED TO THE BUILDING STRUCTURE. IT IS THE CUSTOMER'S RESPONSIBILITY TO ADDRESS ANY STRUCTURAL SUBMITTAL REQUIREMENTS FOR THIS PROJECT.
- ALL FURNITURE DIMENSIONS SHOWN ARE HARD DIMENSIONS UNLESS OTHERWISE NOTED.
- ELECTRICAL ENGINEER AND/OR GENERAL CONTRACTOR SHALL COORDINATE ELECTRICAL WIRING SCHEMATICS WITH ONE WORKPLACE STUDIO.
- REVISIONS AND/OR CHANGES TO PLANS MUST BE FORMALLY SUBMITTED TO ONE WORKPLACE STUDIO PRIOR TO IMPLEMENTATION OF SAID REVISIONS.

ARCHITECTURAL DISCLAIMER
IN THE EVENT THAT CONSTRUCTION IS INCOMPLETE AND/OR CLIENT SITE IS UNAVAILABLE FOR FIELD VERIFICATION, ONE WORKPLACE STUDIO ACCEPTS NO RESPONSIBILITY FOR ACCURACY OF ARCHITECTURAL BASE PLANS PROVIDED BY CLIENT AND/OR DESIGN CONSULTANT. ONE WORKPLACE STUDIO WILL PROVIDE CRITICAL DIMENSIONS FOR FURNITURE PLACEMENT. VERIFY SITE PRIOR TO INSTALLATION AND NOTIFY CLIENT AND/OR DESIGN CONSULTANT OF ANY CONFLICTS. CLIENT SHALL INFORM ONE WORKPLACE STUDIO WHEN SITE IS AVAILABLE FOR FIELD VERIFICATION.

NOTE: THIS DOCUMENT (AND ALL DERIVATIVES, SPECS, & ELECTRONIC FILES ASSOCIATED WITH IT) IS PROPRIETARY INFORMATION FOR THE EXCLUSIVE USE OF ONEWORKPLACE.