

UC BERKELEY CAPITAL PROJECTS
GATEWAY BUILDING - FL00
BERKELEY, CA 94720

HEADQUARTERS
2500 DE LA CRUZ BLVD.,
SANTA CLARA, CA 95050
P: 669.800.2500

SAN FRANCISCO
475 BRANNAN ST., STE 210
SAN FRANCISCO, CA 94107
P: 415.357.2200

OAKLAND
7220 EDGEWATER DR.
OAKLAND, CA 94621
P: 510.729.7800

SACRAMENTO
1631 ALHAMBRA BLVD.,
SUITE 120
SACRAMENTO, CA 95816
P: 916.553.5900

SALINAS
325 S. MAIN ST. SALINAS,
CA 93901 P: 669.800.2500

WWW.ONEWORKPLACE.COM

REV.	DESCRIPTION	OWN.	DATE
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

CLIENT _____ DATE _____
CONTACT _____

SHEET TITLE
**FL00
COMPONENT PLAN**

SCALE 1/8" = 1' - 0"

START DATE 02.01.24

PROJECT NO. 222313

PROJECT MGR. _____

PHONE NO. _____

ACCT. MGR. _____


PHONE NO. _____

DESIGNER NAME S. LVI G. CANNON

PHONE NO. _____

SHEET NO. of 1

F1

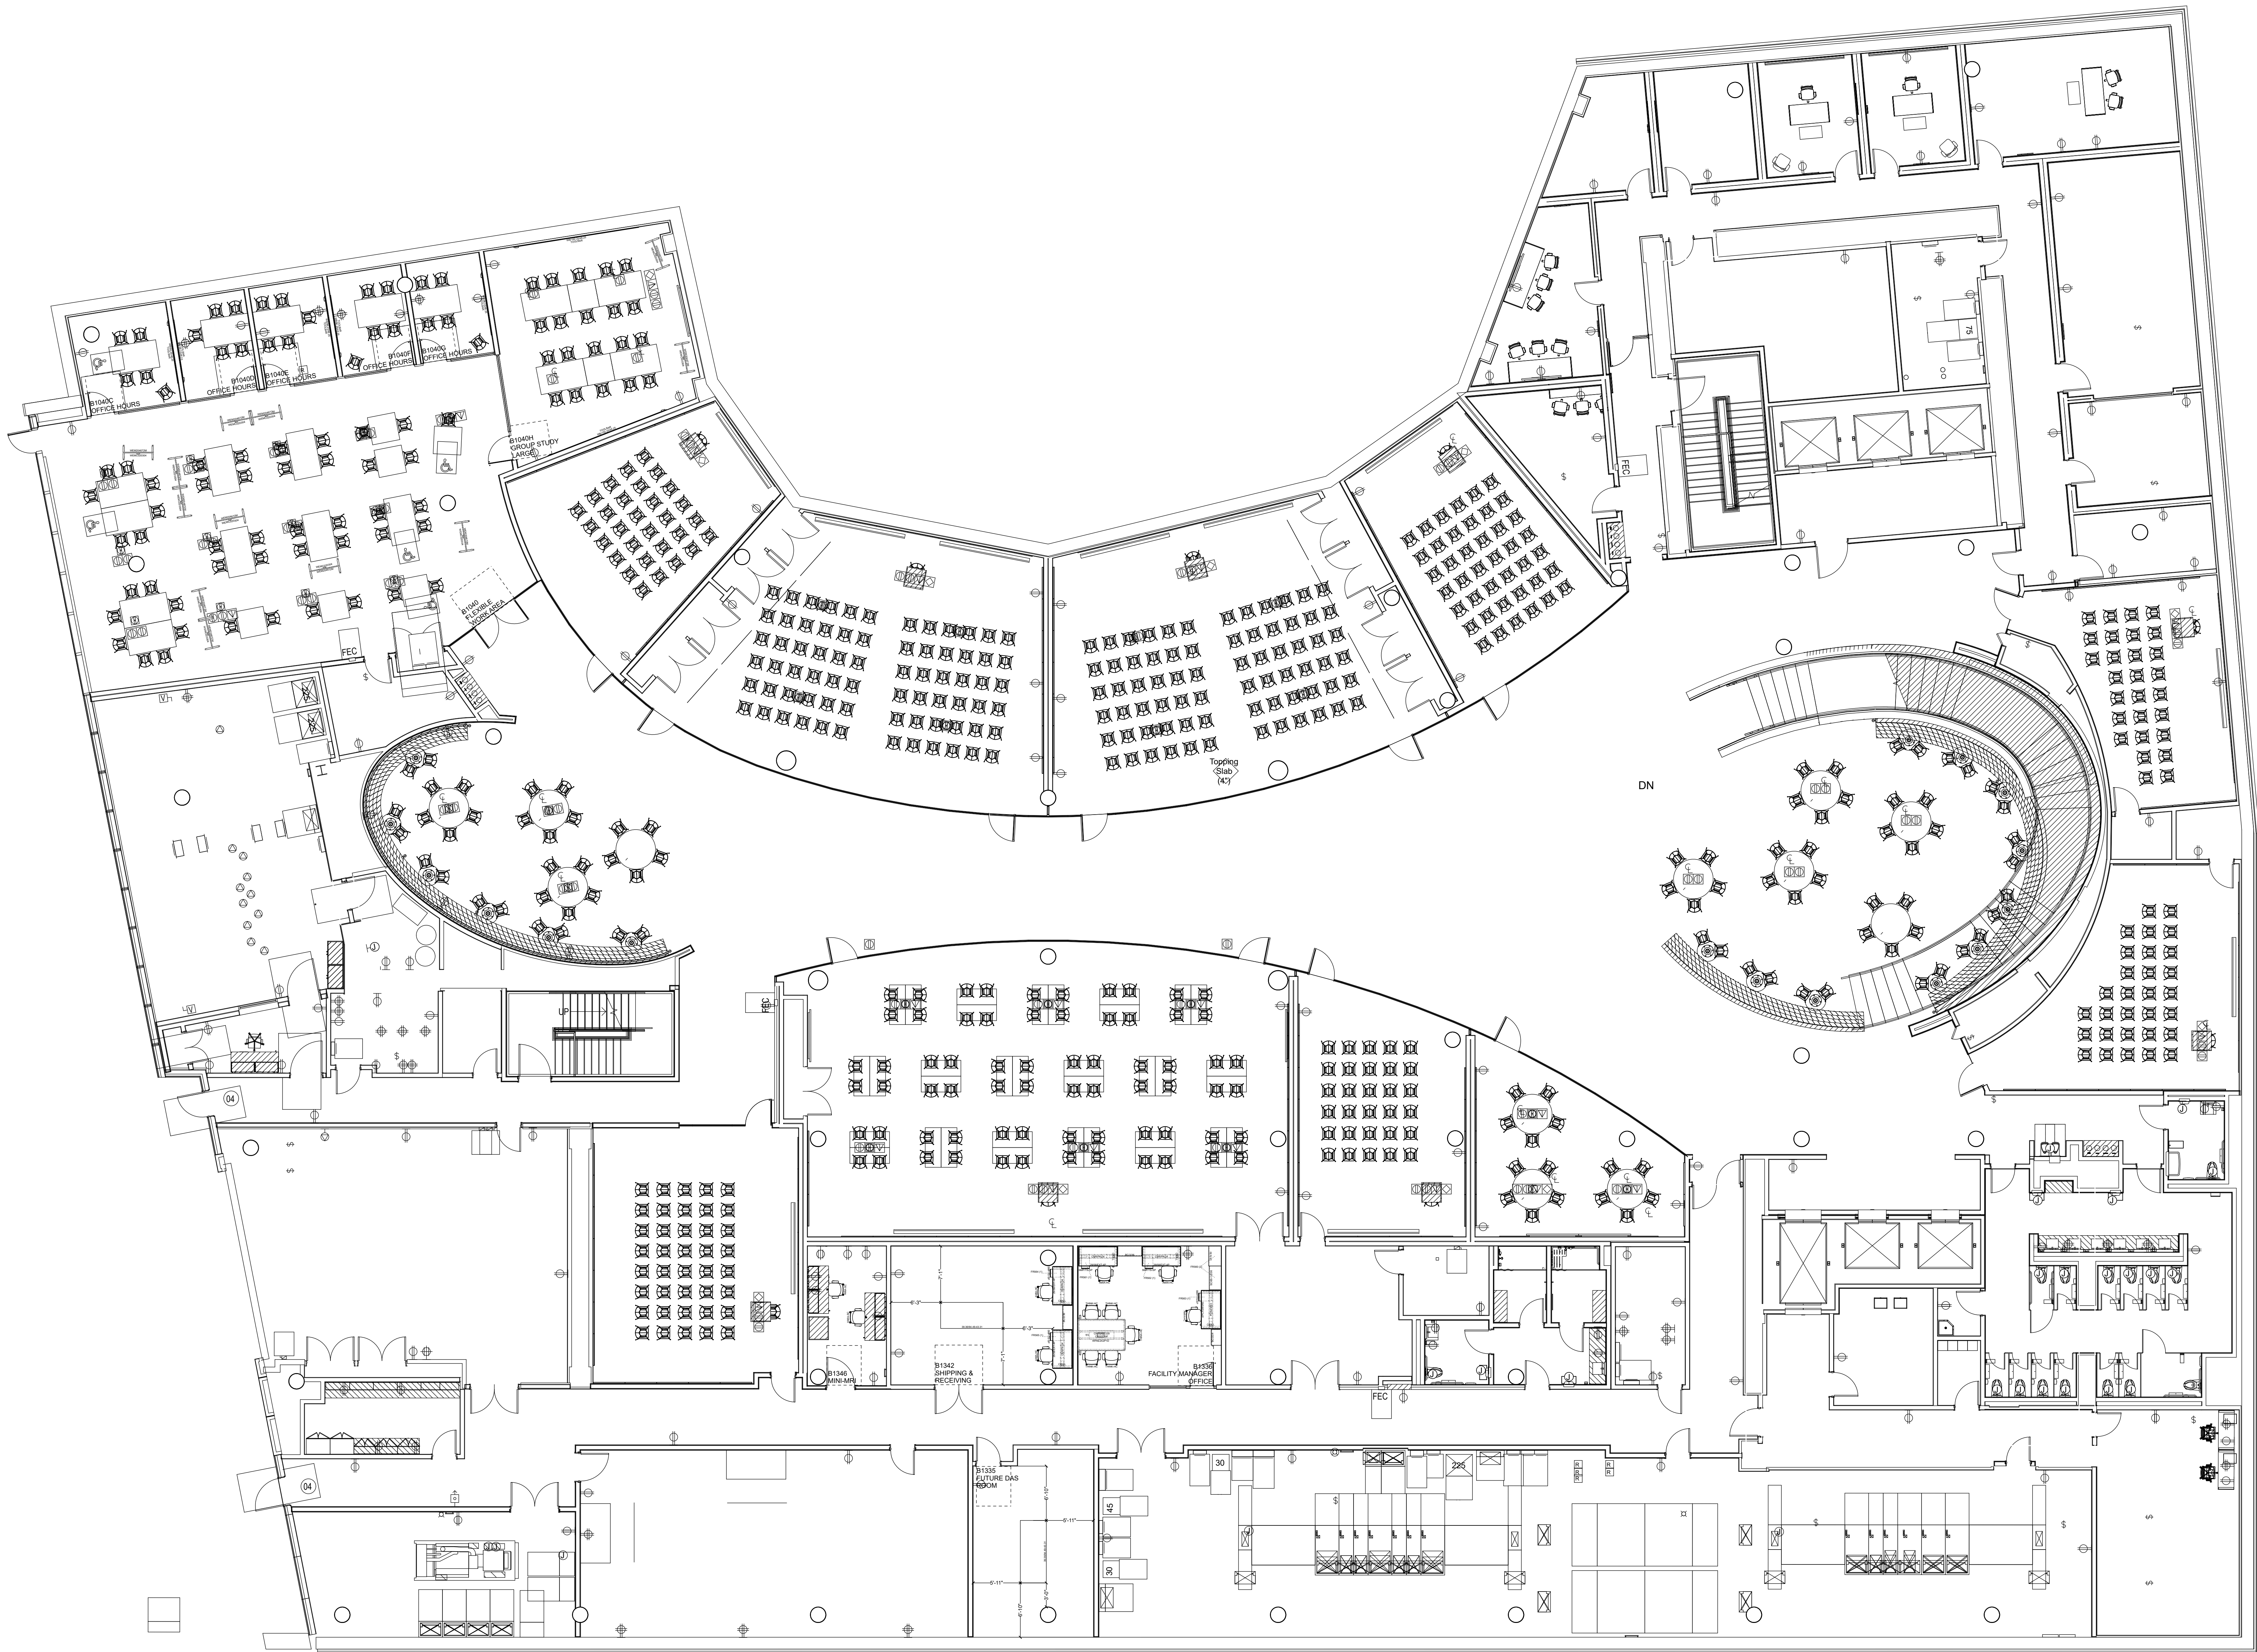

ELECTRICAL NOTES:

- ONE WORKPLACE STUDIO SHALL PROVIDE PLACEMENT INSTRUCTIONS FOR POWER & TELEPHONE NECESSARY TO SUPPORT FUTURE INSTALLATION.
- THE ARCHITECT, ELECTRICAL ENGINEER, AND GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR ADHERENCE TO LOCAL ELECTRICAL CODES.
- ALL AMPERAGE AND ELECTRICAL CIRCUIT REQUIREMENTS SHALL BE DETERMINED BY THE ELECTRICAL ENGINEER.
- ELECTRICAL ENGINEER AND/OR GENERAL CONTRACTOR SHALL COORDINATE ELECTRICAL WIRING SCHEMATICS WITH ONE WORKPLACE STUDIO.
- ONE WORKPLACE STUDIO TO BE NOTIFIED IN THE EVENT THAT PROPOSED POWER DATA LOCATIONS CANNOT BE ACCOMMODATED.
- ALL ELECTRICAL HARDWARE CONNECTIONS OF FURNITURE AND THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER.
- REVISIONS AND/OR CHANGES TO THESE PLANS MUST BE SUBMITTED TO ONE WORKPLACE STUDIO FOR APPROVAL.

GENERAL NOTES:

- THE CALIFORNIA BUILDING CODE HAS BESEAL DESIGN REQUIREMENTS FOR OBJECTS GREATER THAN 4 FEET IN HEIGHT. THESE OBJECTS ARE REQUIRED TO BE ACCURATELY BRACED AND/OR ANCHORED TO THE BUILDING STRUCTURE. IT IS THE CUSTOMER'S RESPONSIBILITY TO ADDRESS ANY STRUCTURAL SUBMITTAL REQUIREMENTS FOR THIS PROJECT.
- ALL FURNITURE DIMENSIONS SHOWN ARE HARD DIMENSIONS UNLESS OTHERWISE NOTED.
- ELECTRICAL DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS.
- REVISIONS AND/OR CHANGES TO PLANS MUST BE FORMALLY SUBMITTED TO ONE WORKPLACE STUDIO PRIOR TO IMPLEMENTATION OF SAID REVISIONS.

ARCHITECTURAL DISCLAIMER

IN THE EVENT THAT CONSTRUCTION IS INCOMPLETE AND/OR CLIENT SITE IS UNAVAILABLE FOR FIELD VERIFICATION, ONE WORKPLACE STUDIO ACCEPTS NO RESPONSIBILITY FOR ACCURACY OF ARCHITECTURAL BASE PLANS PROVIDED BY CLIENT AND/OR DESIGN CONSULTANT. ONE WORKPLACE STUDIO WILL PROVIDE CRITICAL DIMENSIONS FOR FURNITURE PLACEMENT. VERIFY SITE PRIOR TO INSTALLATION AND ADJUST CLIENT AND/OR DESIGN CONSULTANT OF ANY CONFLICTS. CLIENT SHALL RECONFIRM ONE WORKPLACE STUDIO WHEN SITE IS AVAILABLE FOR FIELD VERIFICATION.