

**GD**  
GILMOR & DOYLE  
MECHANICAL & ELECTRICAL  
CONSULTING ENGINEERS  
WATERLOO -- DES MOINES, IOWA  
214 East 4th St. 1717 Ingersoll Ave.  
Waterloo, IA 50703 Des Moines, IA 50309  
319-235-0650 p 515-251-7280 p  
319-235-0644 f 515-251-7349 f  
www.gdeng.com

Project Title:  
**CENTER POINT-  
URBANA  
HIGH SCHOOL**

Owner:  
**Center Point-Urbana CSD  
Center Point, Iowa**

Project No.: 09.048  
Drawn by:  
Checked by:

Issue:

Date	Description
3-1-2010	BID DOCUMENTS
3-31-2010	CONSTRUCTION SET

Note:  
FIELD VERIFY ALL DIMENSIONS AND CLEARANCES.  
DO NOT SCALE DRAWINGS. CONSULT SHOP DRAWINGS AND  
OTHER APPROPRIATE DRAWINGS.  
LAY OUT AND COORDINATE ALL WORK PRIOR TO  
INSTALLATION FOR ACCURACY AND NON-INTERFERENCE  
WITH OTHER TRADES. READ PROJECT MANUAL.


© COPYRIGHT  
UNAUTHORIZED COPYING, DISCLOSURE OR CONSTRUCTION  
WITHOUT WRITTEN PERMISSION BY NEUMANN MONSON  
PC IS PROHIBITED.  
UNAUTHORIZED SCANNING OF DRAWINGS IS PROHIBITED.

Sheet Title:  
**SECOND FLOOR  
FIRE PROTECTION**

Sheet Number:  
**F-102**

REFERENCED NOTES:

- (NOT ALL NOTES MAY BE USED ON THIS SHEET)
1. PITCH PIPE UP FROM THIS LOCATION. FOLLOW THE CEILING ANGLE.
  2. LOCATION OF FIRE DEPARTMENT CONNECTION. COORDINATE INSTALLATION WITH MUNICIPAL FIRE DEPARTMENT. REFER TO SHEET -- FOR ADDITIONAL DETAILS.
  3. SPRINKLER PIPE CROSSING CORRIDOR SHALL BE ADJUSTED TO ALLOW FOR CONTINUATION OF DUCTWORK THROUGH CORRIDOR. COORDINATE THIS WORK WITH OTHER TRADES.
  4. INSTALL 3/4" BALL VALVE AND THREADED CONNECTION FOR SYSTEM DRAIN DOWN.
  5. CONTRACTOR SHALL CONCEAL PIPING ABOVE METAL CEILING SYSTEM.
  6. SPRINKLER CONTRACTOR SHALL PROVIDE CAPACITY FOR FUTURE ADDITION AS SHOWN. CAP MAIN AT END OF NEW CORRIDOR. SIZE FOR ADDITIONAL -- SQUARED FEET.
  7. PROVIDE COOLER AND FREEZER WITH DRY PENDENT SPRINKLER DESIGNED FOR USE IN STORAGE AREAS SUBJECT TO FREEZING AND SUPPLIED FROM A WET SYSTEM IN AN ADJACENT HEATED AREA.

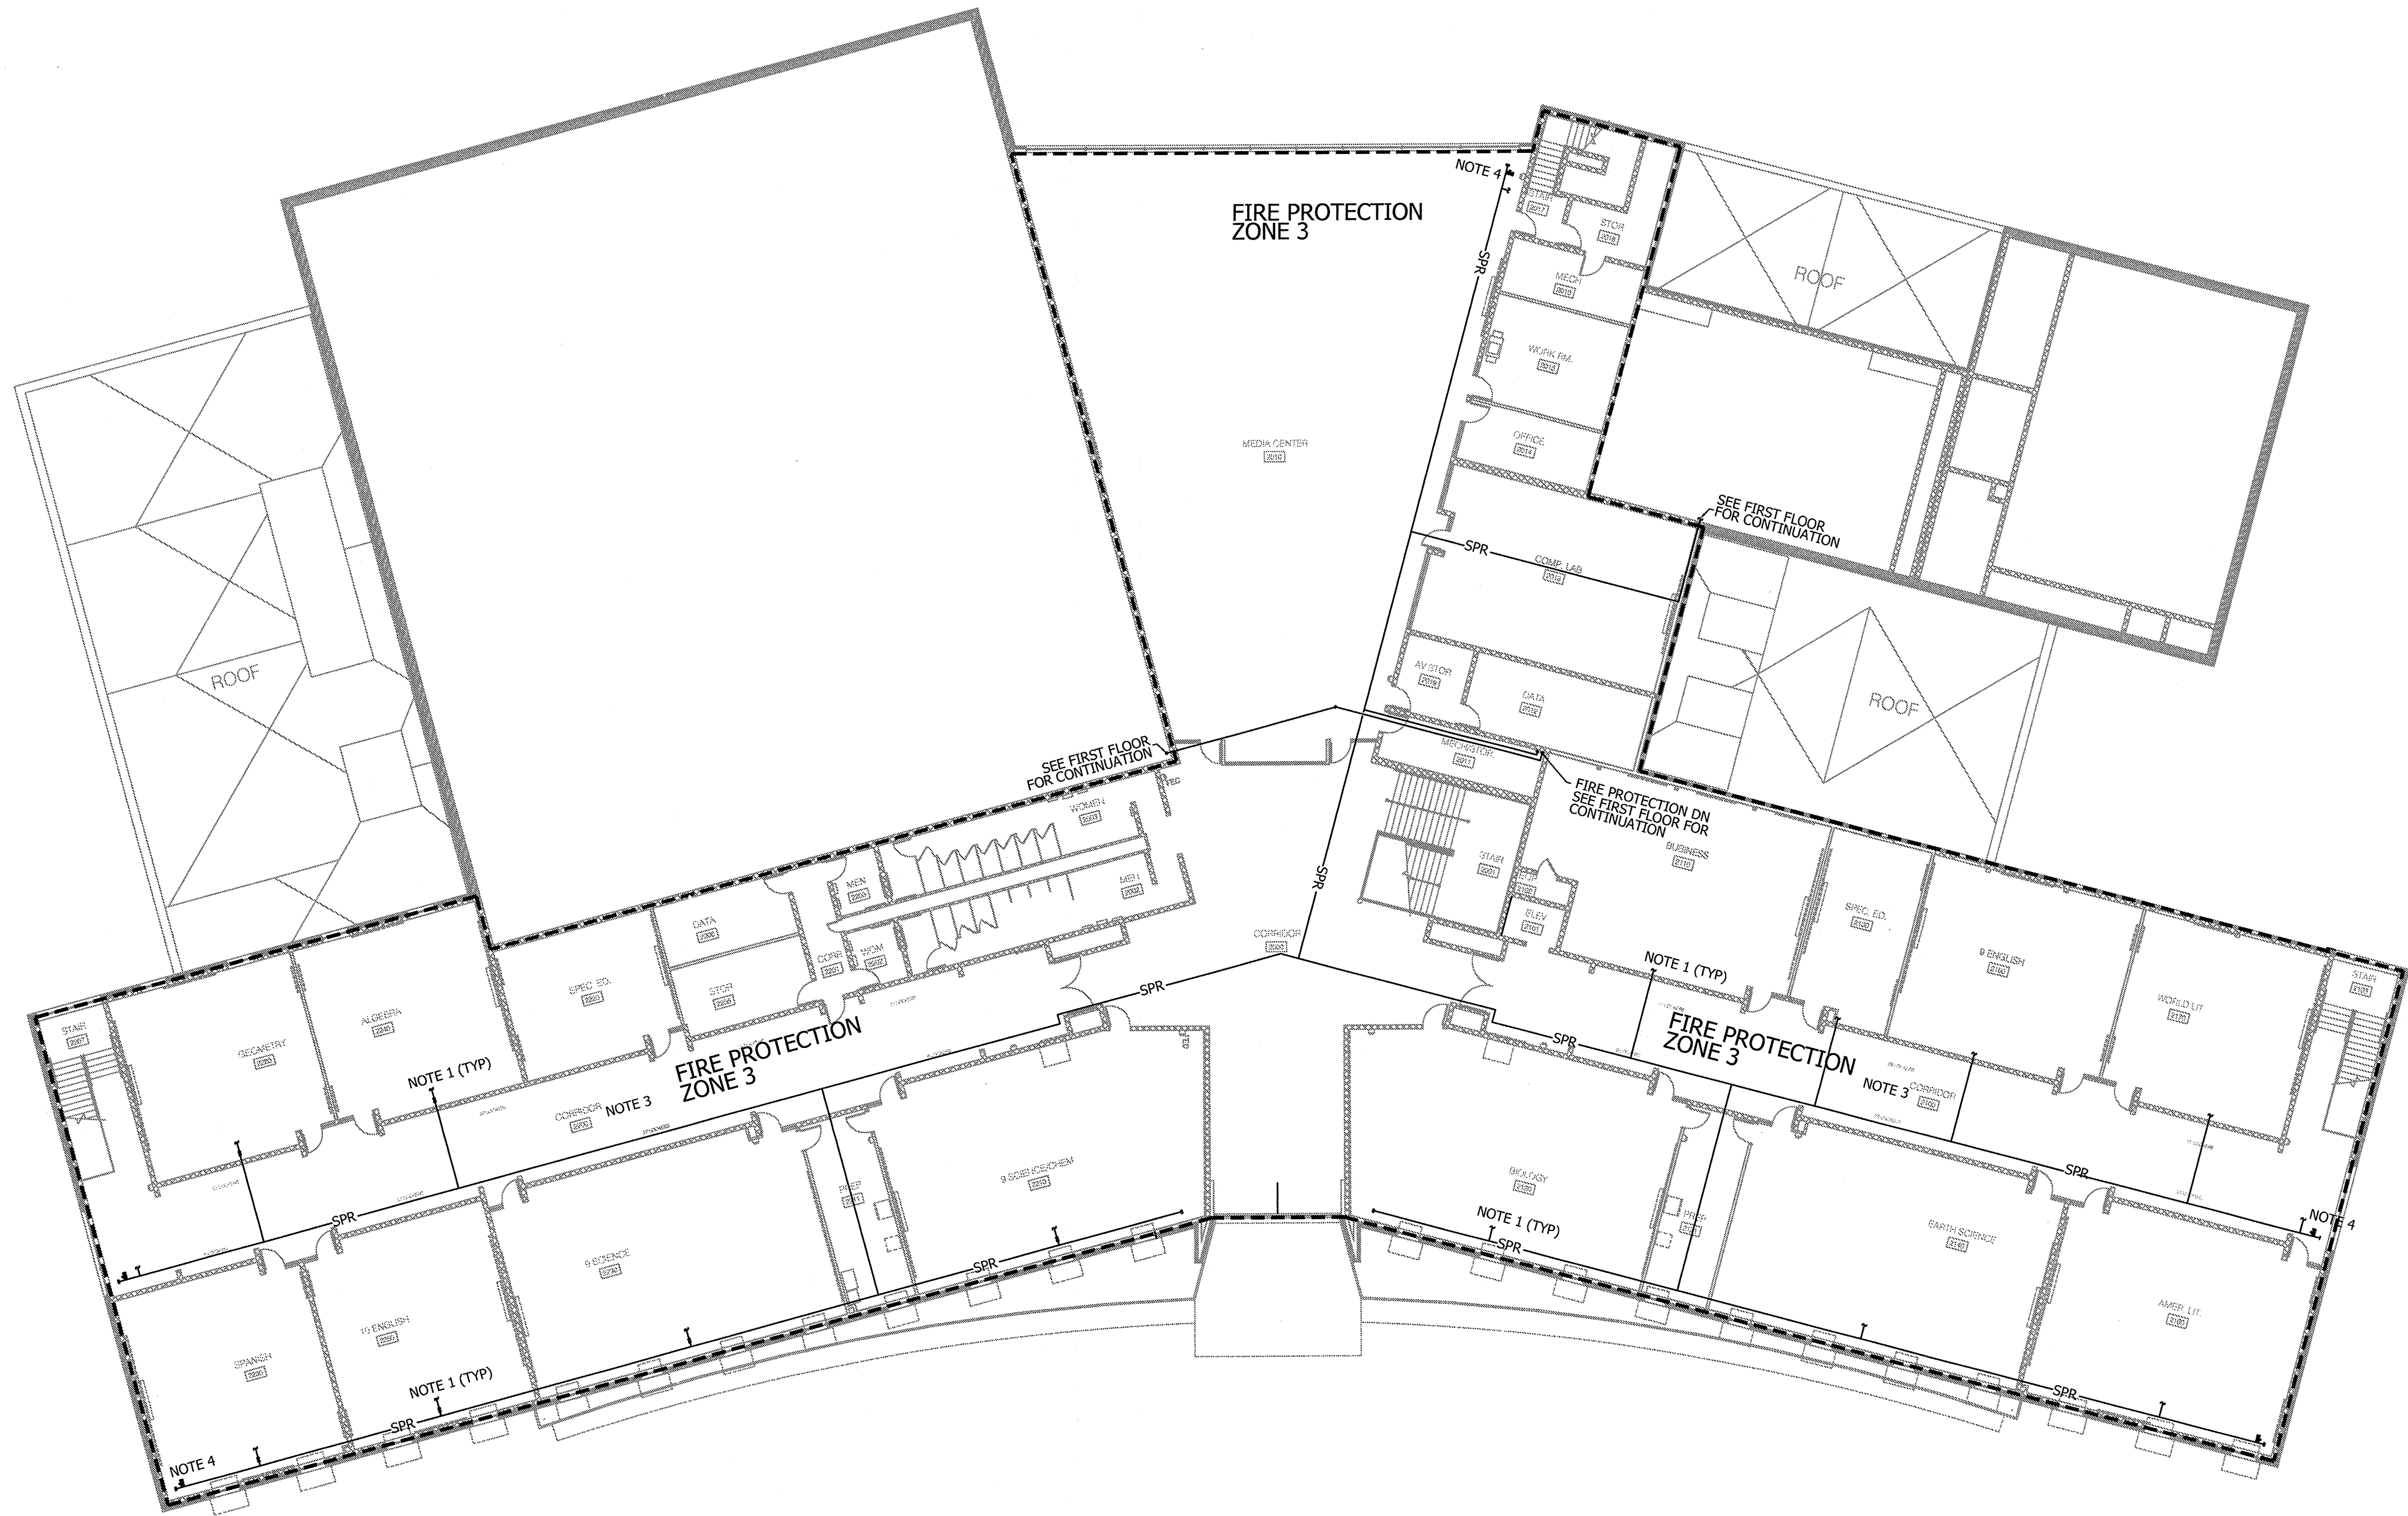

**SECOND FLOOR FIRE PROTECTION**

1/16"=1'-0"