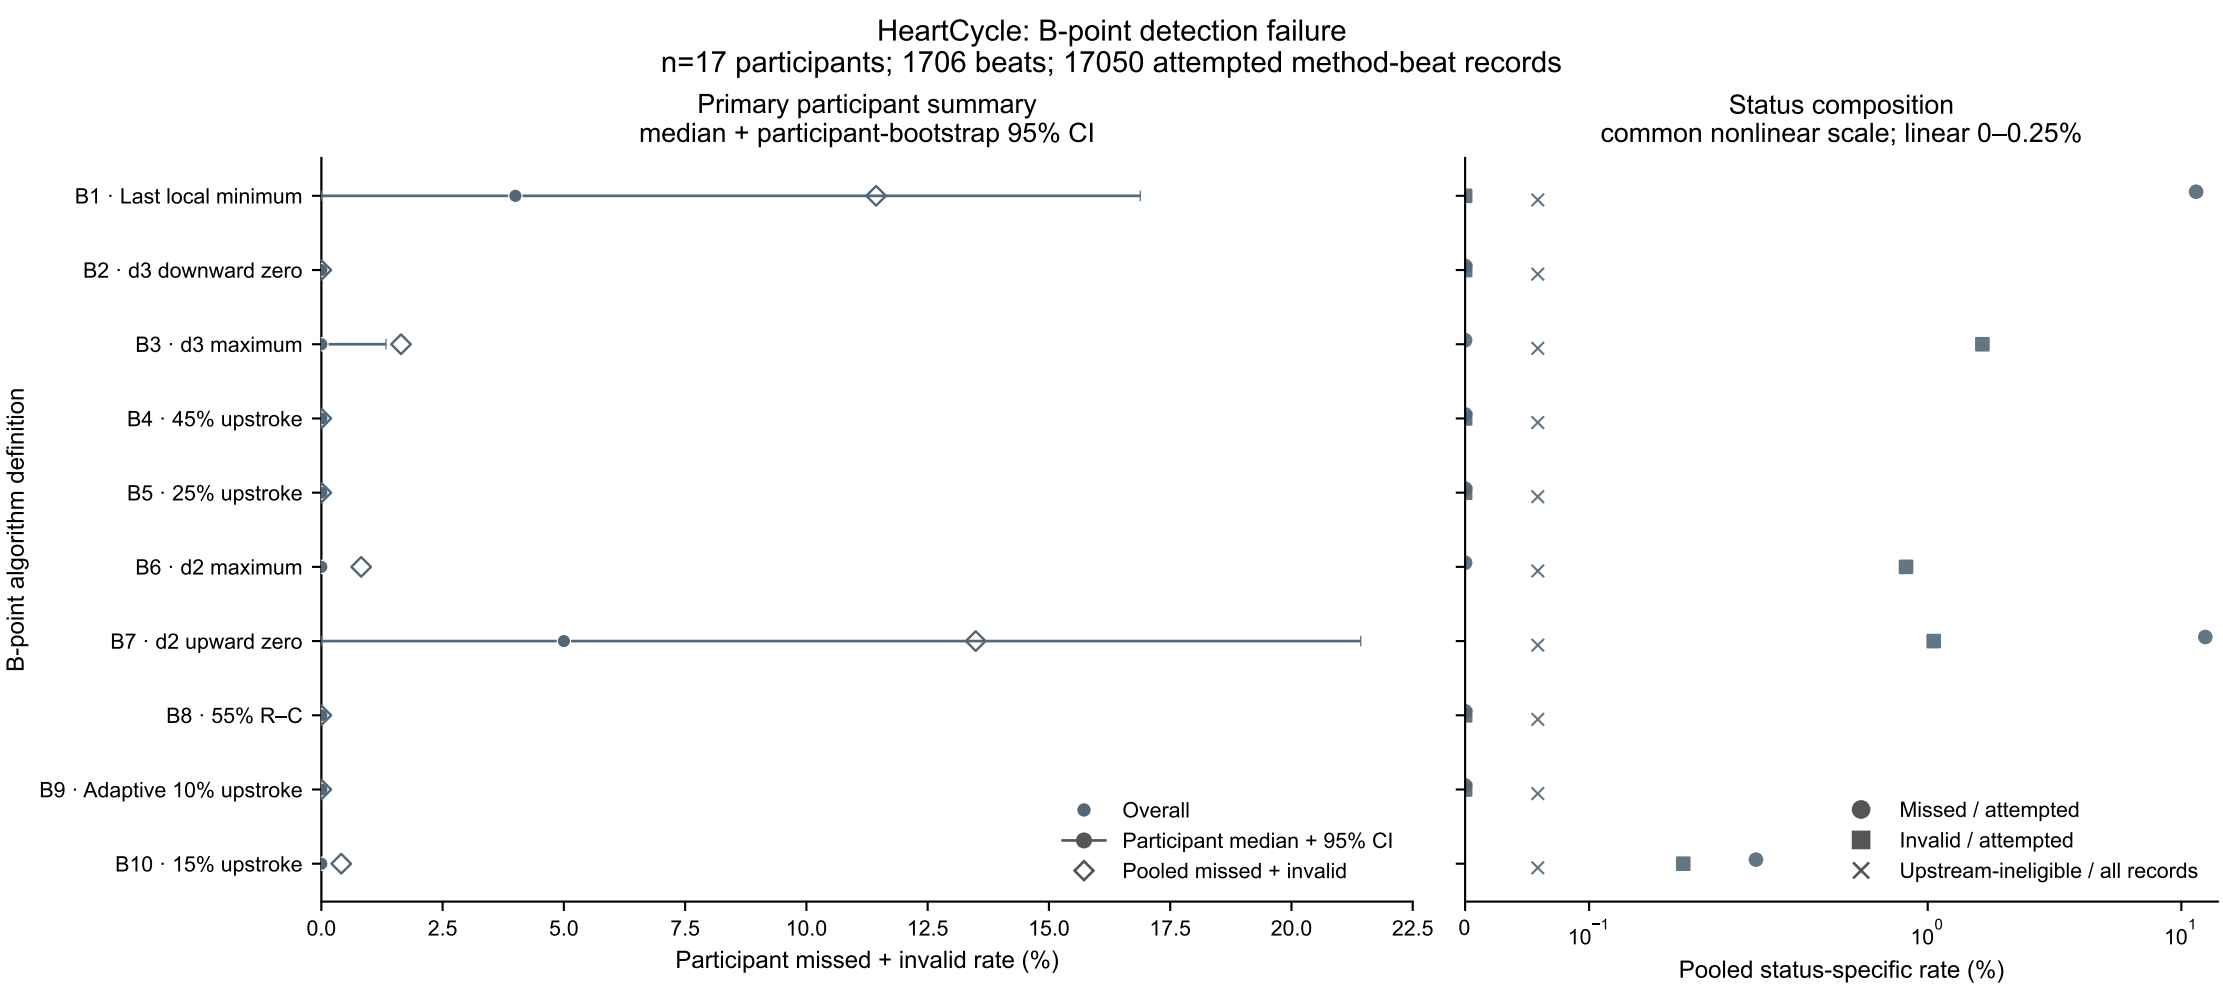
HeartCycle: B-point detection failure
n=17 participants; 1706 beats; 17050 attempted method-beat records
Primary participant summary
median + participant-bootstrap 95% CI
Status composition
common nonlinear scale; linear 0–0.25%
B-point algorithm definition
B1 · Last local minimum
B2 · d3 downward zero
B3 · d3 maximum
B4 · 45% upstroke
B5 · 25% upstroke
B6 · d2 maximum
B7 · d2 upward zero
B8 · 55% R–C
B9 · Adaptive 10% upstroke
B10 · 15% upstroke
Overall
Participant median + 95% CI
Pooled missed + invalid
0.0
2.5
5.0
7.5
10.0
12.5
15.0
17.5
20.0
22.5
Participant missed + invalid rate (%)
Missed / attempted
Invalid / attempted
Upstream-ineligible / all records
0
10^{-1}
10^{0}
10^{1}
Pooled status-specific rate (%)