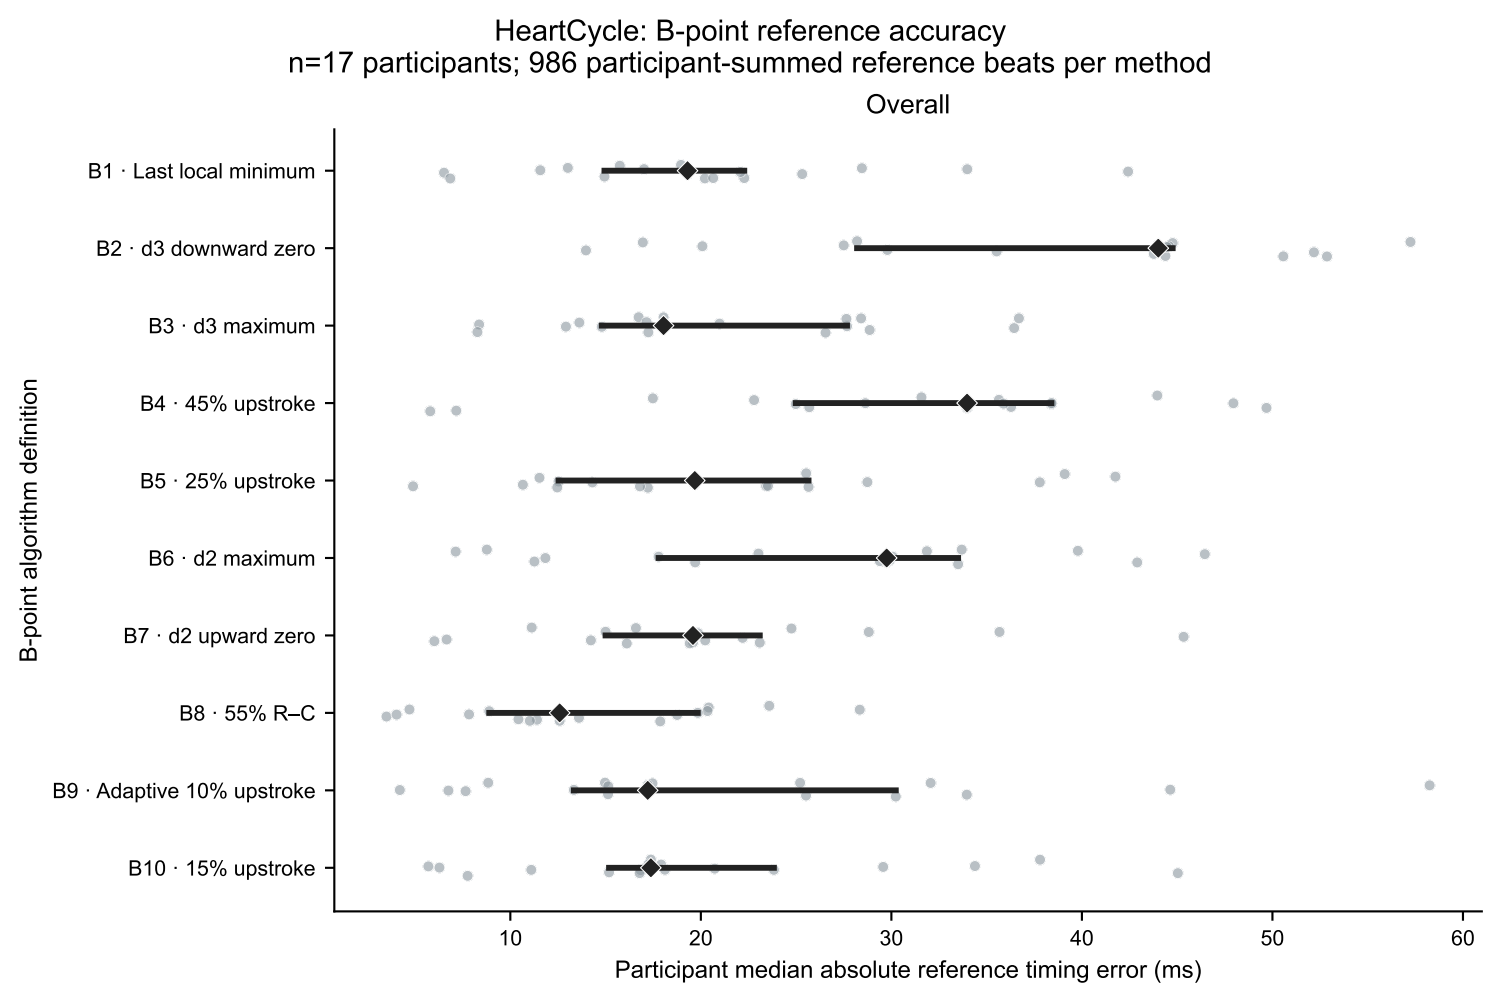
HeartCycle: B-point reference accuracy
n=17 participants; 986 participant-summed reference beats per method
Overall
B-point algorithm definition
B1 · Last local minimum
B2 · d3 downward zero
B3 · d3 maximum
B4 · 45% upstroke
B5 · 25% upstroke
B6 · d2 maximum
B7 · d2 upward zero
B8 · 55% R–C
B9 · Adaptive 10% upstroke
B10 · 15% upstroke
10
20
30
40
50
60
Participant median absolute reference timing error (ms)