VISUAL INTERPRETATION OF DHAI-R BYELAWS

BUILDING CONTROL DIRECTORATE

INDEX

Ser	Topics	Page No
1	Height of the Building (Residential)	3
2	Finish Floor Level	4
3	Set-Back Level	5
4	Car Porch	6
5	Projection	7
6	Parapet Wall	8
7	Open Stairs Case	9
8	Provision of Lift for Residential Plots	10
9	Mumty	11
10	Ramp (Driveway) in Svc Area	12
11	Entry Gate	13
12	Boundary Wall	14
13	Two Adjacent Plots at Different Level	15-16
14	Rain Water Harvesting Tank	17
15	Additional Small Over Head Water Tank	18
16	Installation of Solar Panels	19
17	Height of Commercial Building	20
18	Provision of Lift – Commercial	21


HEIGHT OF THE BUILDING






8.56.3 Height of the Building. The maximum height of the building including the water tank/mumty or any structure should not exceed 37 ft from the reference point. In exceptional cases where site permits increase in height maximum of upto one foot will be allowed after payment as per DHA applicable charges and approval from the Competent Authority.

FINISH FLOOR LEVEL

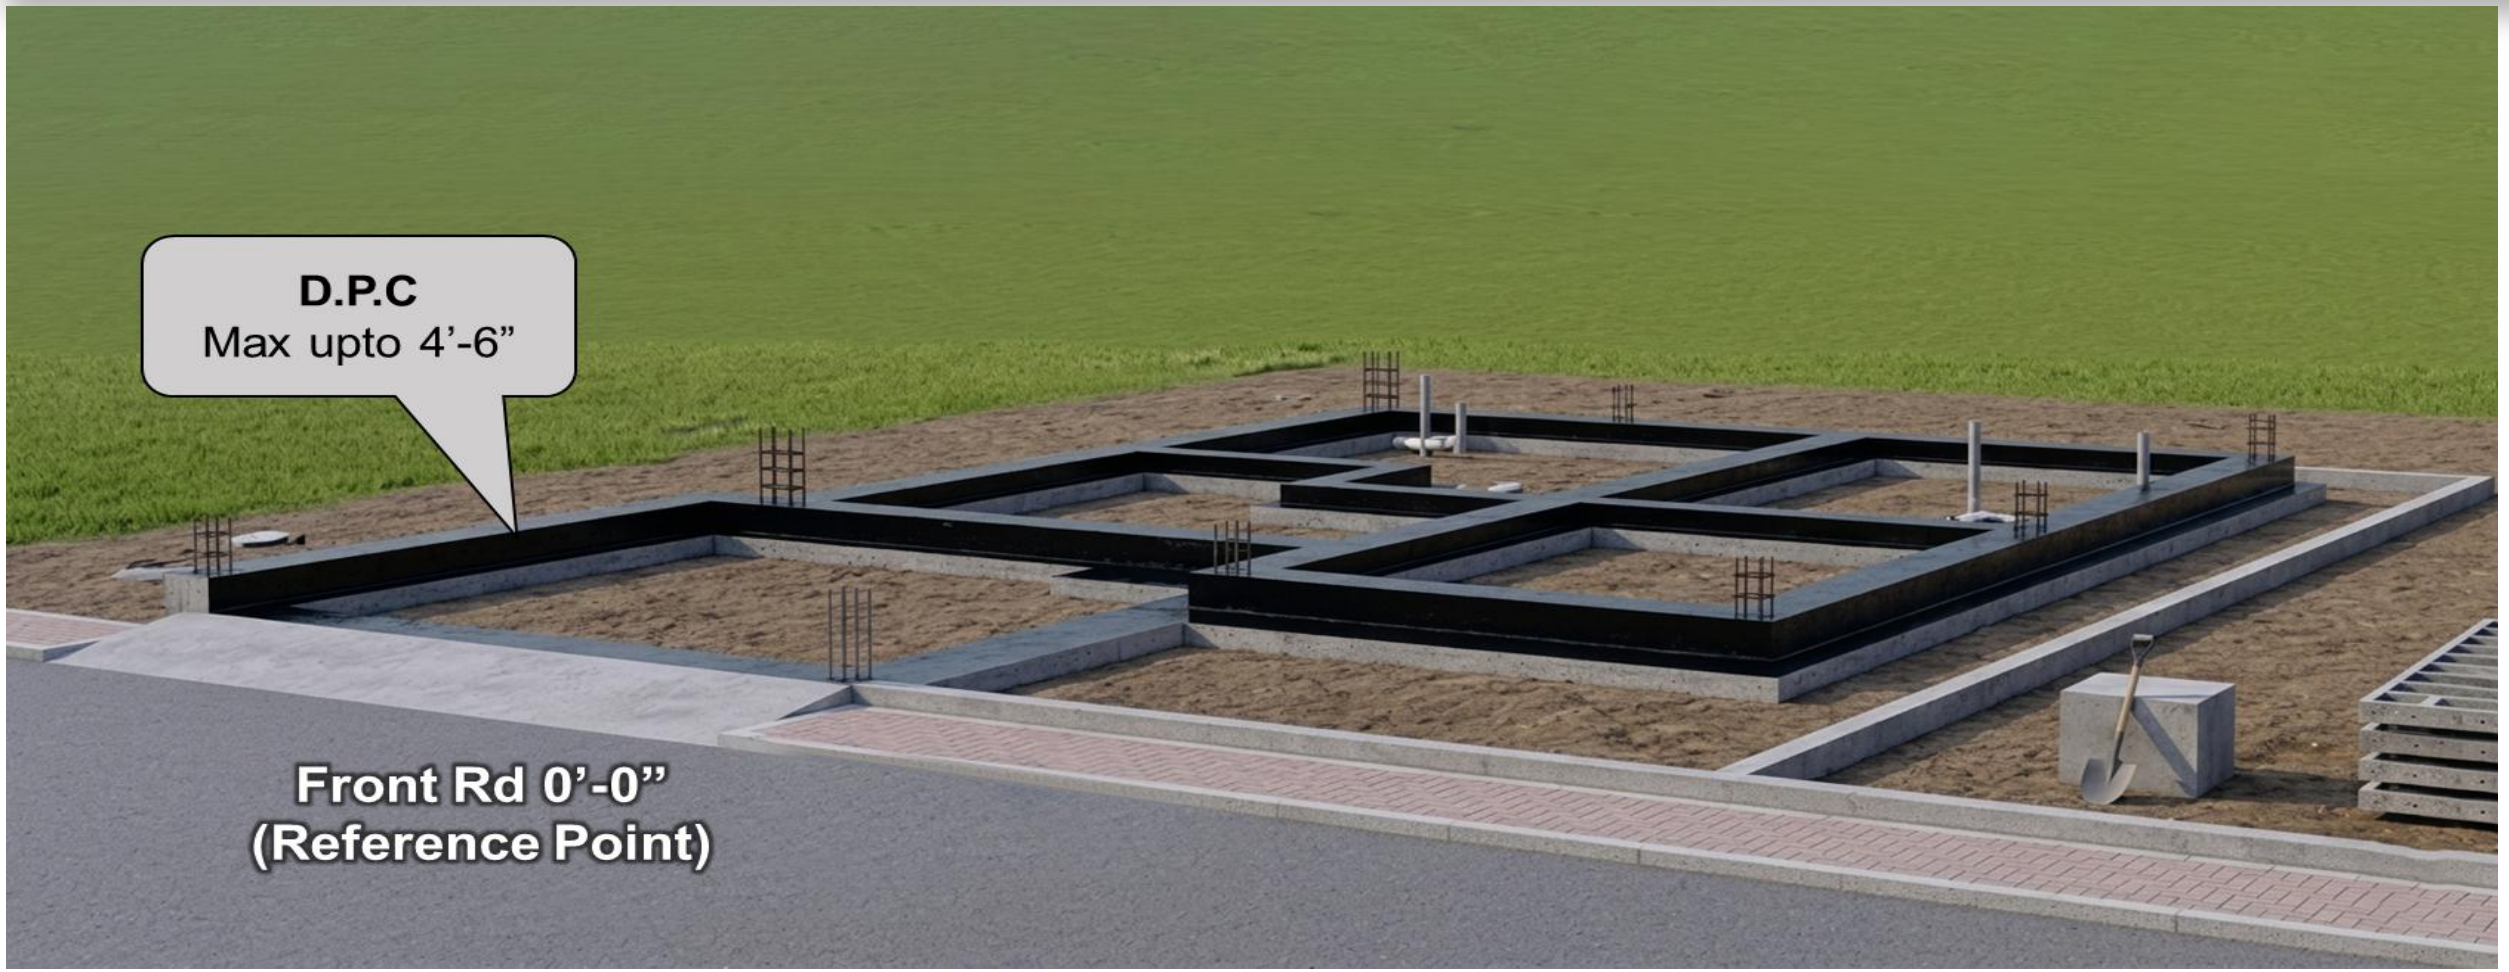


8.56.7 Finish Floor Level. The finish floor/Plinth level of the ground floor should not be more than 4 ft 6 inches.

SET BACK LEVEL

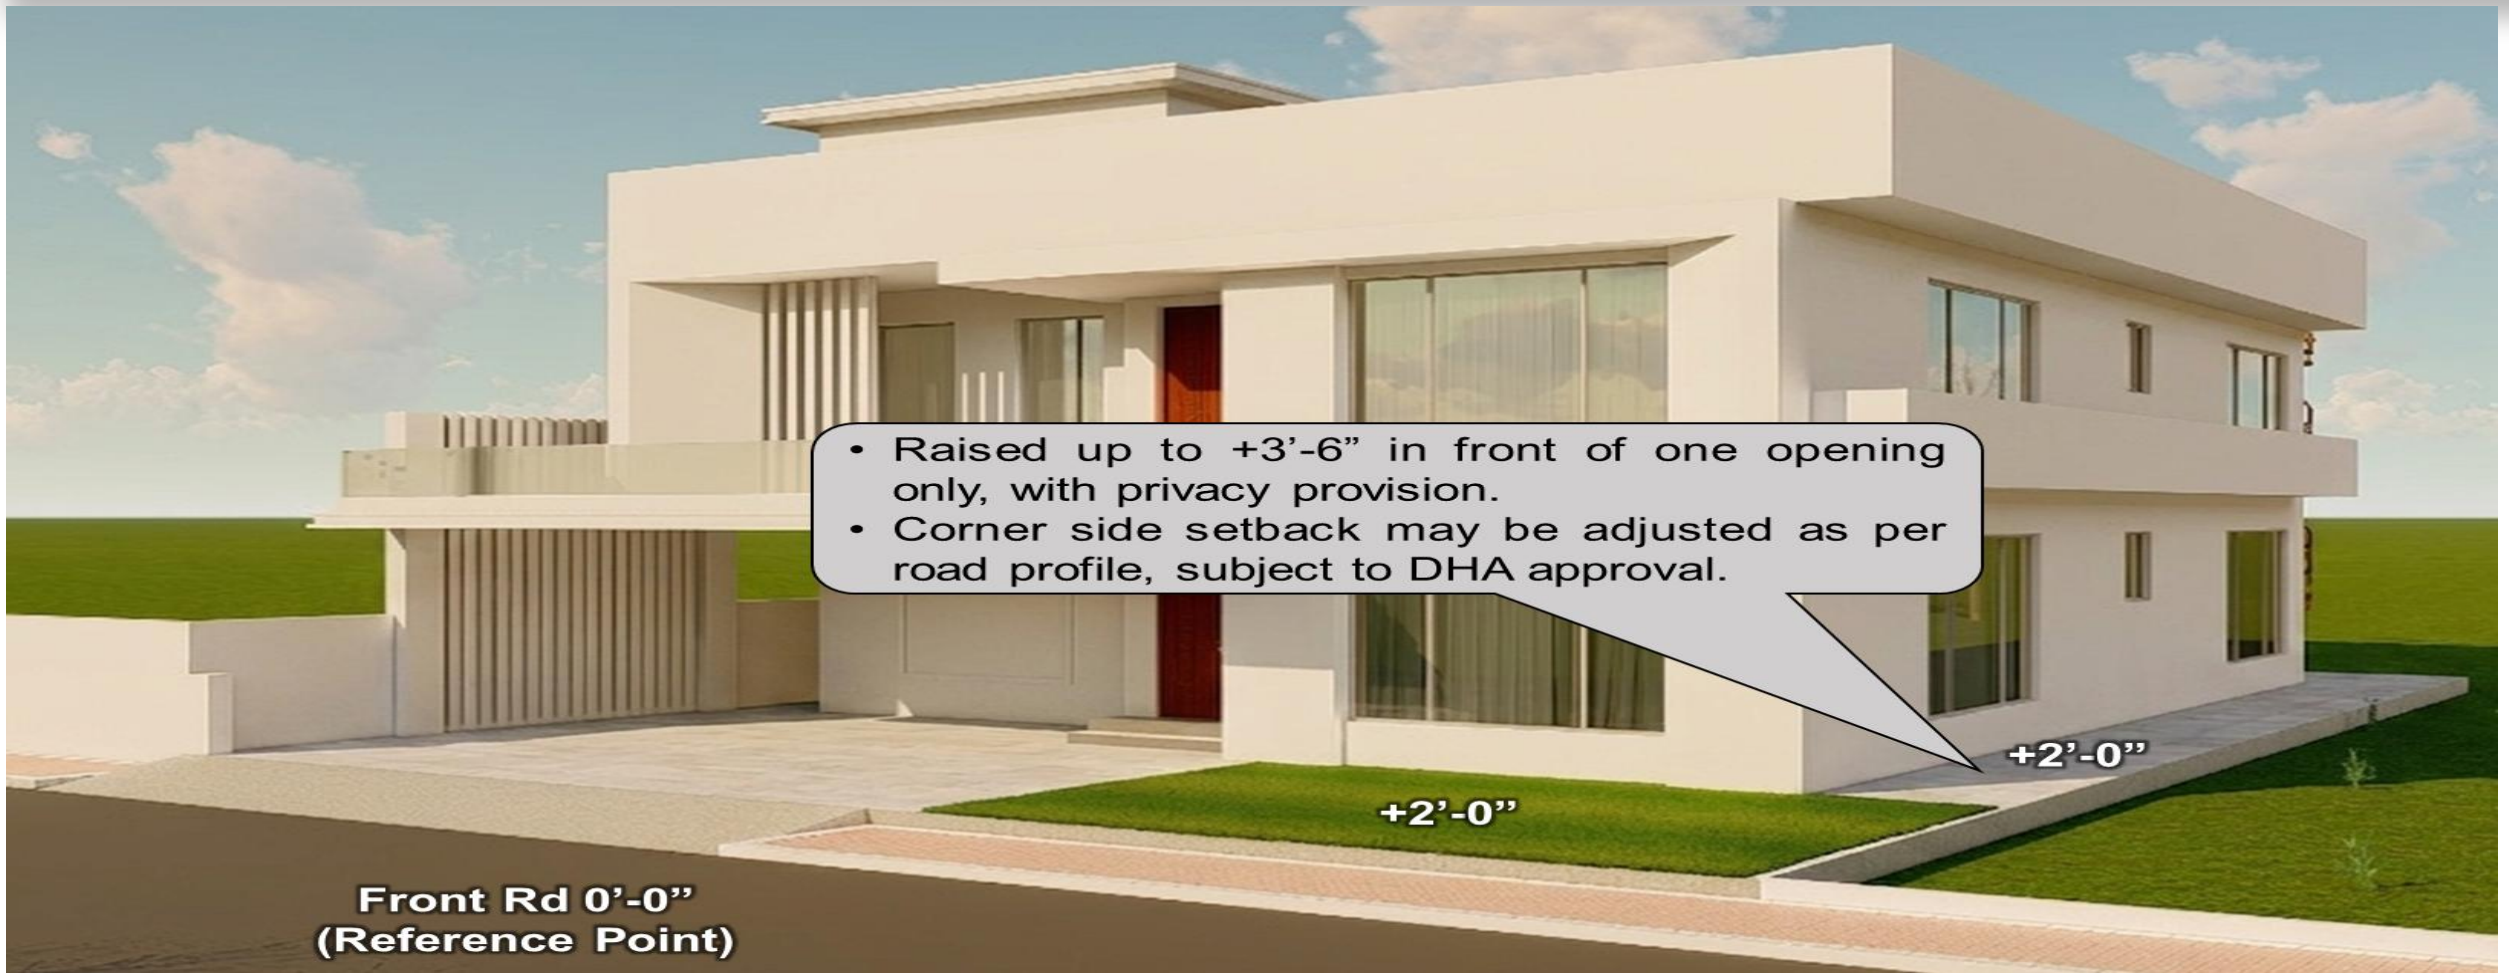

8.56.9 **Set-back Level**. The level of setback should not be more than +2'-00". However setback level in front of the opening into the side setbacks can be raised upto +3'-6", with adequate arrangements for the privacy of the adjacent house. The said option can only be provided at one opening. More than one raised portion in setbacks will not be allowed. In the case of corner plots, the roadside setback may be adjusted as per the level of the adjacent road with prior approval of DHA.

CAR PORCH

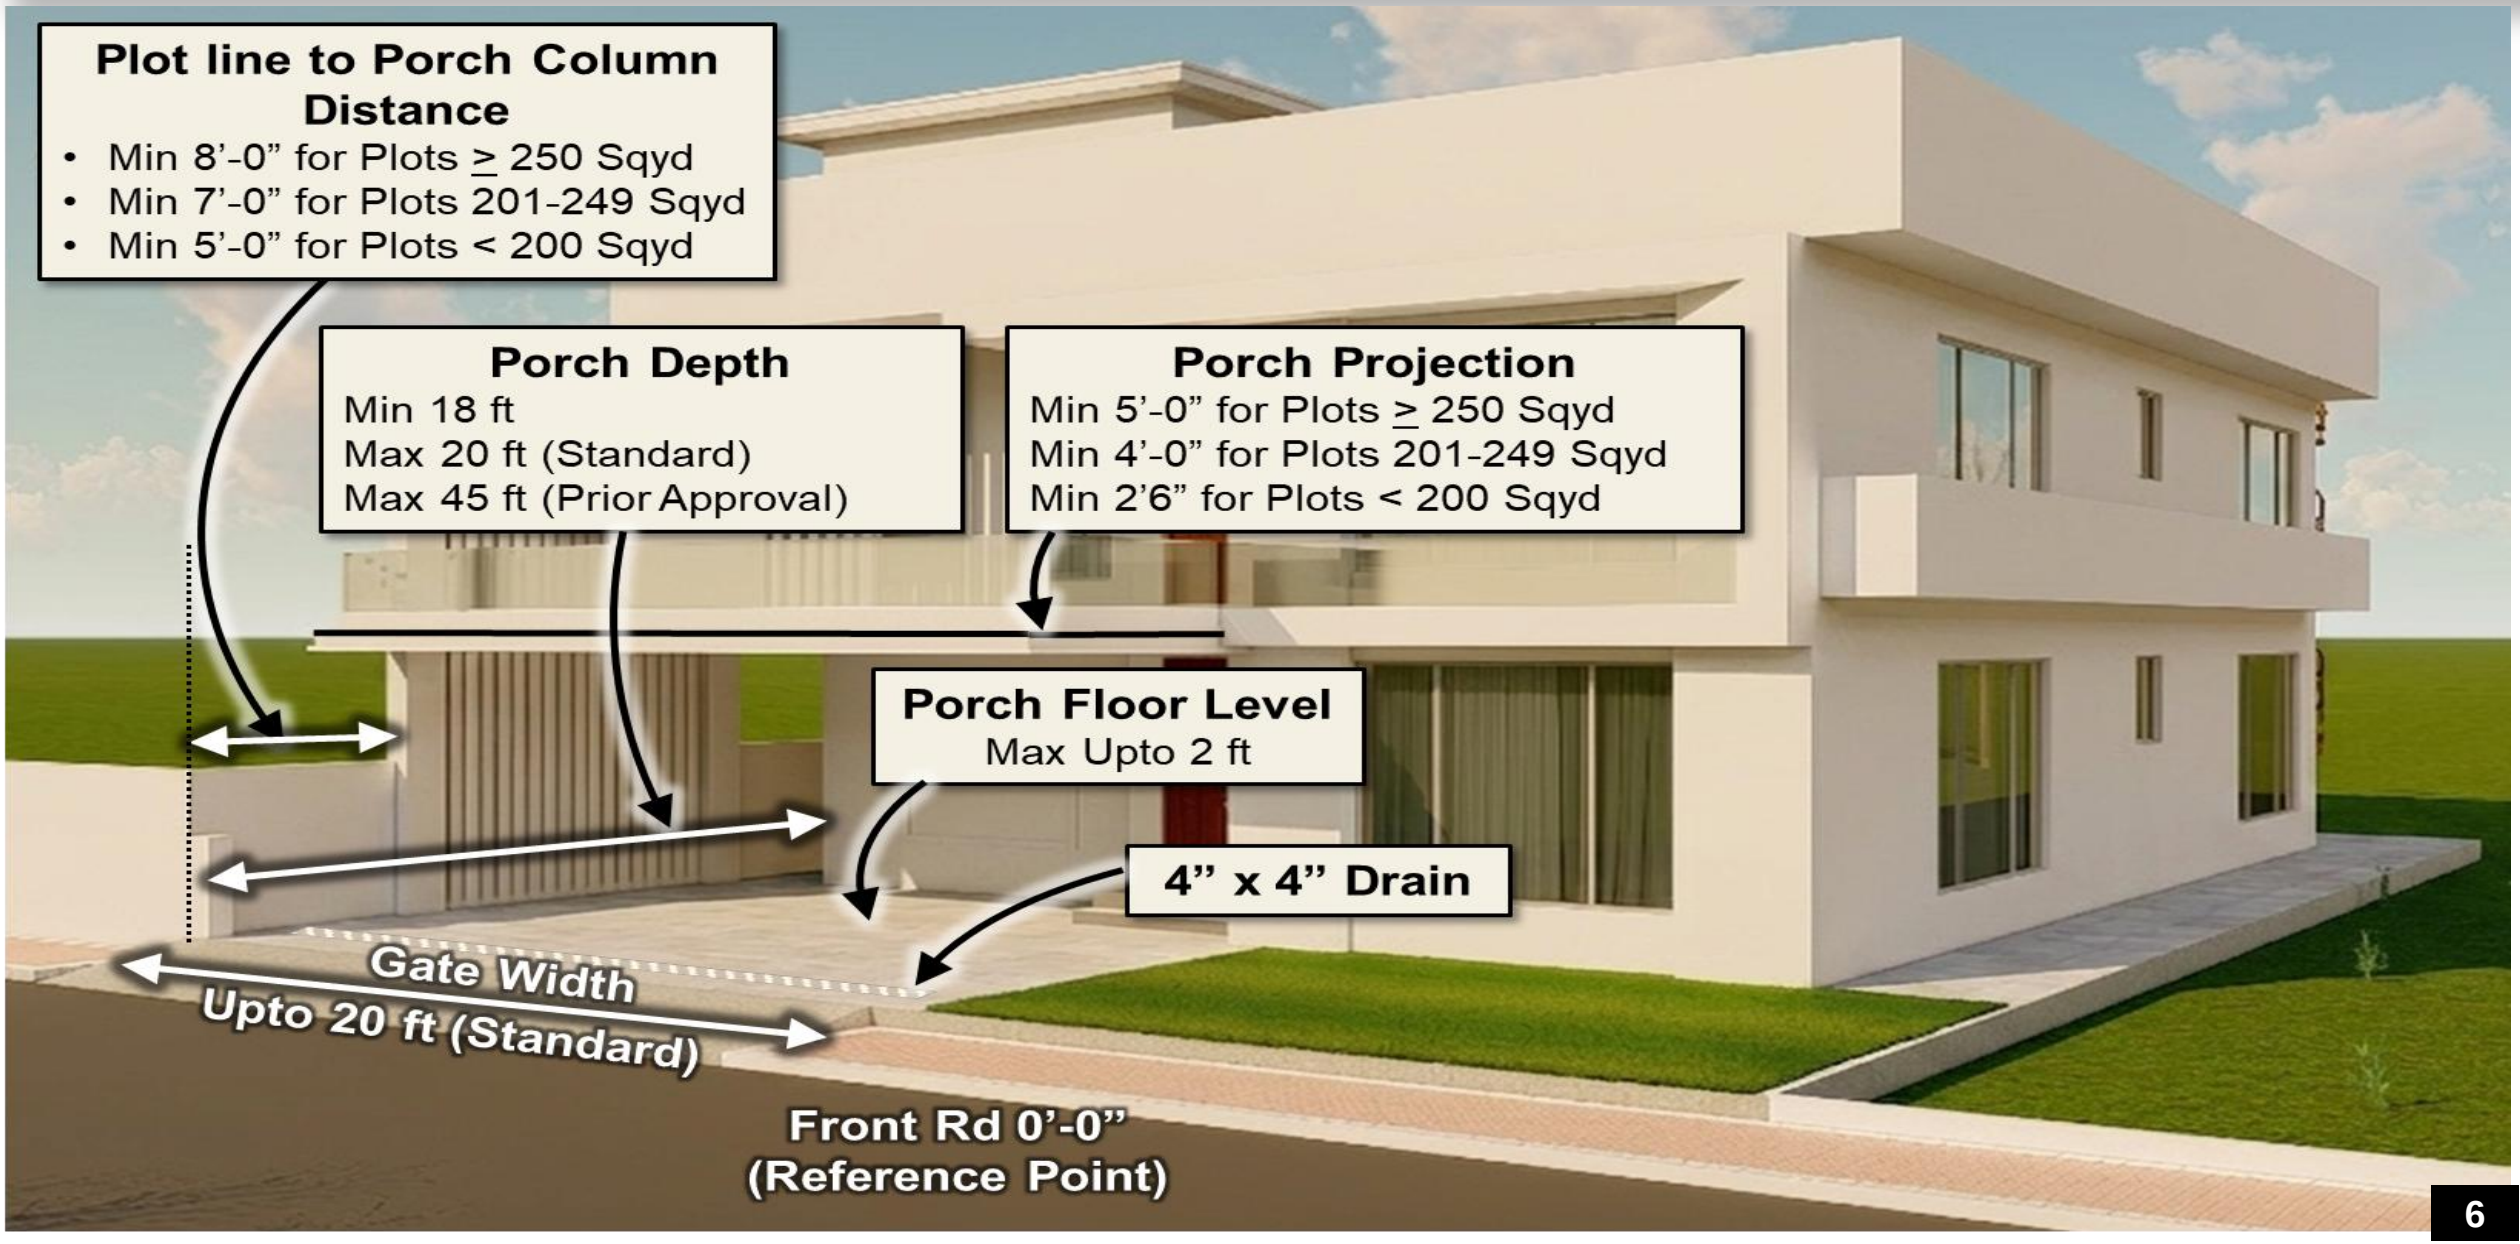
Plot line to Porch Column Distance
• Min 8'-0" for Plots ≥ 250 Sqyd
• Min 7'-0" for Plots 201-249 Sqyd
• Min 5'-0" for Plots < 200 Sqyd
Porch Depth
Min 18 ft
Max 20 ft (Standard)
Max 45 ft (Prior Approval)
Porch Projection
Min 5'-0" for Plots ≥ 250 Sqyd
Min 4'-0" for Plots 201-249 Sqyd
Min 2'6" for Plots < 200 Sqyd
Porch Floor Level
Max Upto 2 ft
4" x 4" Drain
Gate Width
Upto 20 ft (Standard)
Front Rd 0'-0"
(Reference Point)

PROJECTIONS




PARAPET WALL





8.56.14 Parapet Wall. Parapet wall maximum upto 5 ft and minimum upto 2 ft 6 inches height may be allowed. However, the height of the parapet wall at the front and side (If there is open space/nullah/road on that side) can be kept less than 2 ft 6 inches for design purposes only, provided that a specific area of the roof should be unapproachable in normal conditions.

OPEN STAIR CASE

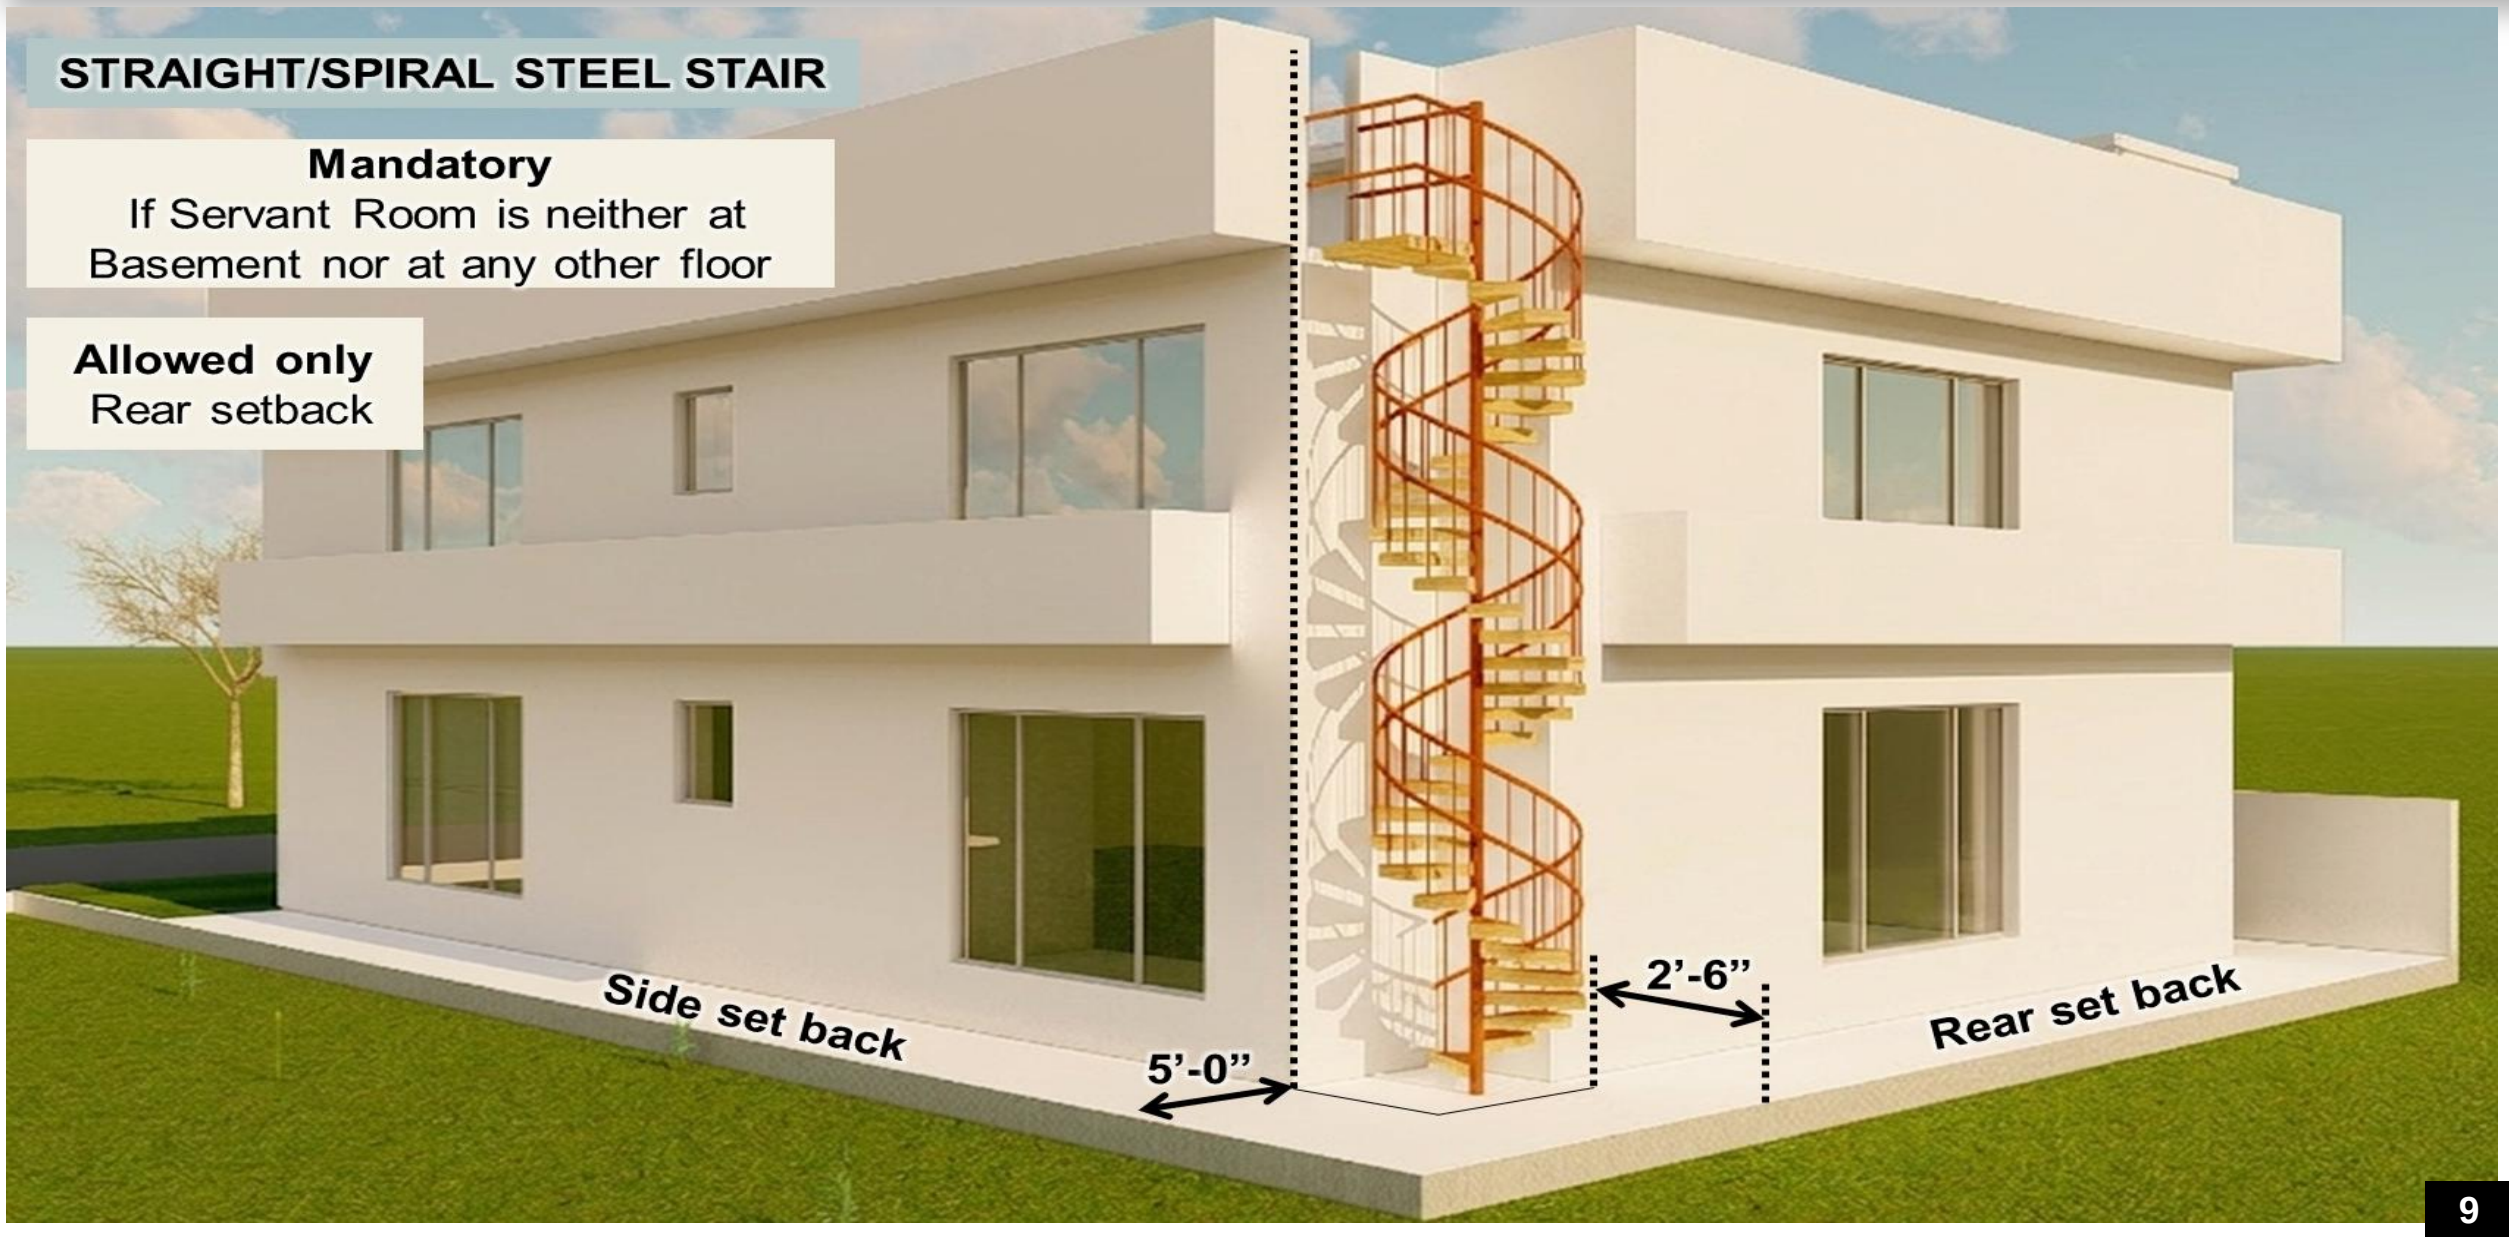

PROVISION OF LIFT FOR RESDL PLOTS

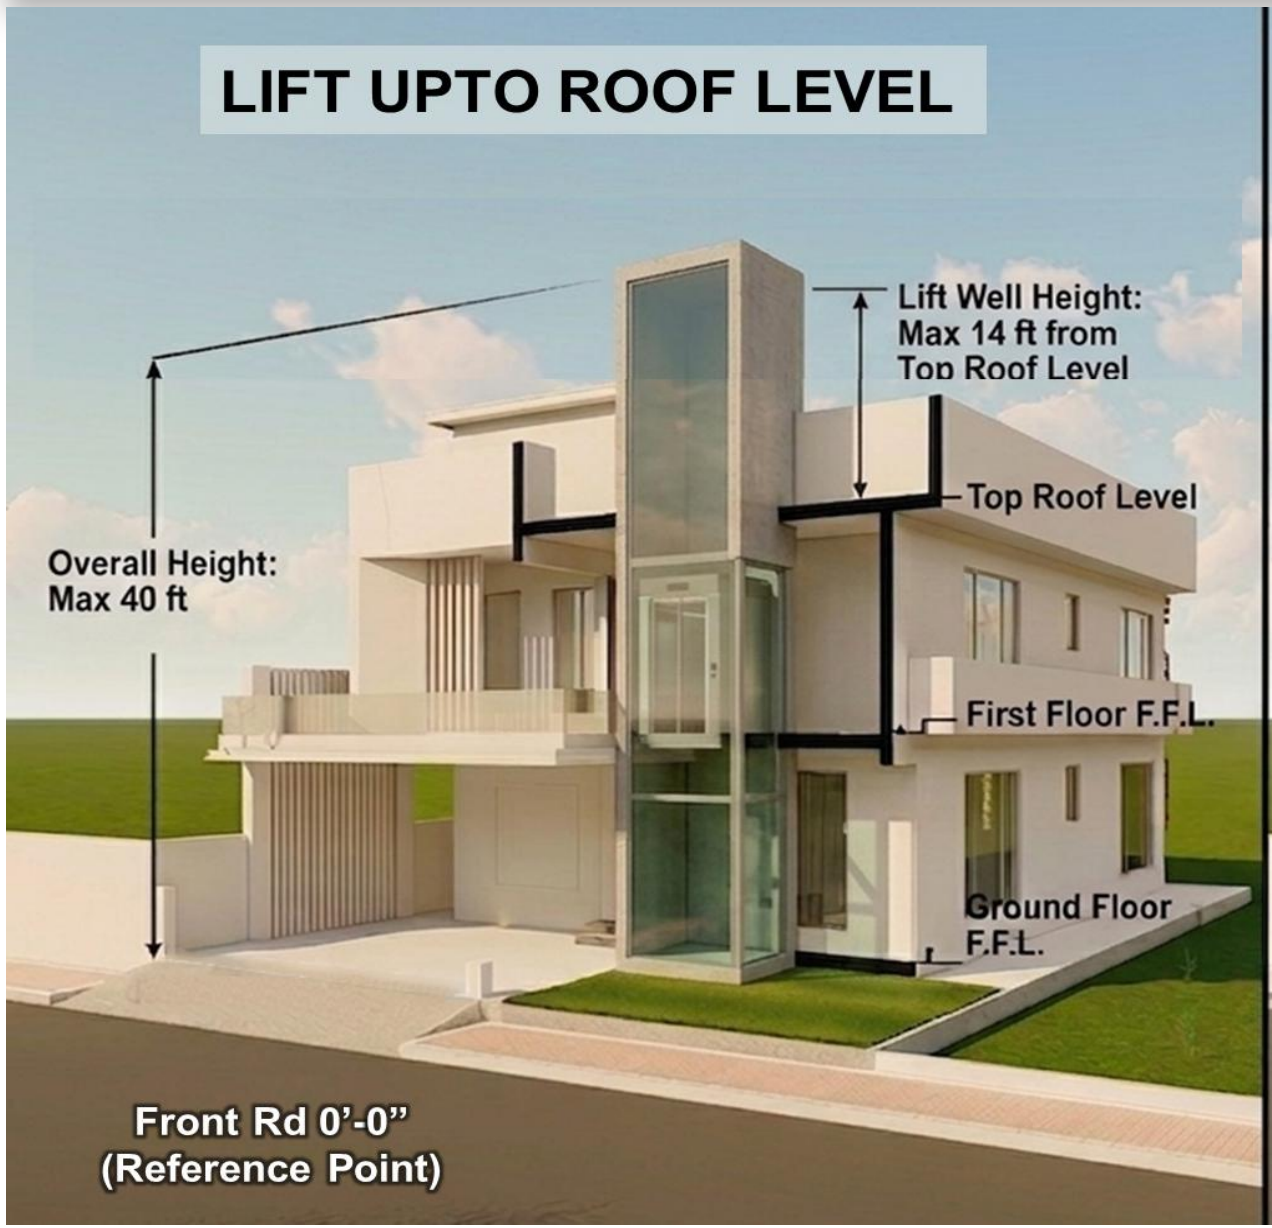


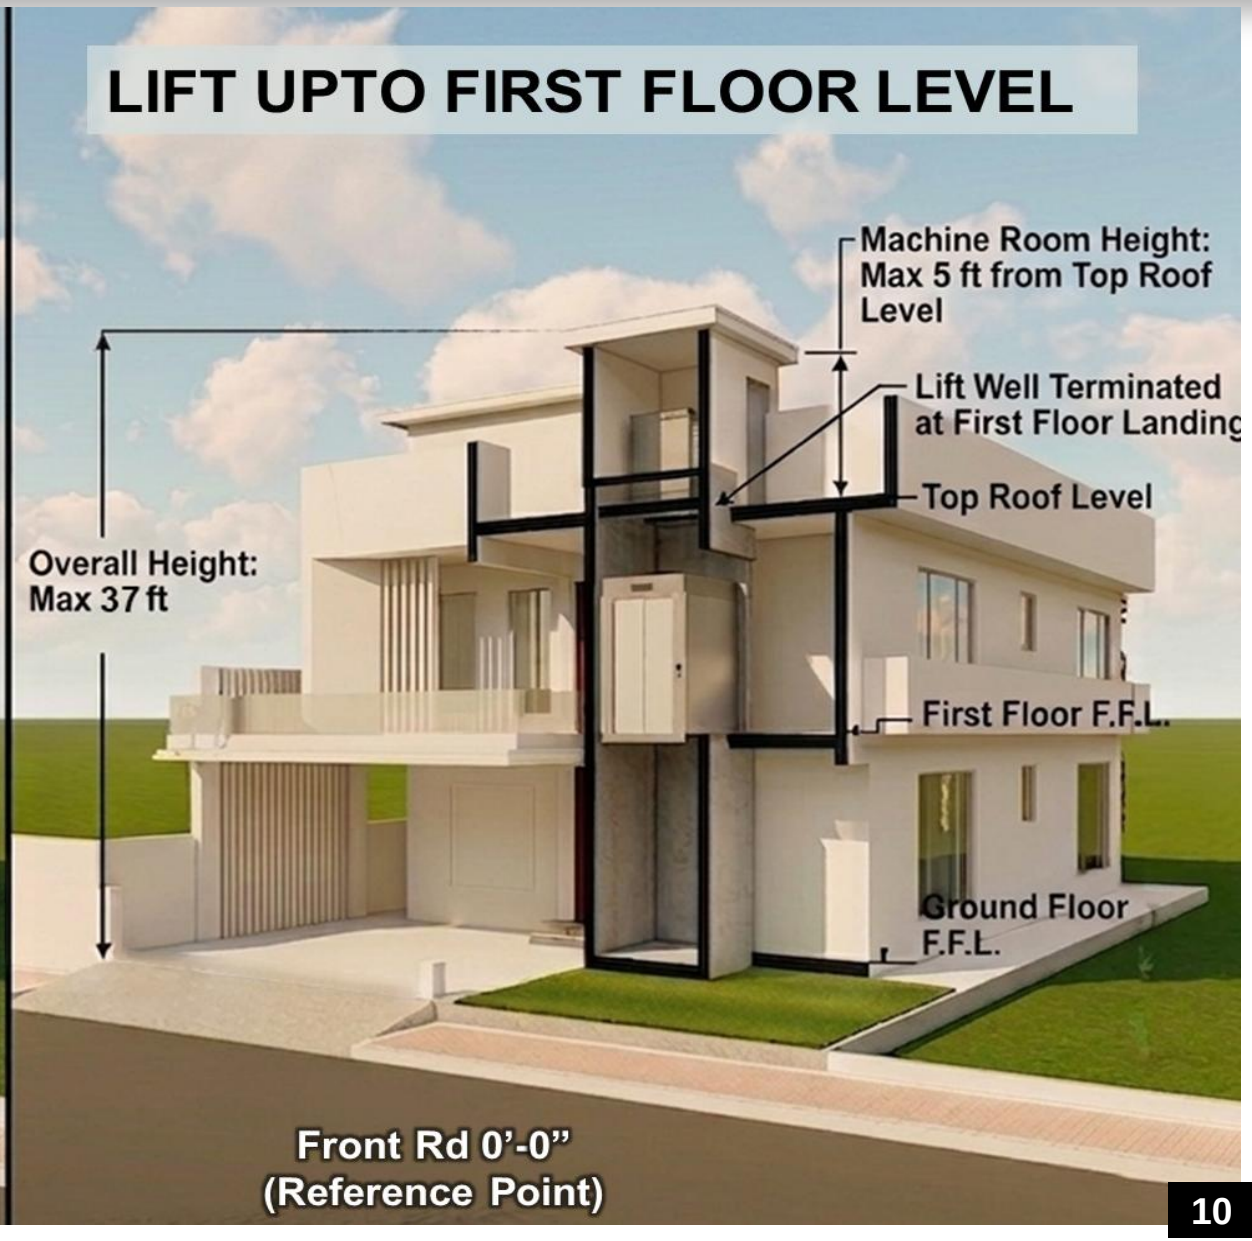


MUMTY


Location
Mandatory over Primary Stairs
Width
Half of the Plot Width
Overall Height
Max 11'-0"
Machine Room
5'
Total / Average Plot Width
Parapet Wall Exception
(If Lift machine room is within the Mumty)
Can be raised enough for aesthetical look
Covered Area
(If Lift machine room is within the Mumty)
Area will be calculated in covered area of mumty
(If Lift machine room height does not exceed 5 ft)
Will not be calculated in covered area of mumty

RAMP (DRIVEWAY) IN SERVICES AREA

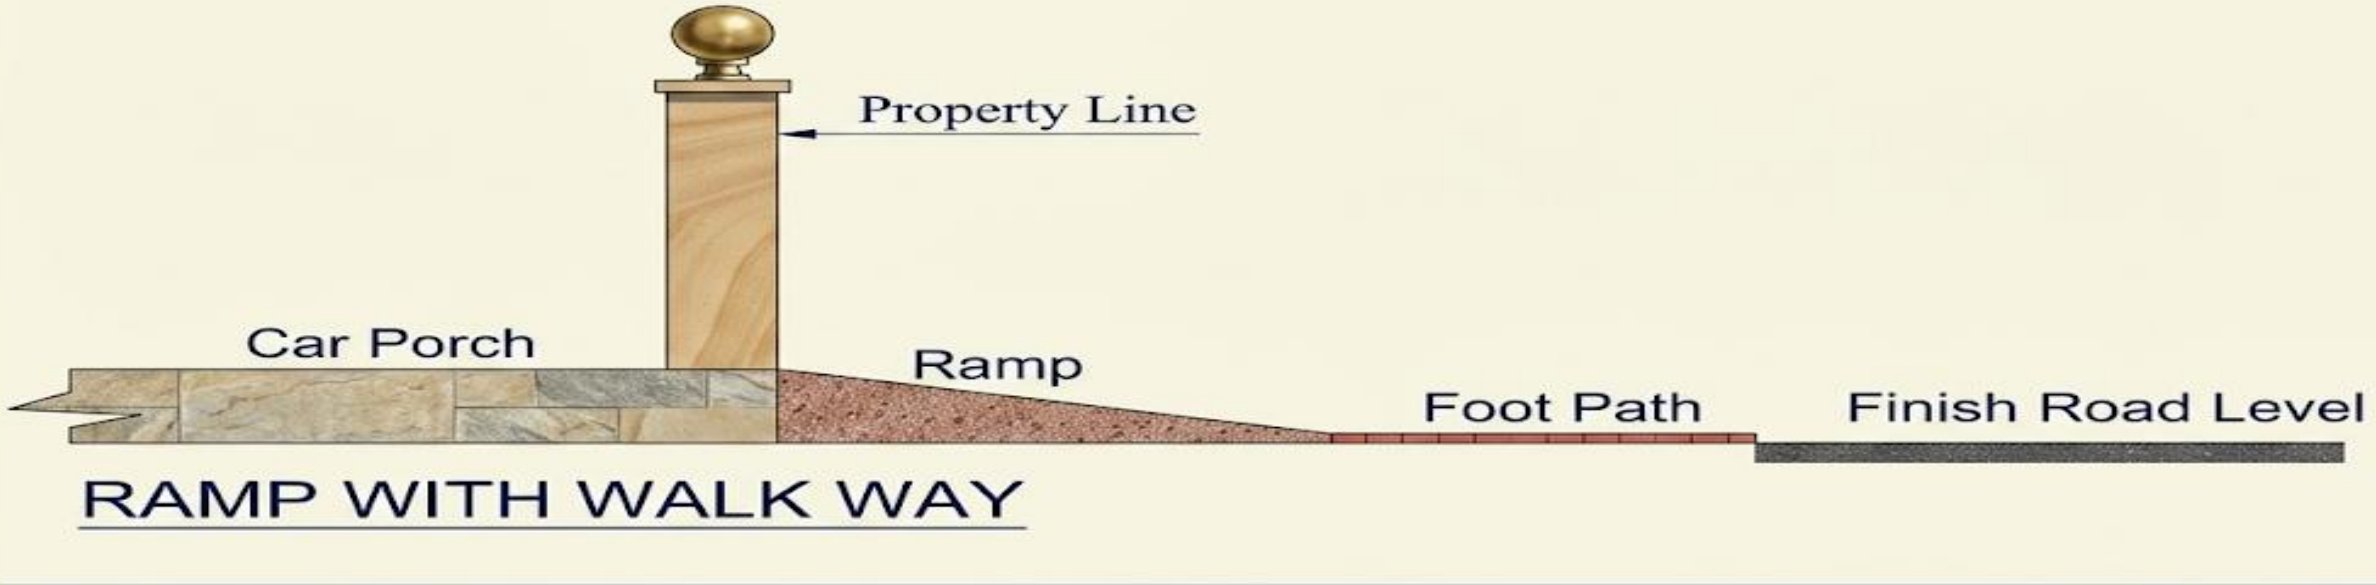

RAMP WITH WALK WAY

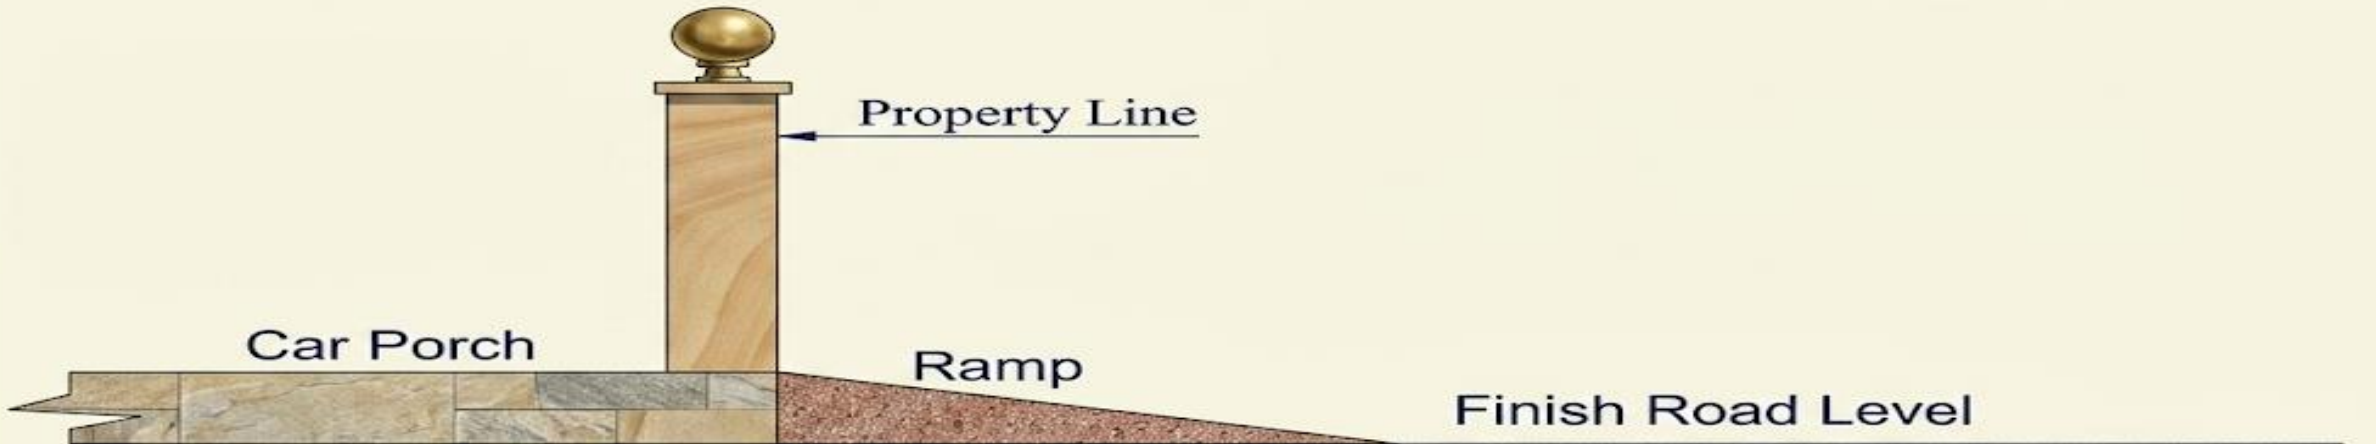


RAMP WITHOUT WALK WAY


ENTRY GATE


Pillar Width
(Including Wall)
Not more than 1'-6"
Design Element over Wicket Gate
(Allowed see Clause 8.61.4.1)
2nd Gate Width
Upto 14 ft (Standard)
Upto 16 ft (Payment)
Design Element over Main Gate
(Not Allowed)
Width
Upto 20 ft (Standard)
Increased Upto 27 ft (Payment)
Wicket Gate in Extra Land
Upto 3 ft (Standard)
Upto 14 ft (Payment)

BOUNDRY WALL

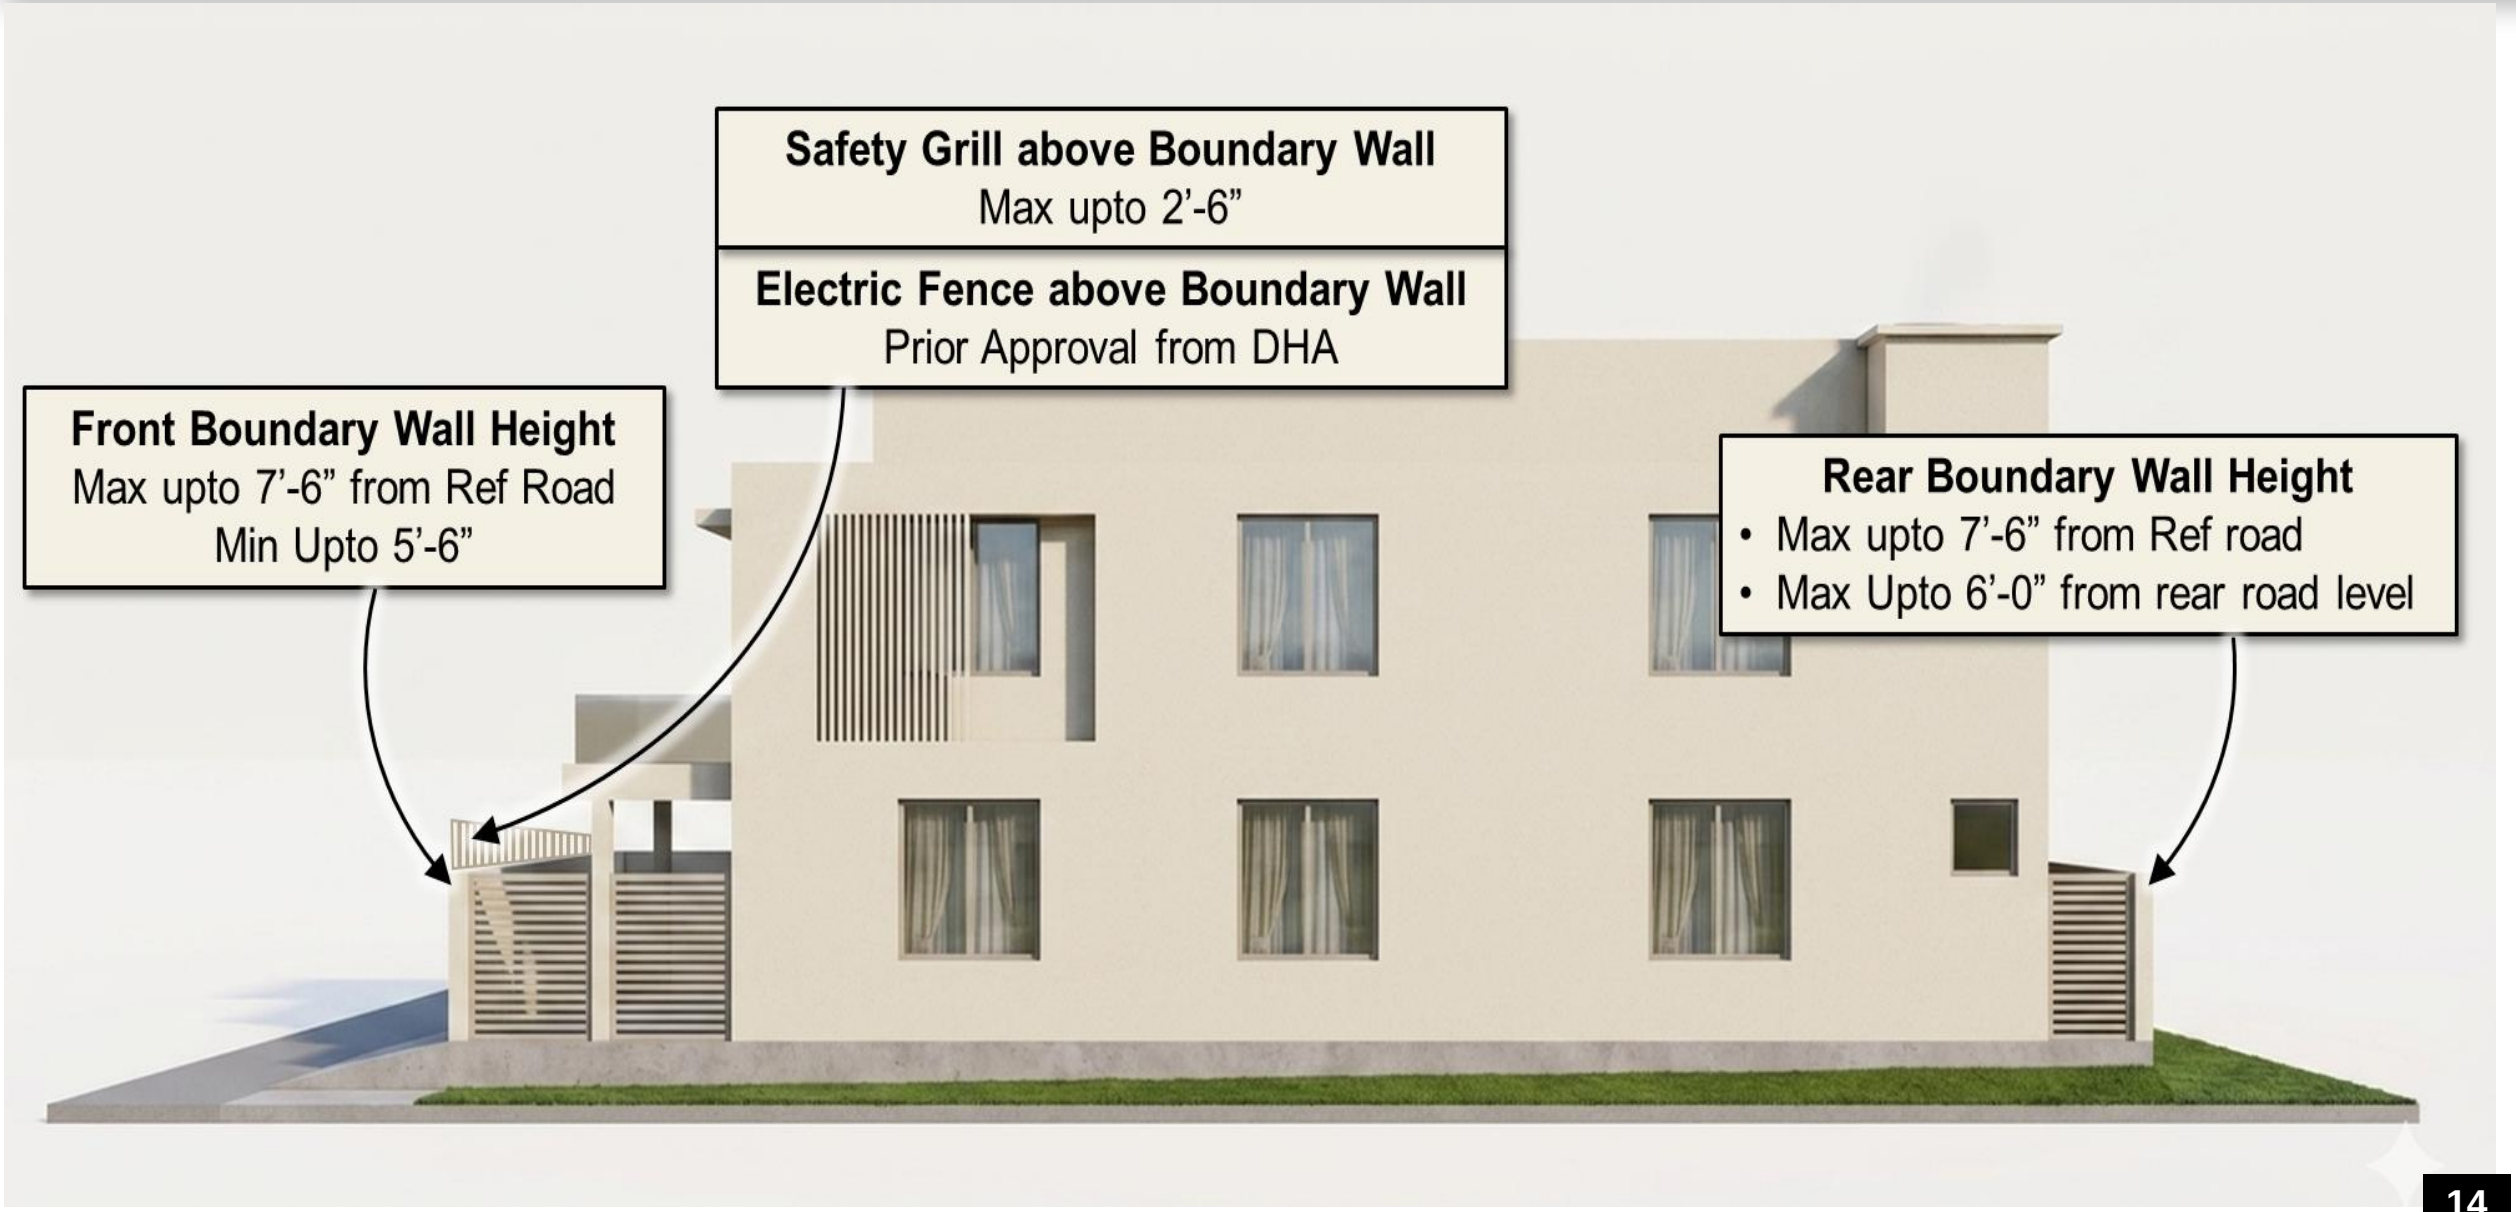


TWO ADJACENT PLOTS AT DIFFERENT LVLS

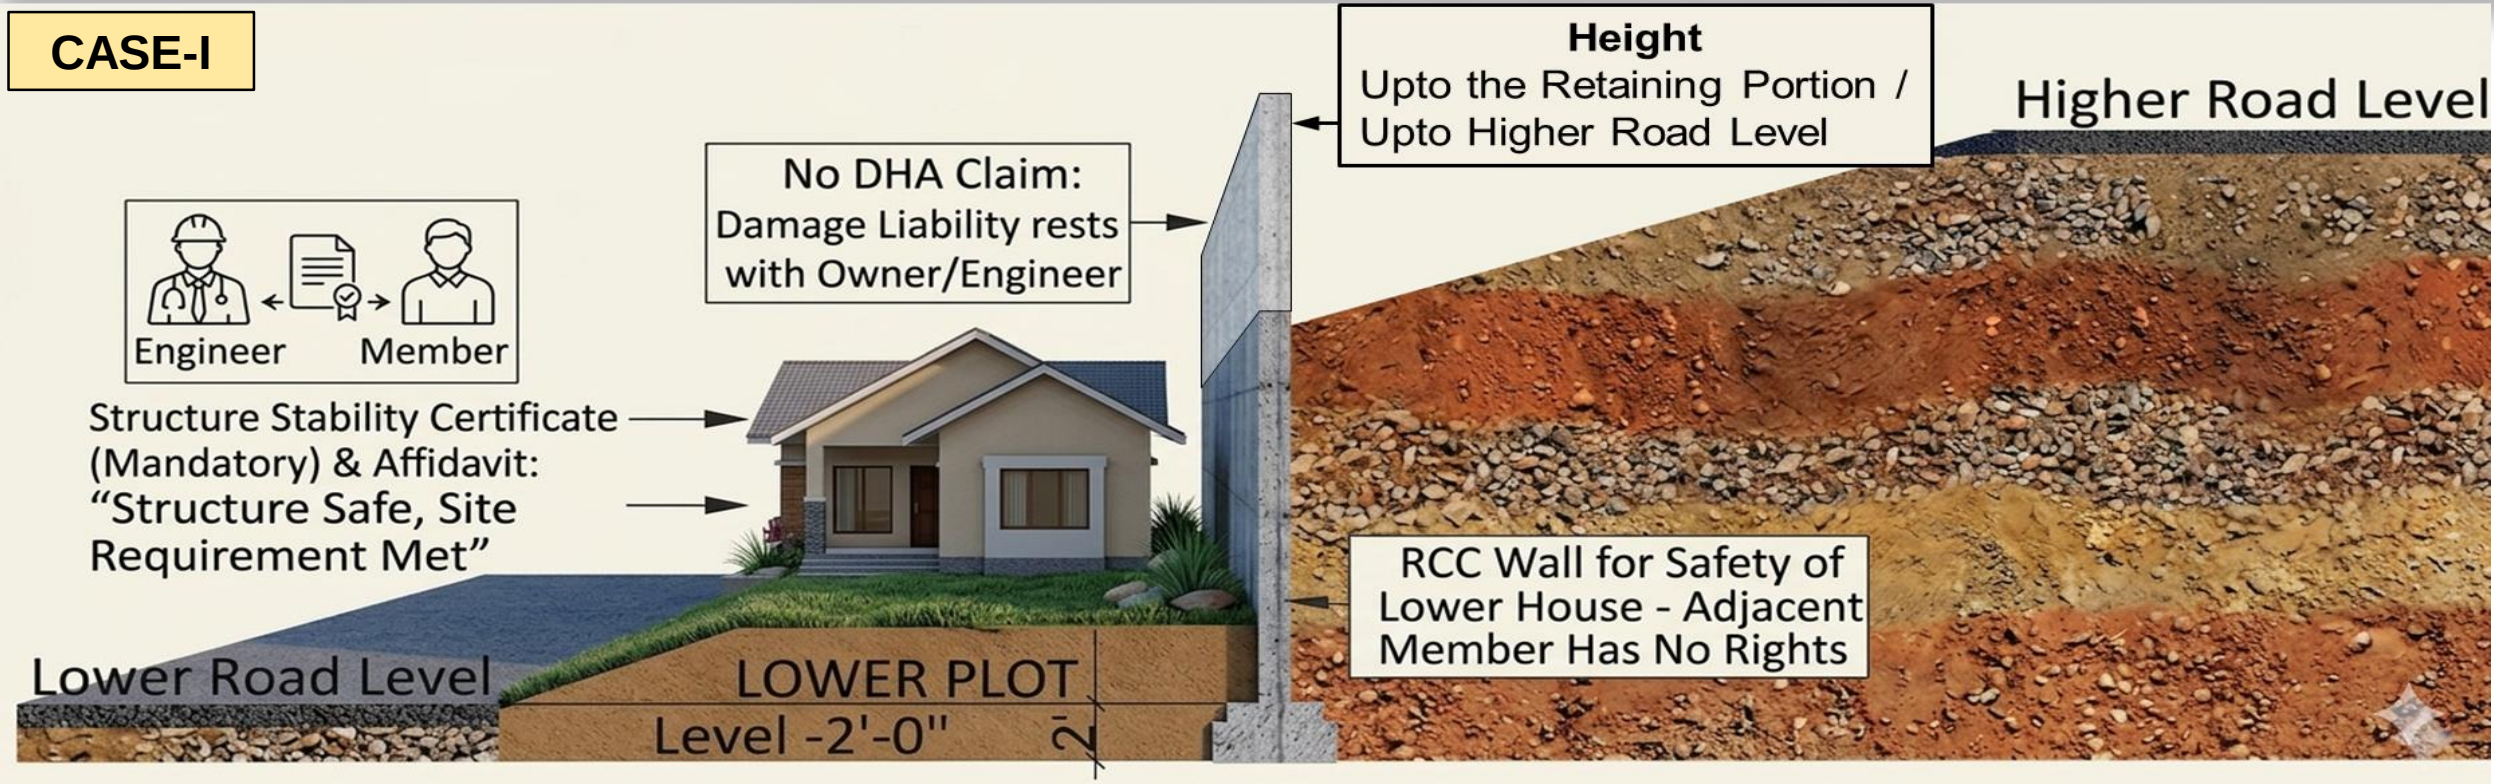

8.65.1 Case-I (Two back-to-back plots with a level difference of 5 ft or more and construction on a lower plot). If the house is constructed on the lower side first then the member will have to construct an RCC wall and the top of the RCC wall should be up to the retaining portion/rear road level to ensure the safety of the house. The structure stability certificate by the Structure Engineer and affidavit by the member is mandatory stating that the structure is safe and as per site requirement, and in case of any damage the owner/Structure Engineer will be responsible and the member will not claim any damage from DHA. This retaining wall is only for the safety of his own house and any adjacent member will have no right to the constructed wall.

TWO ADJACENT PLOTS AT DIFFERENT LVLS

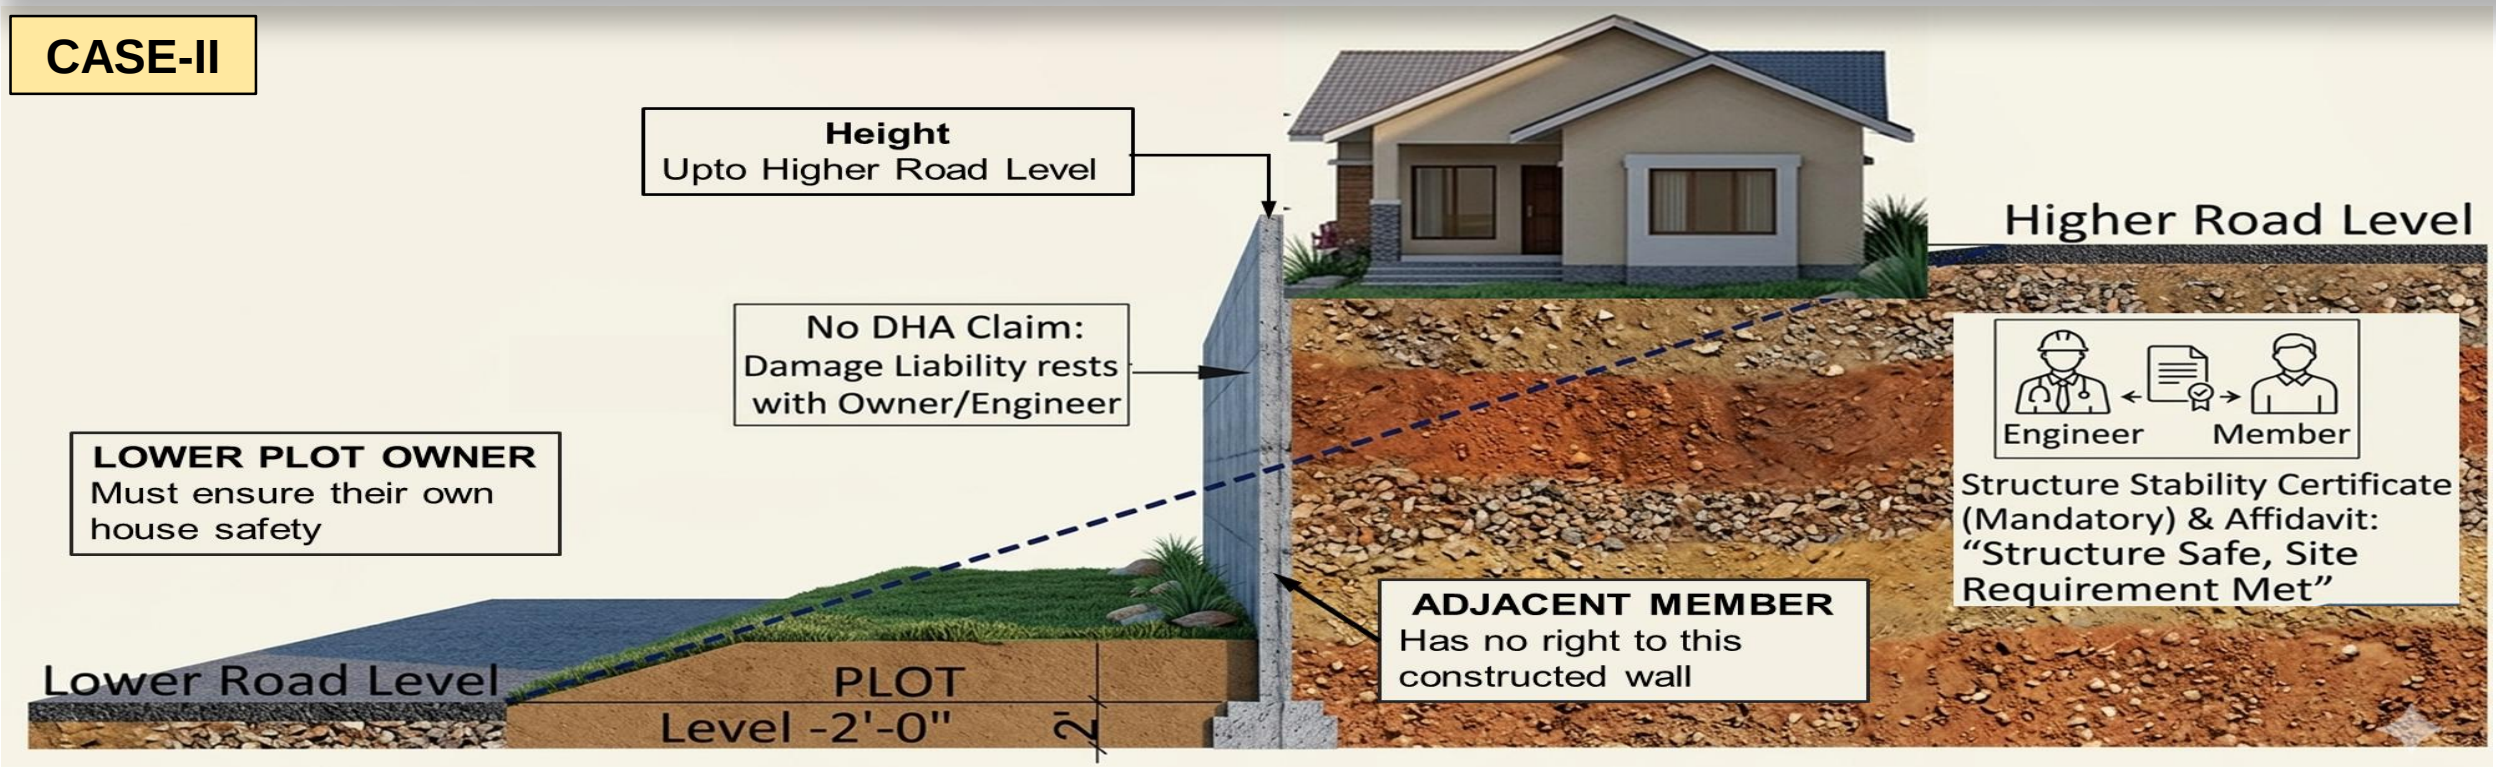

8.65.2 Case-II (Two back-to-back plots with a level difference of 5 ft or more and construction on higher plot). If the house is constructed on the upper side then its foundation shall start 2 ft below the level of the lower road and its top shall be upto the retaining portion. The structure stability certificate by the Structure Engineer and affidavit by the member is mandatory stating that the structure is safe and as per site requirement, and in case of any damage the owner /structure engineer will be responsible and the member will not claim any damage from DHA. This retaining wall should be only for the safety of the upper house and members of the house on the lower side will have no right on this wall and he will have to ensure the safety of his own house by constructing the type of structure as designed/recommended by his structure engineer based on site conditions and approved by DHA. This retaining wall is only for the safety of his own house and any adjacent member will have no right on the constructed wall.

RAIN WATER HARVESTING TANK




8.67.4 Rain Water Harvesting Tank. The RCC 'Rain Water' harvesting tank is mandatory for plots One Kanal & above. The harvesting tank shall be constructed in front COS/setback only after leaving at least 2 ft from the adjacent plot/house and 3 ft from the front boundary wall (for plots having a front COS/setback of 10 ft or more). The tank shall be waterproof and treated, "safe and sound". The layout of the rainwater harvesting tank along with the x-section shall be shown in the submission drawing.

ADDITIONAL SMAL OHWT


Allowed Only
(For Rain water usage)

Capacity
(1/4th of Original OHWT)

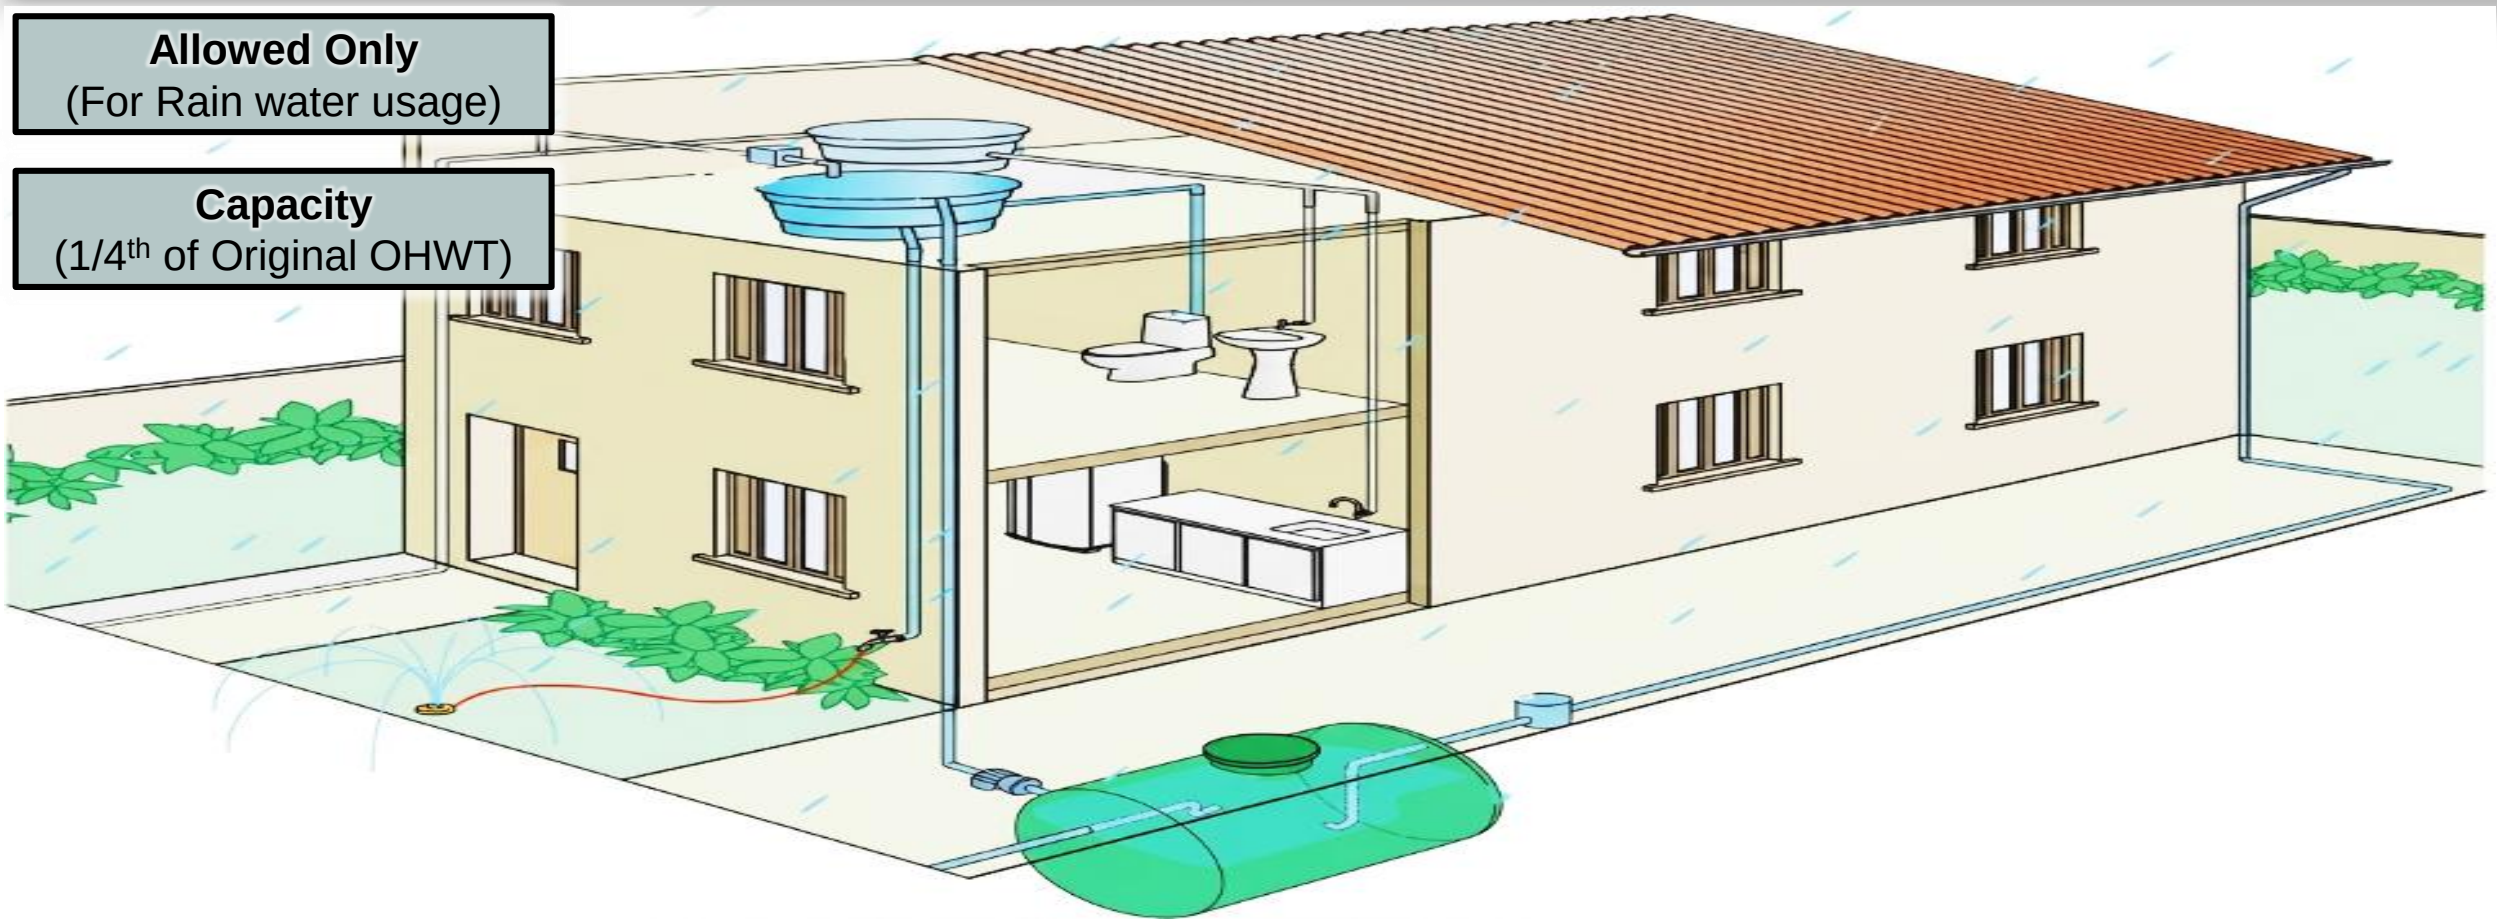


8.67.6 Additional Small OHT. Construction of an additional small overhead tank may be allowed if the member agrees to connect rainwater to the water tanks of commodes in the house and it shall not be more than ¼ size of the original OHT. The layout of the additional small overhead tank along with the x-section shall be shown in the submission drawing.


INSTALLATION OF SOLAR PANELS

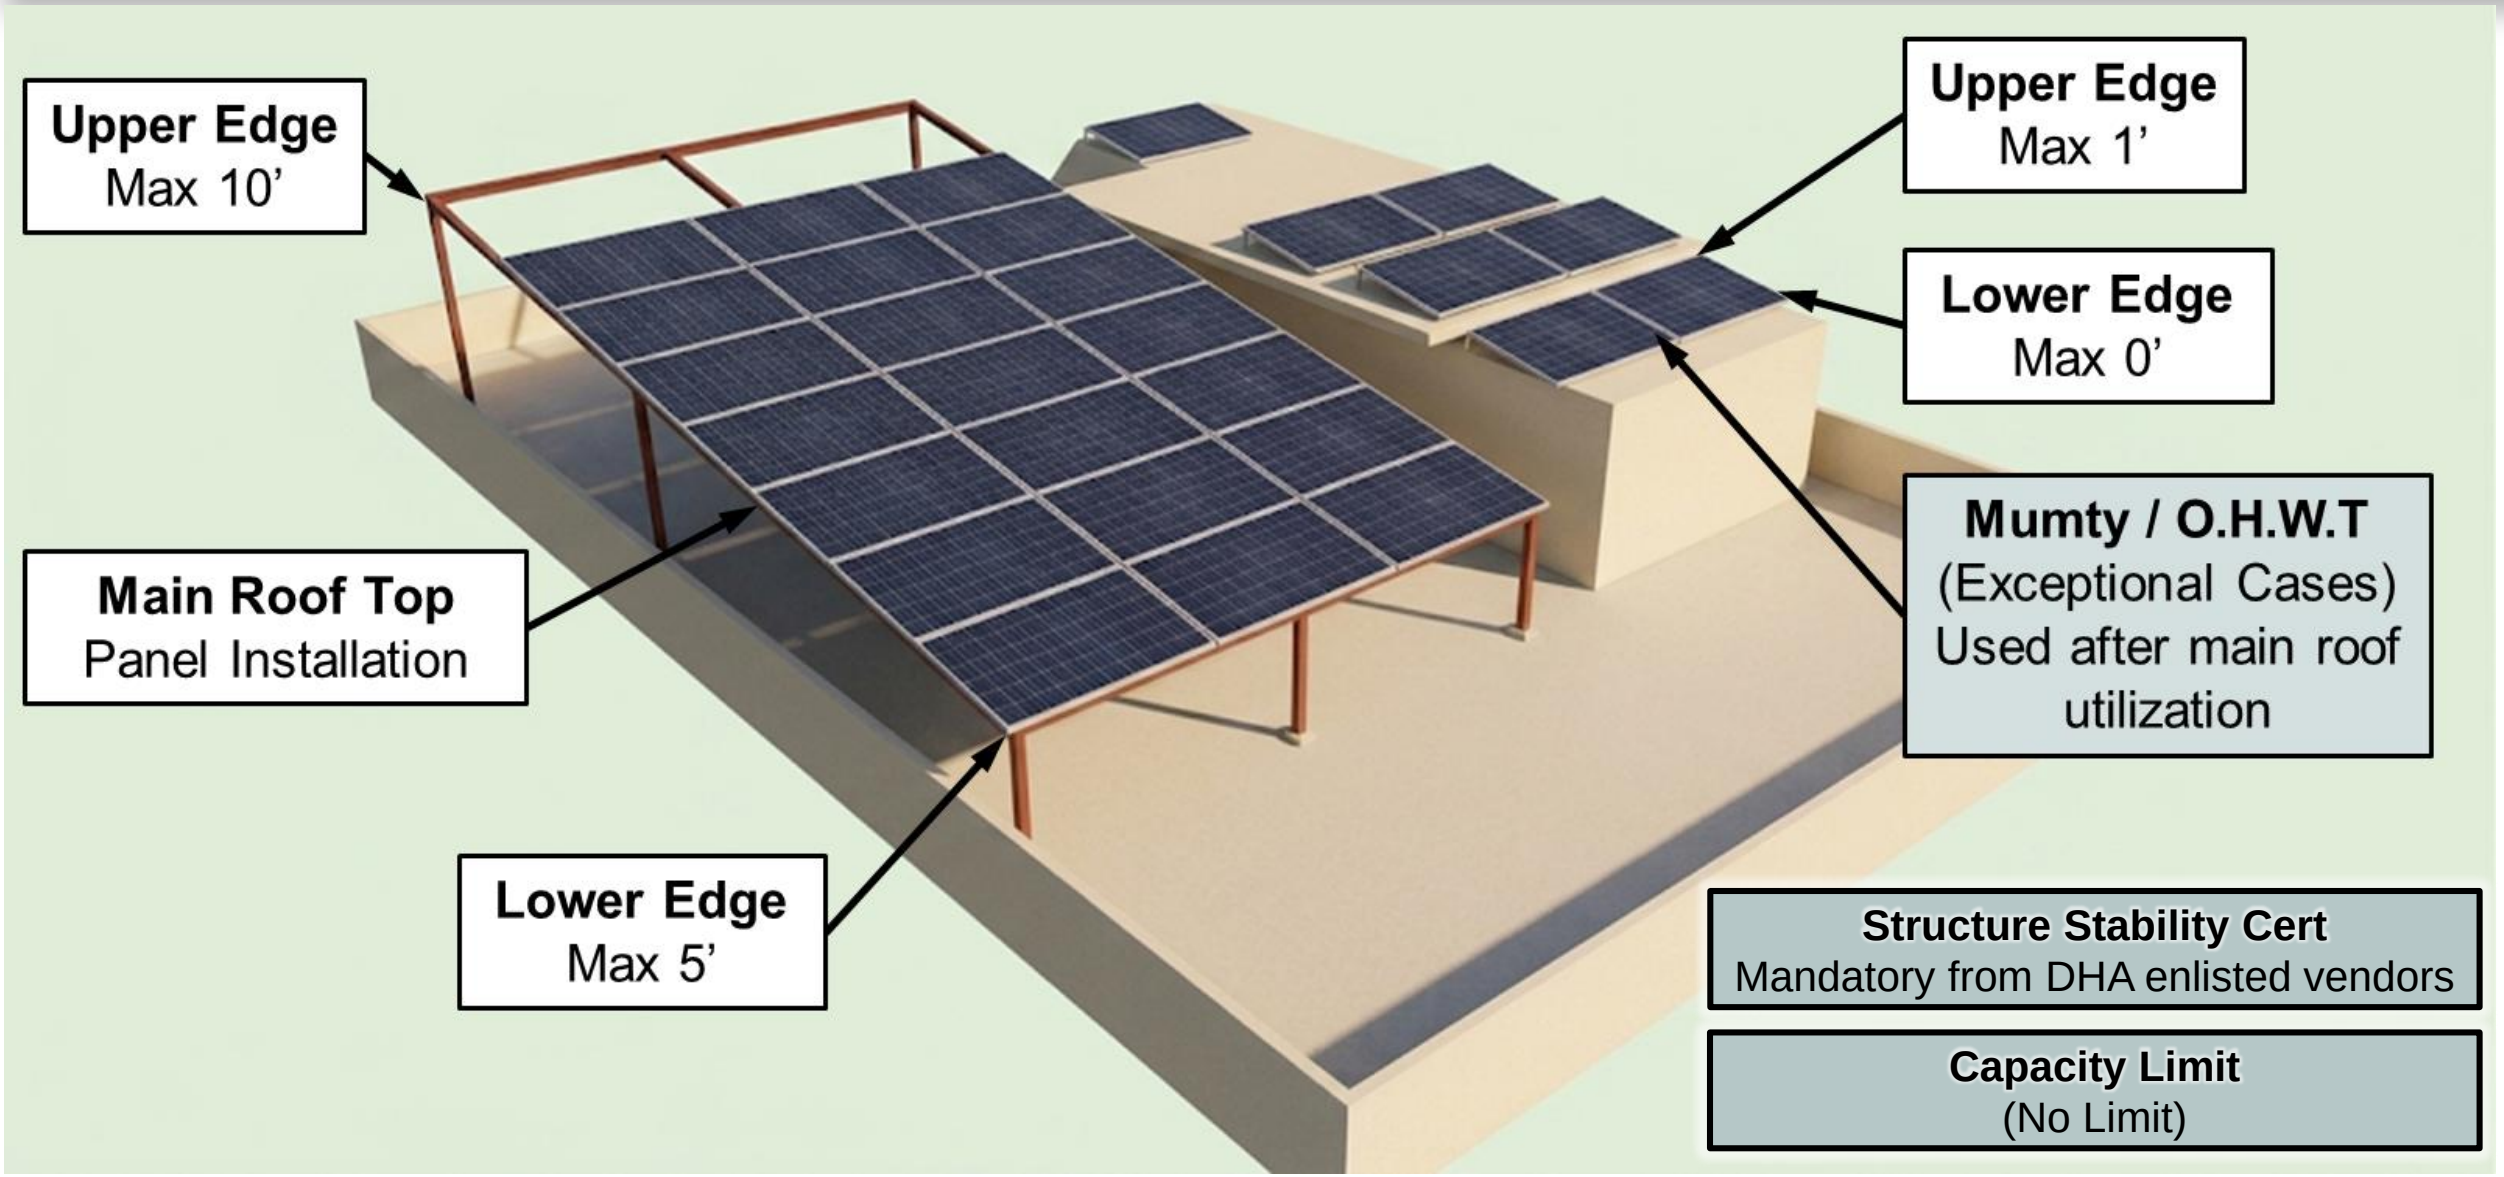

HEIGHT OF COMM BLDG

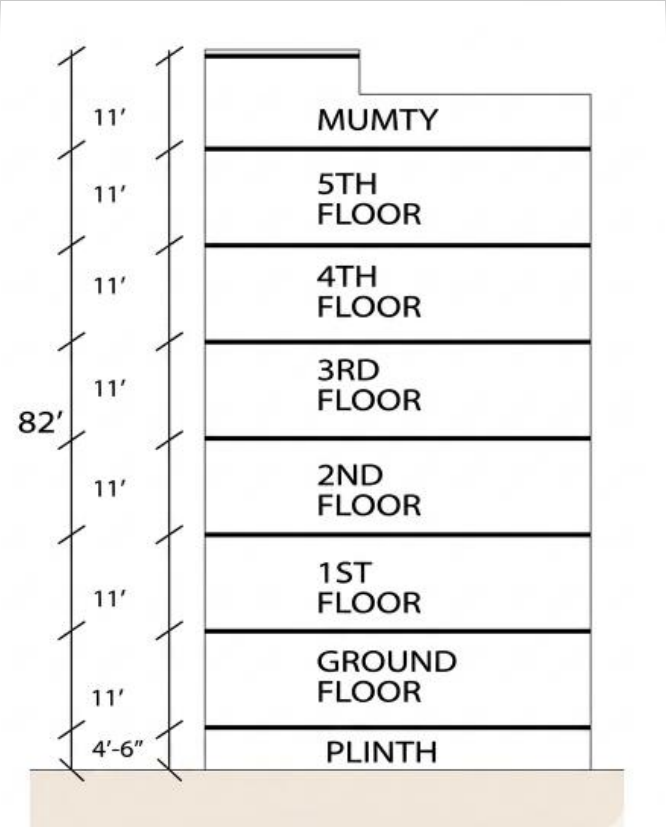

Main Comm

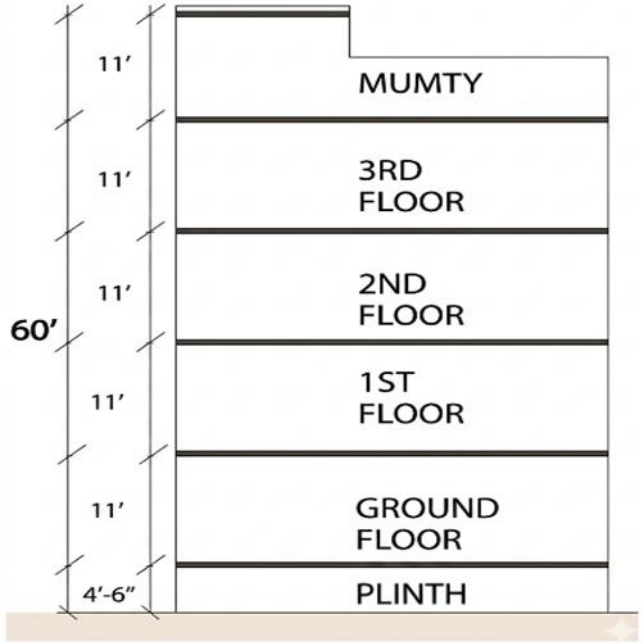

Sector Comm

8.86.1 Main Commercial. Max height of the main commercial shall not be more than 82 ft from the reference point, including the water tank & mumty.

8.86.2 Sector Commercial. Max height of the sector commercial shall not be more than 60 ft from the reference point, including the water tank & mumty.

PROVISION OF LIFT (COMM)

