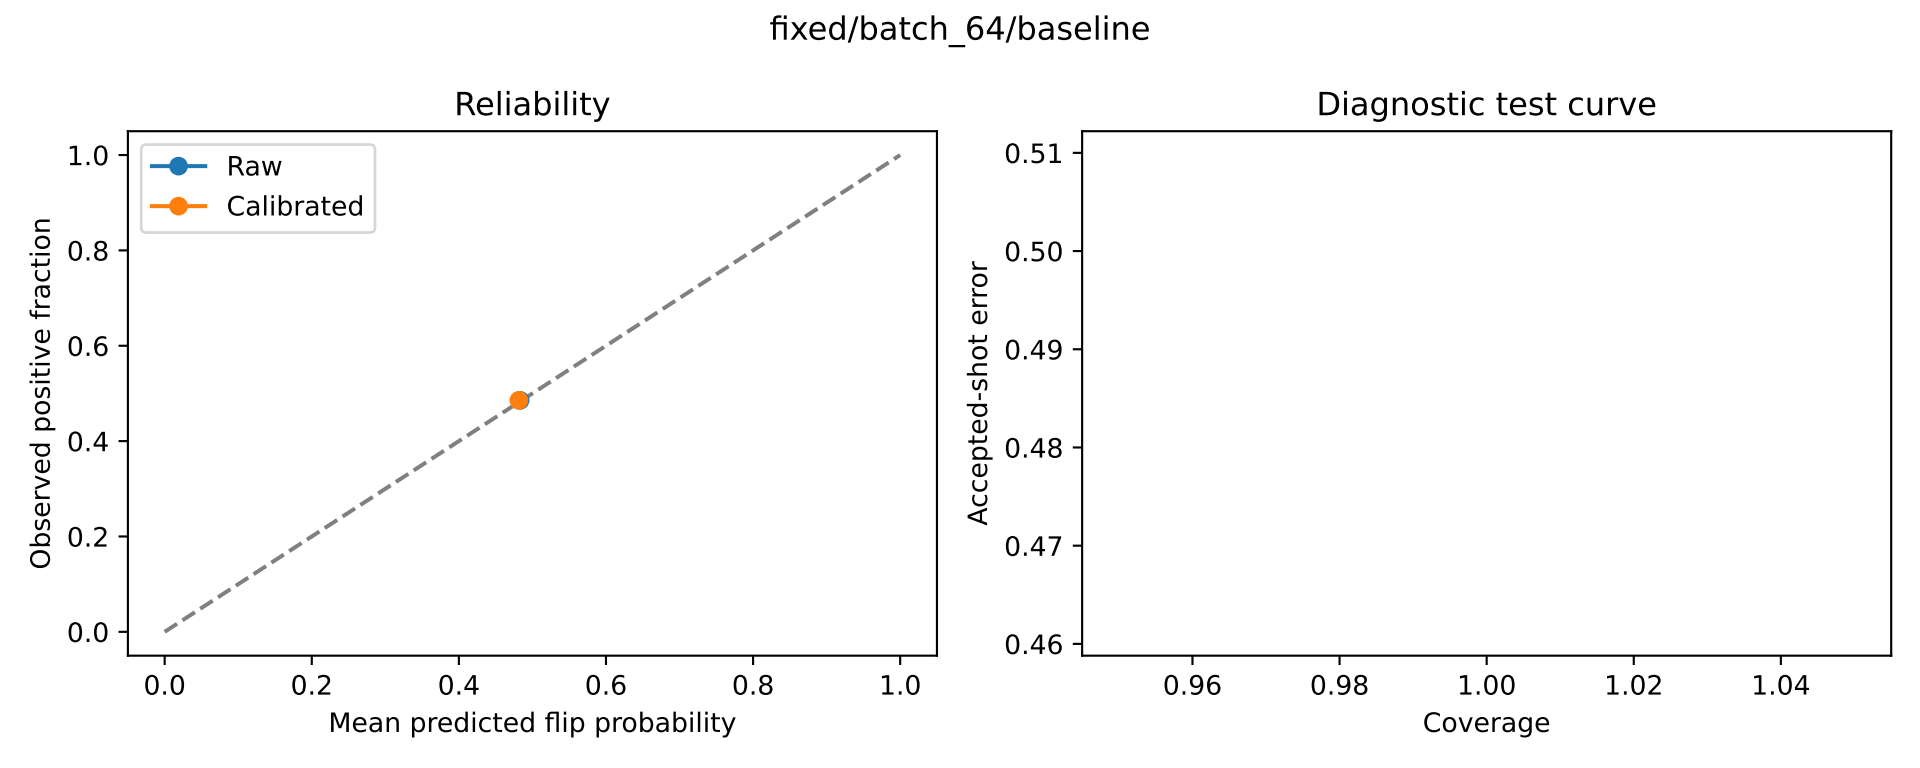
fixed/batch_64/baseline
Reliability
Raw
Calibrated
Observed positive fraction
Mean predicted flip probability
0.0
0.2
0.4
0.6
0.8
1.0
Diagnostic test curve
Accepted-shot error
Coverage
0.46
0.47
0.48
0.49
0.50
0.51
0.96
0.98
1.00
1.02
1.04