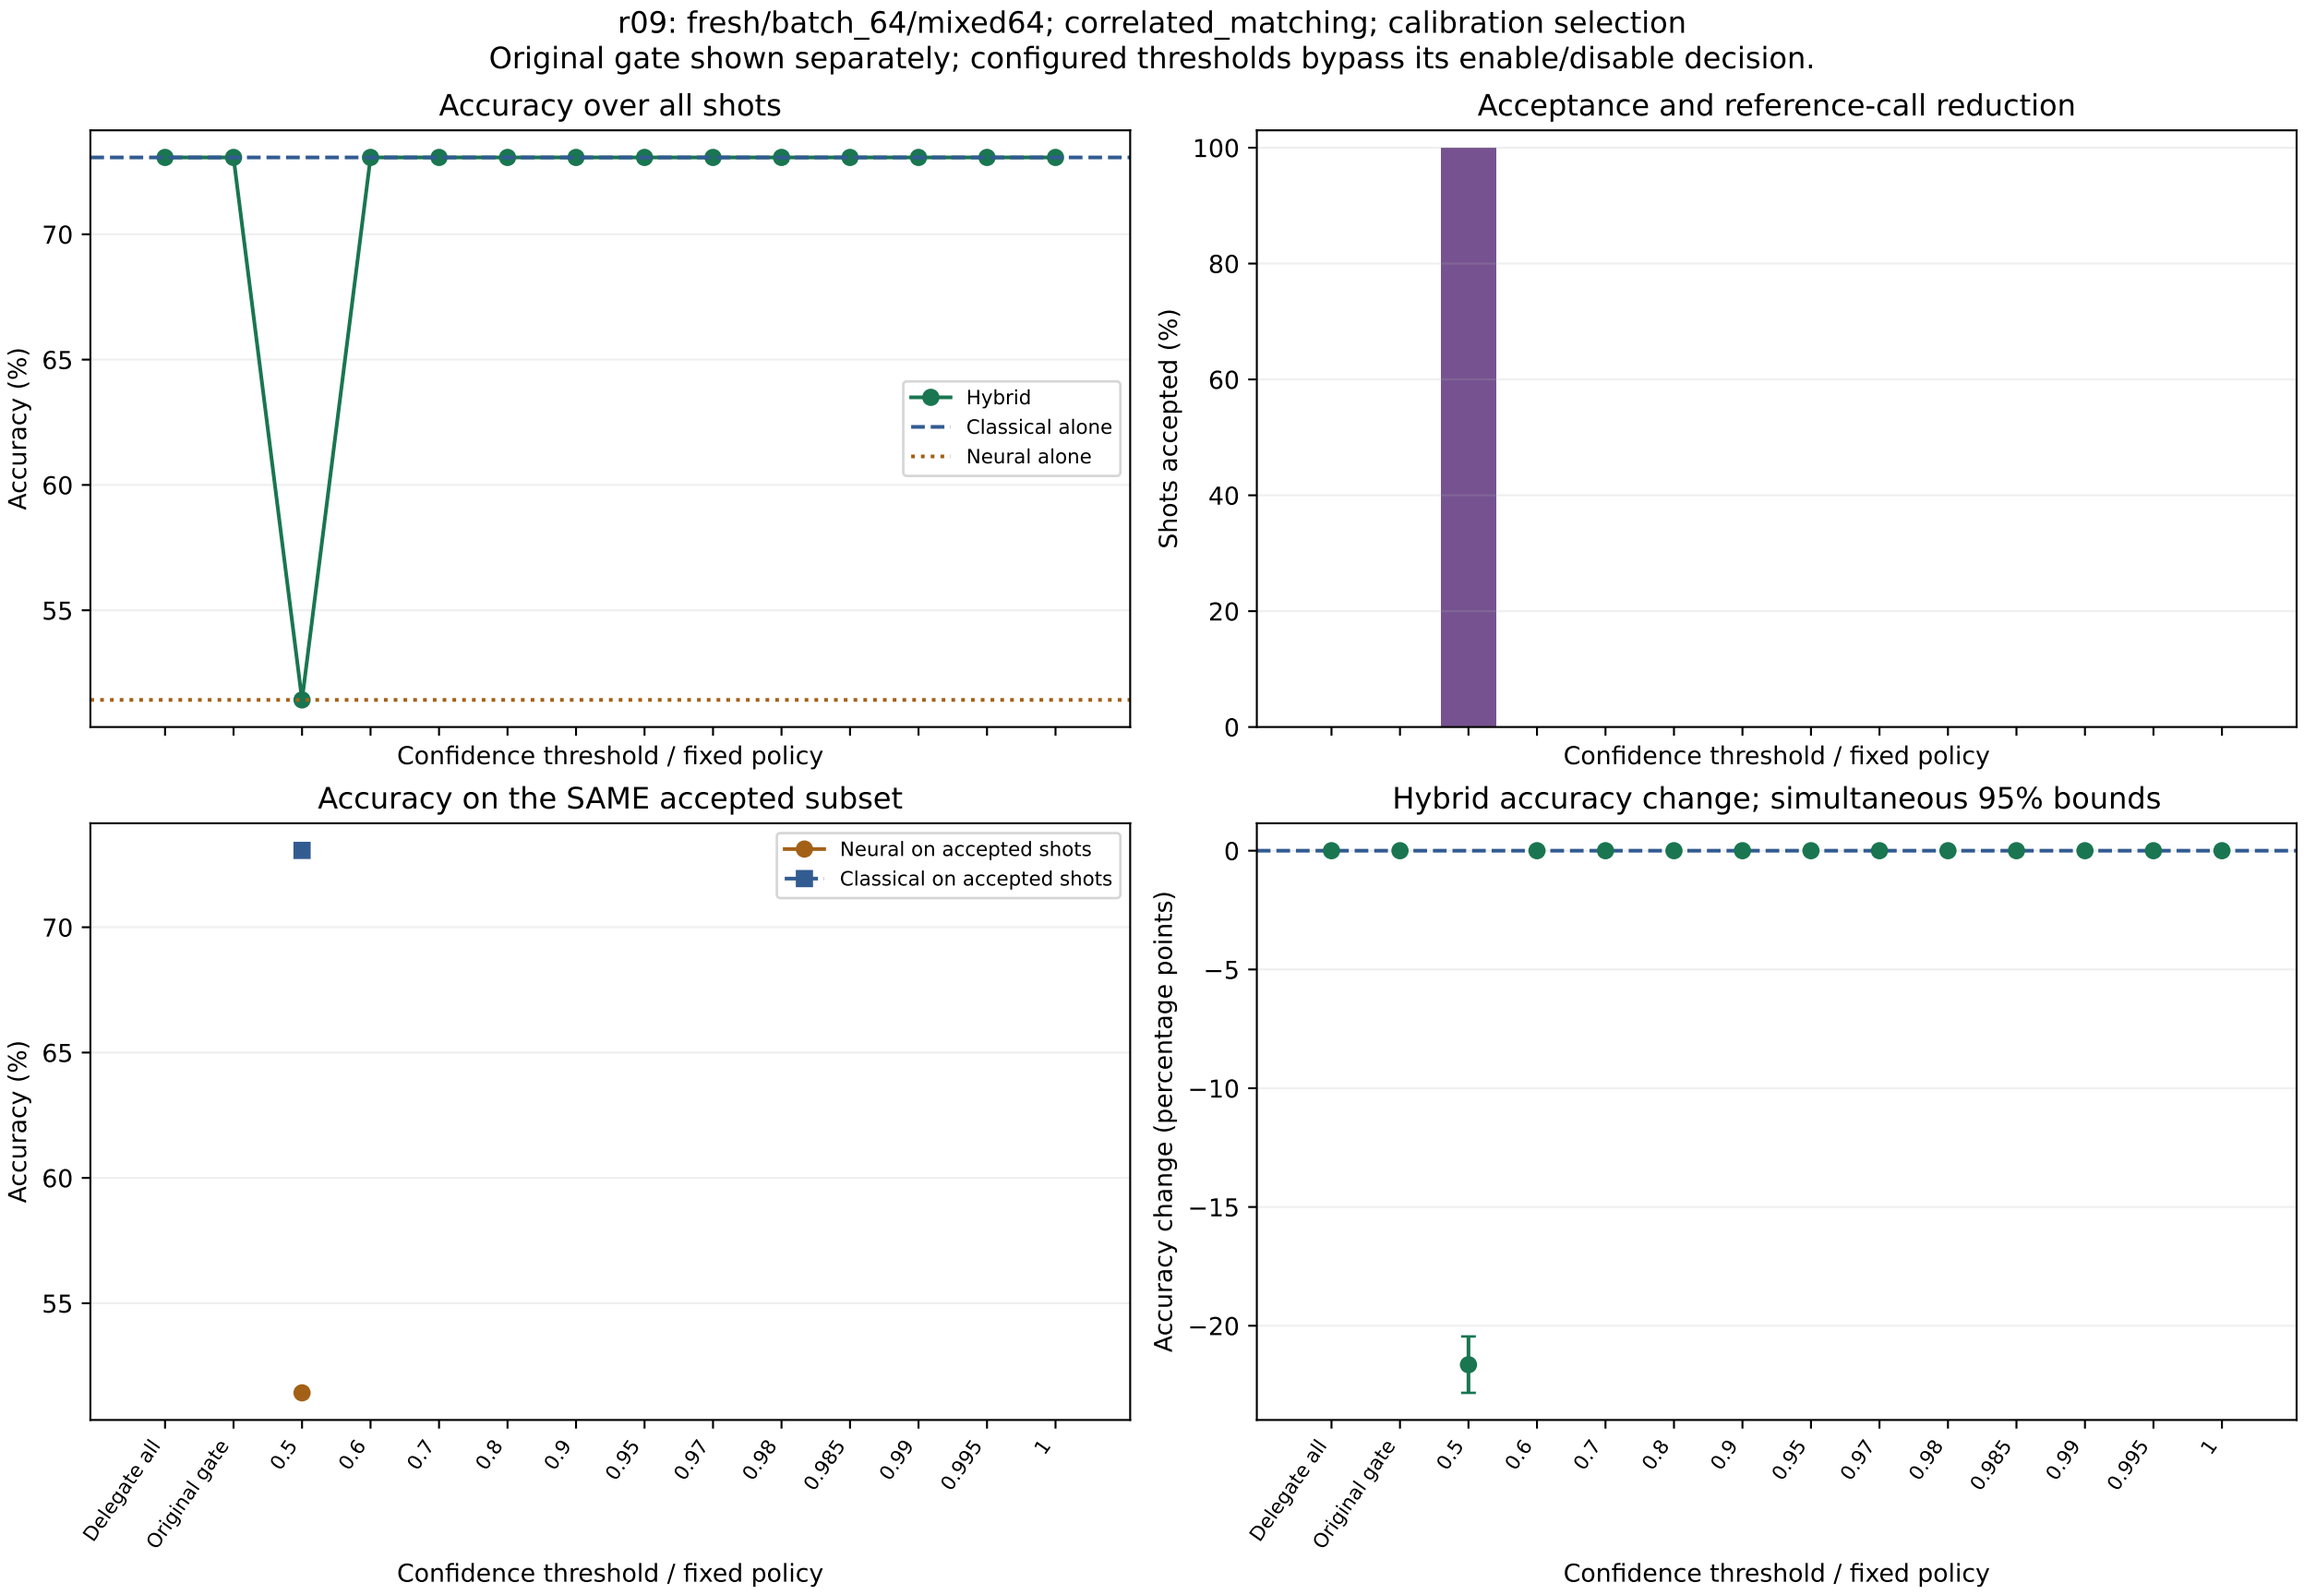
r09: fresh/batch_64/mixed64; correlated_matching; calibration selection
Original gate shown separately; configured thresholds bypass its enable/disable decision.
Accuracy over all shots
Accuracy (%)
Hybrid
Classical alone
Neural alone
Confidence threshold / fixed policy
Acceptance and reference-call reduction
Shots accepted (%)
Confidence threshold / fixed policy
Accuracy on the SAME accepted subset
Accuracy (%)
Neural on accepted shots
Classical on accepted shots
Delegate all
Original gate
0.5
0.6
0.7
0.8
0.9
0.95
0.97
0.98
0.985
0.99
0.995
1
Confidence threshold / fixed policy
Hybrid accuracy change; simultaneous 95% bounds
Accuracy change (percentage points)
Confidence threshold / fixed policy