NEW CHAPTER INSPECTION & CONSULTING

+16725330062
info@newchapterinspectbc.com
https://www.newchapterinspectbc.com

RESIDENTIAL REPORT

Coquitlam

04/22/2026

Inspector
Jake choi
CHI, Commercial Inspector
+16725330062
info@newchapterinspectbc.com

TABLE OF CONTENTS

11 MAINTENANCE ITEM

10 RECOMMENDATION

1 SAFETY HAZARD

SUMMARY

- 2.2.1 Exterior - Siding, Flashing & Trim: Caulking Needed
- 2.2.2 Exterior - Siding, Flashing & Trim: Squeaky Door
- 2.3.1 Exterior - Exterior Doors: Difficult Door Operation
- 2.3.2 Exterior - Exterior Doors: Stiff Door Knob
- 2.4.1 Exterior - Decks, Balconies, Porches & Steps: Loose Brick
- 3.1.1 Roof - Coverings: Roof Moss Growth Requiring Maintenance
- 4.5.1 Basement, Foundation, Crawlspace & Structure - Ceiling Structure: Ceiling Discoloration and Possible Mold Growth
- 5.1.1 Heating - Equipment: Furnace Maintenance Required
- 5.1.2 Heating - Equipment: Make-Up Air Heating Unit Not Fully Tested
- 6.4.1 Plumbing - Hot Water Systems, Controls, Flues & Vents: Water Heater at End of Life Expectancy
- 6.6.1 Plumbing - Sinks, faucets, toilets, bathtubs, showers: Caulking and Silicone Maintenance Needed
- 6.6.2 Plumbing - Sinks, faucets, toilets, bathtubs, showers: Non-Functional Sink Plug
- 6.6.3 Plumbing - Sinks, faucets, toilets, bathtubs, showers: Leaking Shower Handle
- 6.6.4 Plumbing - Sinks, faucets, toilets, bathtubs, showers: Stiff Faucet Handles
- 7.2.1 Electrical - Main & Subpanels, Service & Grounding, Main Overcurrent Device: No Legend on Main Panel
- 9.4.1 Attic, Insulation & Ventilation - Exhaust Systems: Weak Bathroom Exhaust Fan
- 10.2.1 Doors, Windows & Interior - Windows: Deteriorated Window and Door Caulking
- 10.2.2 Doors, Windows & Interior - Windows: Window Child Safety Devices
- 10.3.1 Doors, Windows & Interior - Floors: Squeaky Floors
- 10.5.1 Doors, Windows & Interior - Ceilings: Possible Asbestos in Ceiling Material
- 12.2.1 Garage - Floor: Minor Floor Cracks
- 12.4.1 Garage - Garage Door: Door Opener Under Repair

1: INSPECTION DETAILS

Information

In Attendance
Client, Home Owner, Client's Agent, Listing Agent

Occupancy
Furnished

Type of Building
Detached

Temperature
11 Celsius (C)

Weather Conditions
Cloudy

2: EXTERIOR

Information

General: Inspection Method

Visual

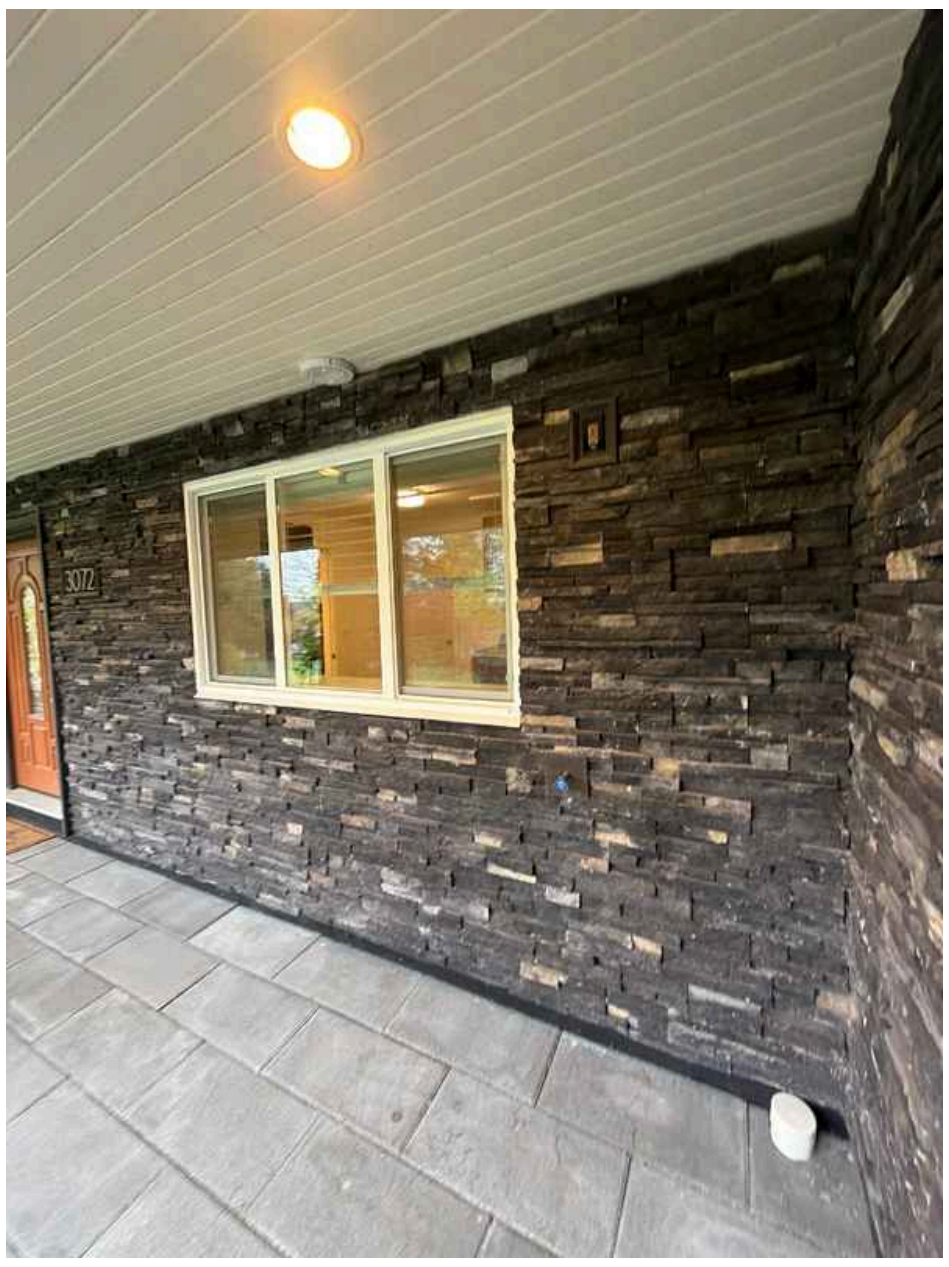

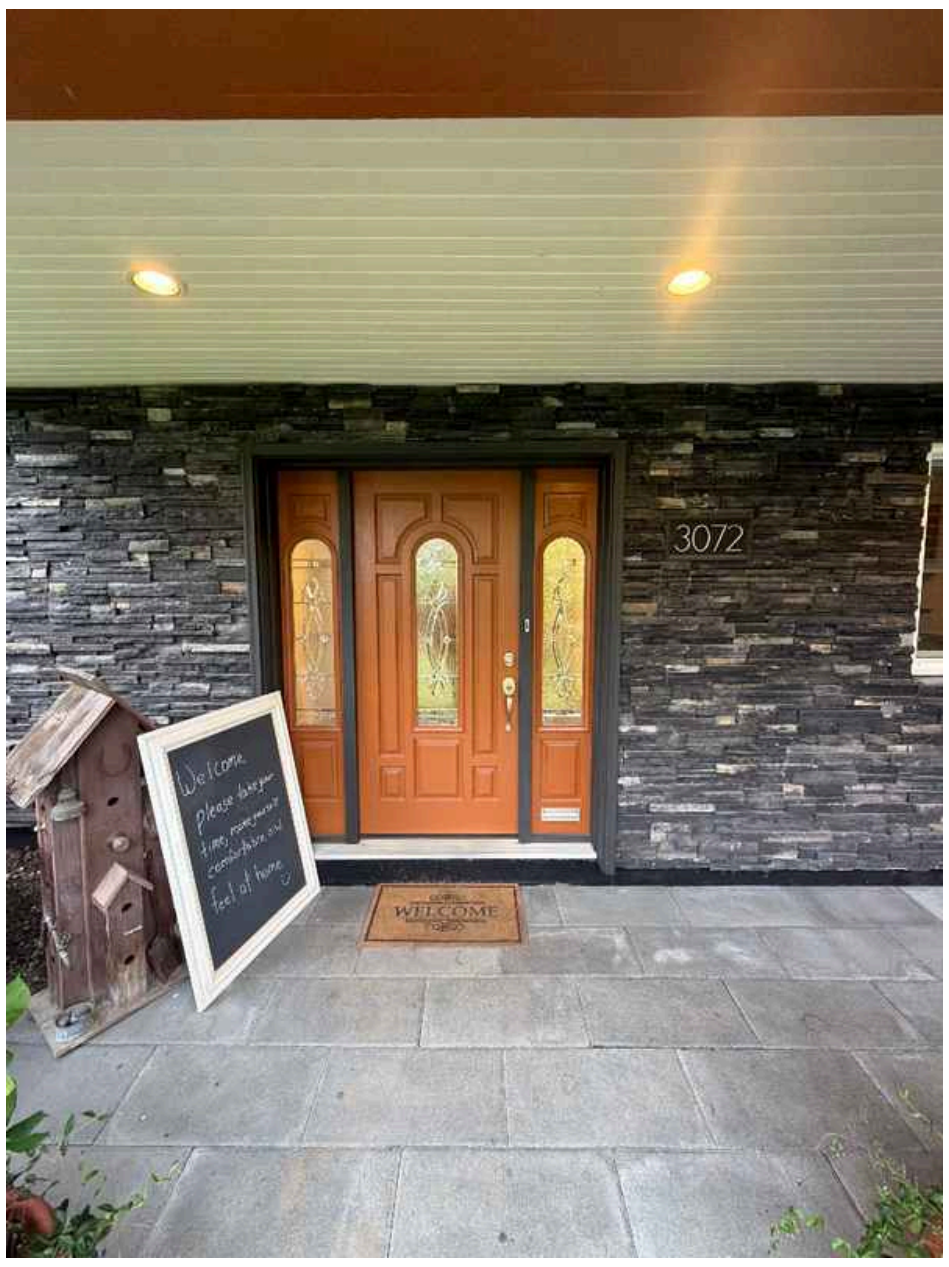

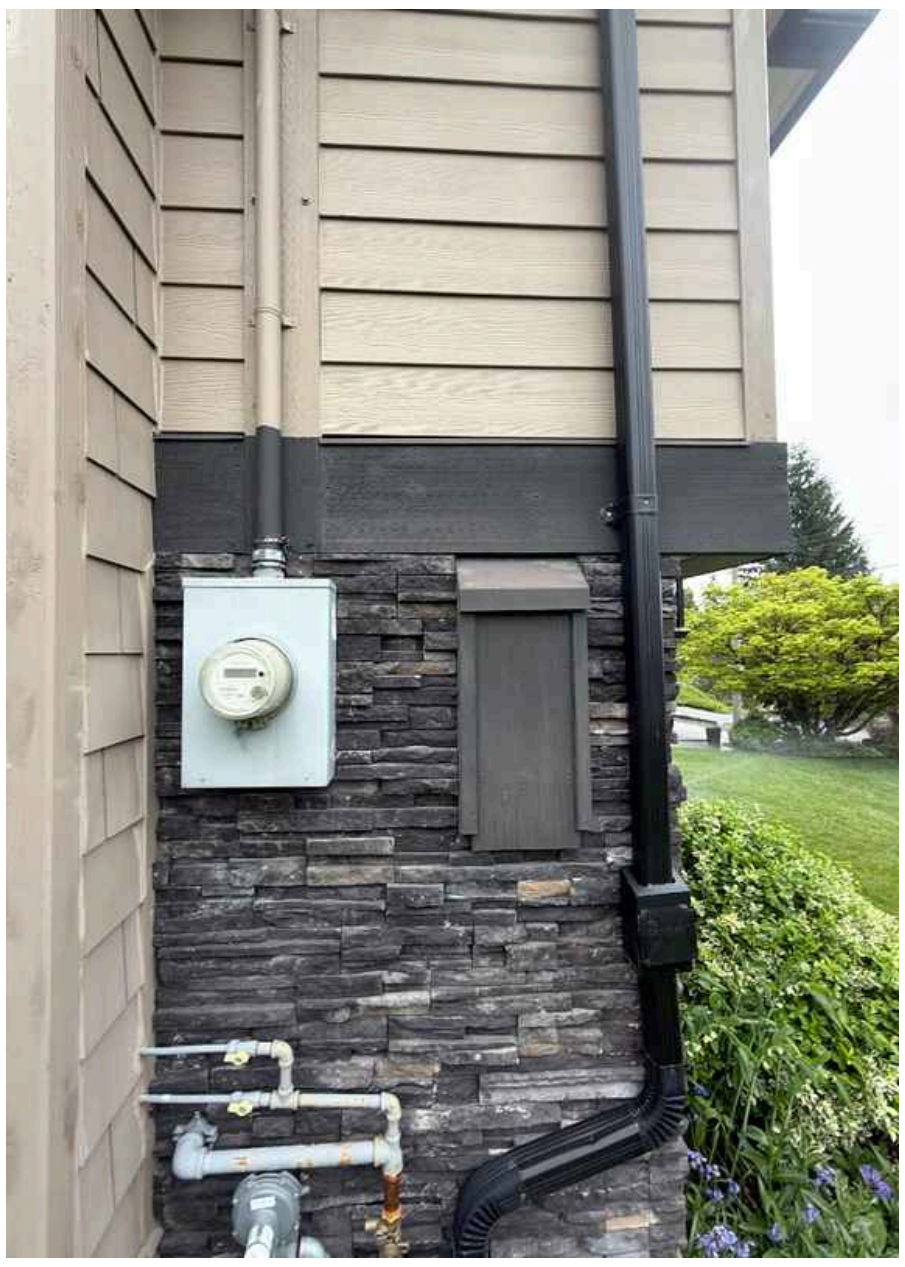
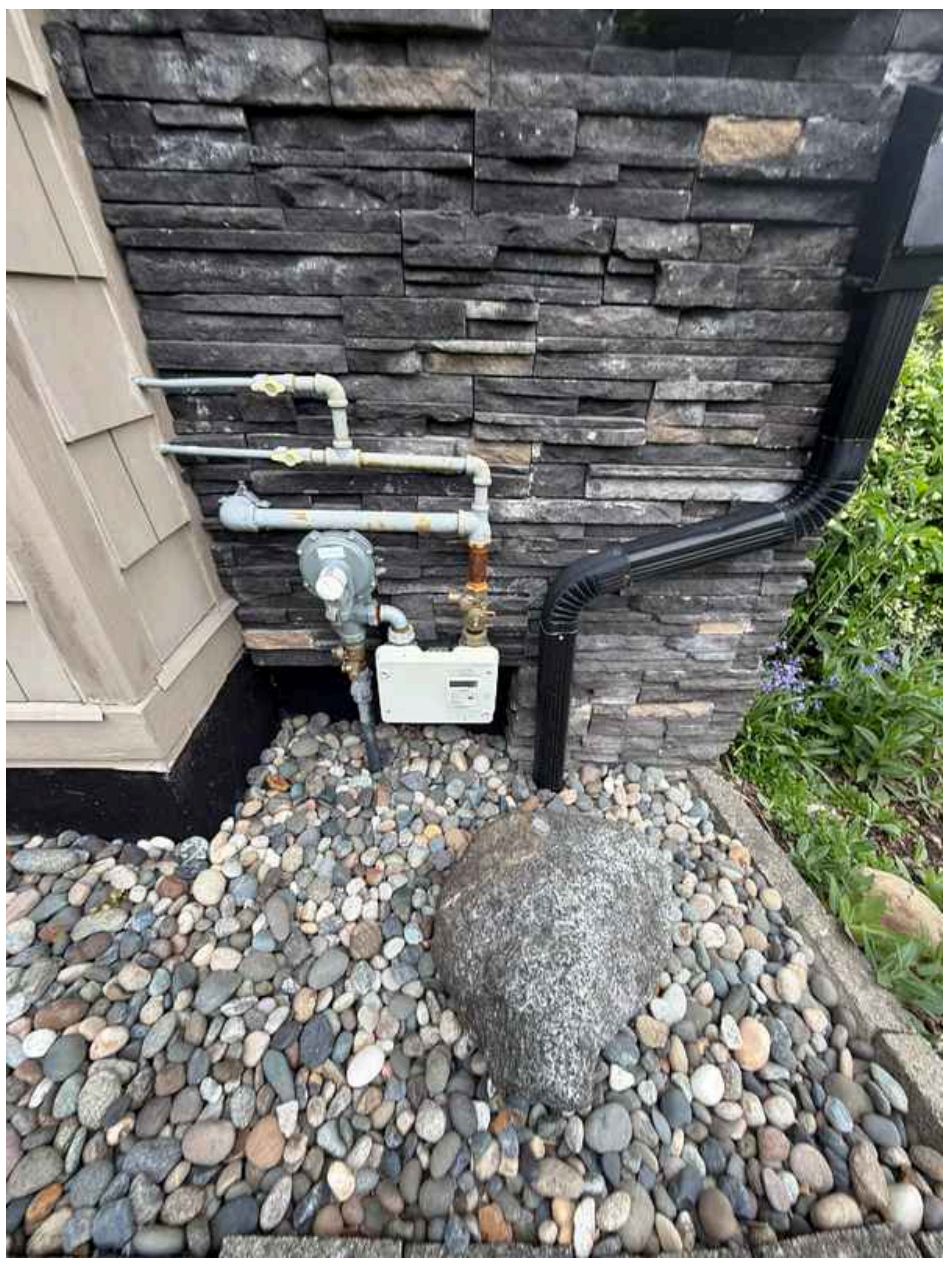
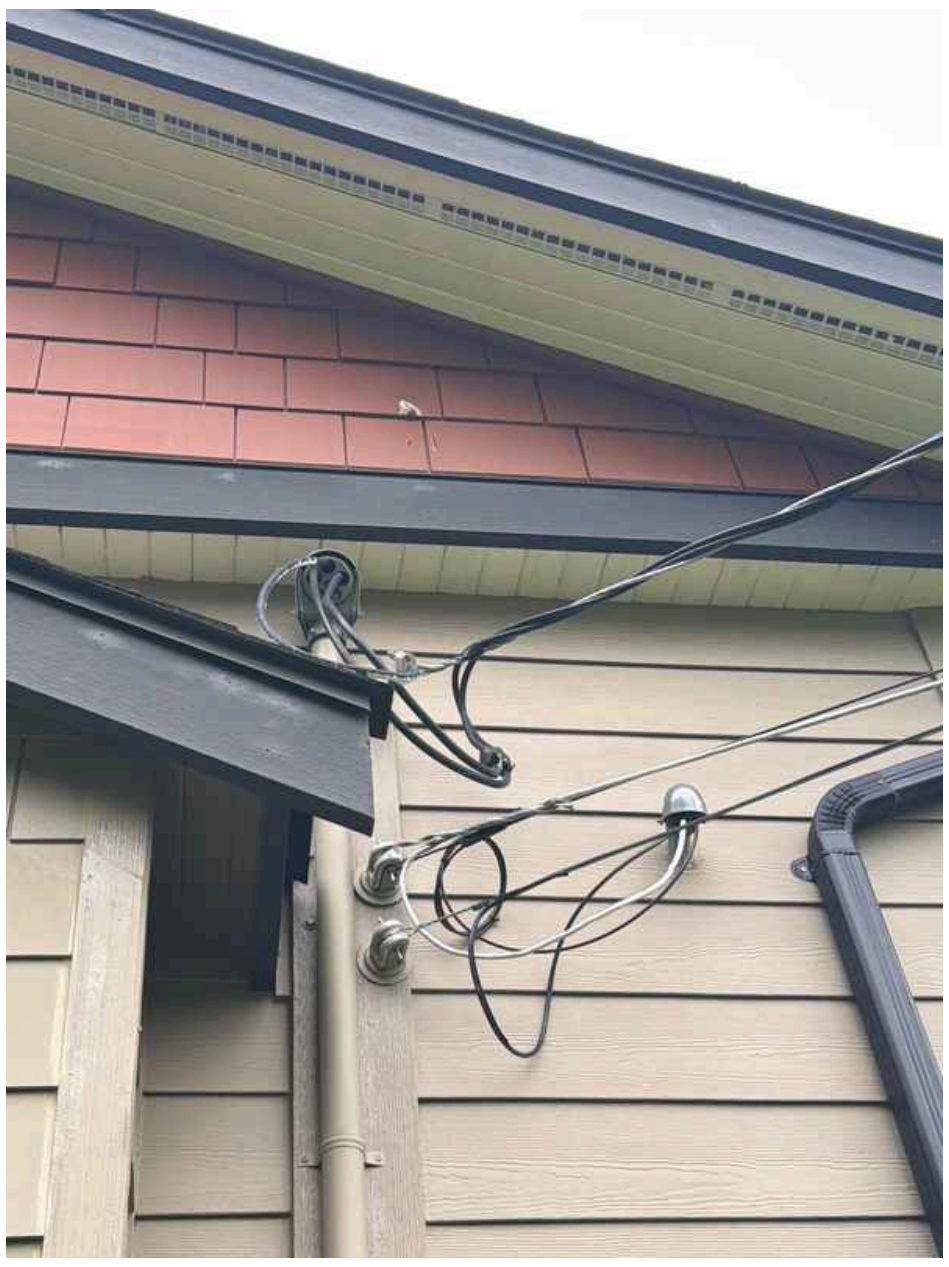





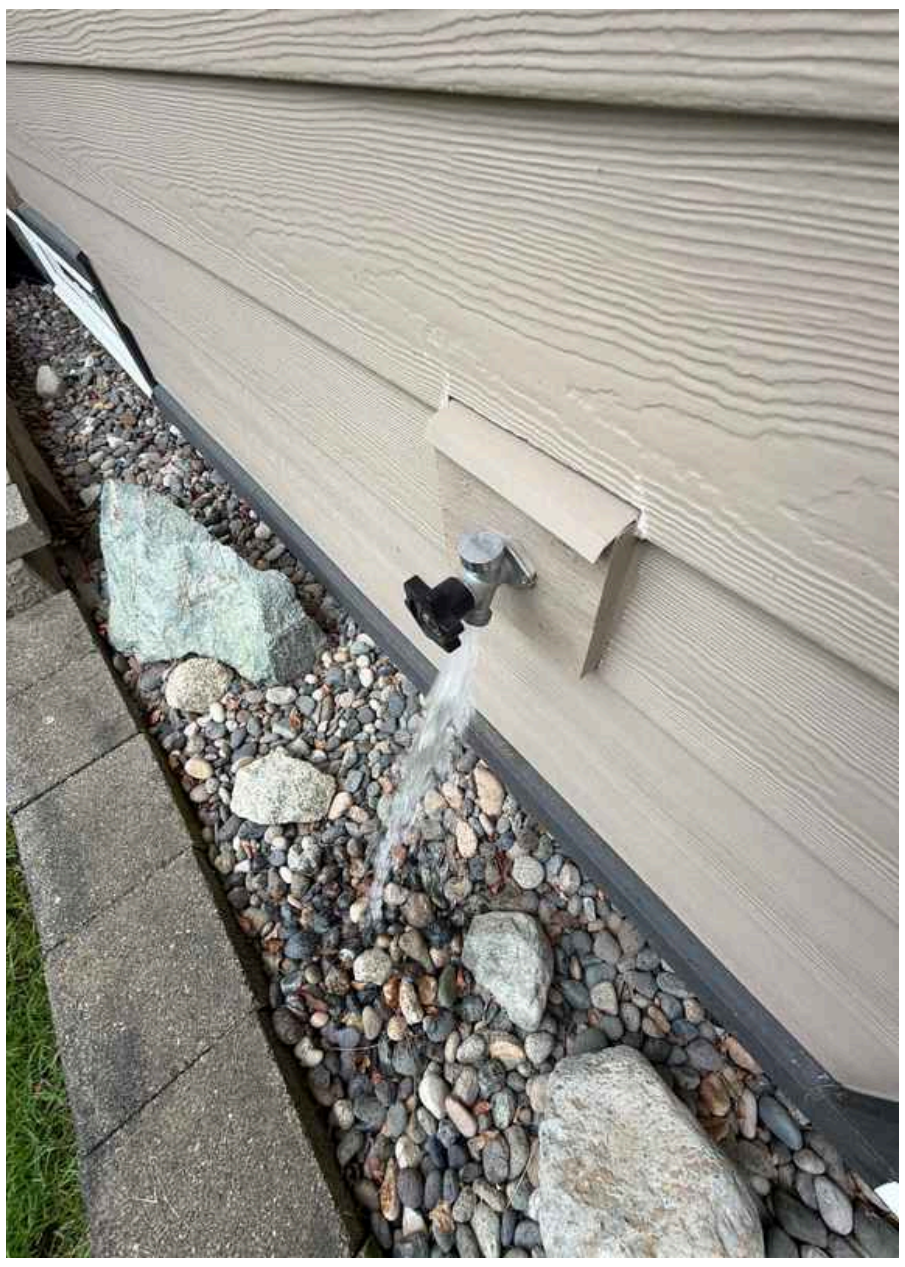



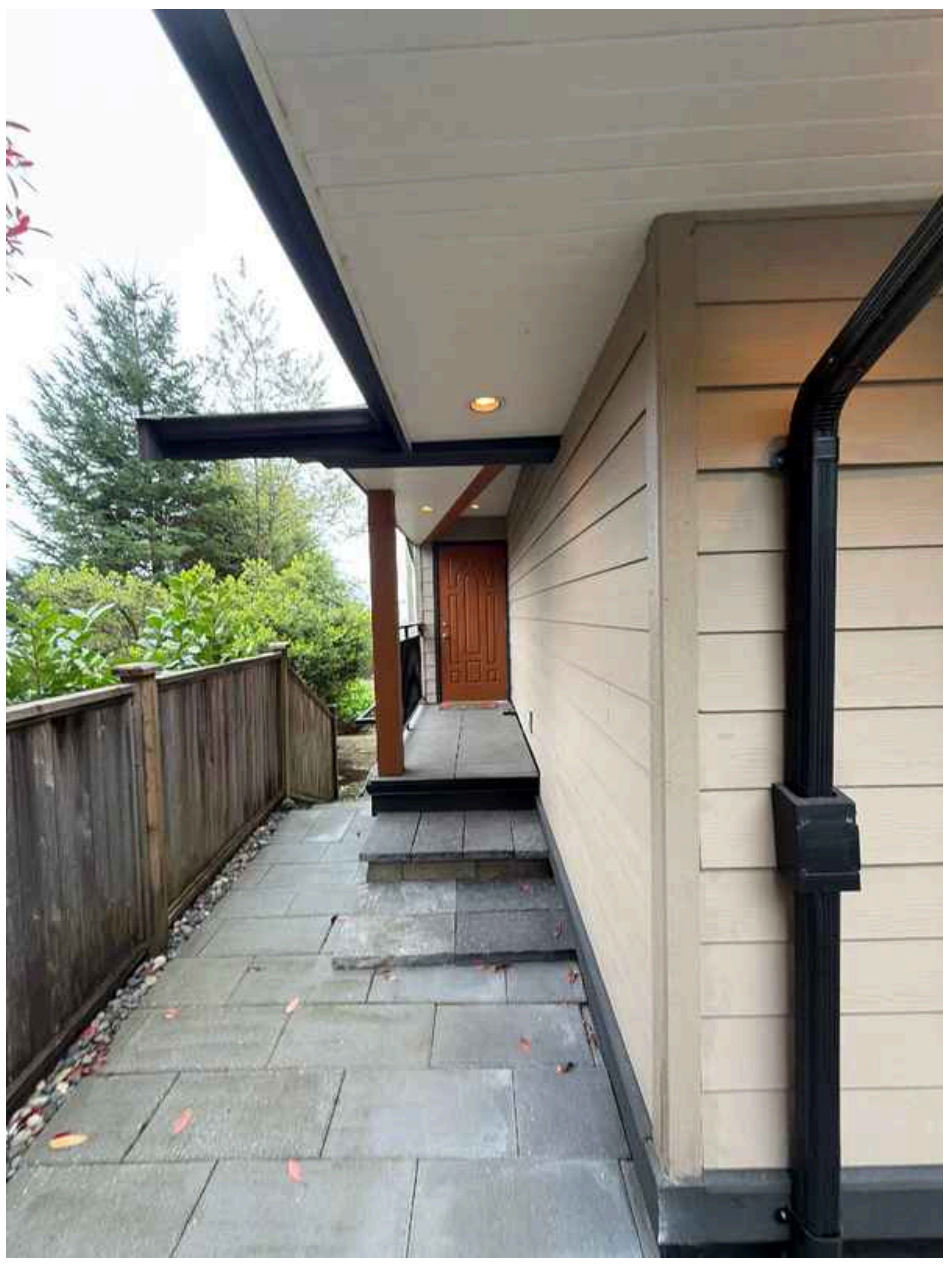
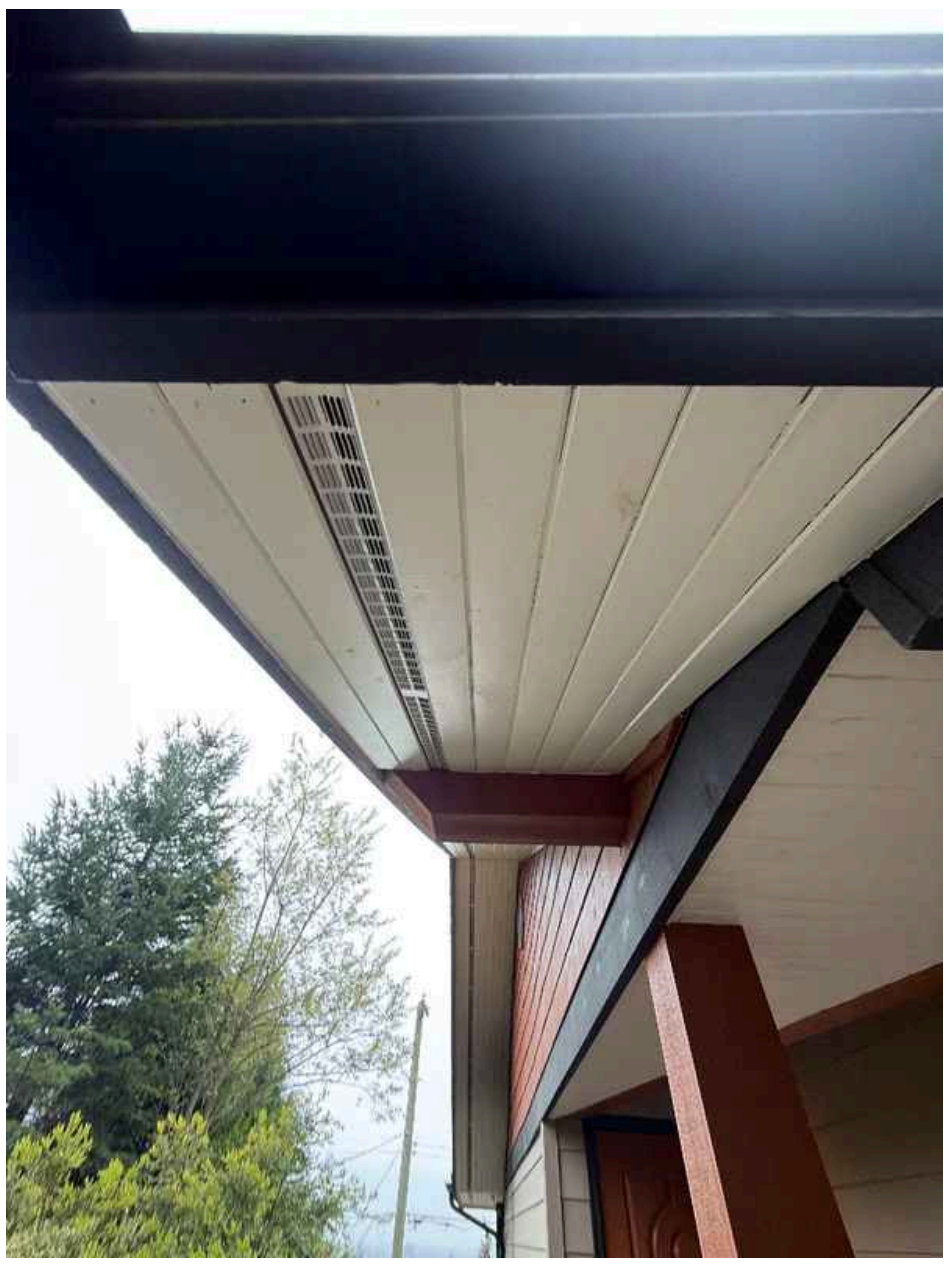

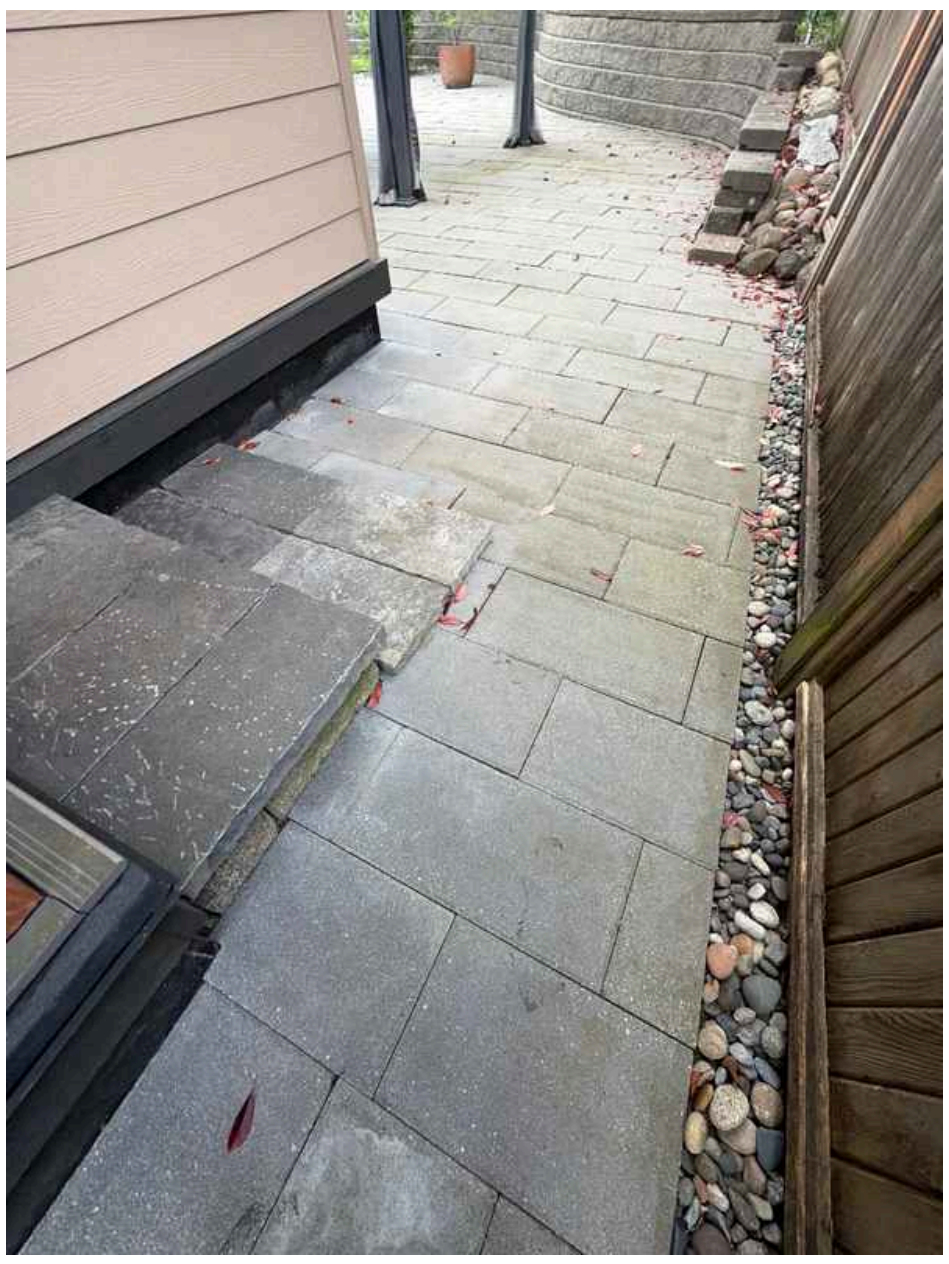
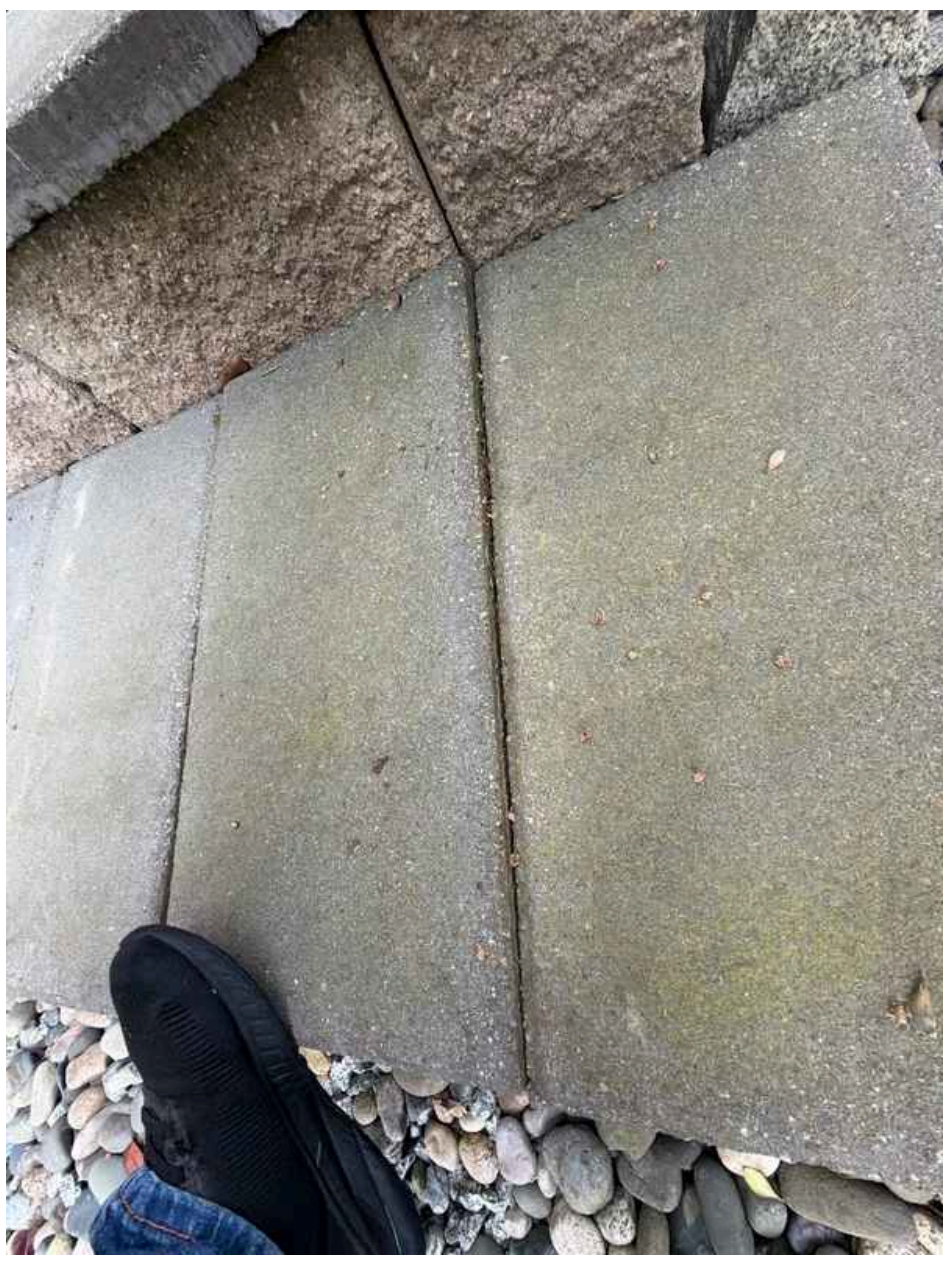

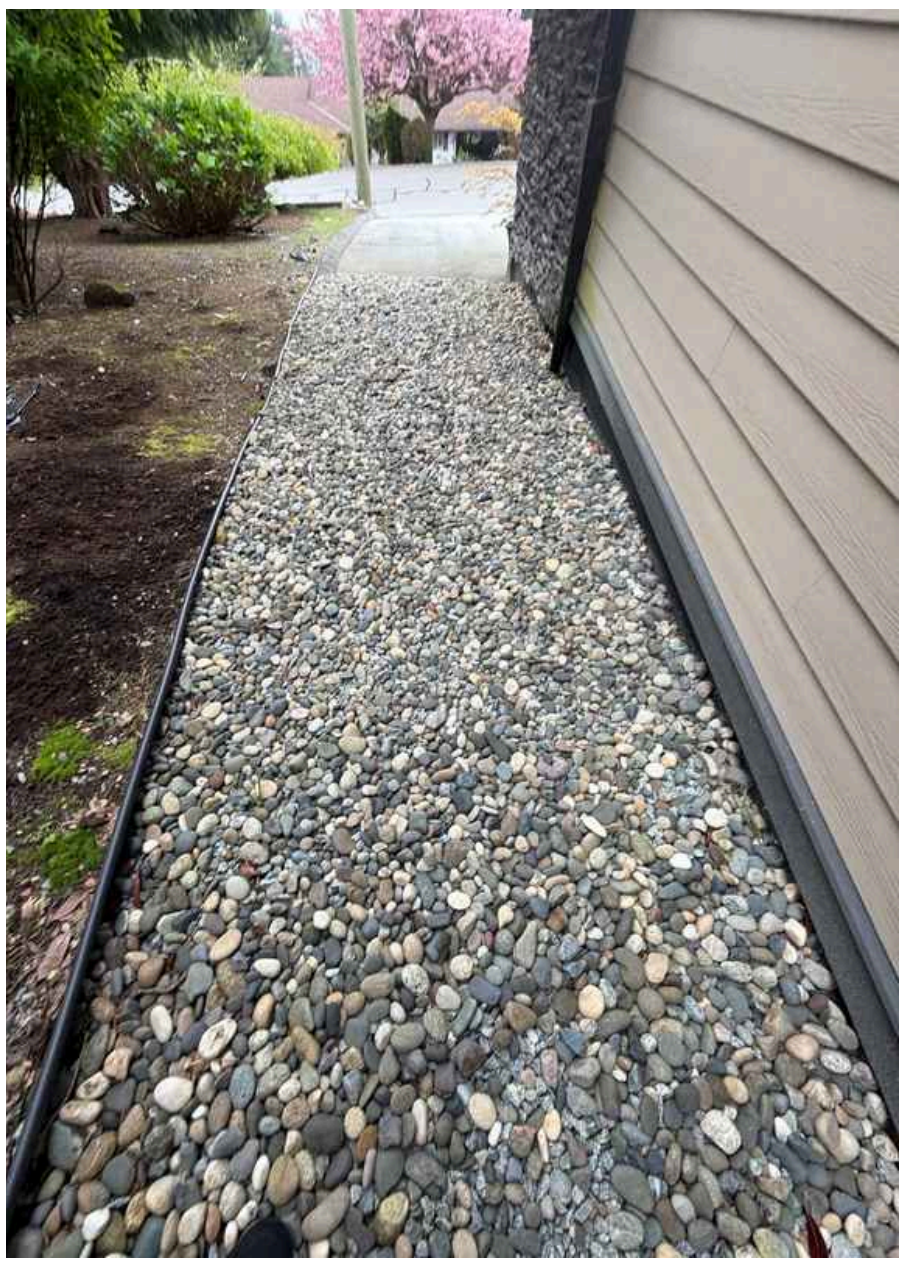
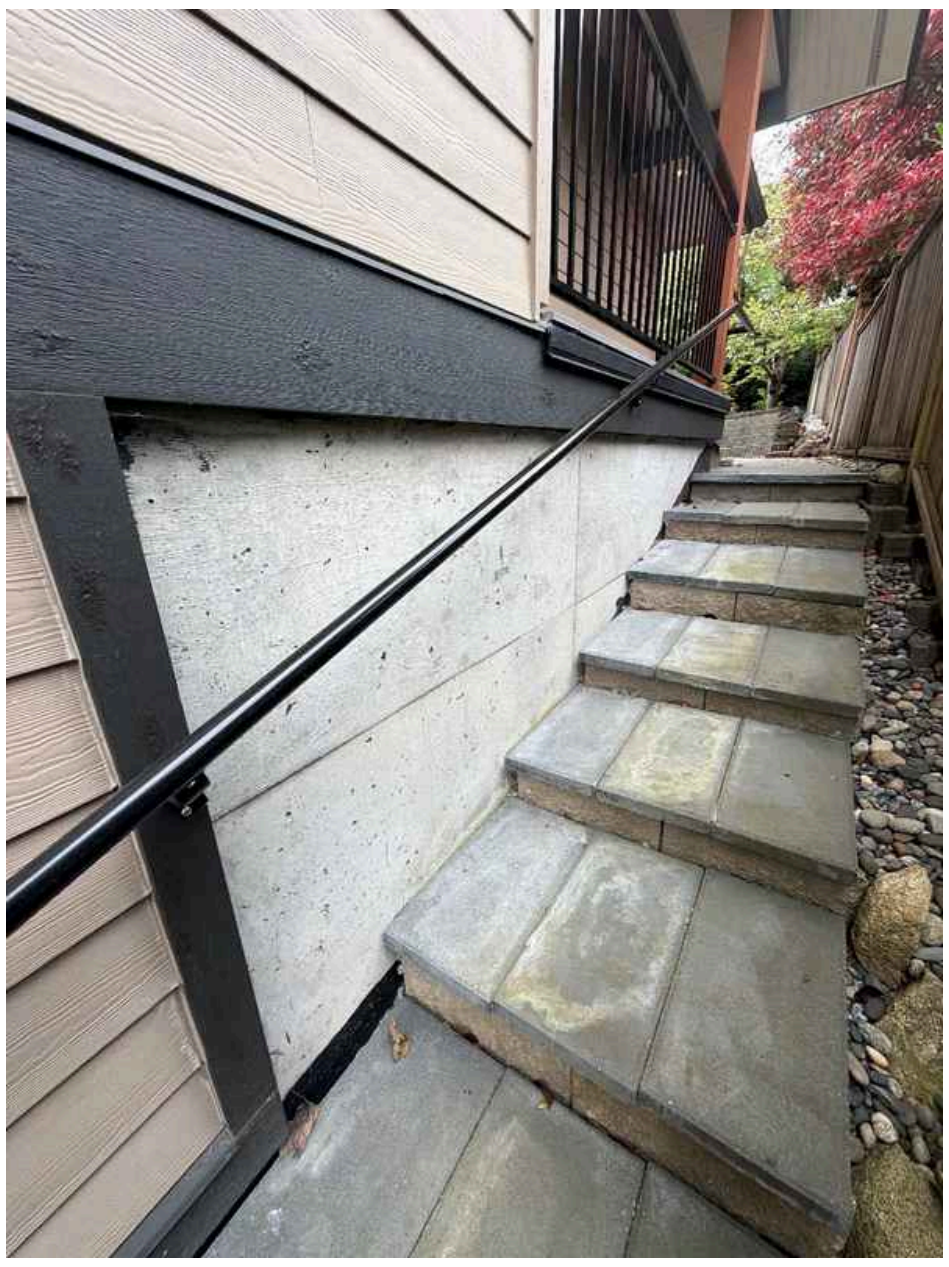
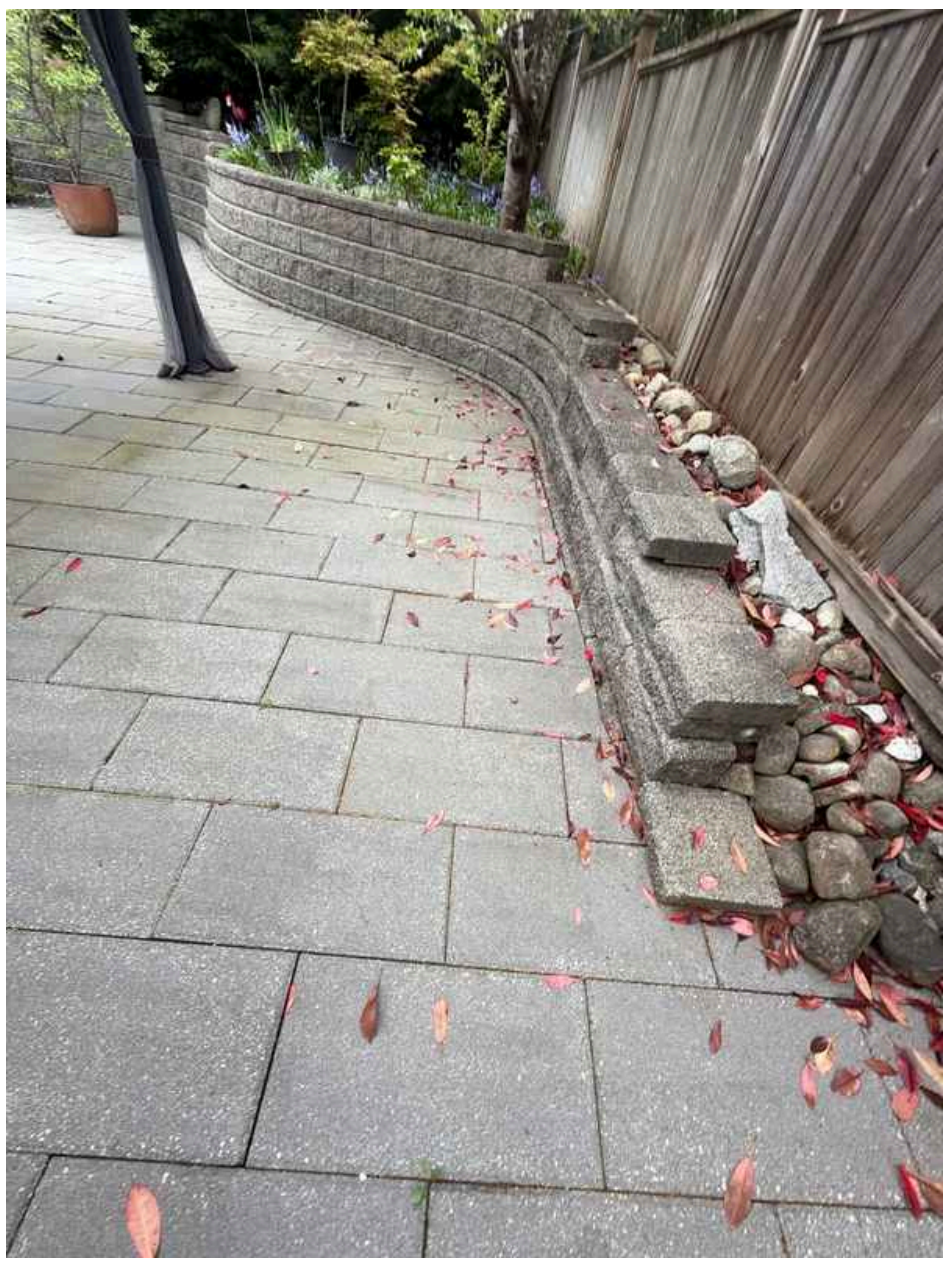
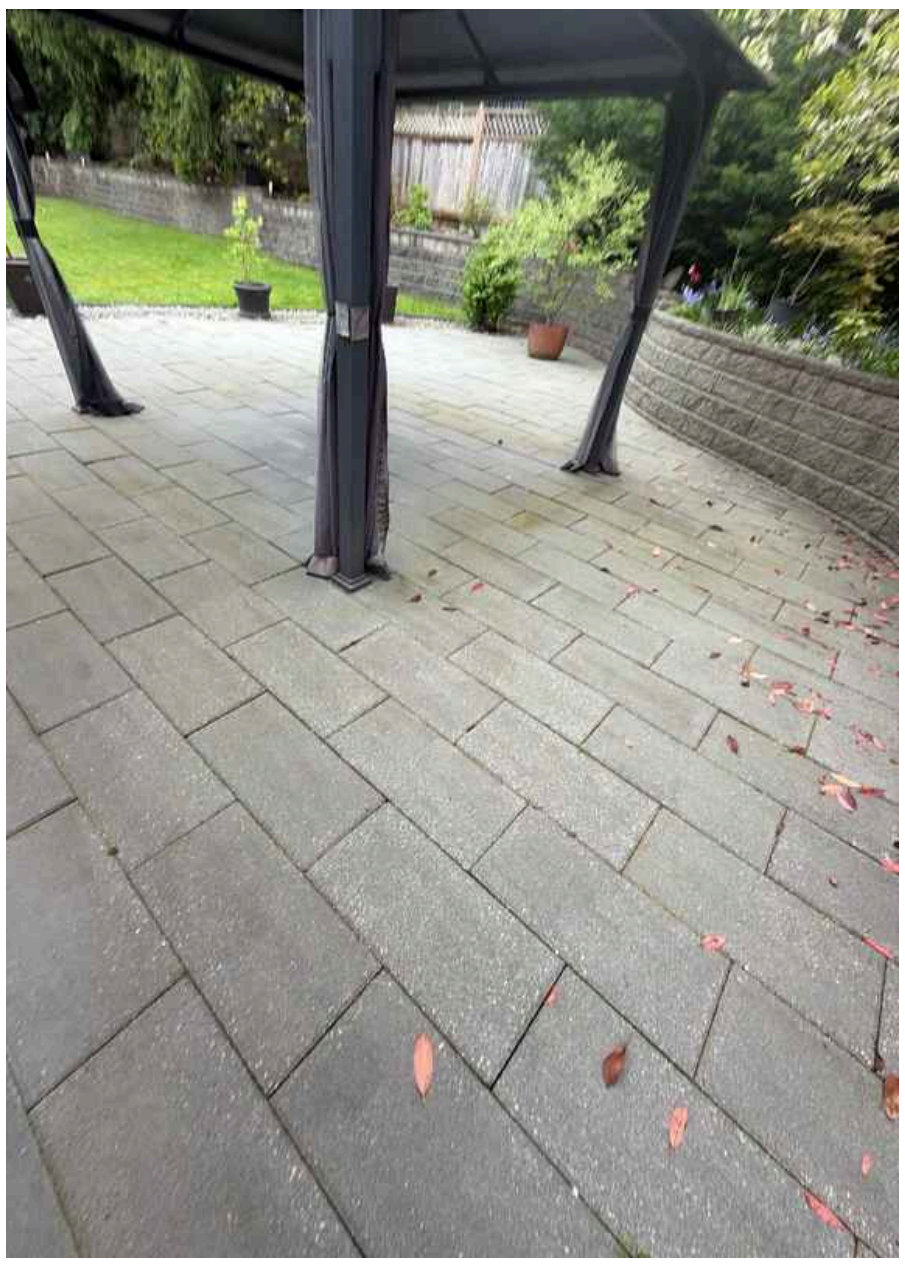
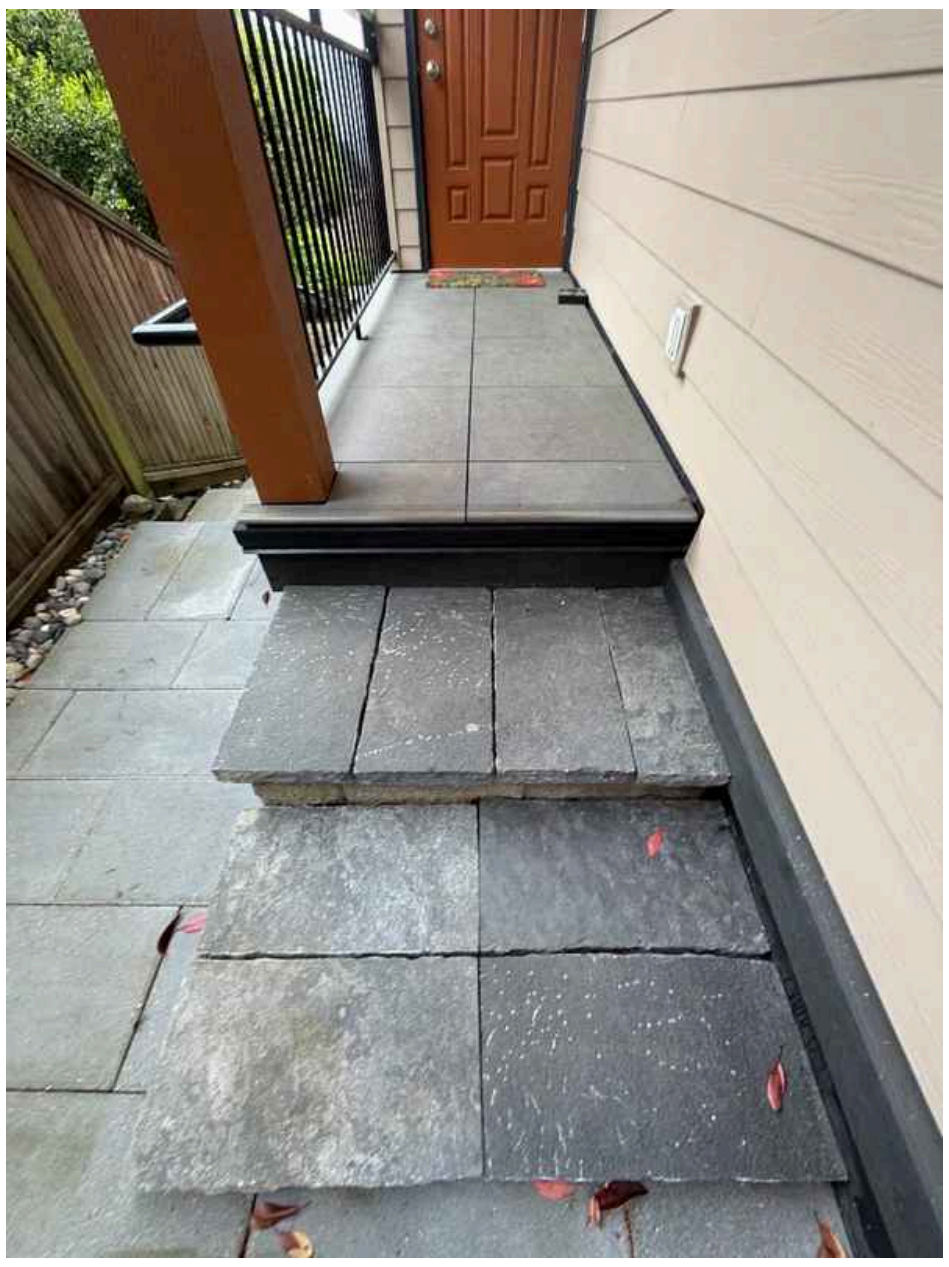
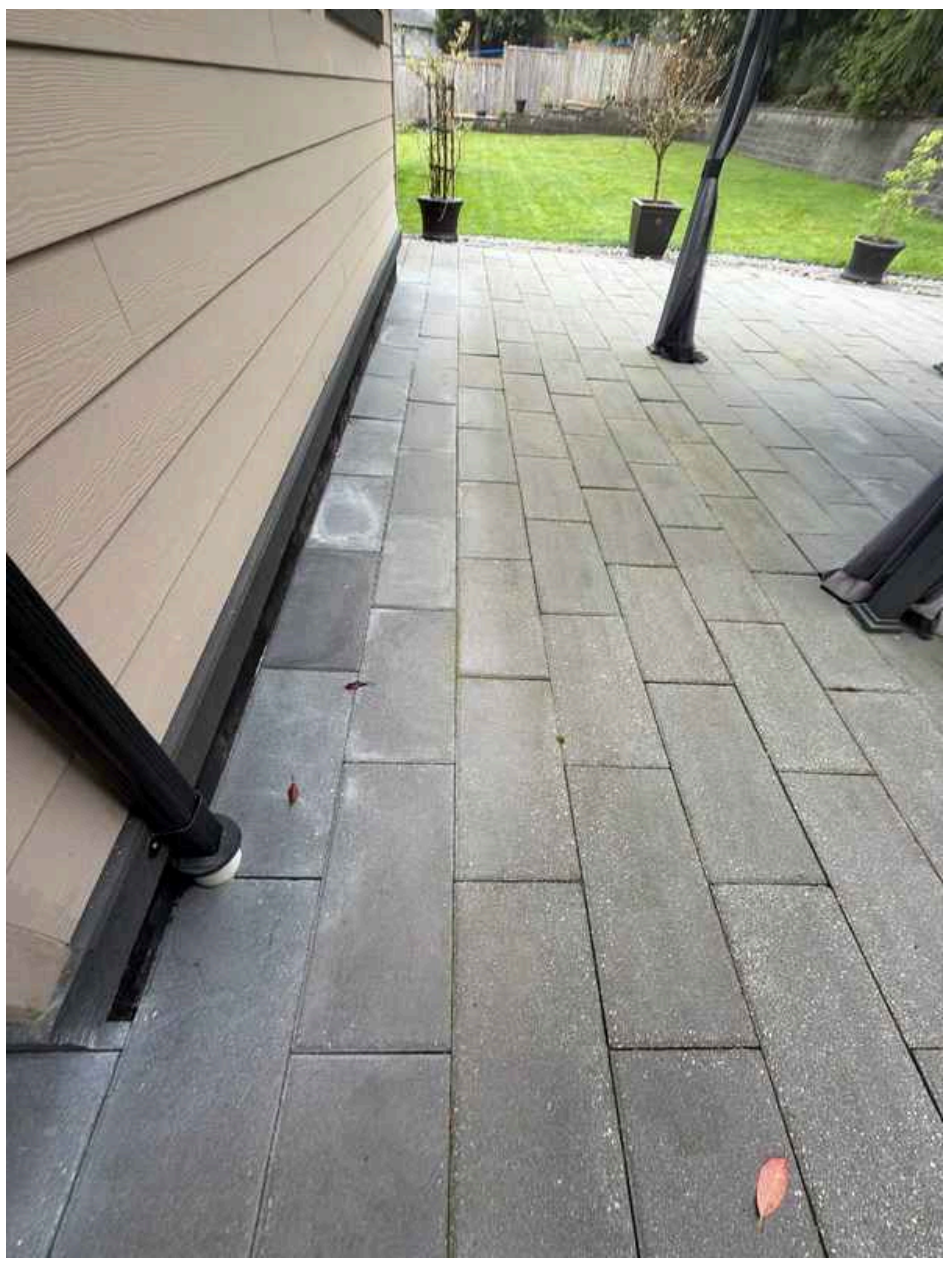
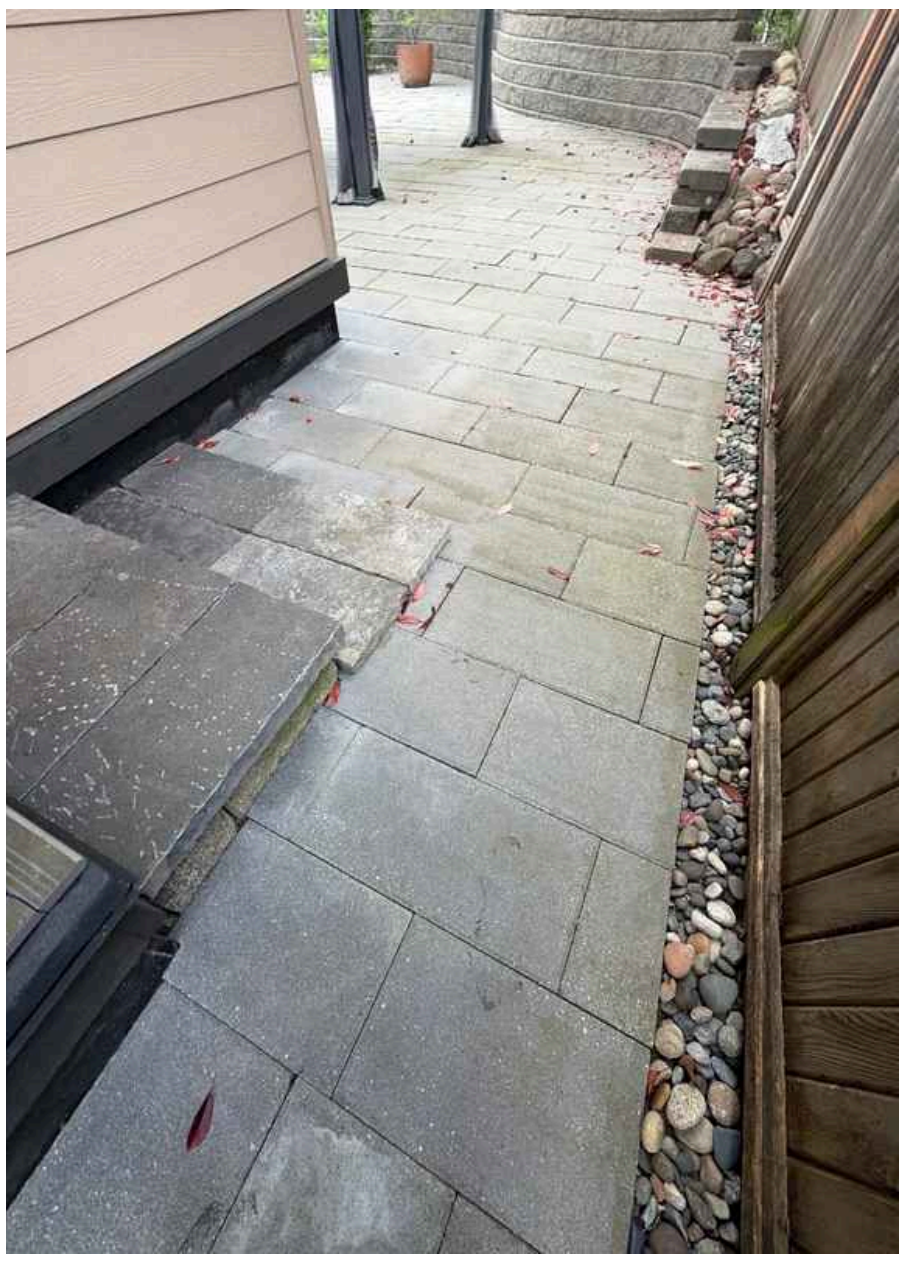
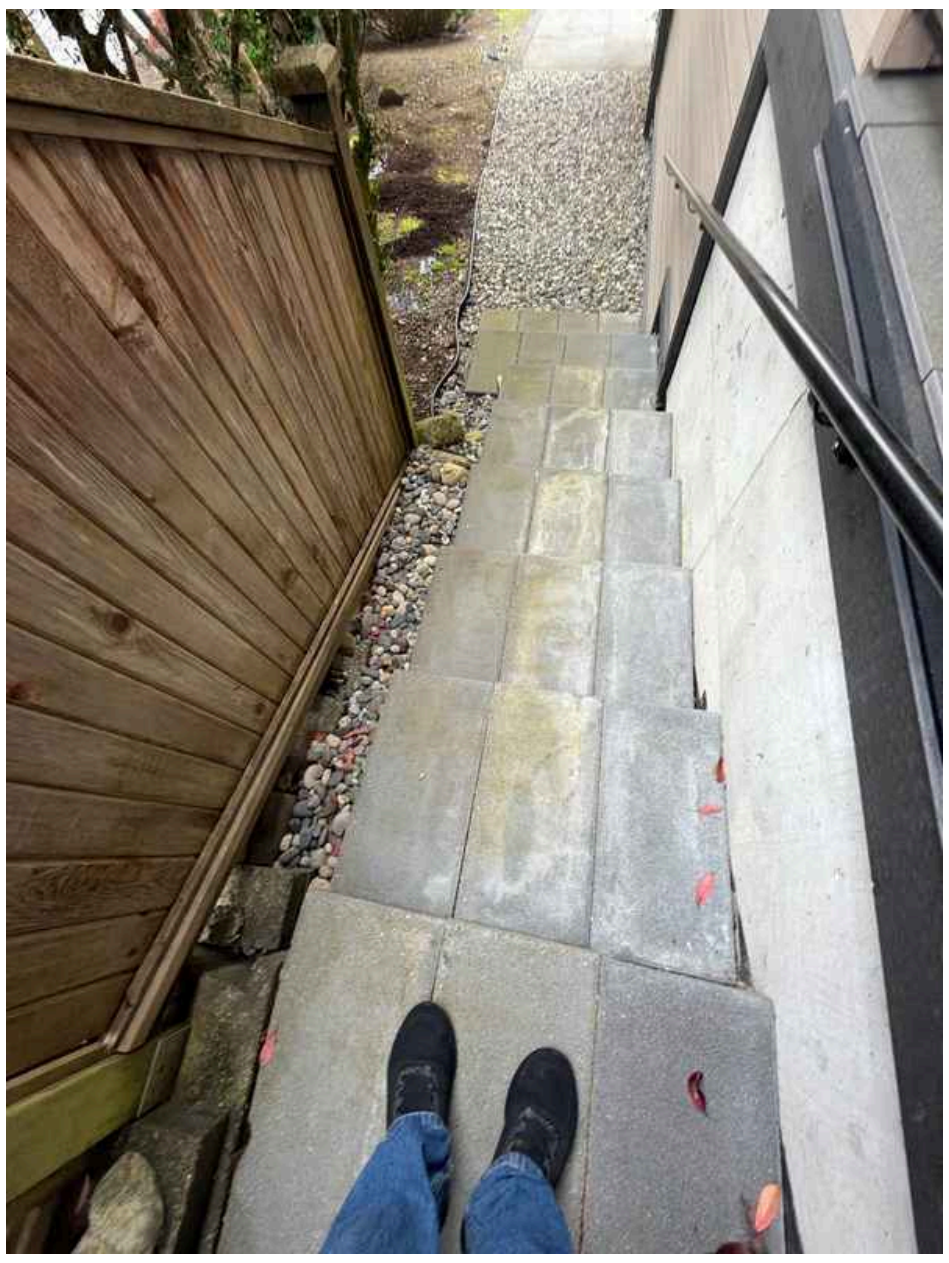







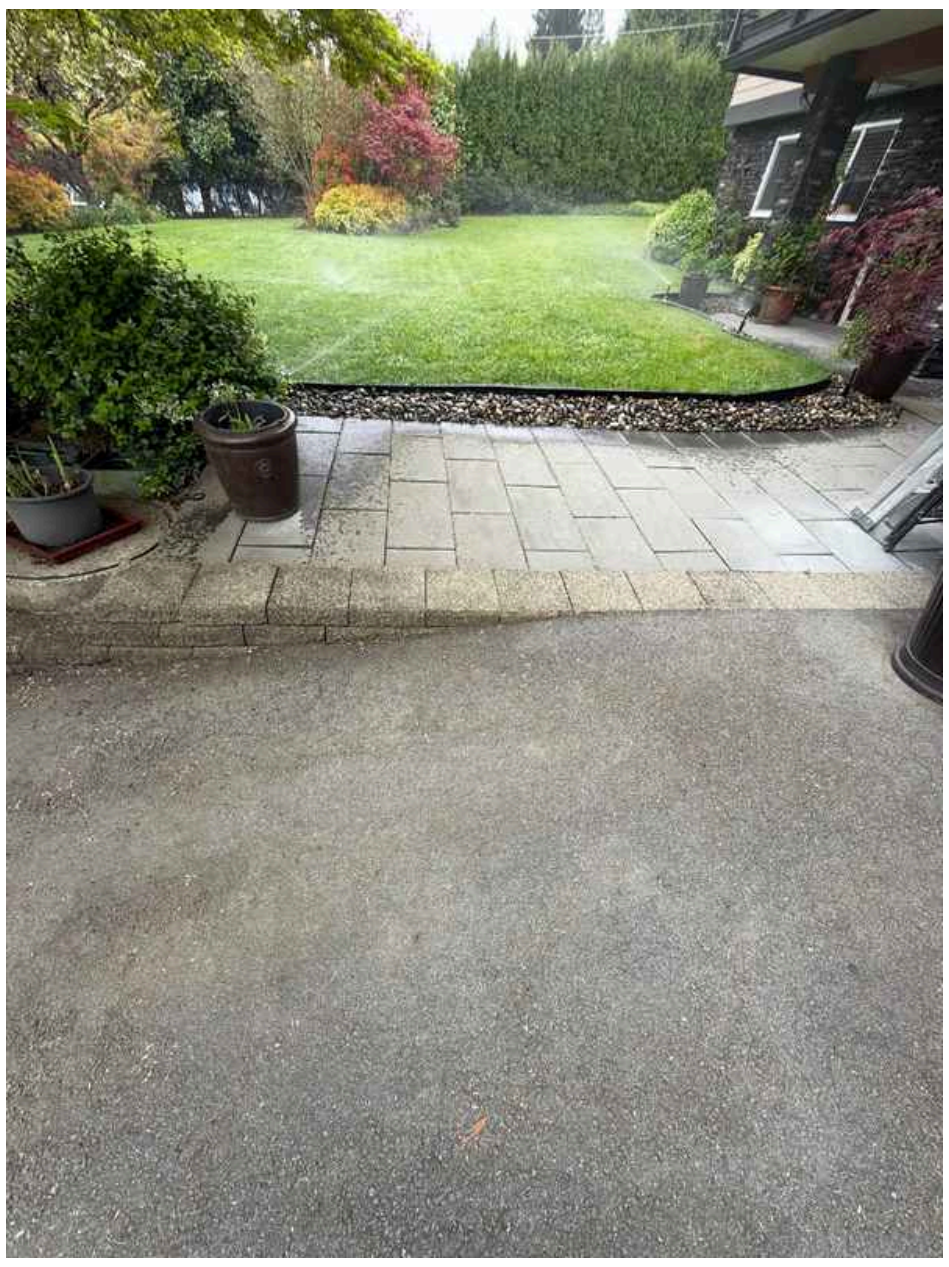


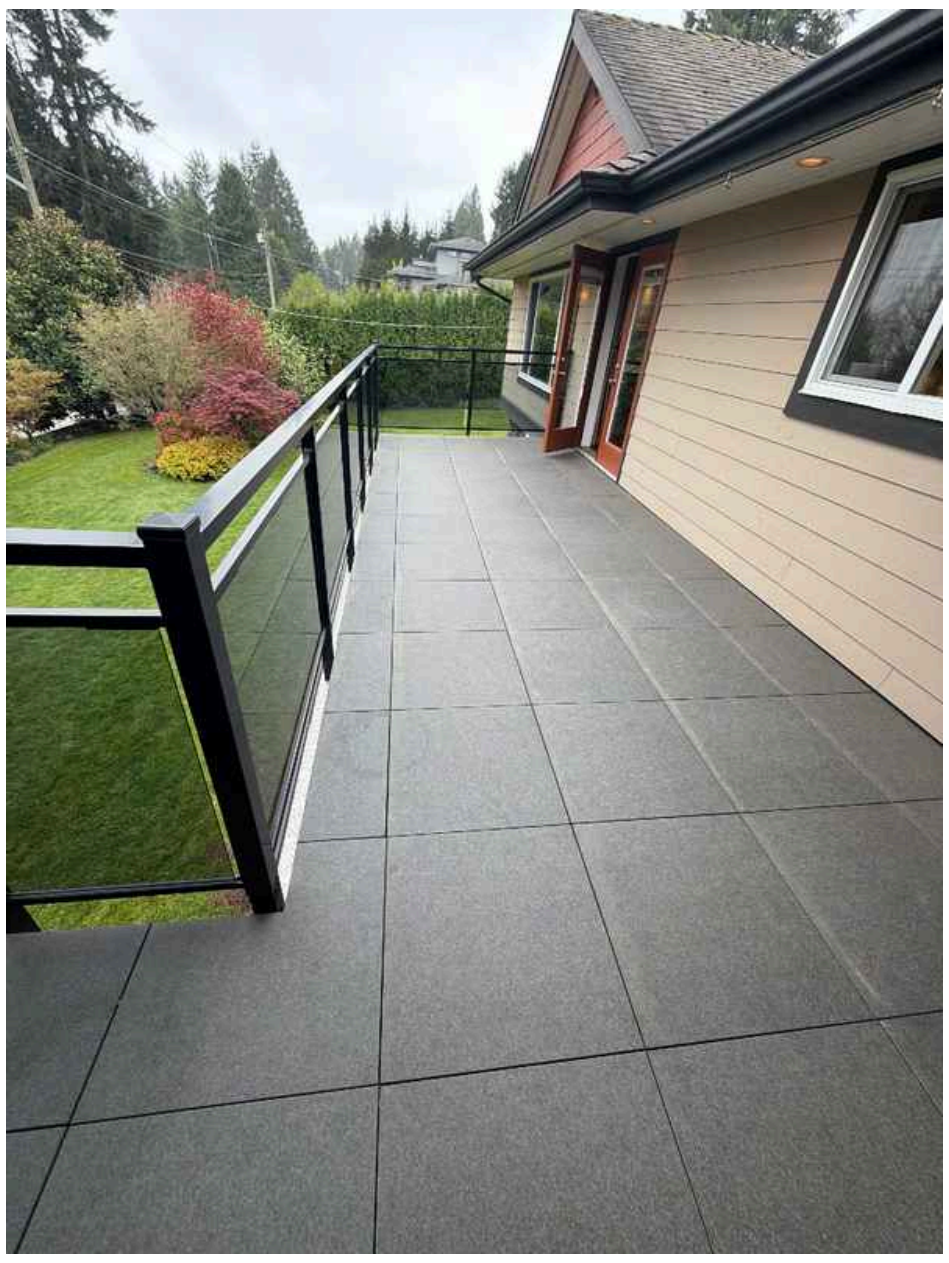

 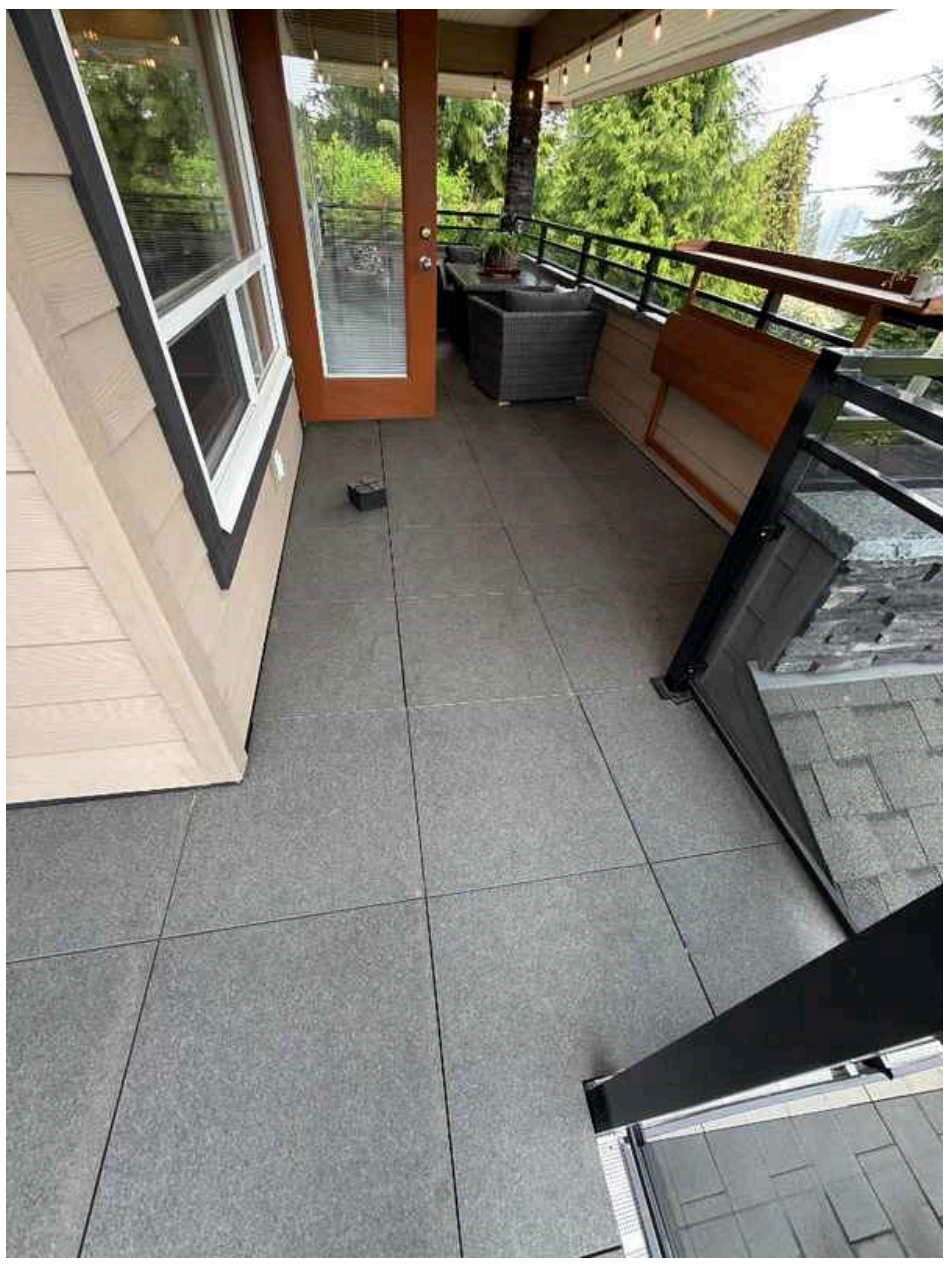 

Siding, Flashing & Trim: **Siding Material**
Brick Veneer, Fiber Cement, Wood

Exterior Doors: **Exterior Entry Door**
Wood, Fiberglass, Glass

Decks, Balconies, Porches & Steps: **Appurtenance**
Front Porch, Covered Porch

Decks, Balconies, Porches & Steps: **Material**
Pavers

Walkways, Patios & Driveways: **Driveway Material**
Asphalt

Deficiencies

2.2.1 Siding, Flashing & Trim

Maintenance Item

CAULKING NEEDED

Caulk sealant is missing or deteriorated throughout the exterior siding, flashing, and trim areas. Gaps and separations in caulking allow water infiltration behind these components. Without proper sealing, moisture can lead to wood rot, mold growth, and structural damage. A qualified contractor should inspect and re-caulk all joints and seams to restore weathertightness.

Recommendation

Contact a qualified professional.

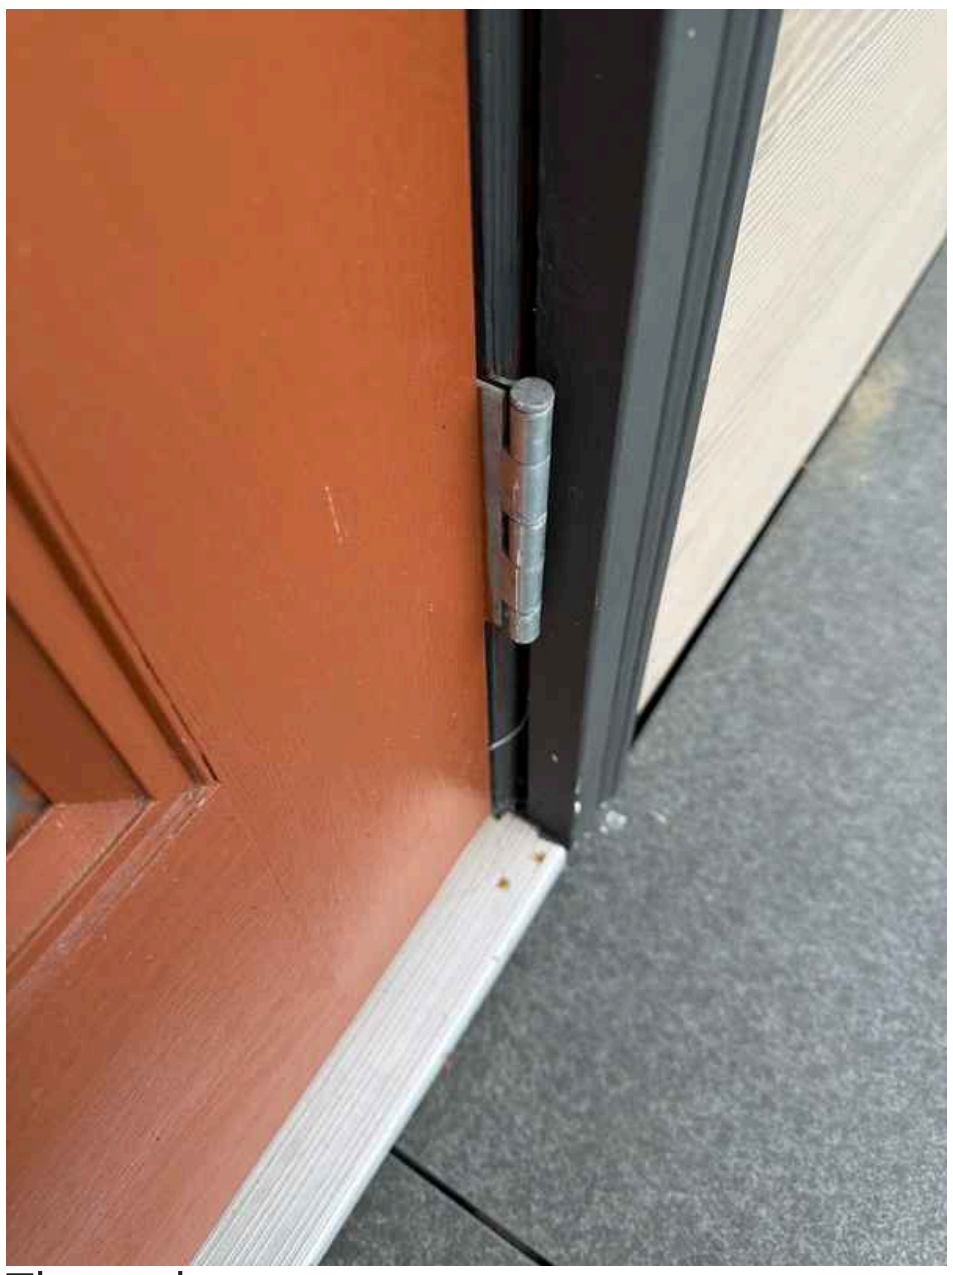
Throughout

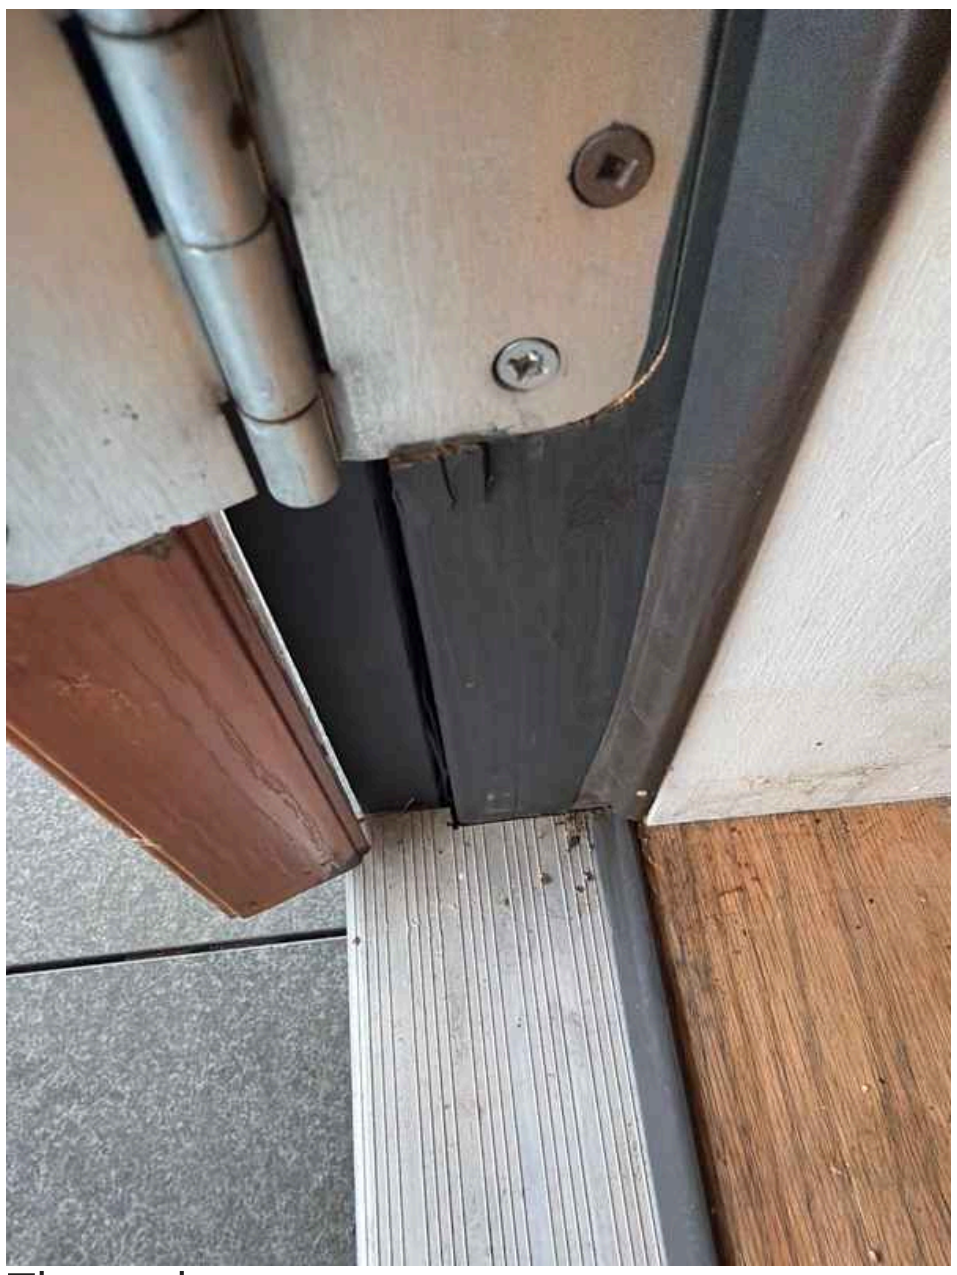
Throughout


Throughout

2.2.2 Siding, Flashing & Trim

Maintenance Item

SQUEAKY DOOR

A minor squeaking noise was detected from the door during operation. This is typically caused by dry hinges or hardware that requires lubrication. Applying lubricant to the hinges and moving parts will resolve the issue and restore quiet operation.

Recommendation

Contact a qualified professional.

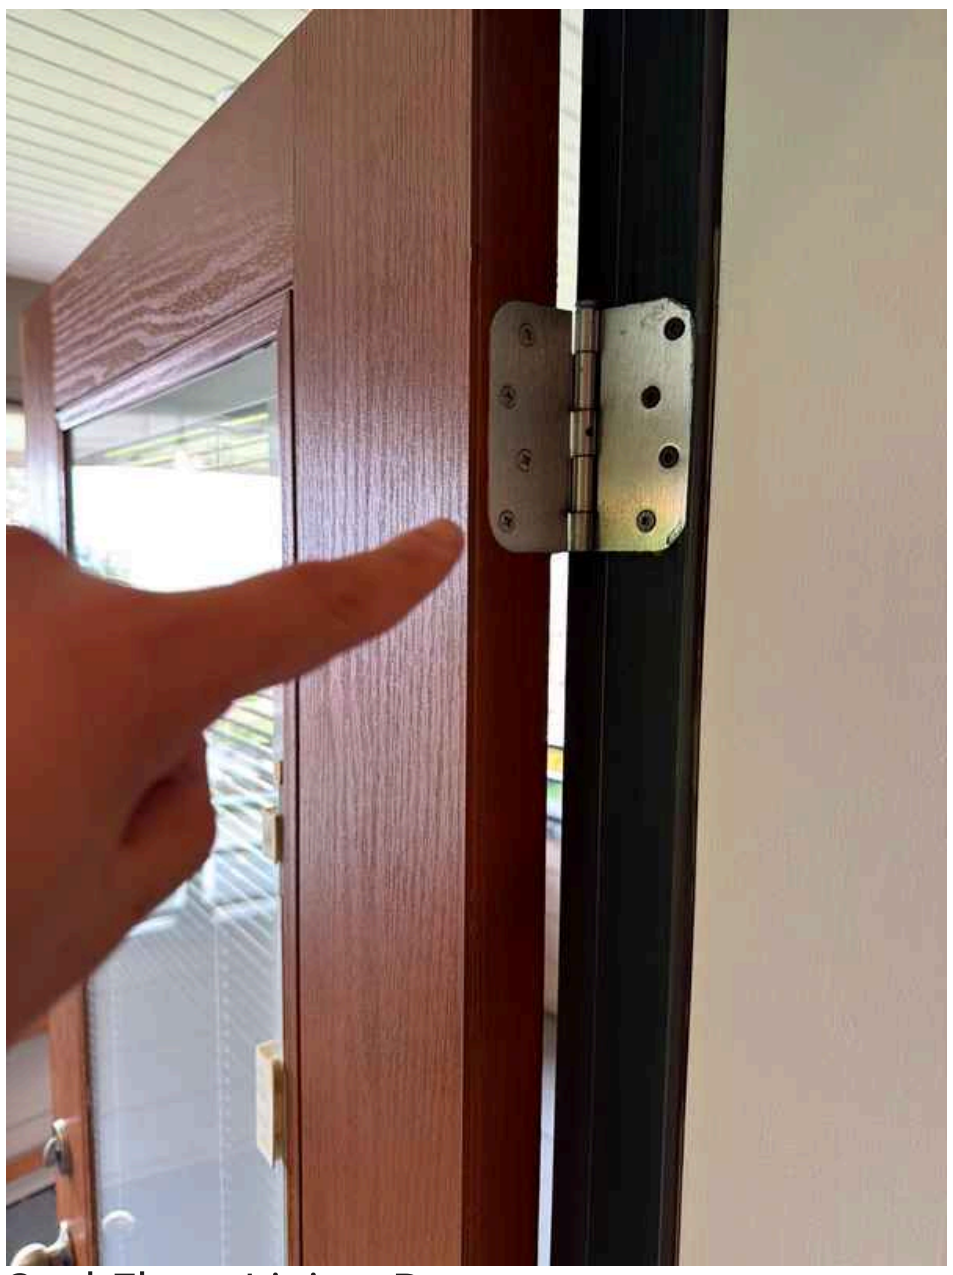
2nd Floor Living Room

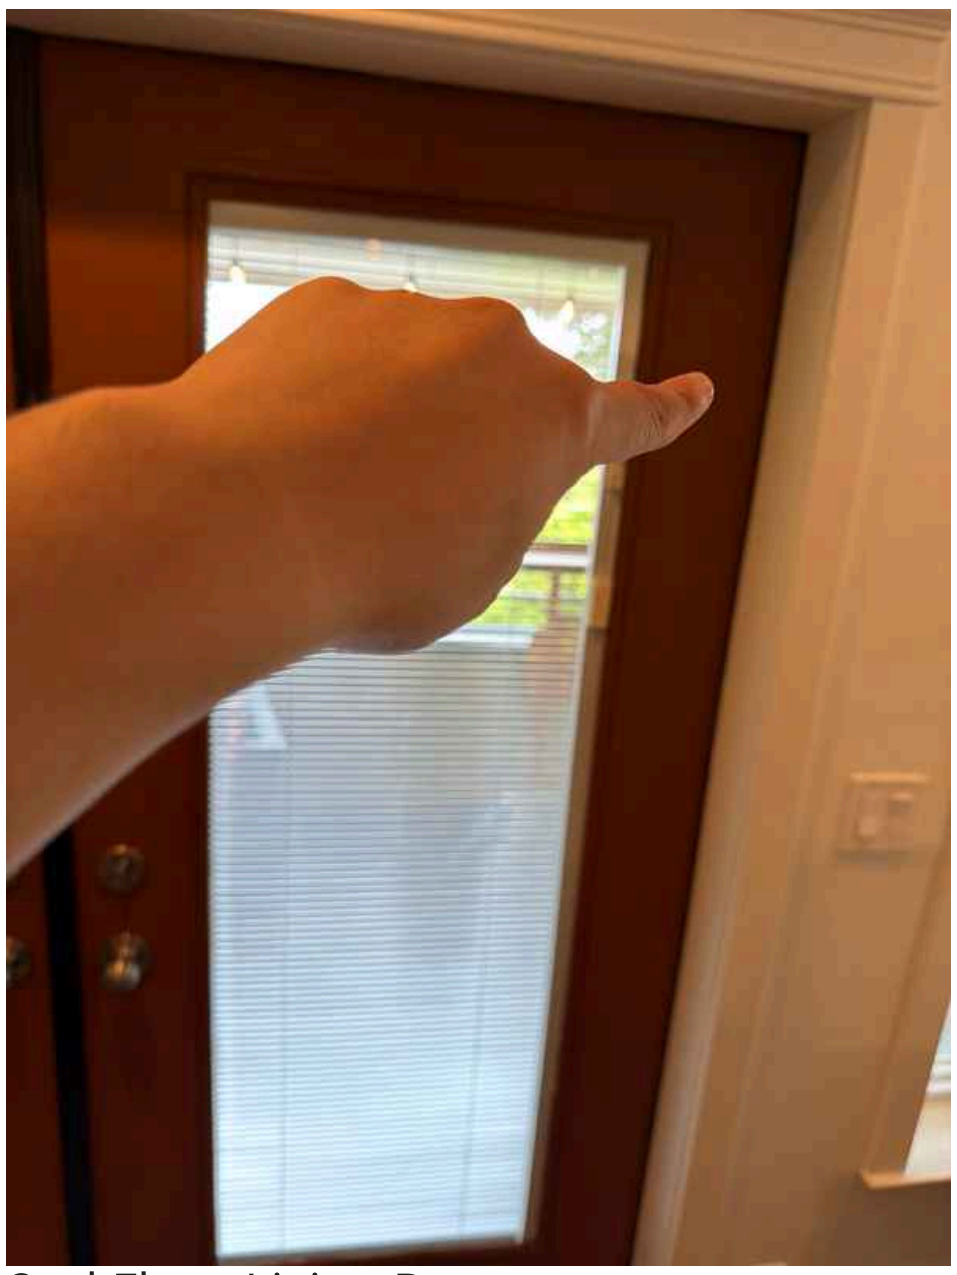
2nd Floor Living Room

2.3.1 Exterior Doors

Recommendation

DIFFICULT DOOR OPERATION

The exterior door is difficult to open and close during normal use. This suggests misalignment, frame damage, or binding issues that may worsen over time. A door repair contractor should evaluate the door frame, hinges, and alignment to determine the underlying cause and recommend appropriate repairs.

Recommendation

Contact a qualified professional.

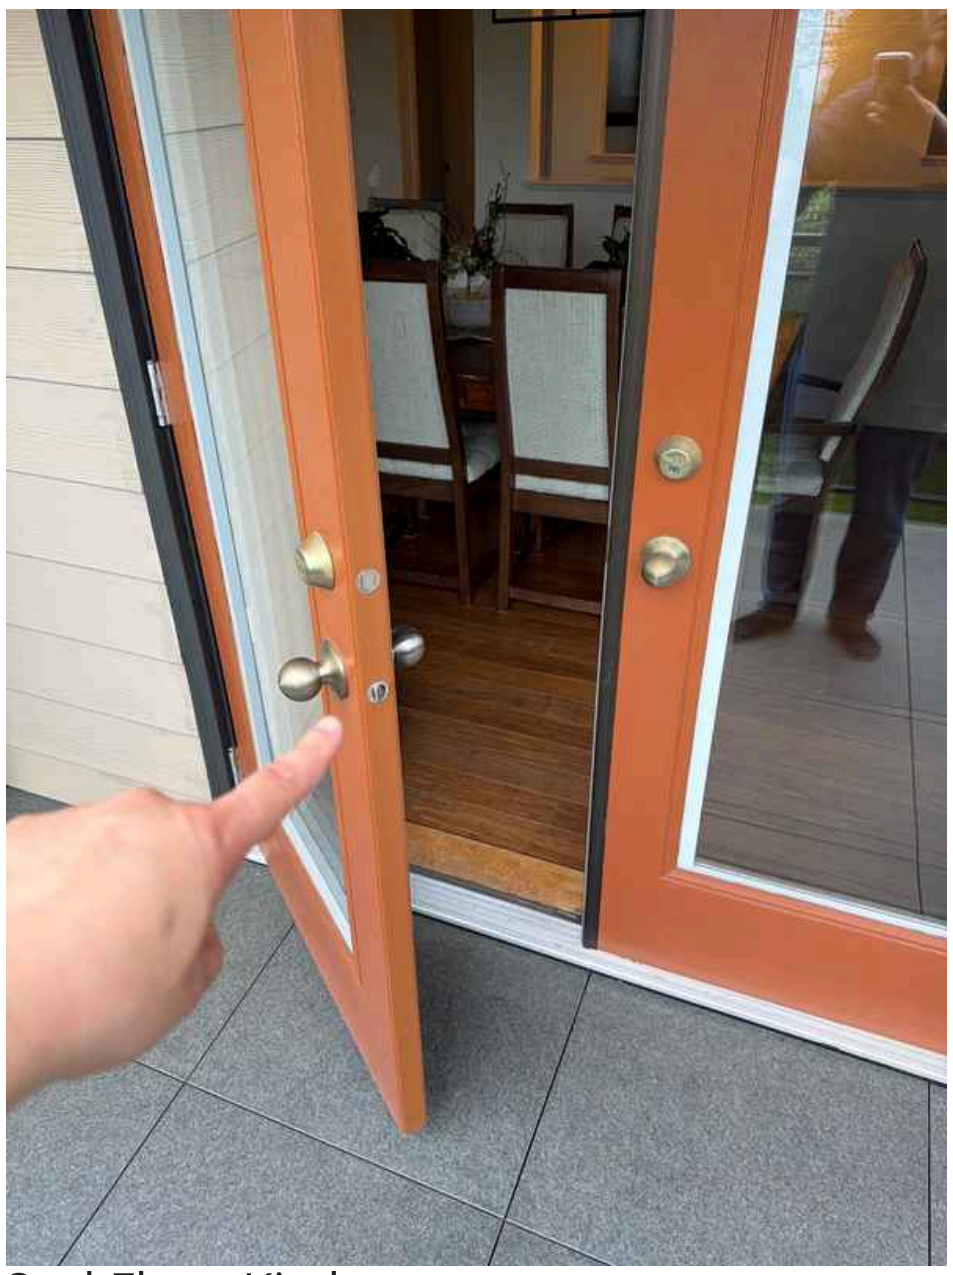
2nd Floor Kitchen

2.3.2 Exterior Doors

Recommendation

STIFF DOOR KNOB

The door knob operates with excessive resistance and does not turn smoothly. This stiffness may indicate internal mechanism wear, lack of lubrication, or misalignment. Applying lubricant or professional adjustment should restore normal operation.

Recommendation

Contact a qualified professional.

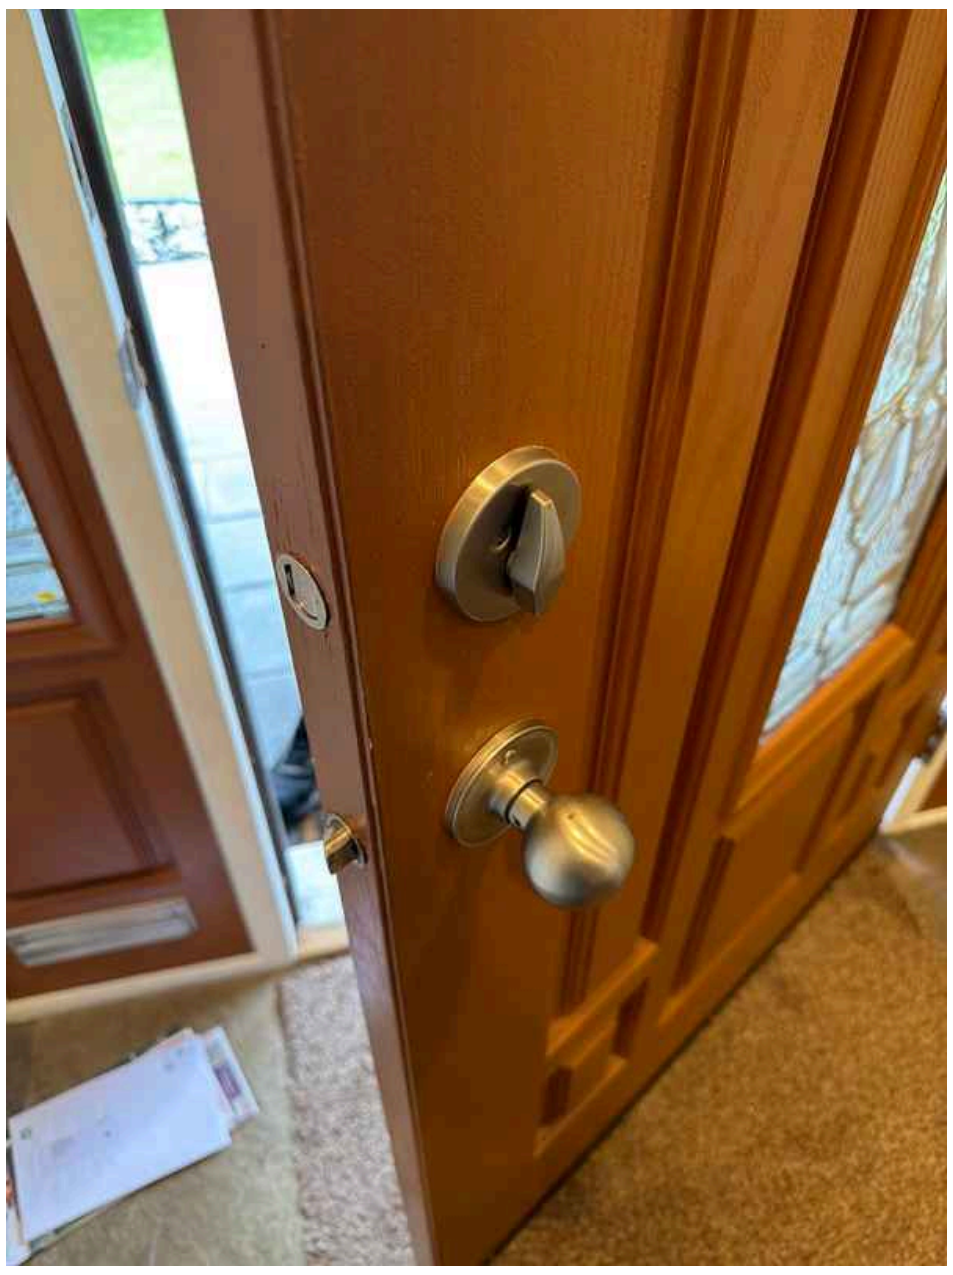

2.4.1 Decks, Balconies, Porches & Steps

Maintenance Item

LOOSE BRICK

A loose brick was observed on the deck, balcony, porch, or steps during inspection. Loose bricks can shift over time, creating tripping hazards and allowing water infiltration behind the masonry. The brick should be reset and properly secured with mortar to restore structural integrity and prevent further deterioration.

Recommendation

Contact a qualified professional.

3: ROOF

Information

Inspection Method

Ladder, Ground


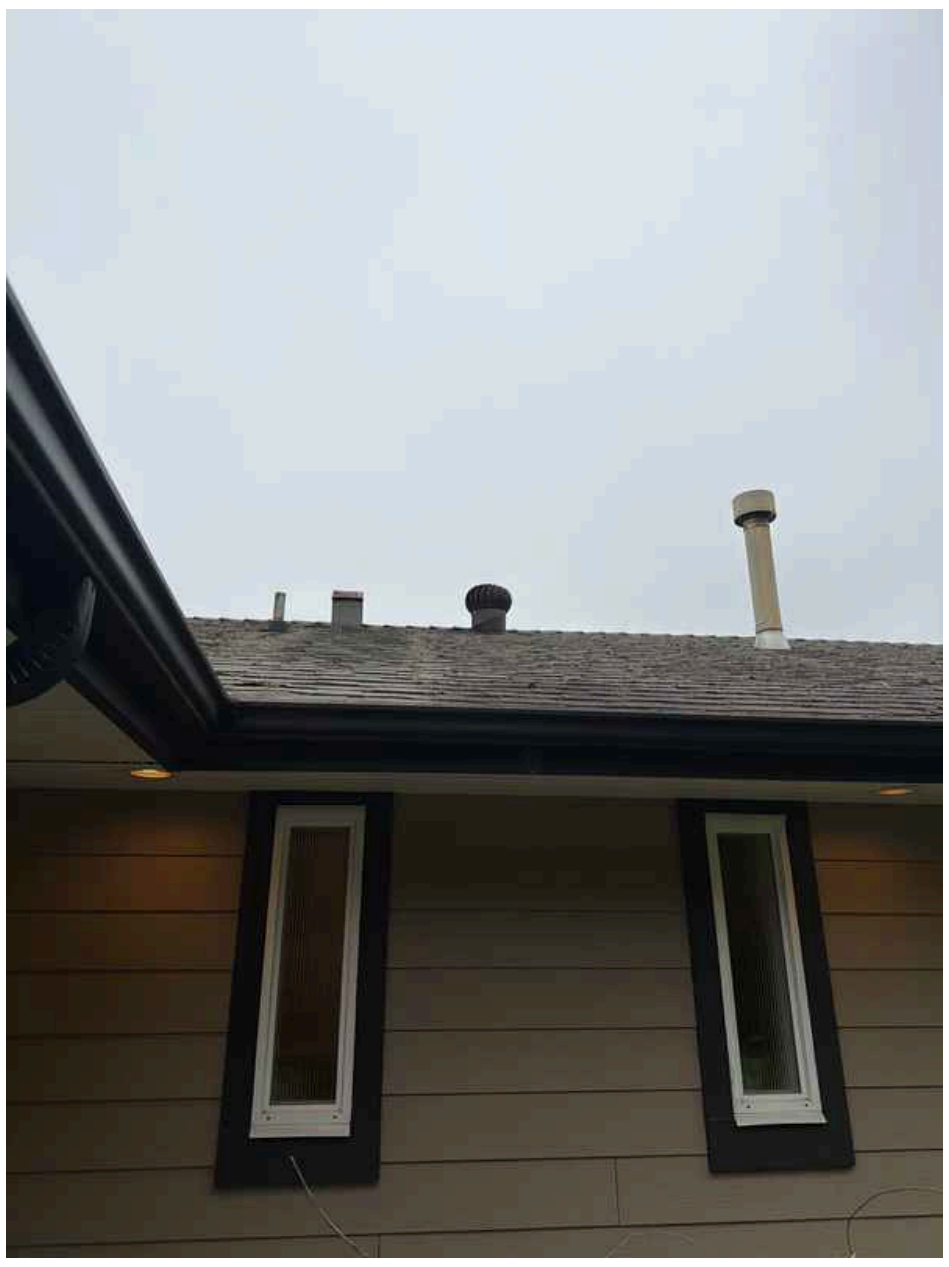














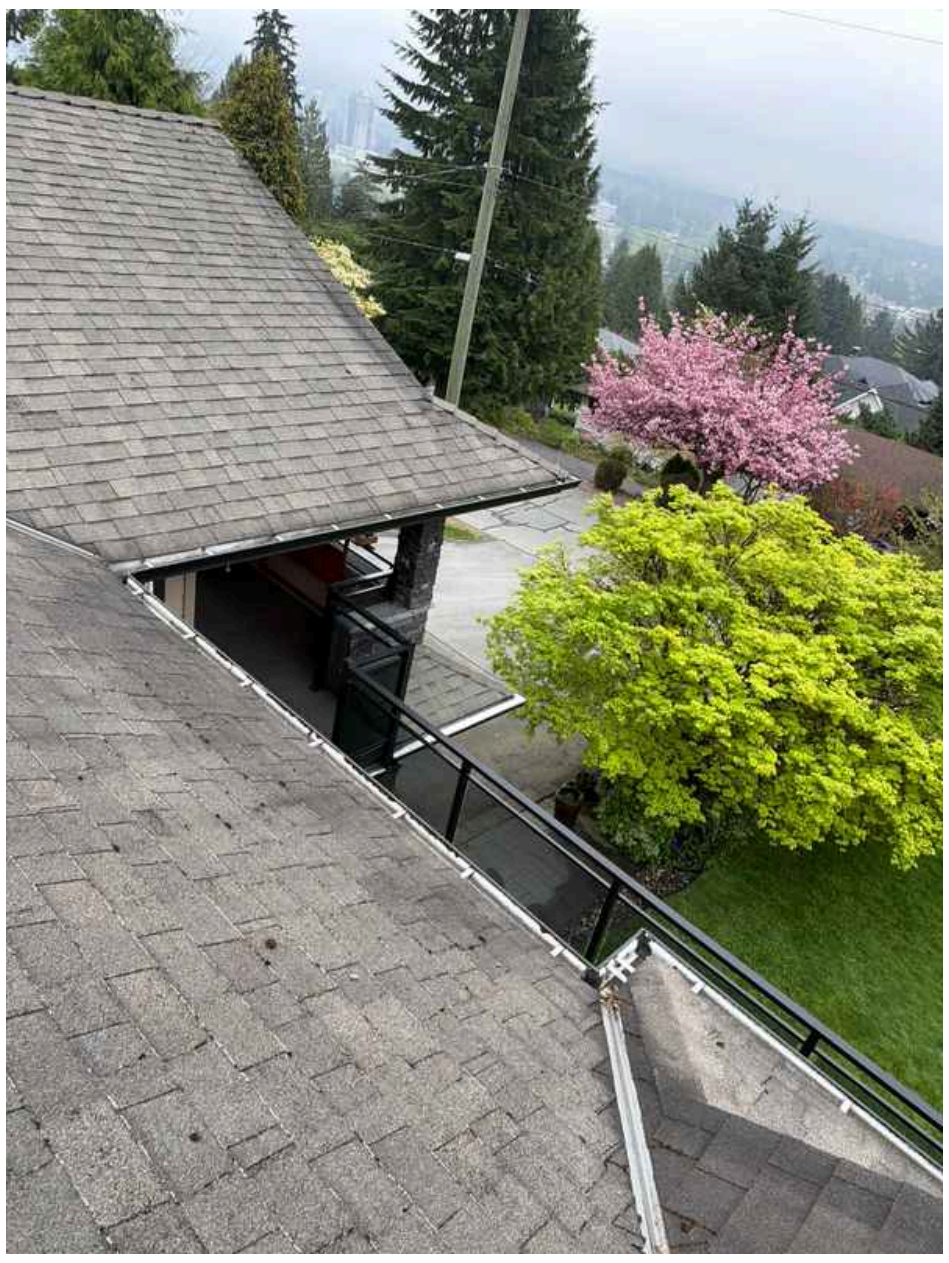

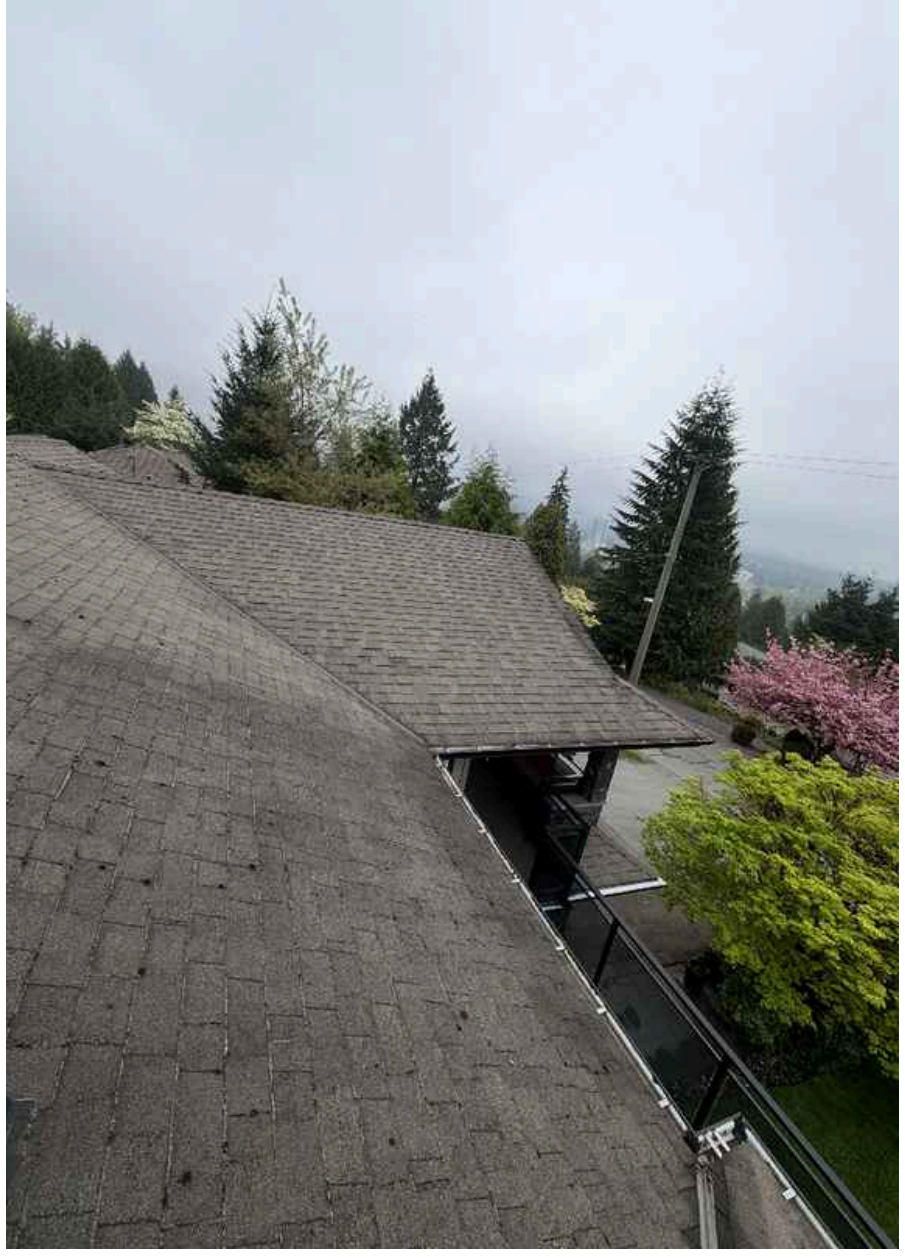
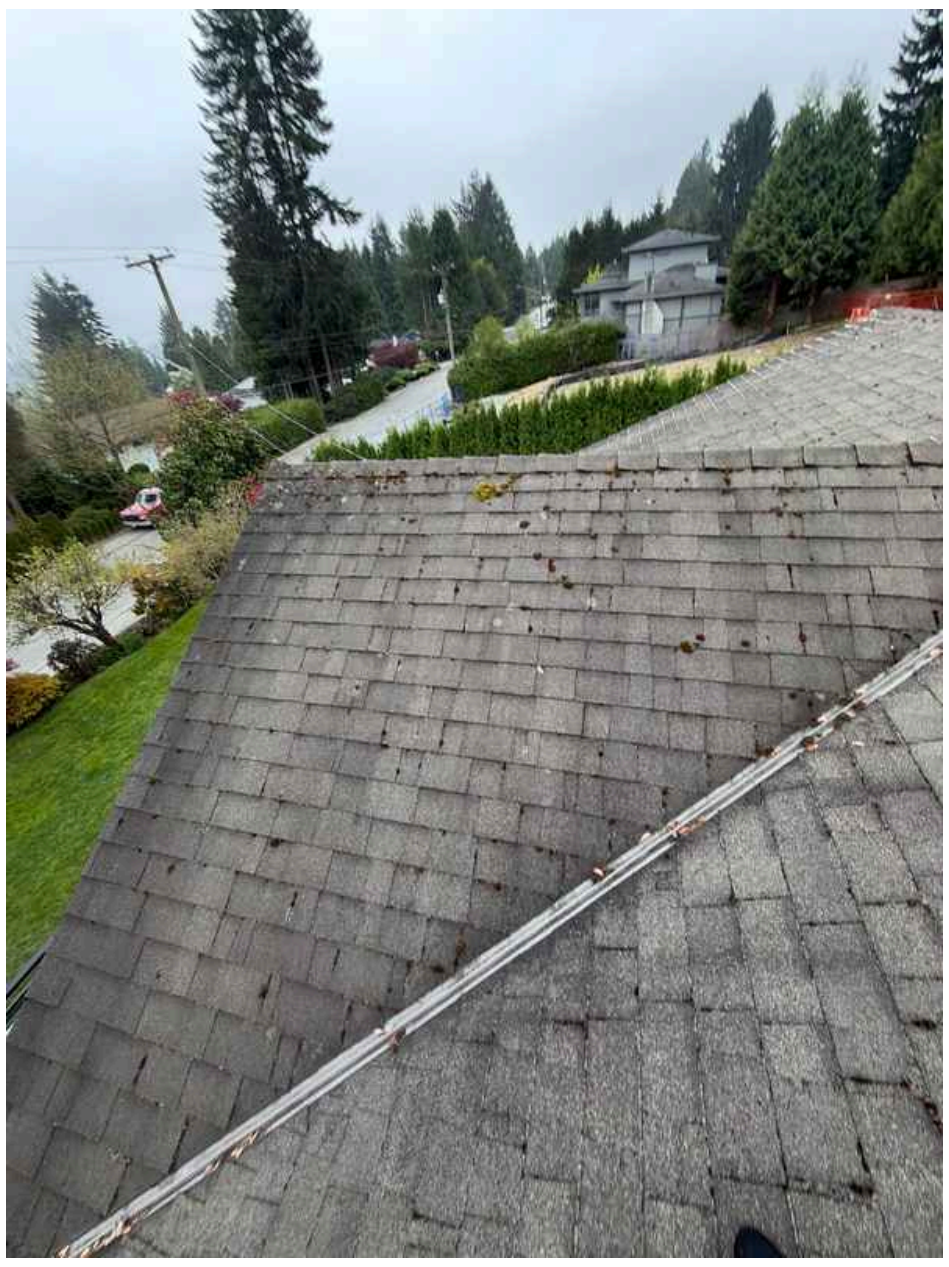

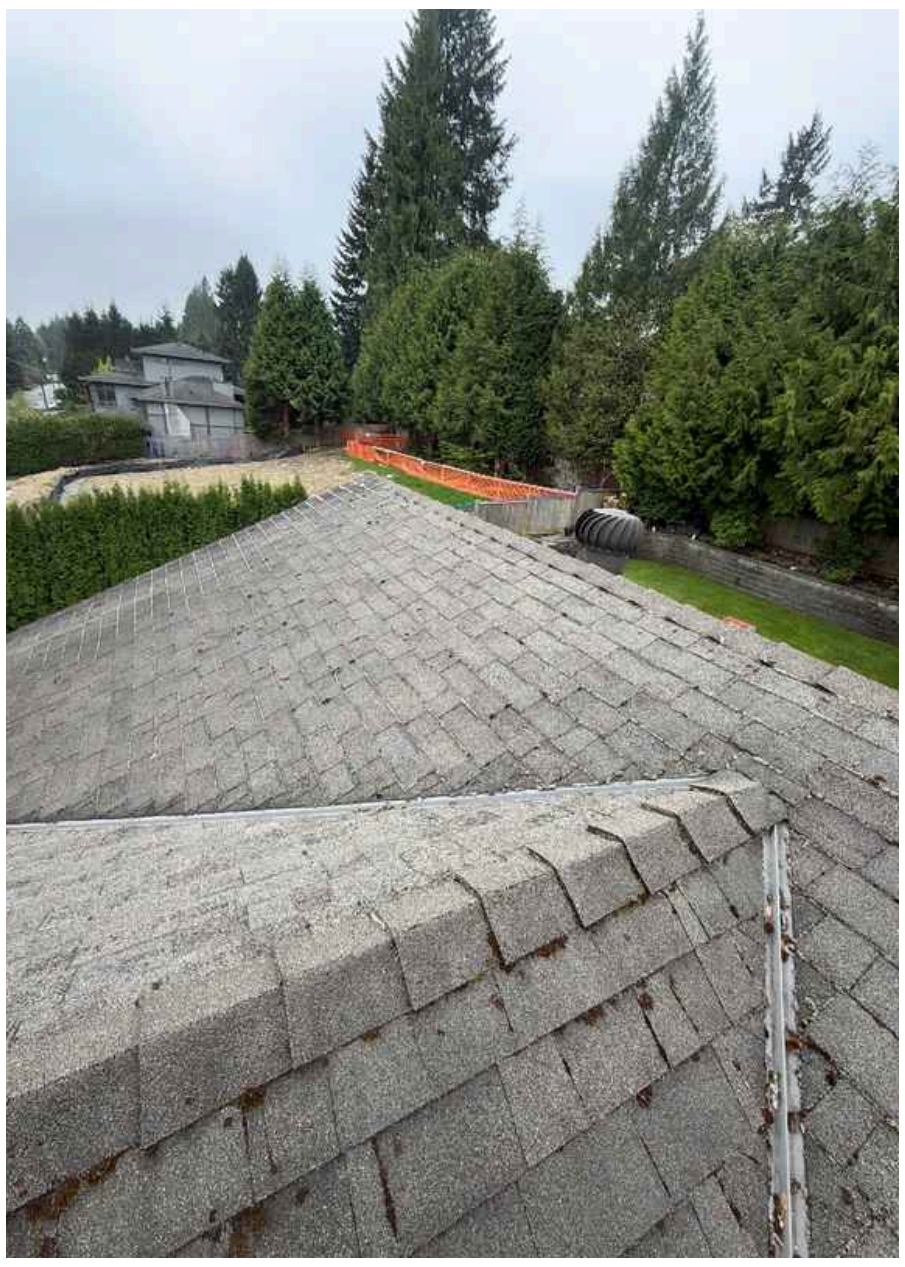
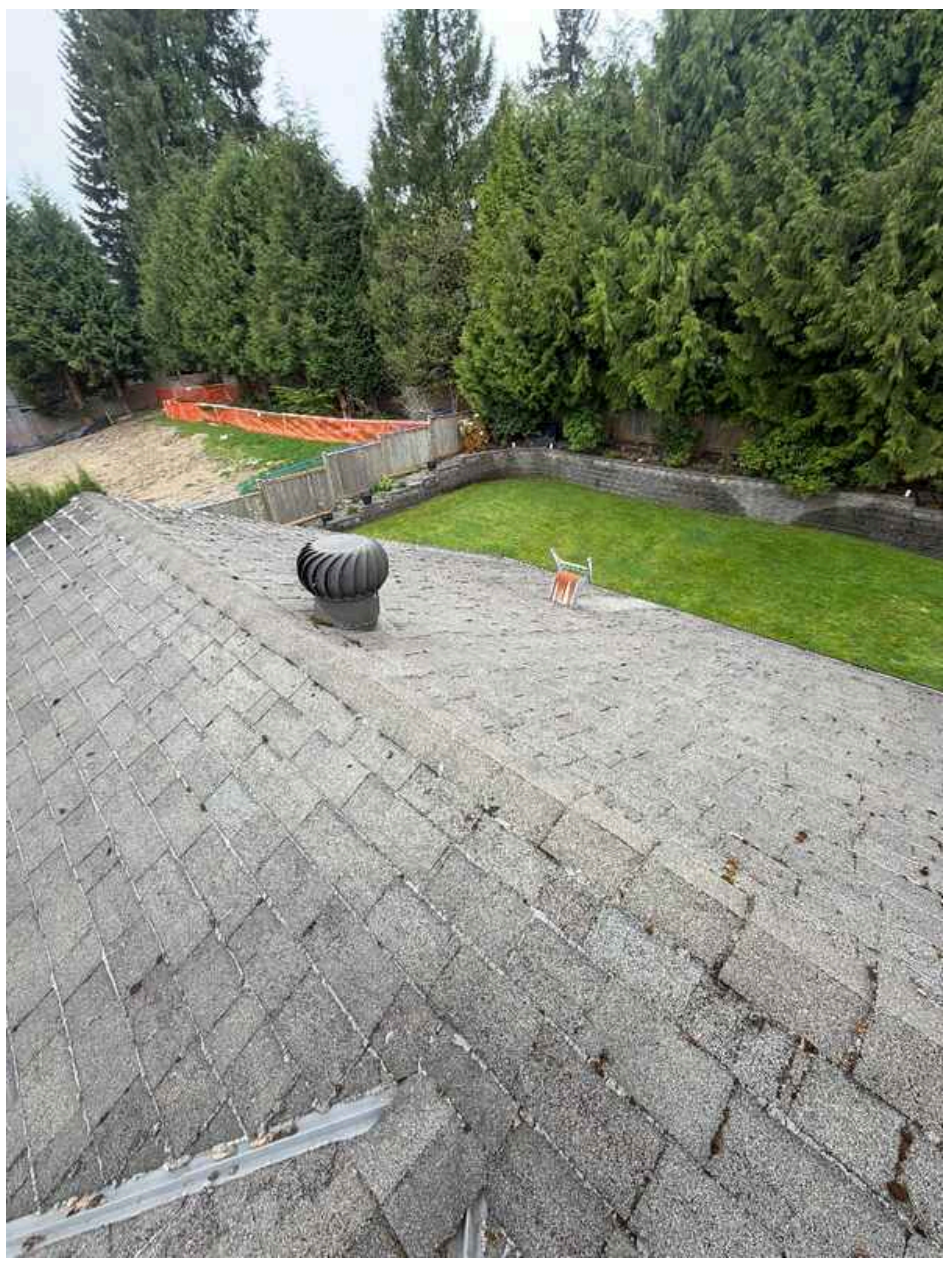

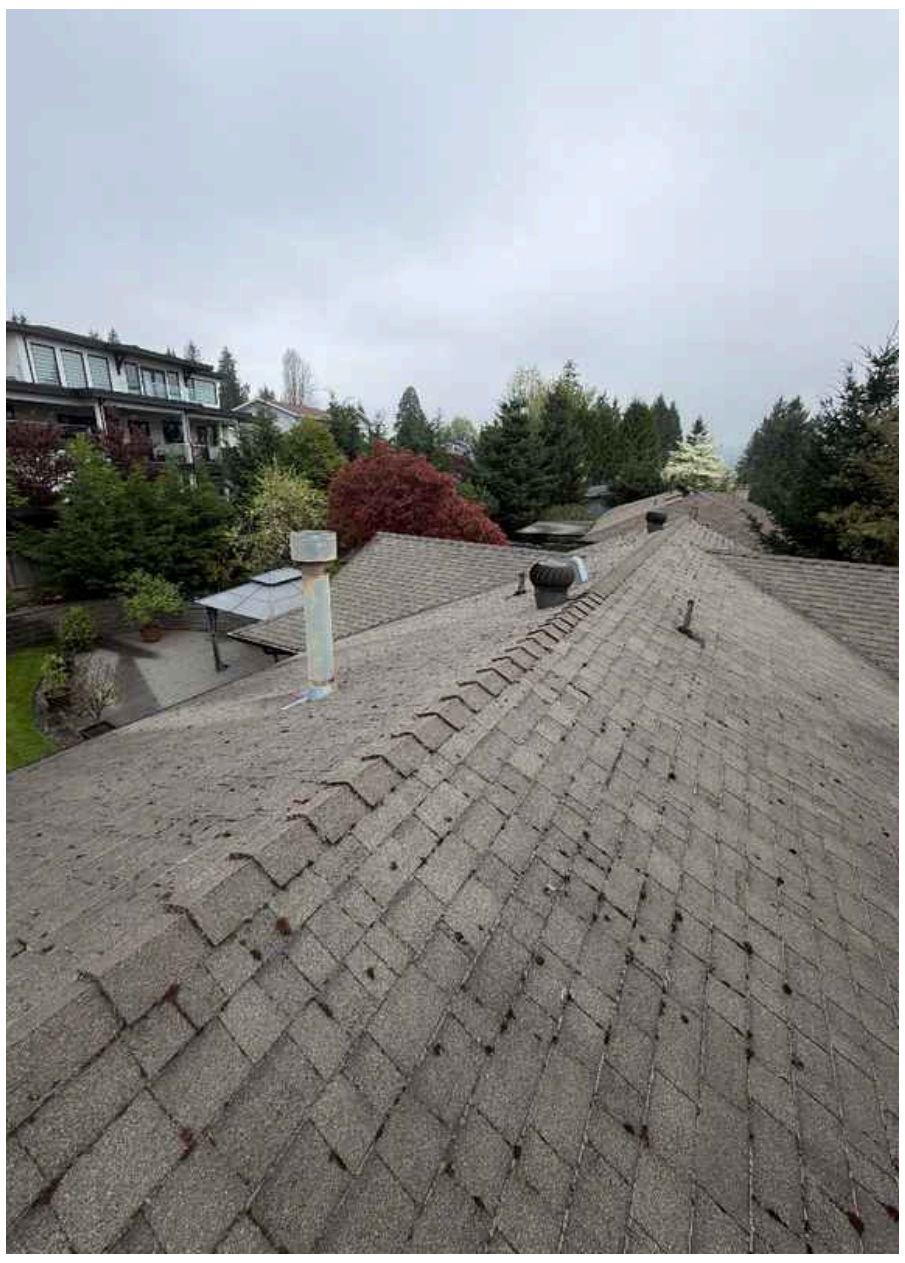
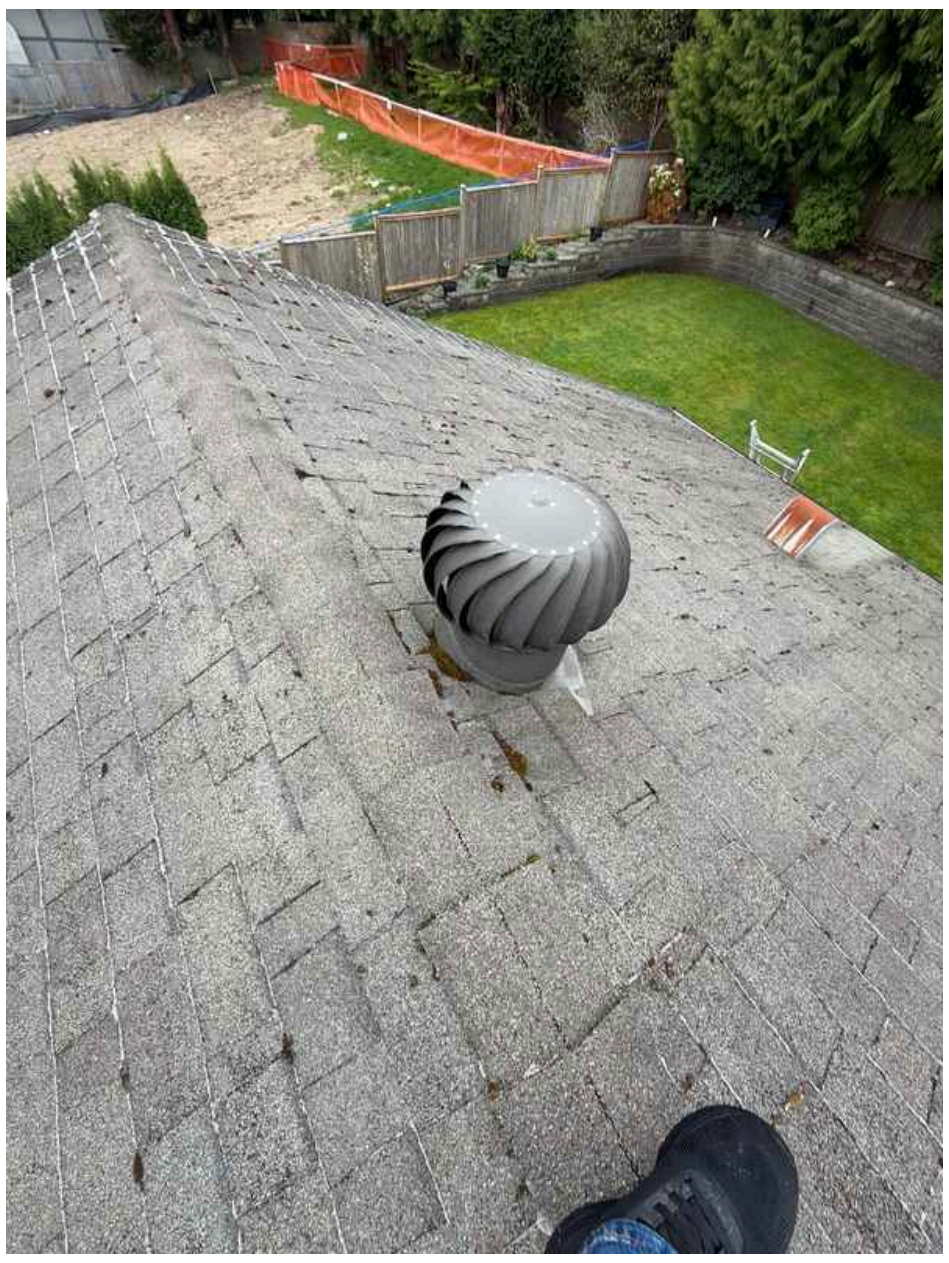



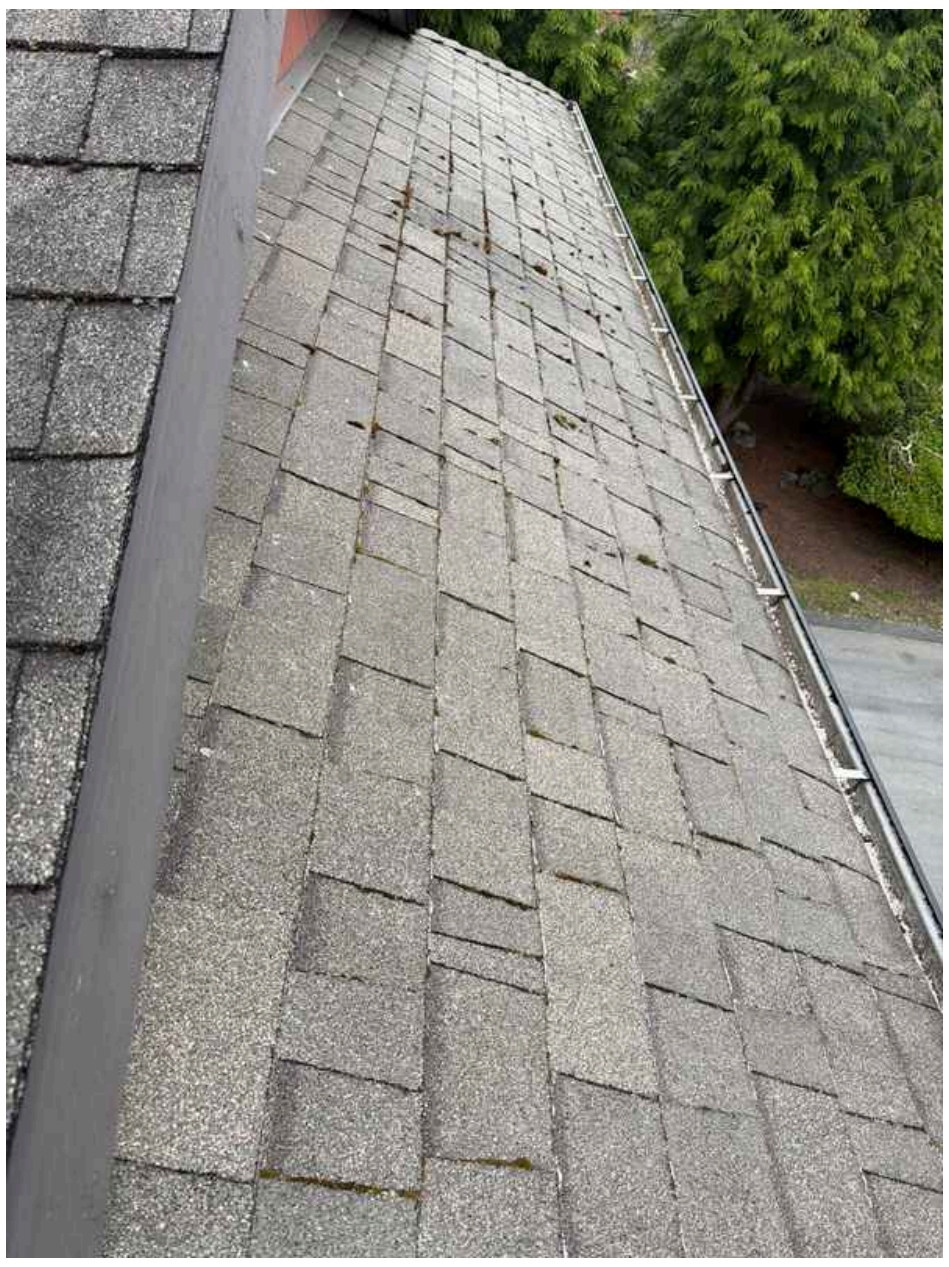

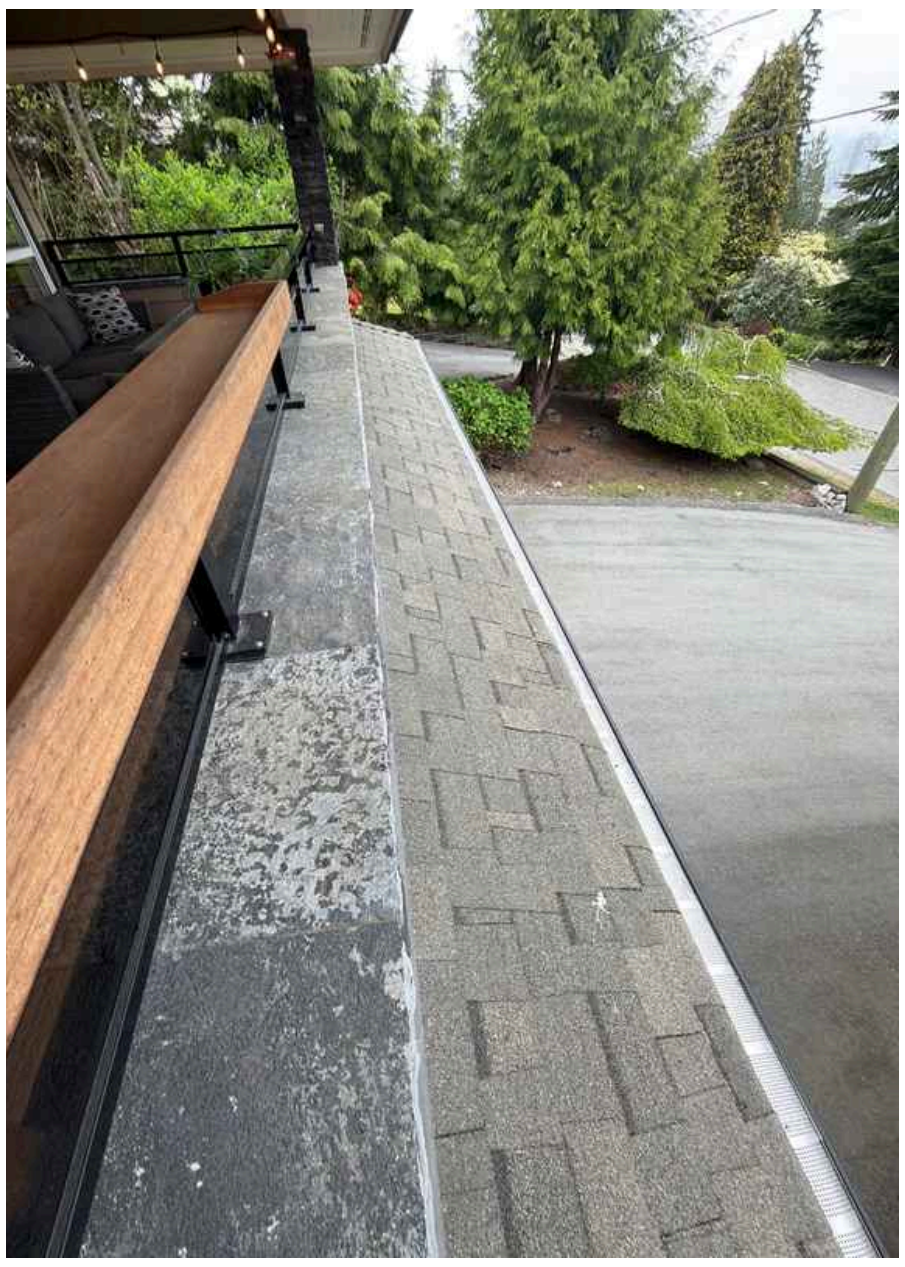
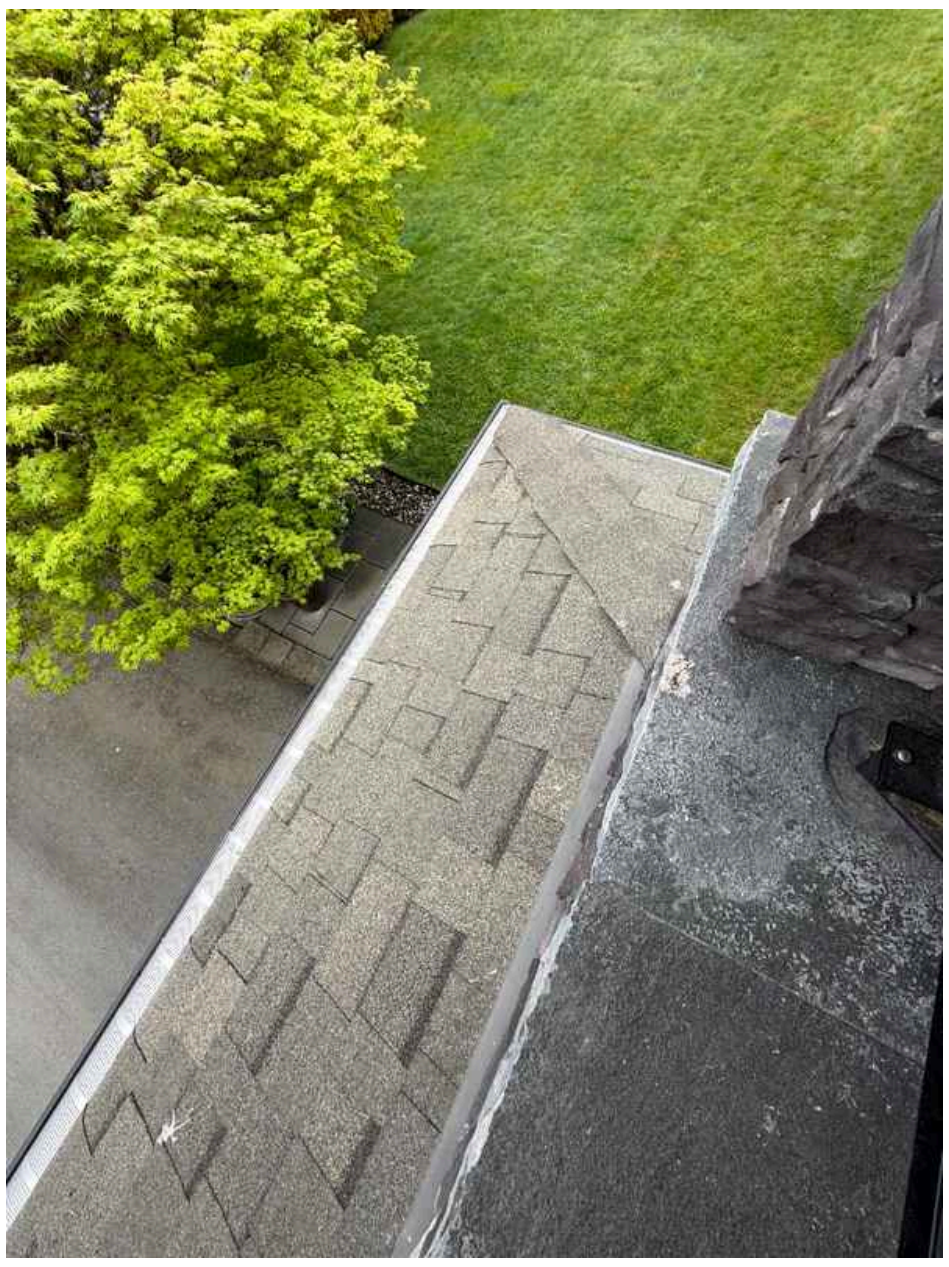
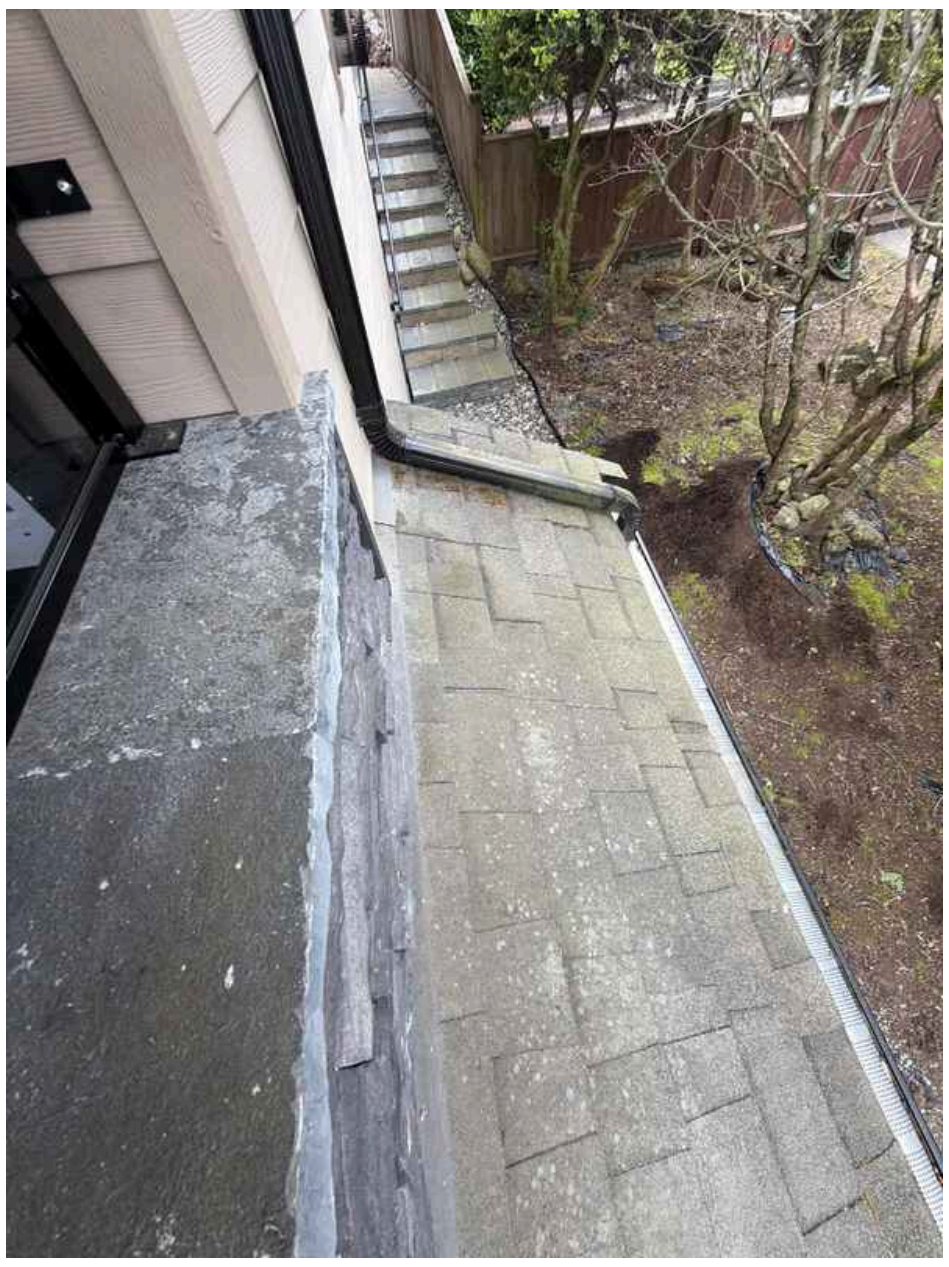
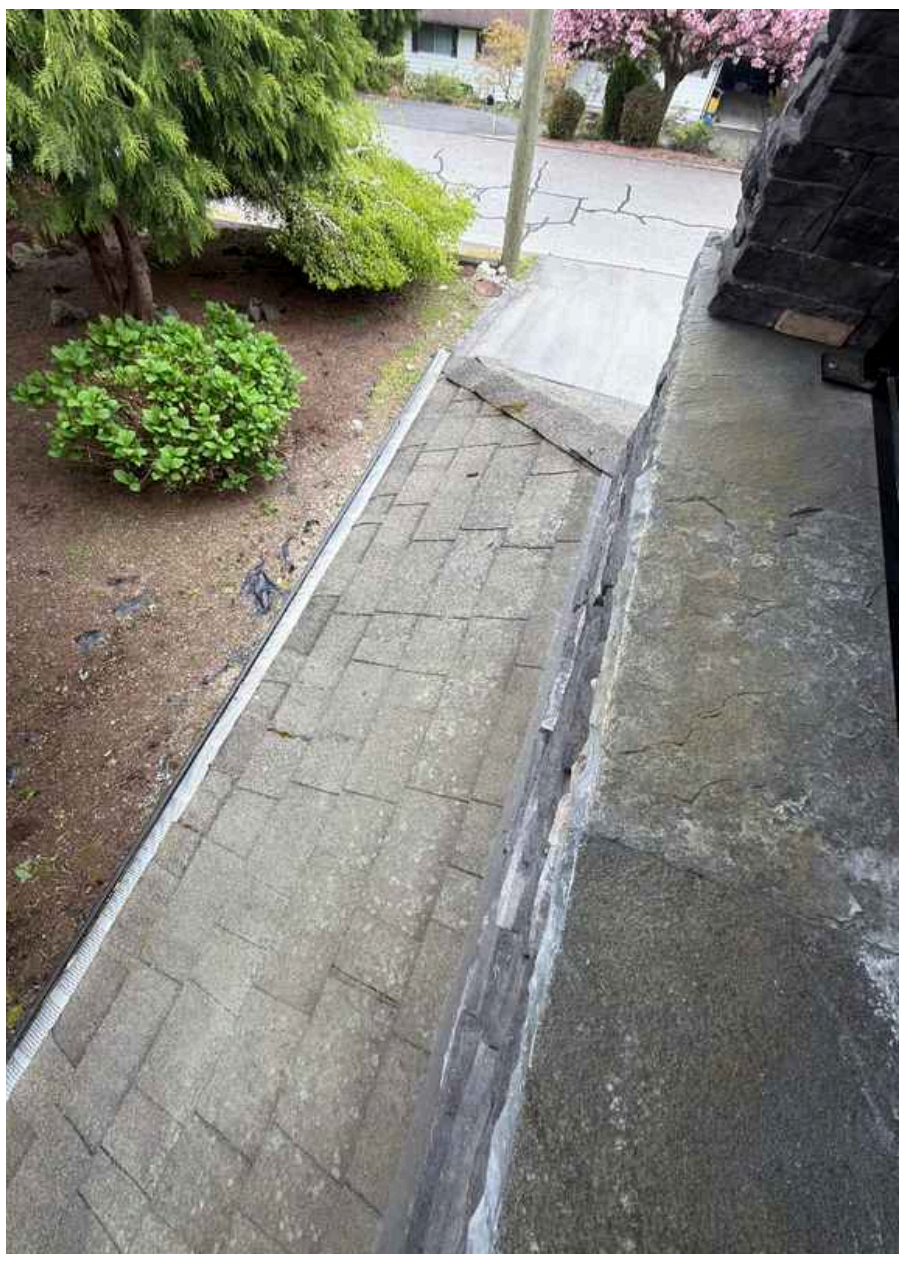

Roof Type/Style
Combination

Coverings: Material
Asphalt

Roof Drainage Systems: Gutter Material
Aluminum

Flashings: Material
Metal

Deficiencies

3.1.1 Coverings

Maintenance Item

ROOF MOSS GROWTH REQUIRING MAINTENANCE

Moss growth was observed on the roof coverings during inspection. Moss accumulation can trap moisture against the roofing material, potentially leading to premature deterioration, reduced roof lifespan, and water infiltration issues. A qualified roofing professional should evaluate the extent of growth and recommend appropriate cleaning and preventive measures.

Recommendation

Contact a qualified professional.

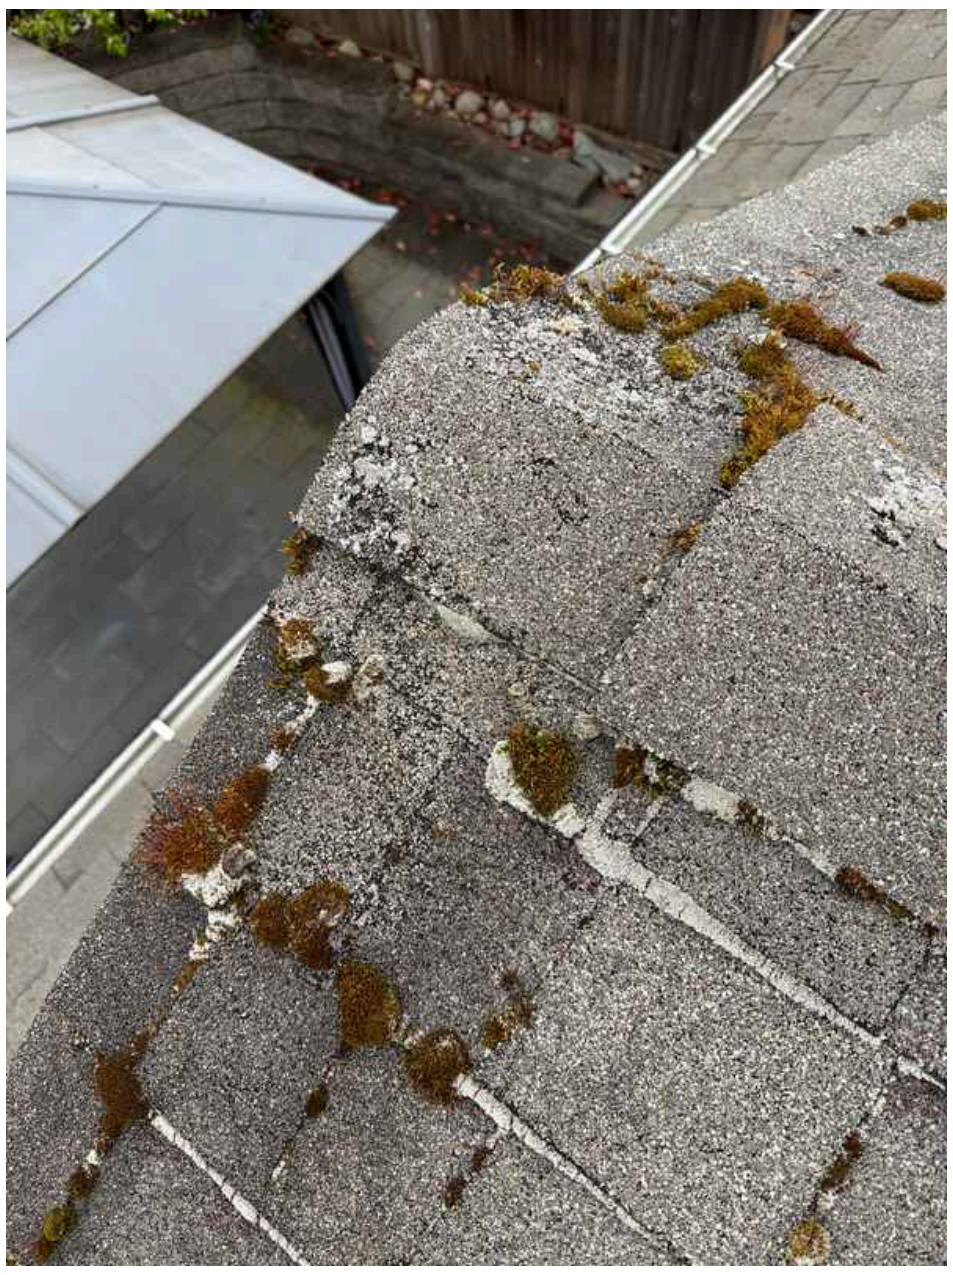


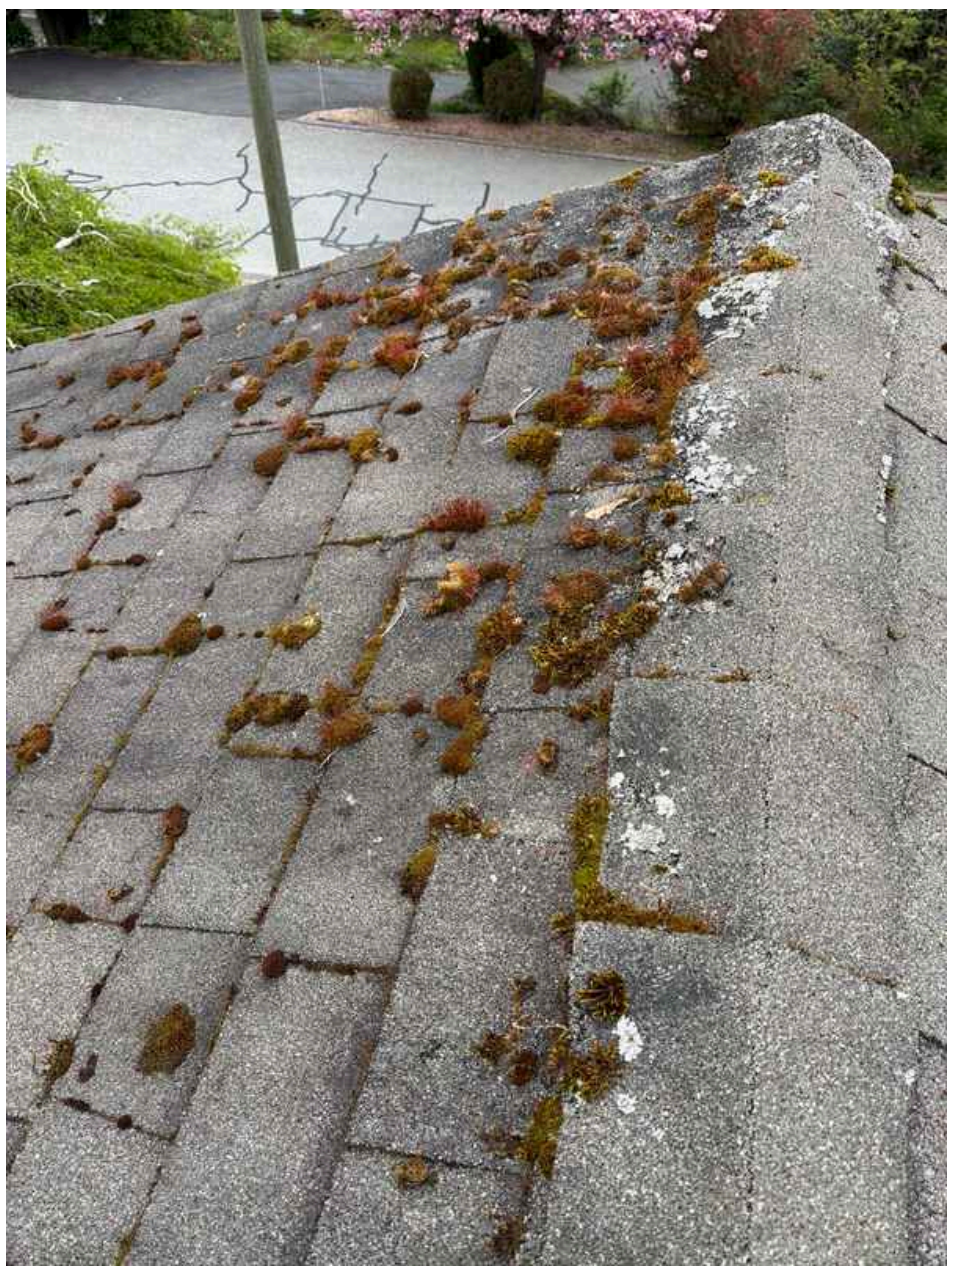

4: BASEMENT, FOUNDATION, CRAWLSPACE & STRUCTURE

Information

Inspection Method
Visual

Foundation: Material
Concrete

Floor Structure: Basement/Crawlspace Floor
Concrete, Wood

Floor Structure: Material
Slab, Wood partially

Floor Structure: Sub-floor
Inaccessible

Limitations

Floor Structure

FLOOR STRUCTURE NOT VISIBLE

BASEMENT

The floor structure cannot be fully inspected due to soffits blocking visual access. This limitation prevents a complete assessment of the structural framing, joists, and support systems. A more detailed evaluation may require removal or repositioning of the soffits or consultation with a structural professional.

Deficiencies

4.5.1 Ceiling Structure

Recommendation

CEILING DISCOLORATION AND POSSIBLE MOLD GROWTH

BASEMENT

Blackenings and possible organic growth were observed on the ceiling structure during inspection. The material was not tested to confirm the presence of organic growth can indicate moisture issues and may pose health concerns depending on the type and extent. A qualified mold professional should evaluate the affected area, identify the moisture source, and recommend appropriate remediation or cleanining

Recommendation

Contact a qualified professional.



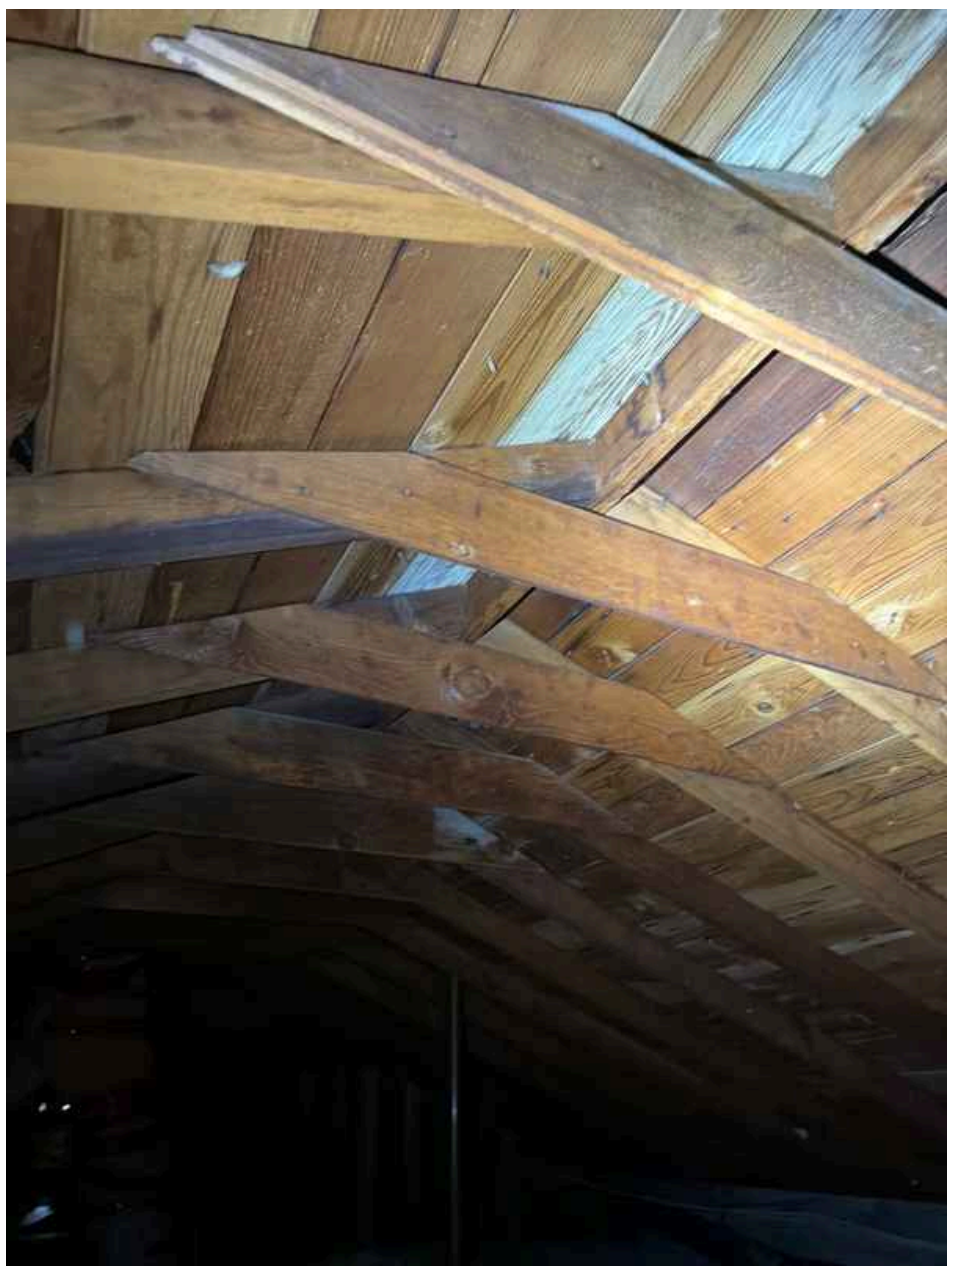

5: HEATING

Information

Homeowner's Responsibility

Most HVAC (heating, ventilating and air-conditioning) systems in houses are relatively simple in design and operation. They consist of four components: controls, fuel supply, heating or cooling unit, and distribution system. The adequacy of heating and cooling is often quite subjective and depends upon occupant perceptions that are affected by the distribution of air, the location of return-air vents, air velocity, the sound of the system in operation, and similar characteristics.

It's your job to get the HVAC system inspected and serviced every year. And if you're system as an air filter, be sure to keep that filter cleaned.

Thermal Imaging Assessment

A thermal imaging camera was used during the heating system inspection to visualize temperature distribution and identify potential heat loss or operational inefficiencies. This non-invasive diagnostic tool helps detect areas of concern that may not be visible to the naked eye, such as insulation gaps, air leaks, or uneven heating patterns within the home.

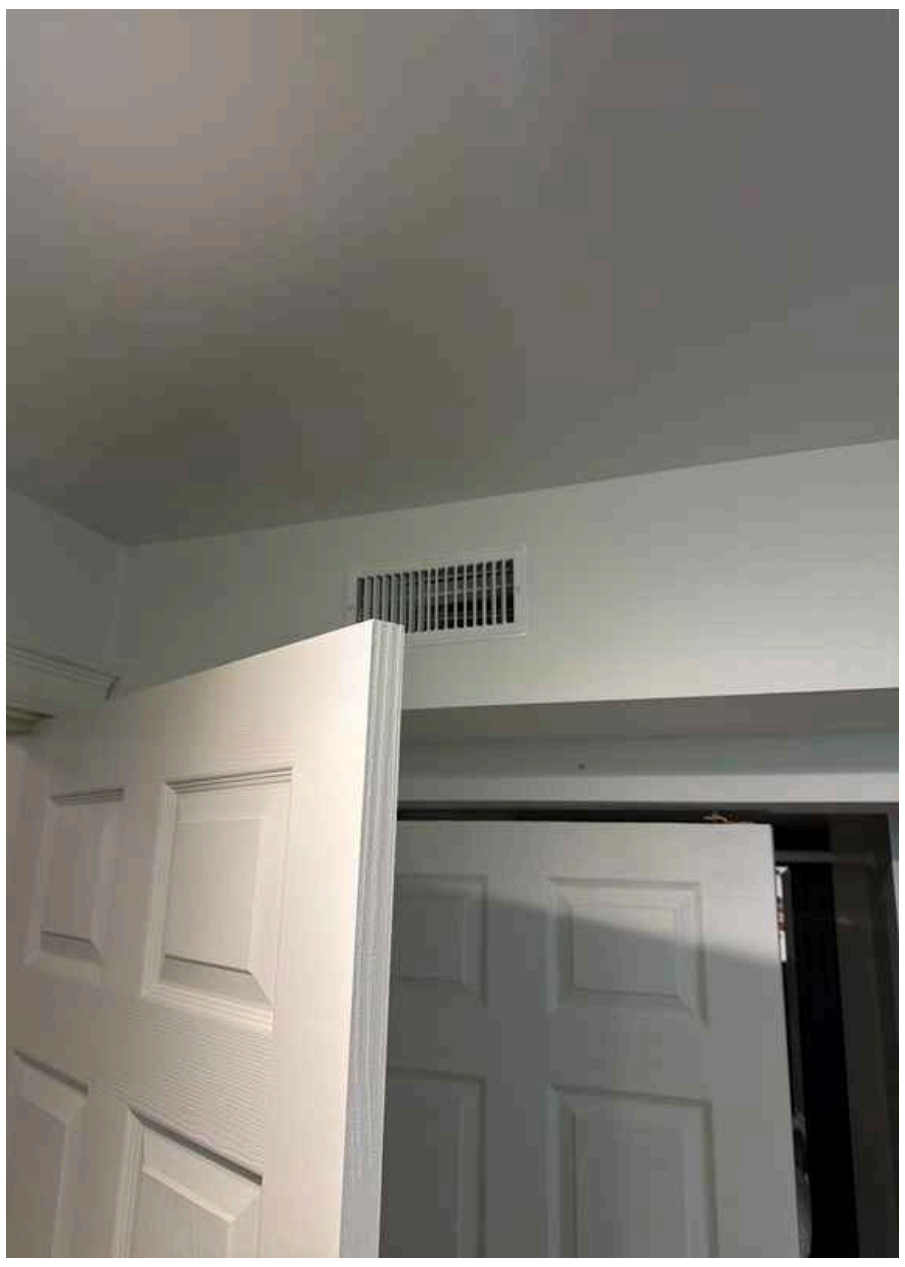

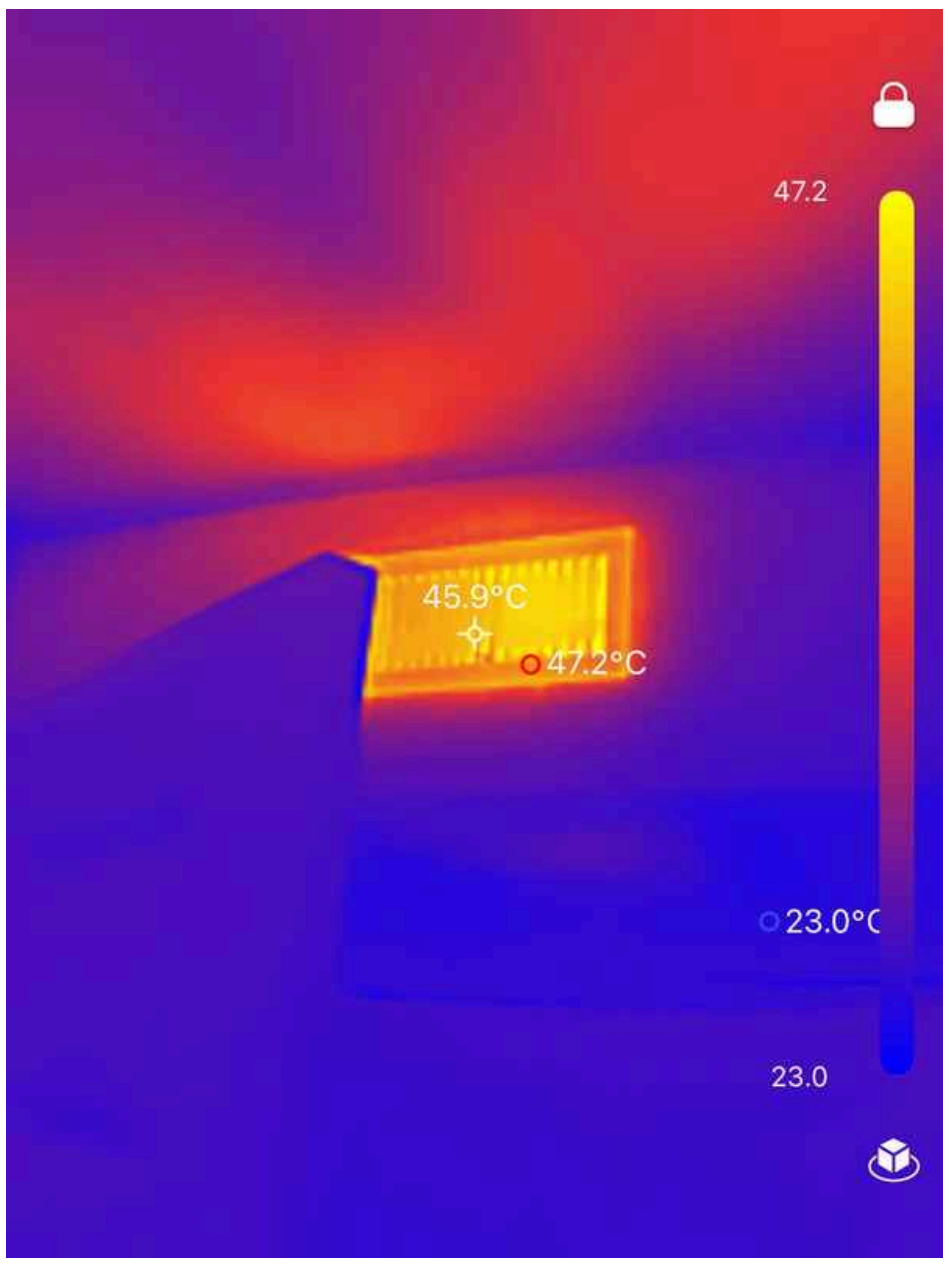

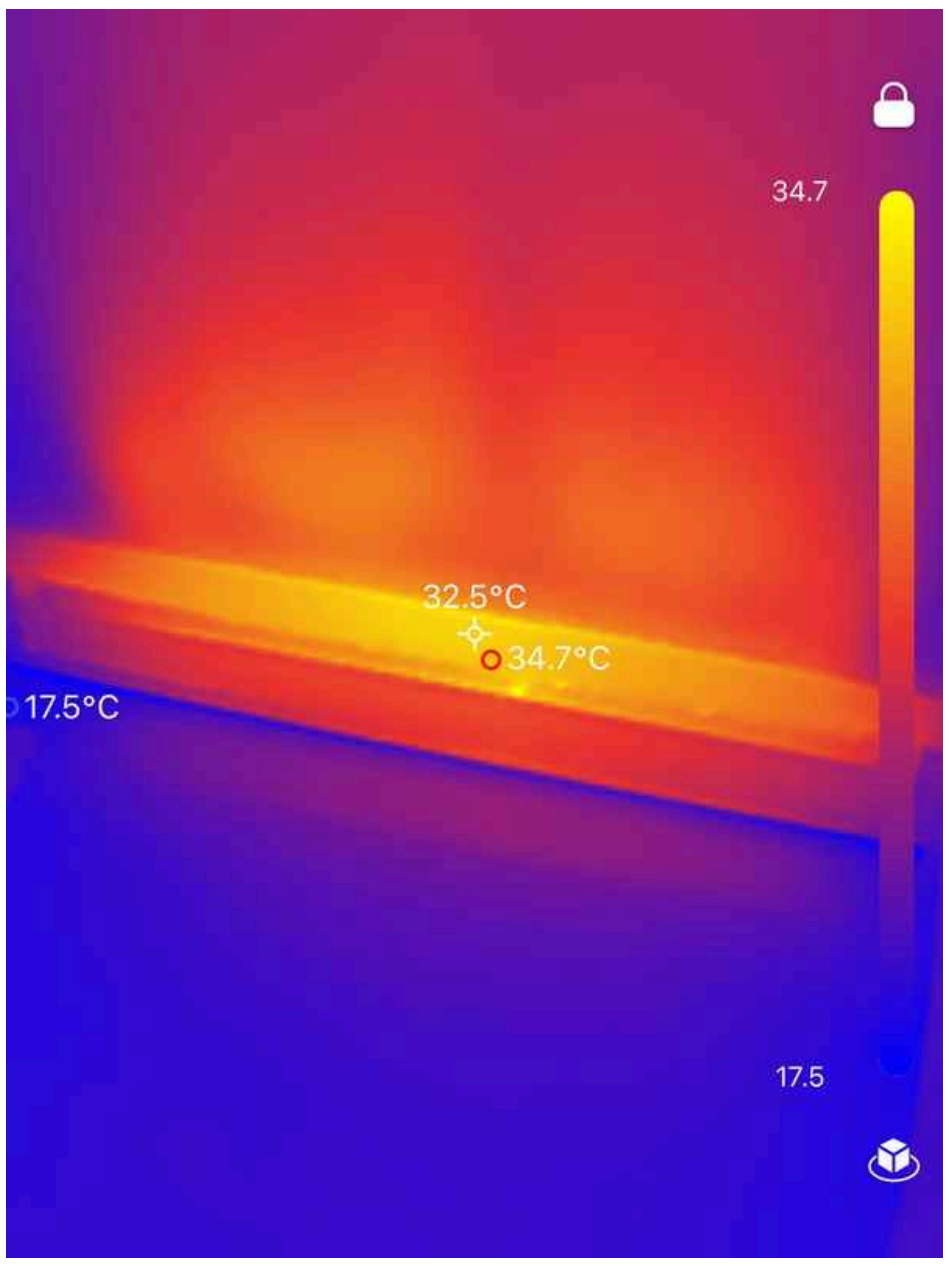

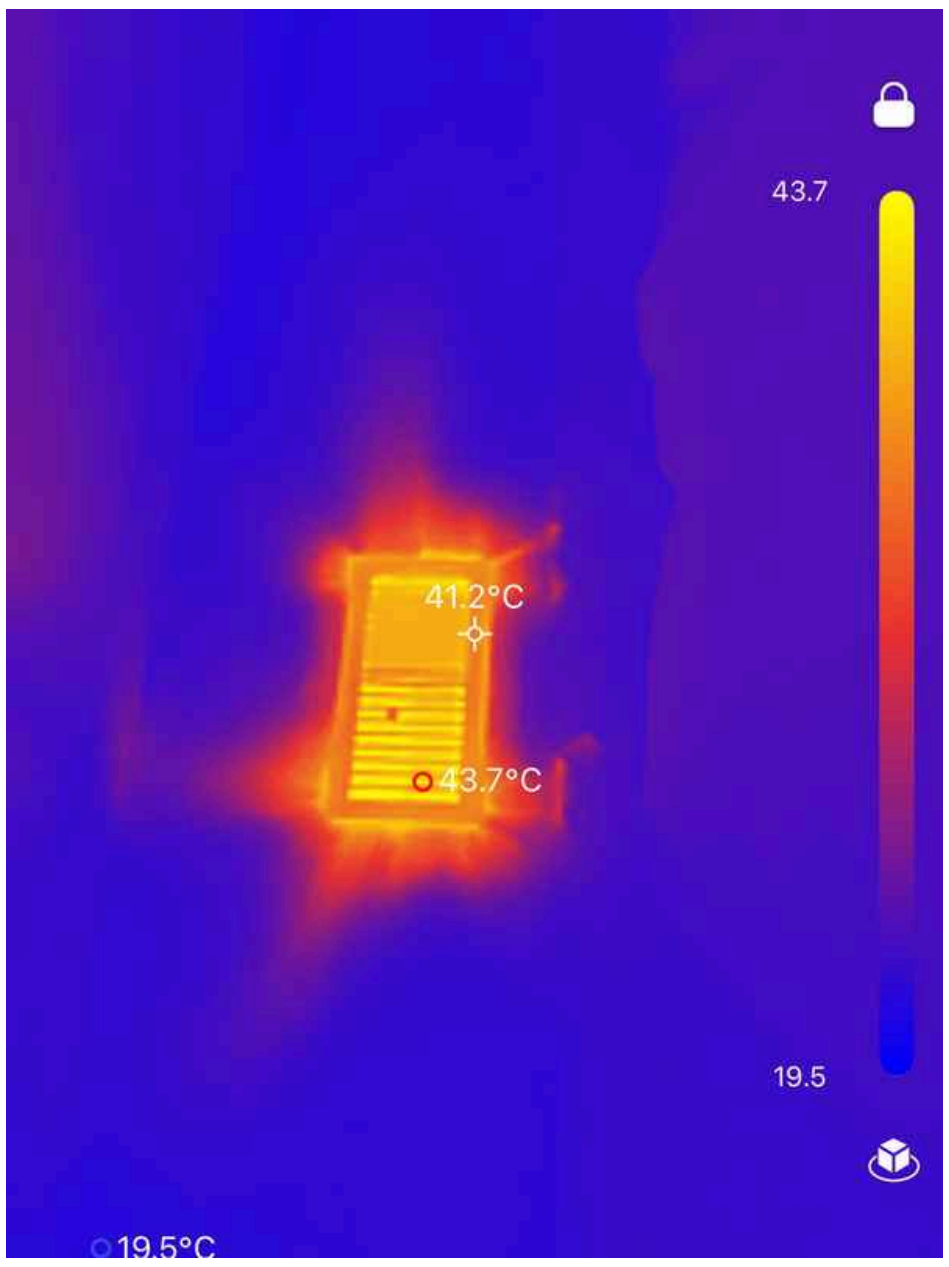

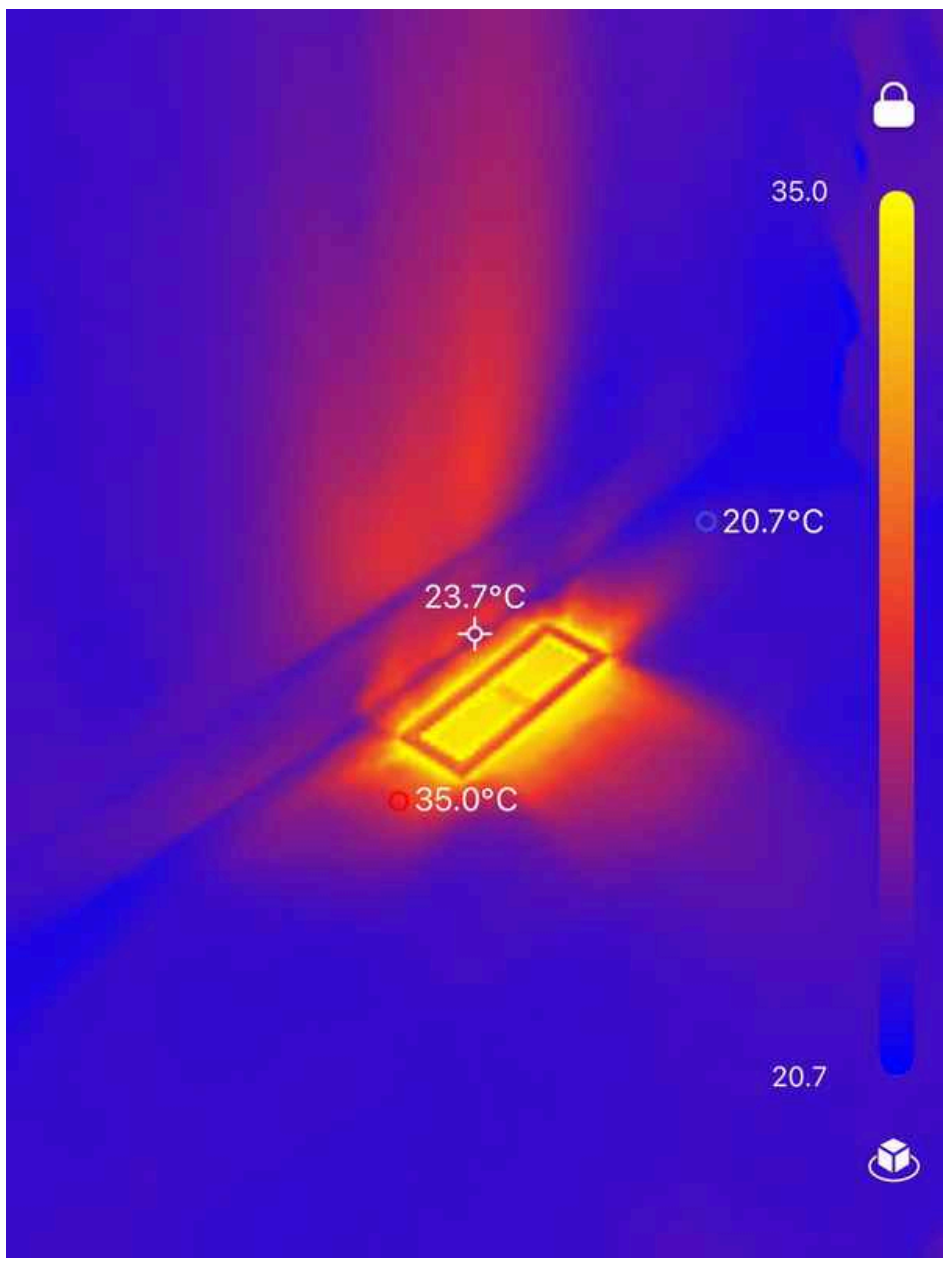

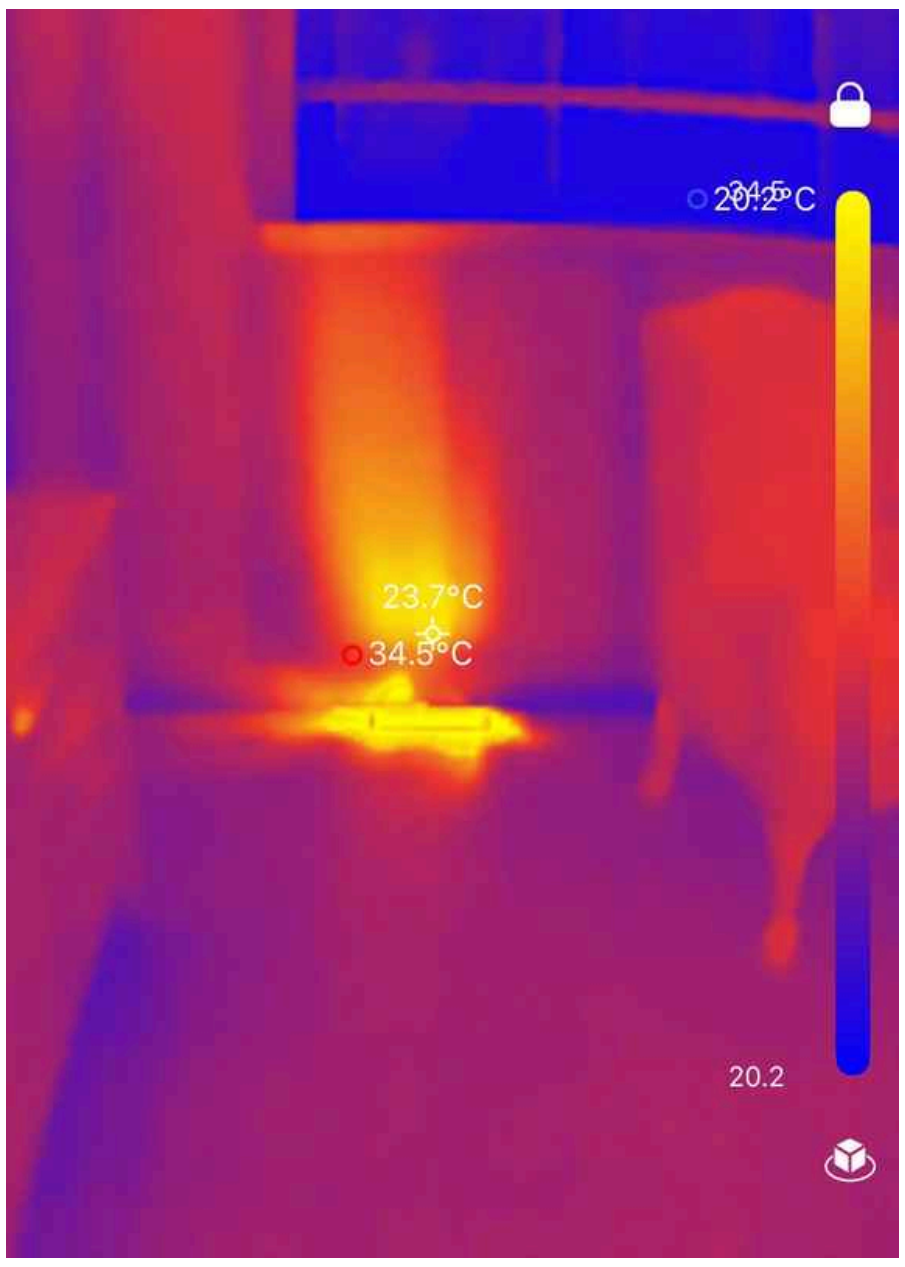
23.7°C
34.5°C
20.2

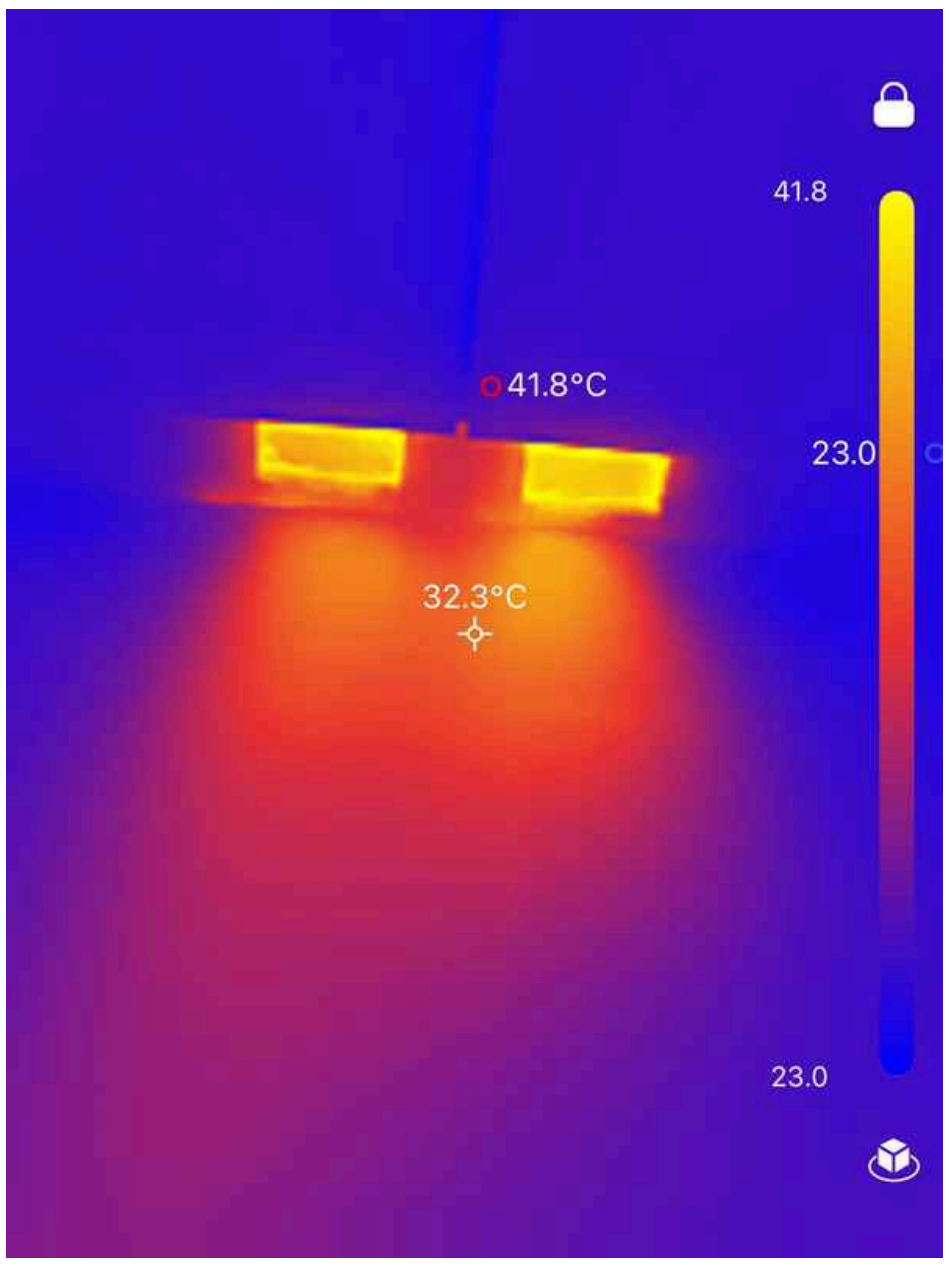
41.8
41.8°C
23.0
32.3°C
23.0

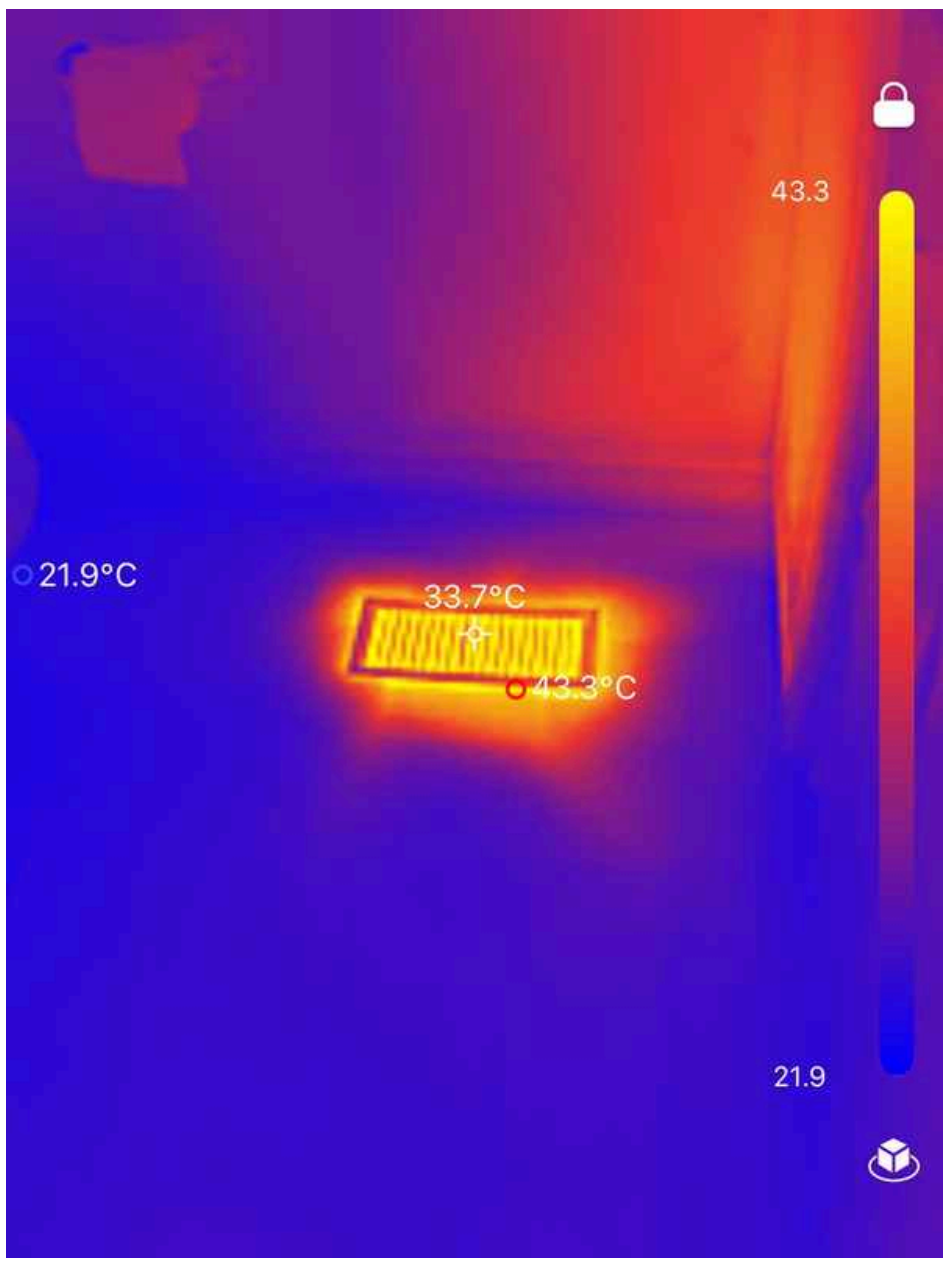
43.3
21.9°C
33.7°C
43.3°C
21.9

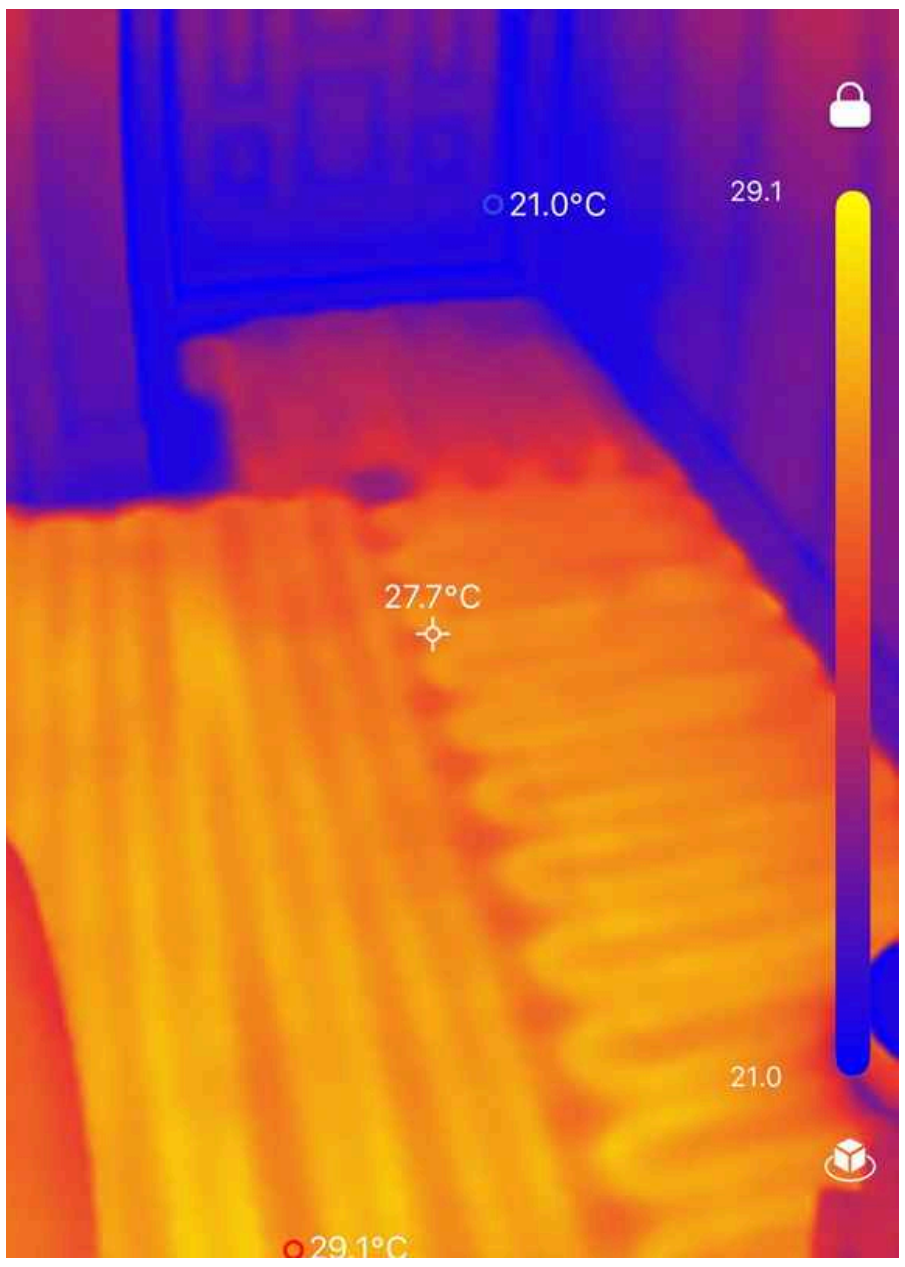
21.0°C
29.1
27.7°C
21.0
29.1°C

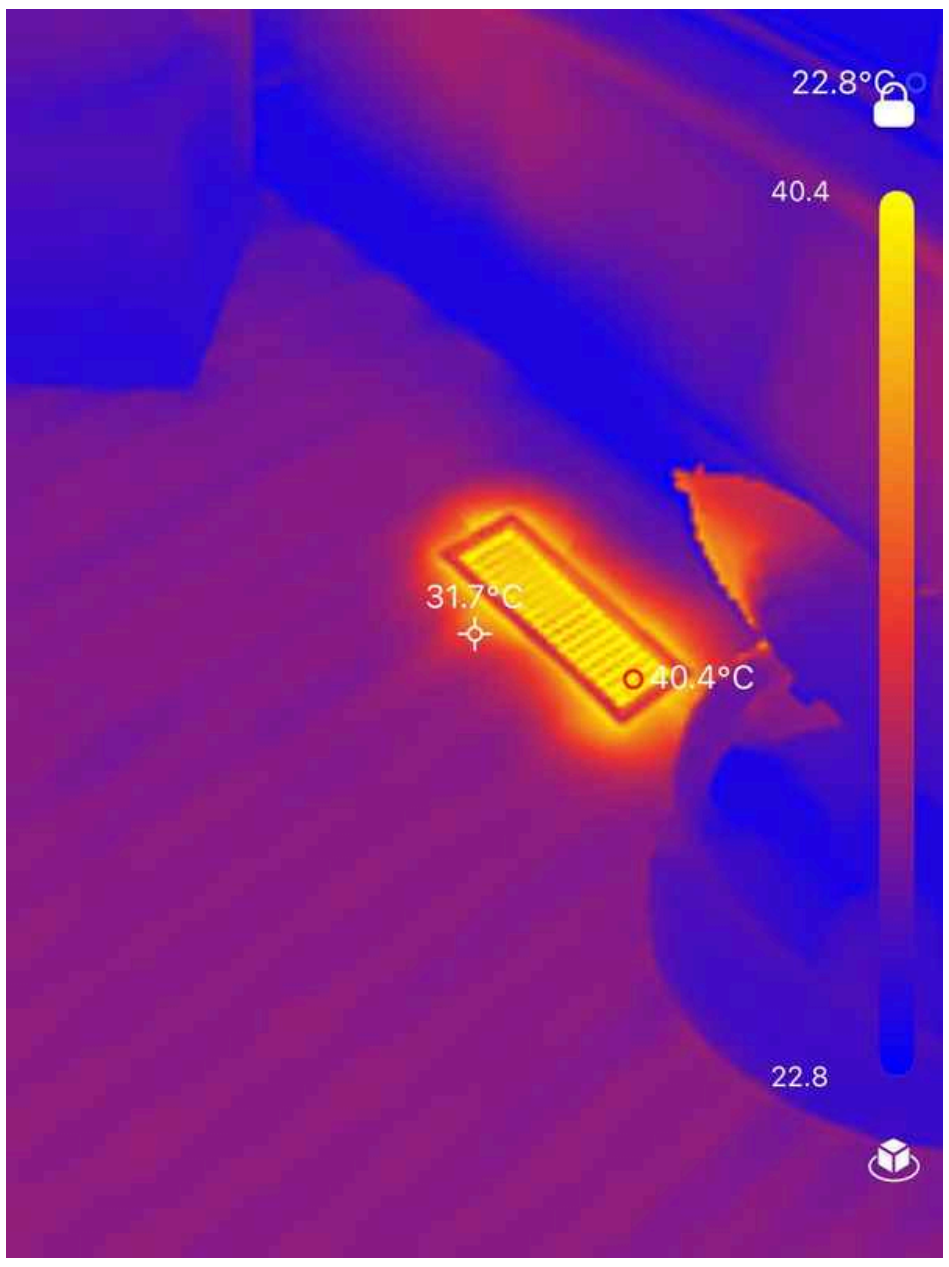
22.8°C
40.4
31.7°C
40.4°C
22.8

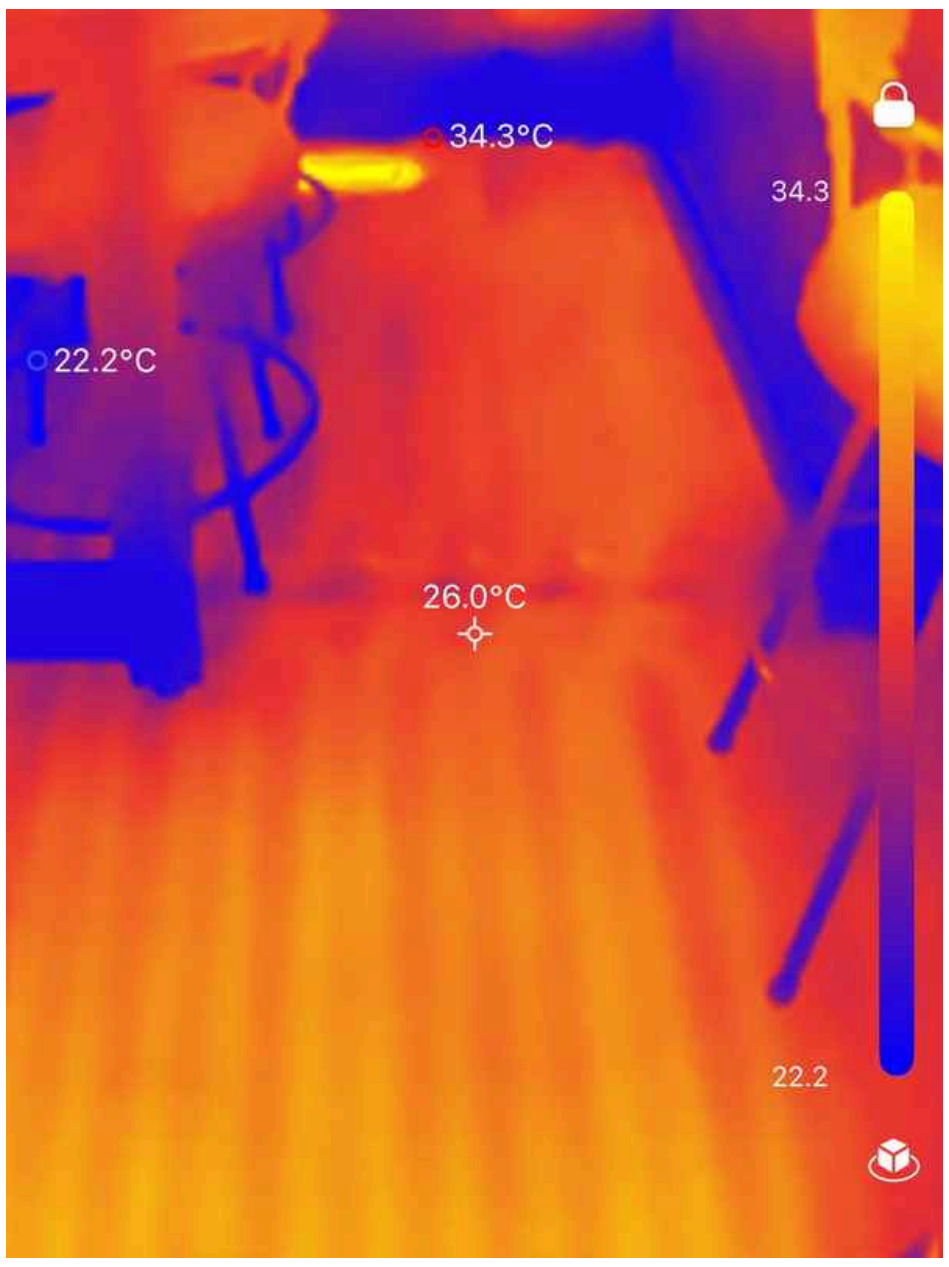
34.3°C
34.3
22.2°C
26.0°C
22.2

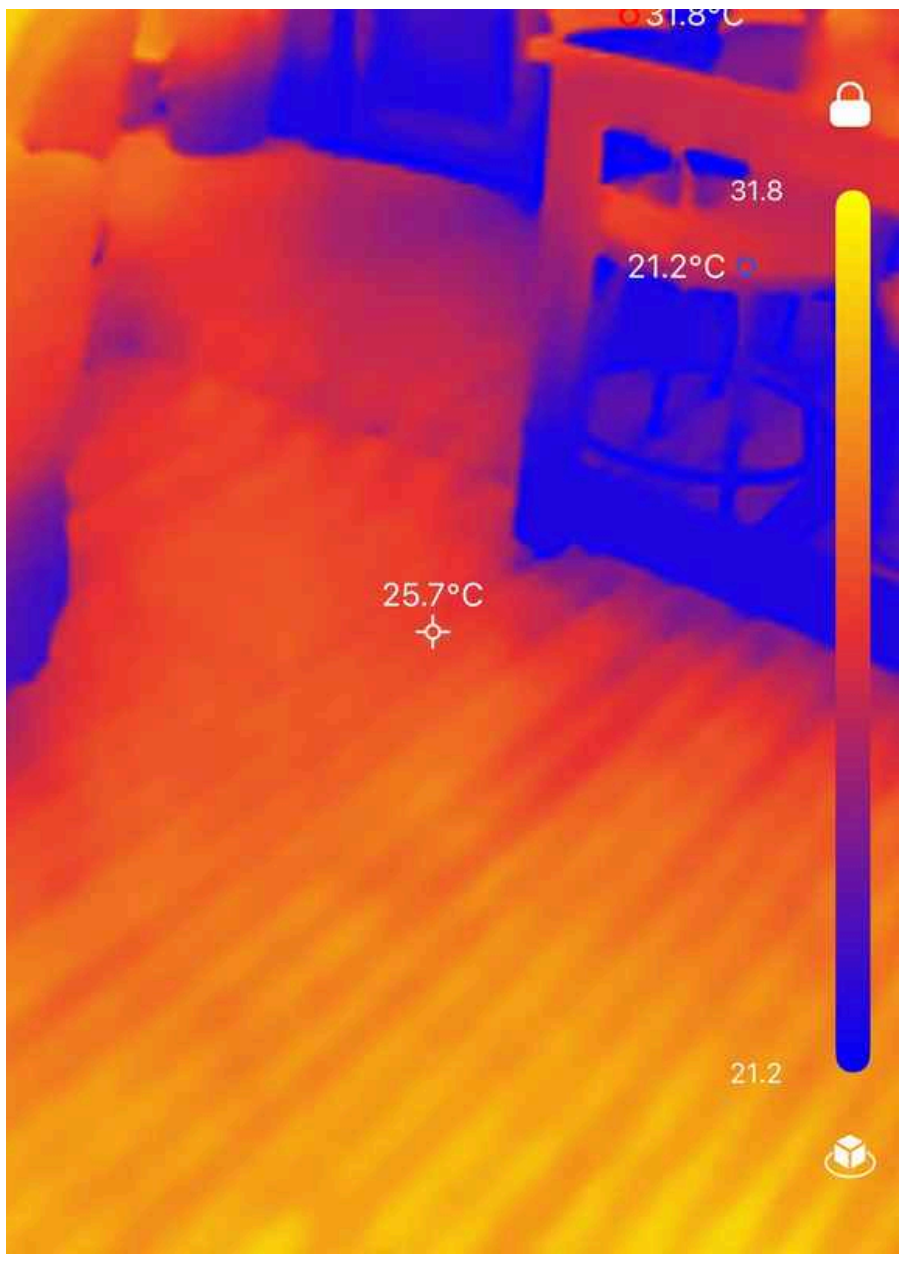
31.8°C
31.8
21.2°C
25.7°C
21.2

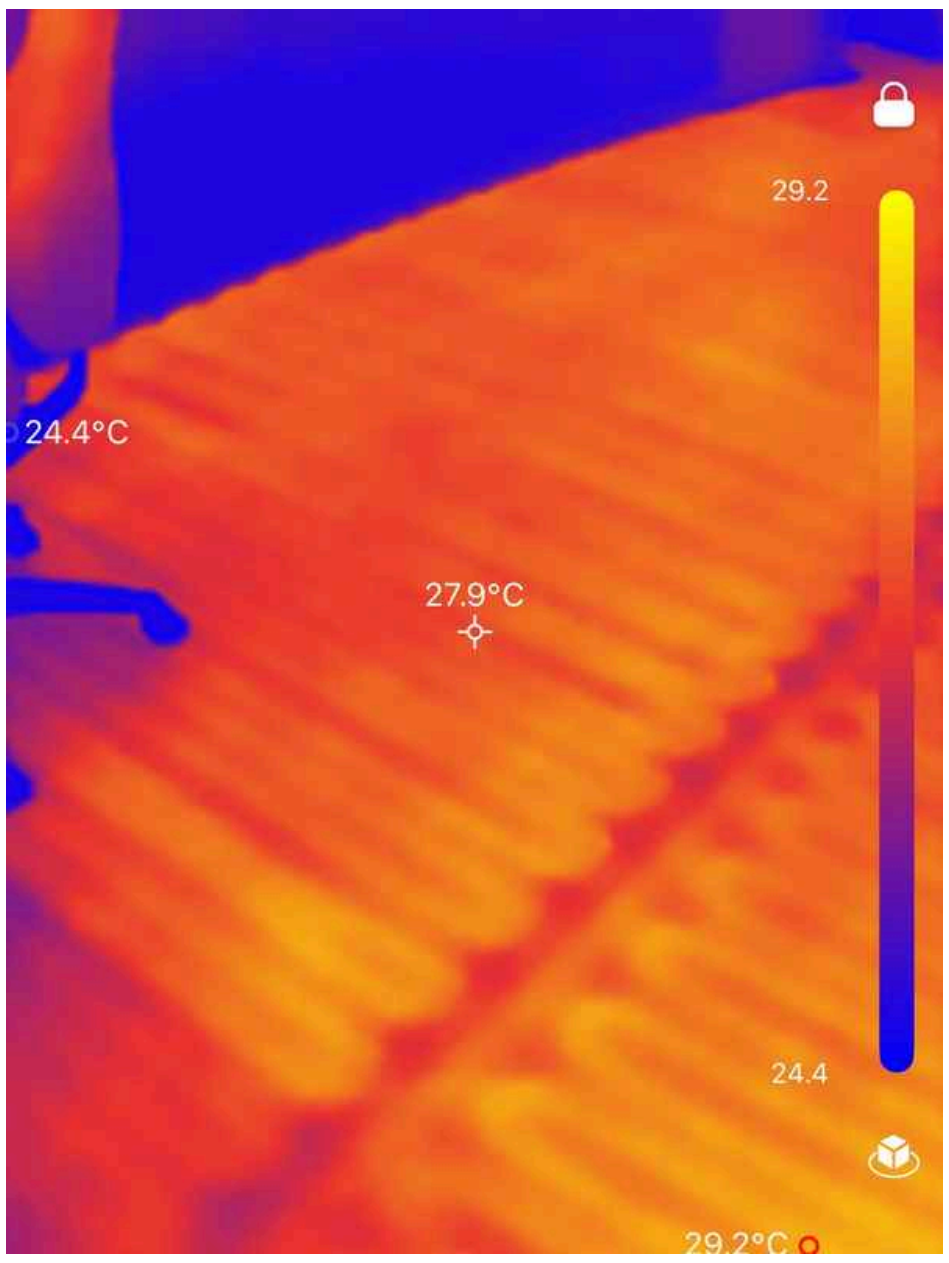
29.2
24.4°C
27.9°C
24.4
29.2°C

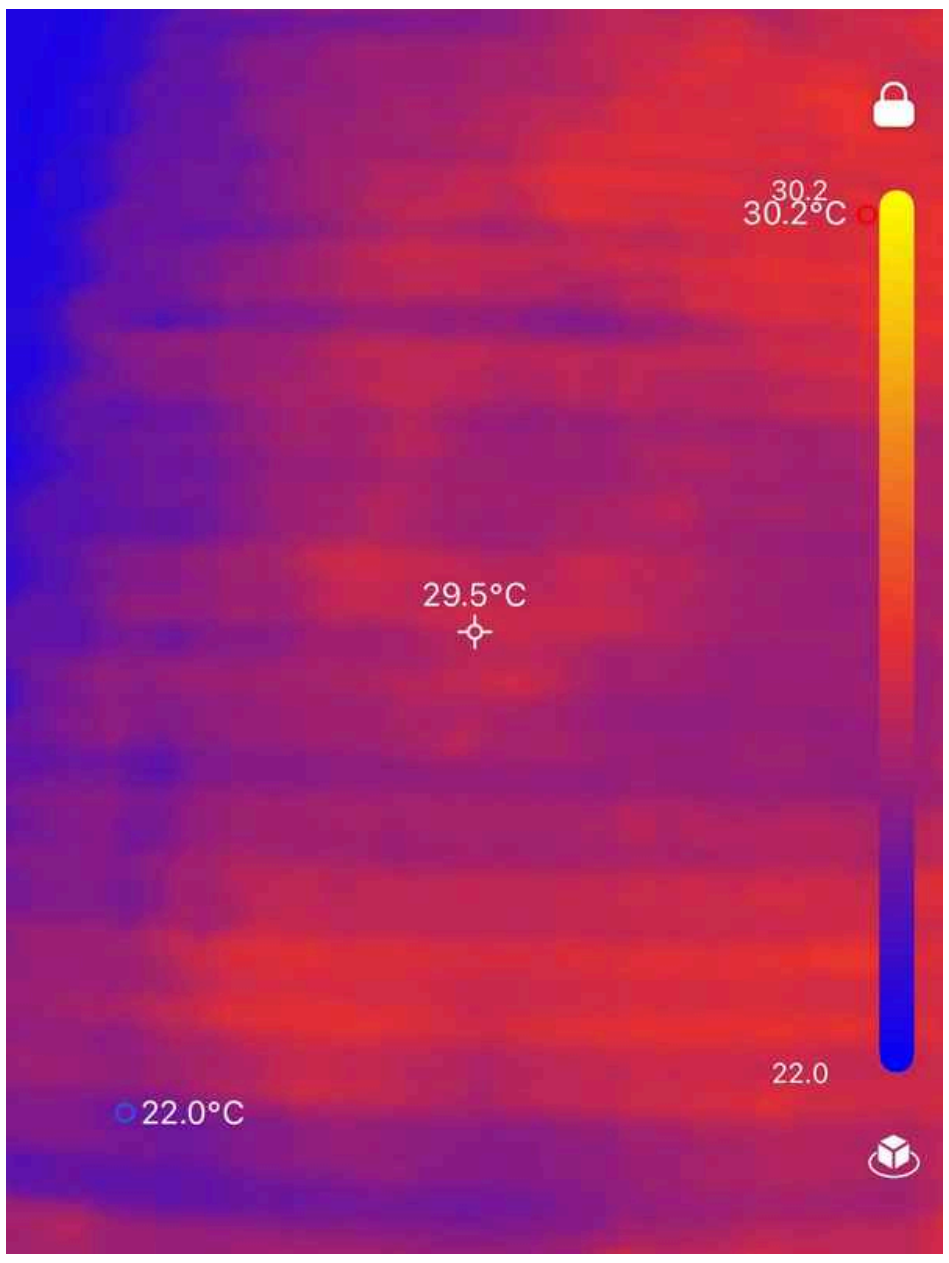
30.2°C
29.5°C
22.0
22.0°C

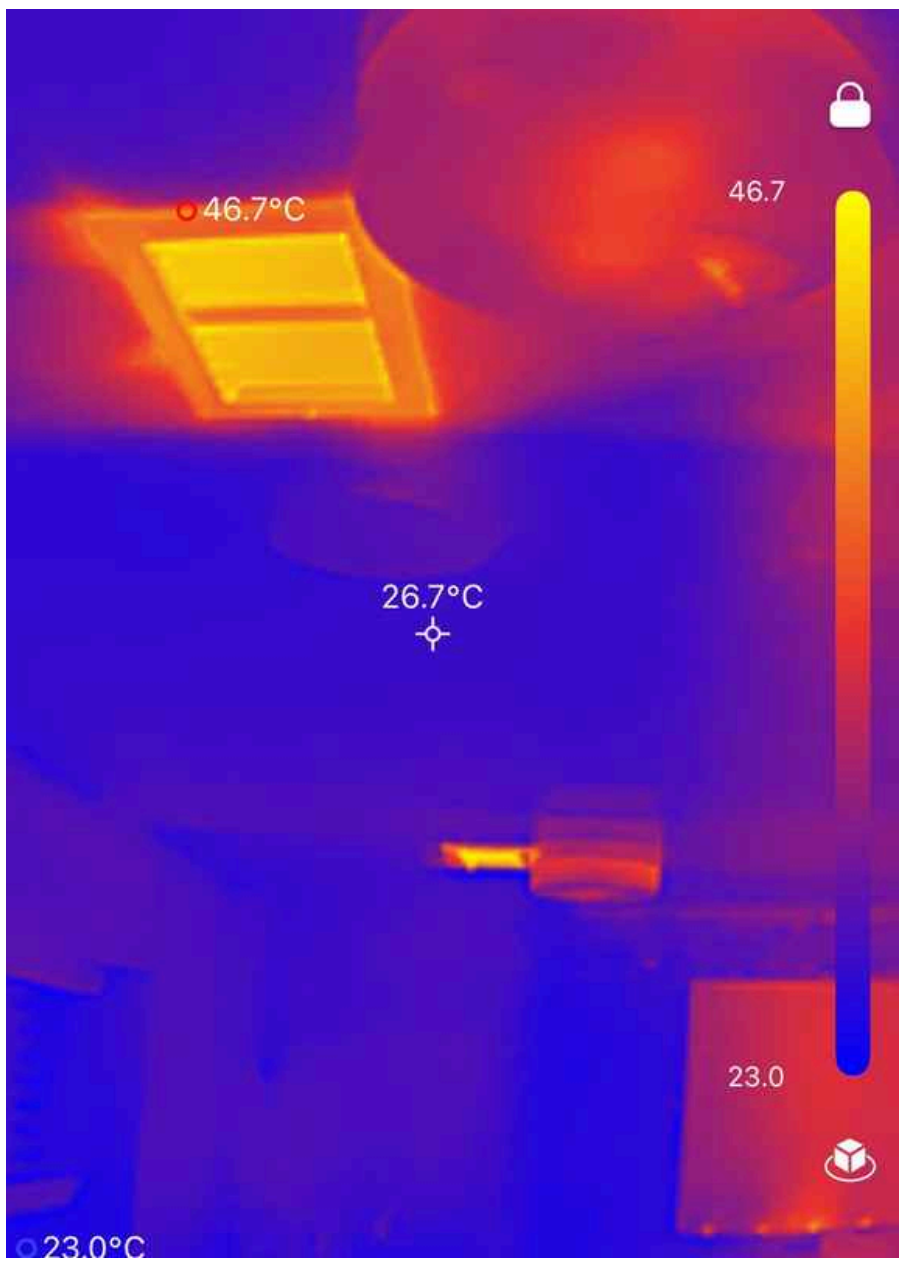
46.7°C
46.7
26.7°C
23.0
23.0°C

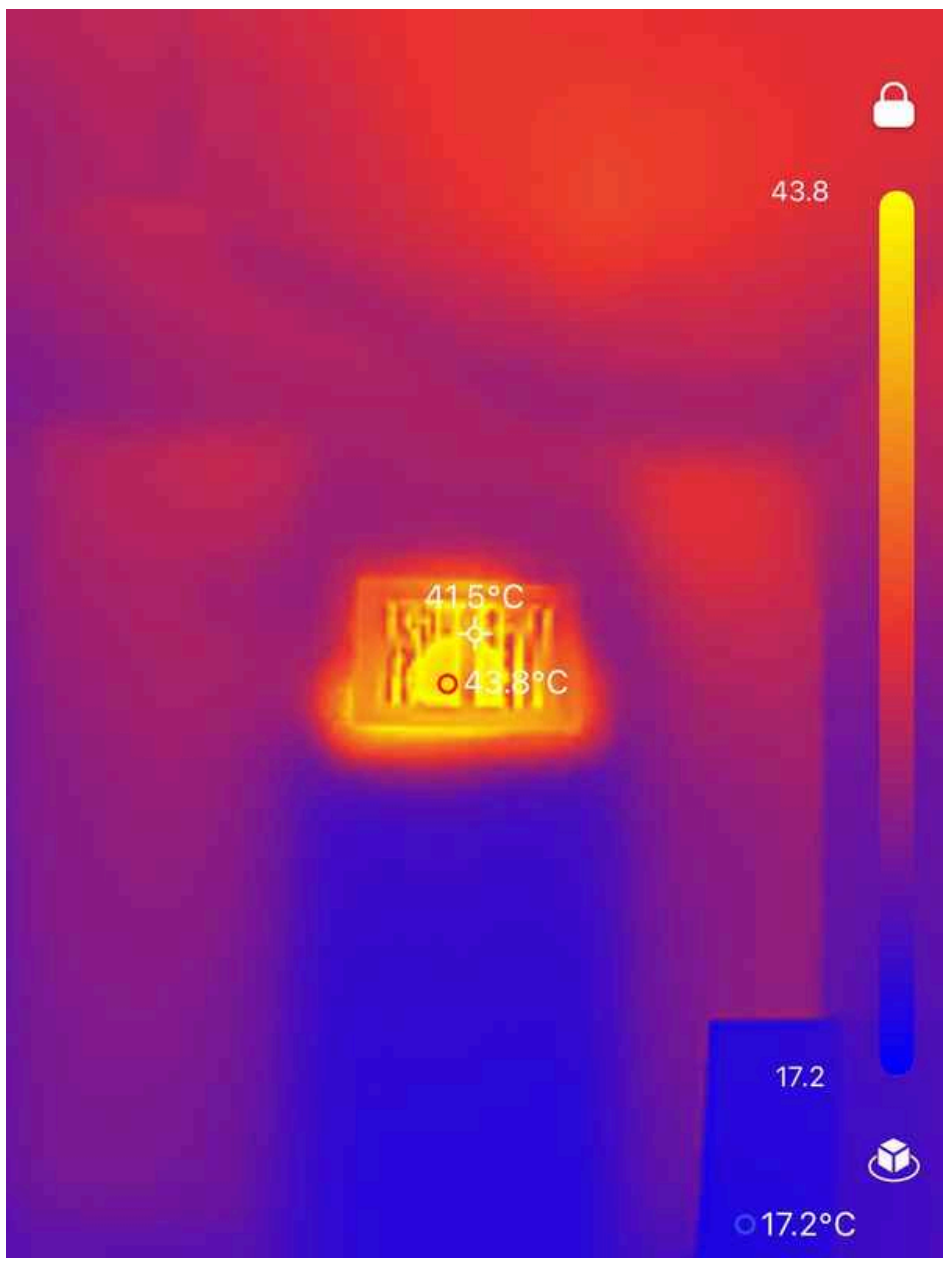
43.8
41.5°C
43.8°C
17.2
17.2°C

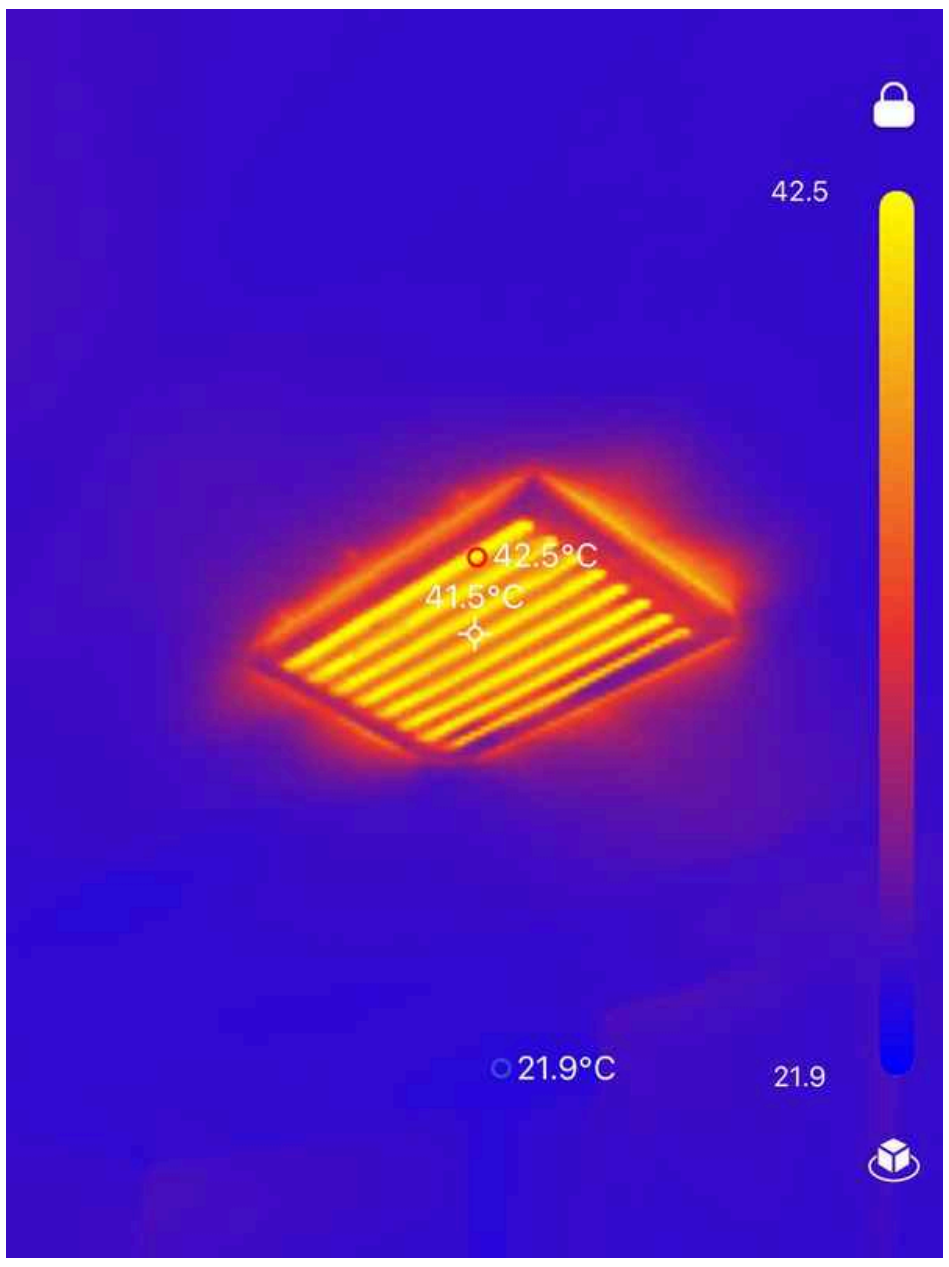
42.5
42.5°C
41.5°C
21.9°C
21.9

Equipment: **Brand**

American Standard

2nd Floor hallway

2nd Floor Hallway

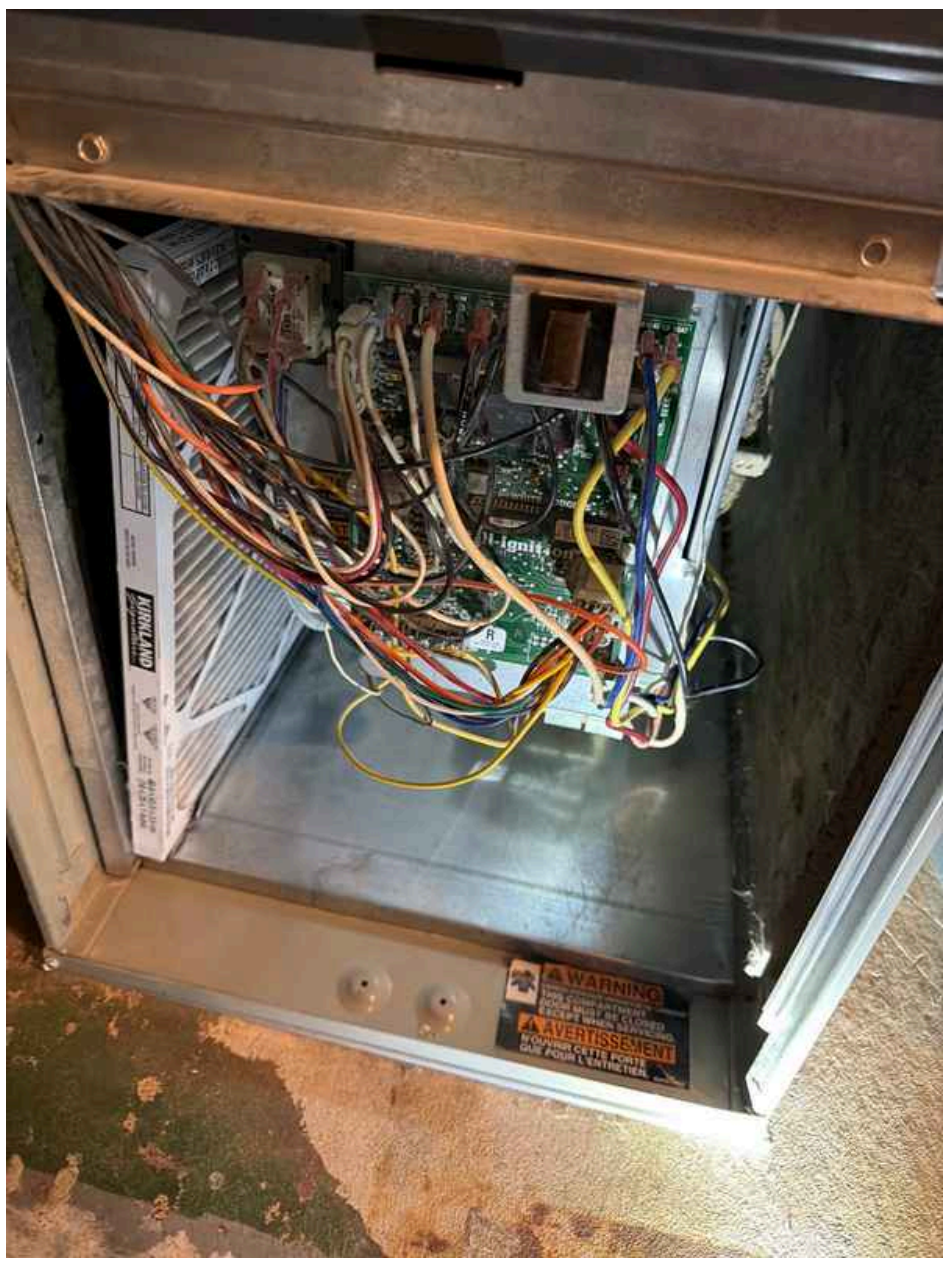

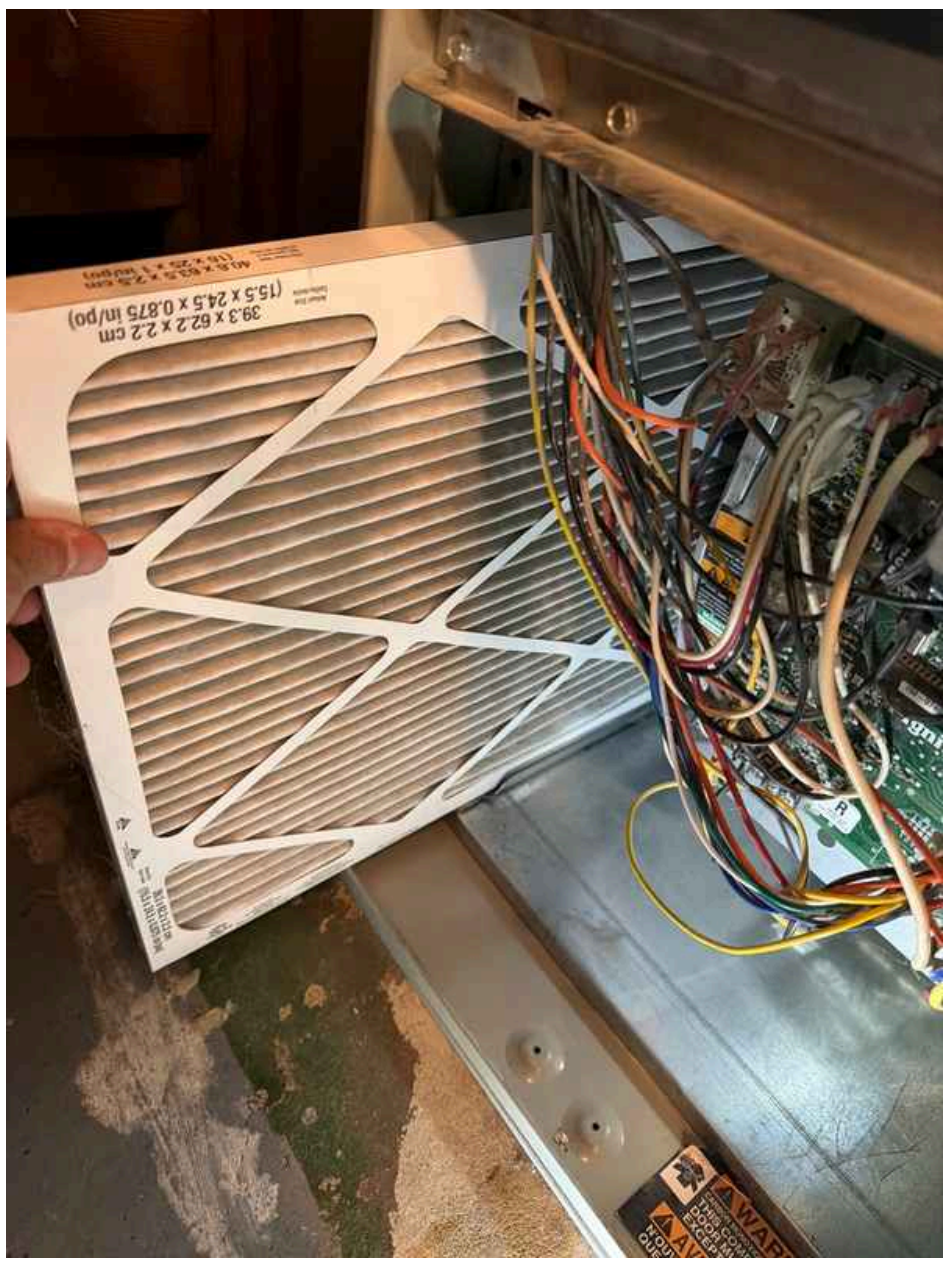

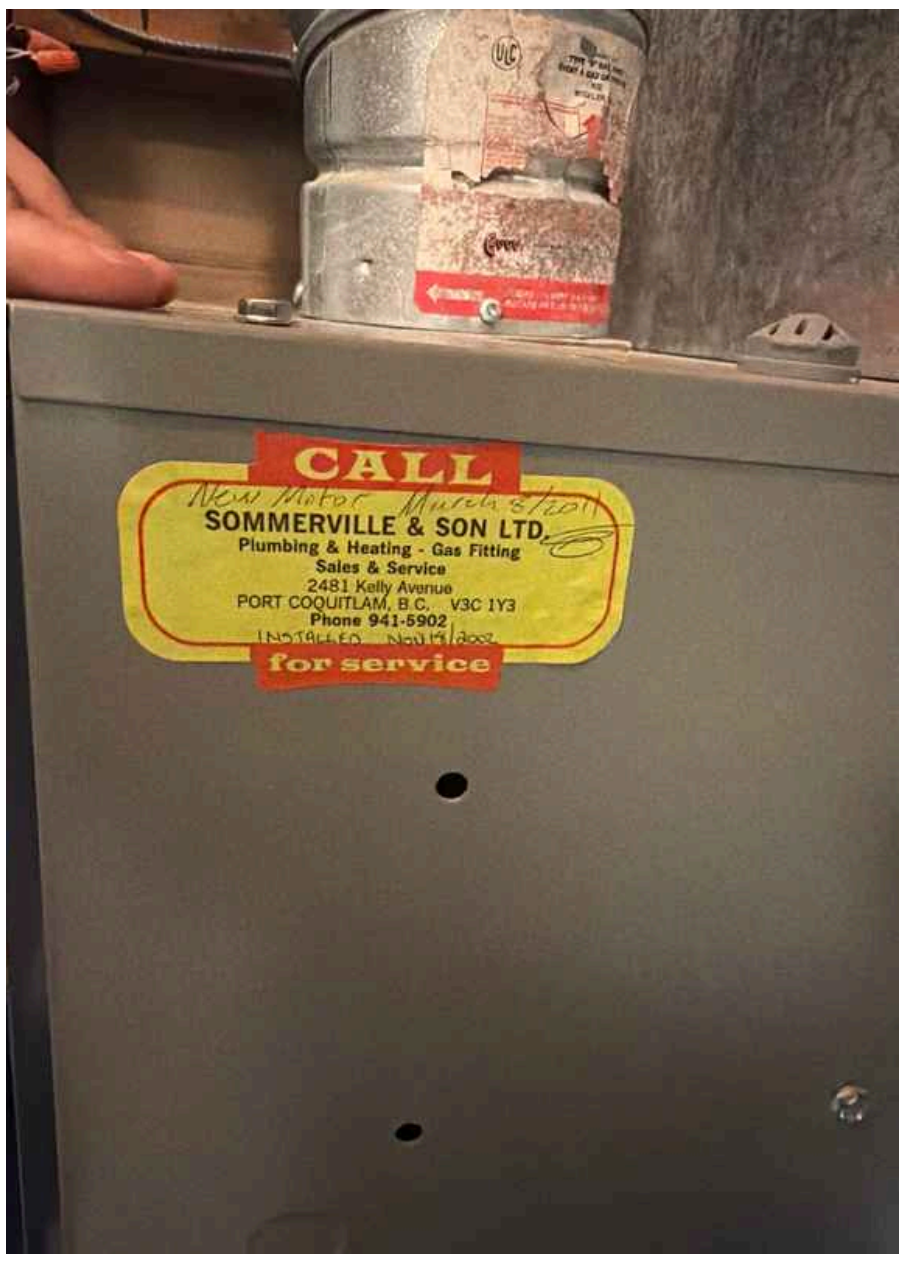

Equipment: Energy Source
Natural Gas

Equipment: Heat Type
Radiant Heat, Forced Air, Forced Air, Space Heater

Distribution Systems: Ductwork
Not visible

Presence of Installed Heat Source in Each Room: Baseboard Heaters Present
Baseboard heaters are electric heating units installed along the base of walls throughout the home. These provide supplemental or primary heat by warming air that rises naturally into the room. They are a common heating solution in many residential properties and require periodic maintenance to ensure efficient operation.

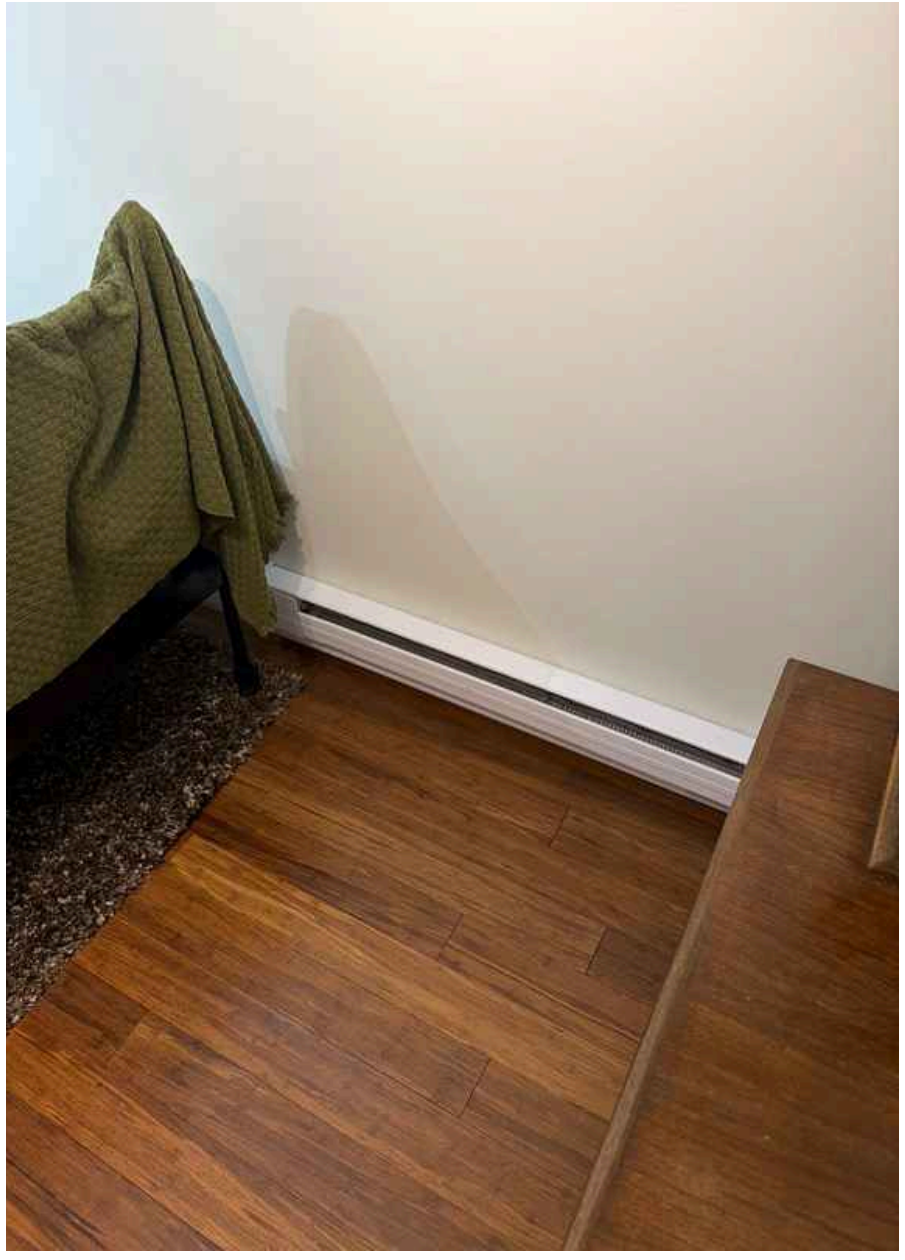

Deficiencies

5.1.1 Equipment

FURNACE MAINTENANCE REQUIRED

Maintenance Item

The furnace requires annual maintenance to ensure proper operation and efficiency. Regular maintenance includes filter replacement, combustion analysis, and system checks. Neglecting routine maintenance can lead to reduced efficiency, increased energy costs, and potential safety issues including carbon monoxide concerns. Contact a qualified HVAC professional to schedule annual furnace maintenance.

Recommendation

Contact a qualified professional.

5.1.2 Equipment

MAKE-UP AIR HEATING UNIT NOT FULLY TESTED

Maintenance Item

The make-up air heating unit could not be fully tested during inspection because the indoor temperature was elevated and the thermostat showed no call for heat. Performance of the heating function could not be confirmed under normal operating conditions. Have an HVAC contractor verify operation when conditions require heat activation or perform a manual system check.

Recommendation

Contact a qualified professional.


finish
NETTOYAGE
AVANCÉE

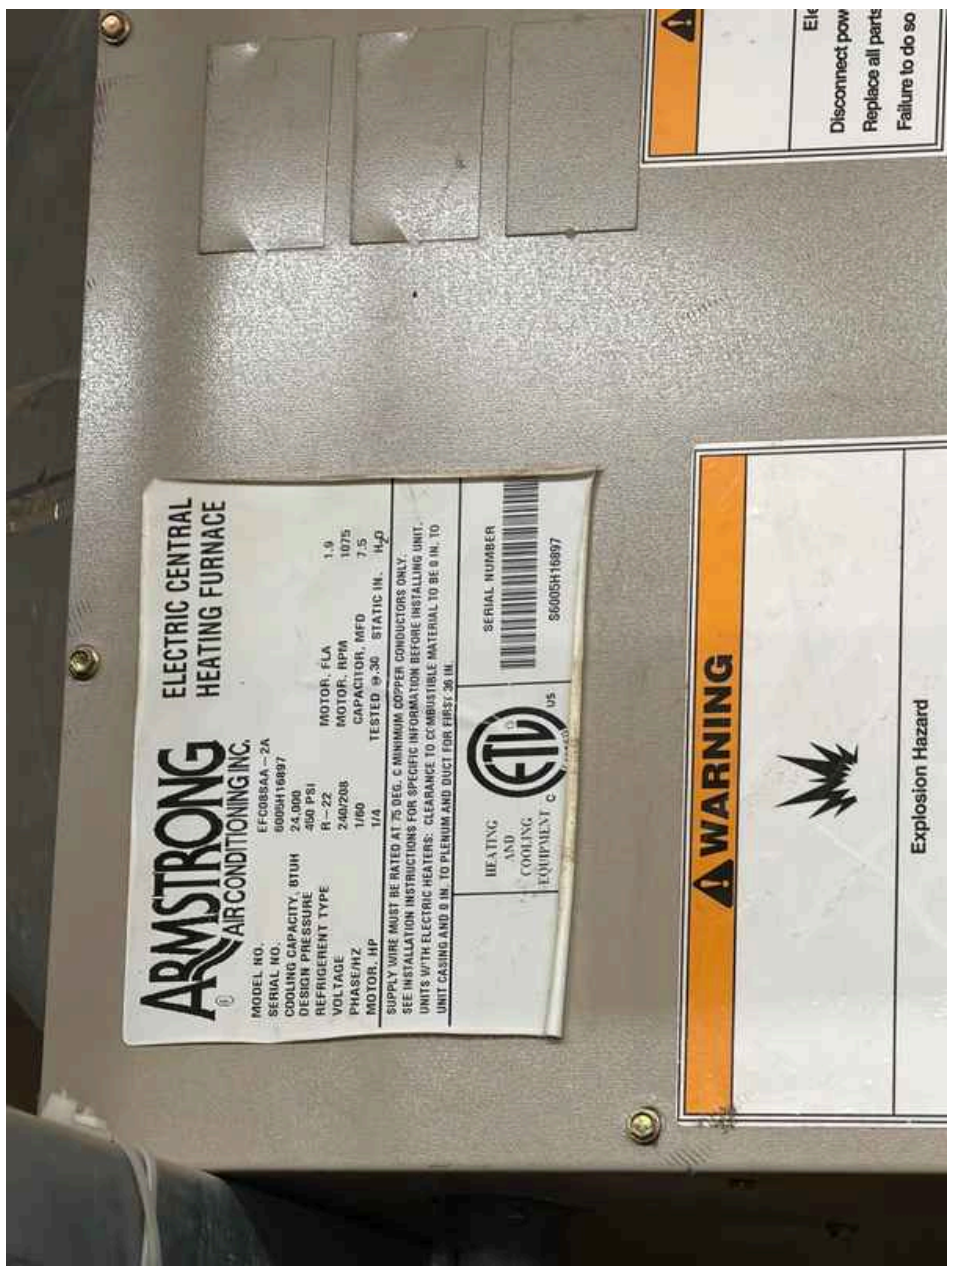
ARMSTRONG
AIR CONDITIONING INC.
ELECTRIC CENTRAL
HEATING FURNACE
WARNING
Explosion Hazard

6: PLUMBING

Information

Filters
Unknown

Water Source
Public

Plumbing Fixtures Photographed

Photographs were taken of all plumbing fixtures including sinks, faucets, toilets, showers, and tubs during the inspection. This documentation provides a visual record of the condition and operation of these fixtures for reference and future assessment.

2nd Floor kitchen start




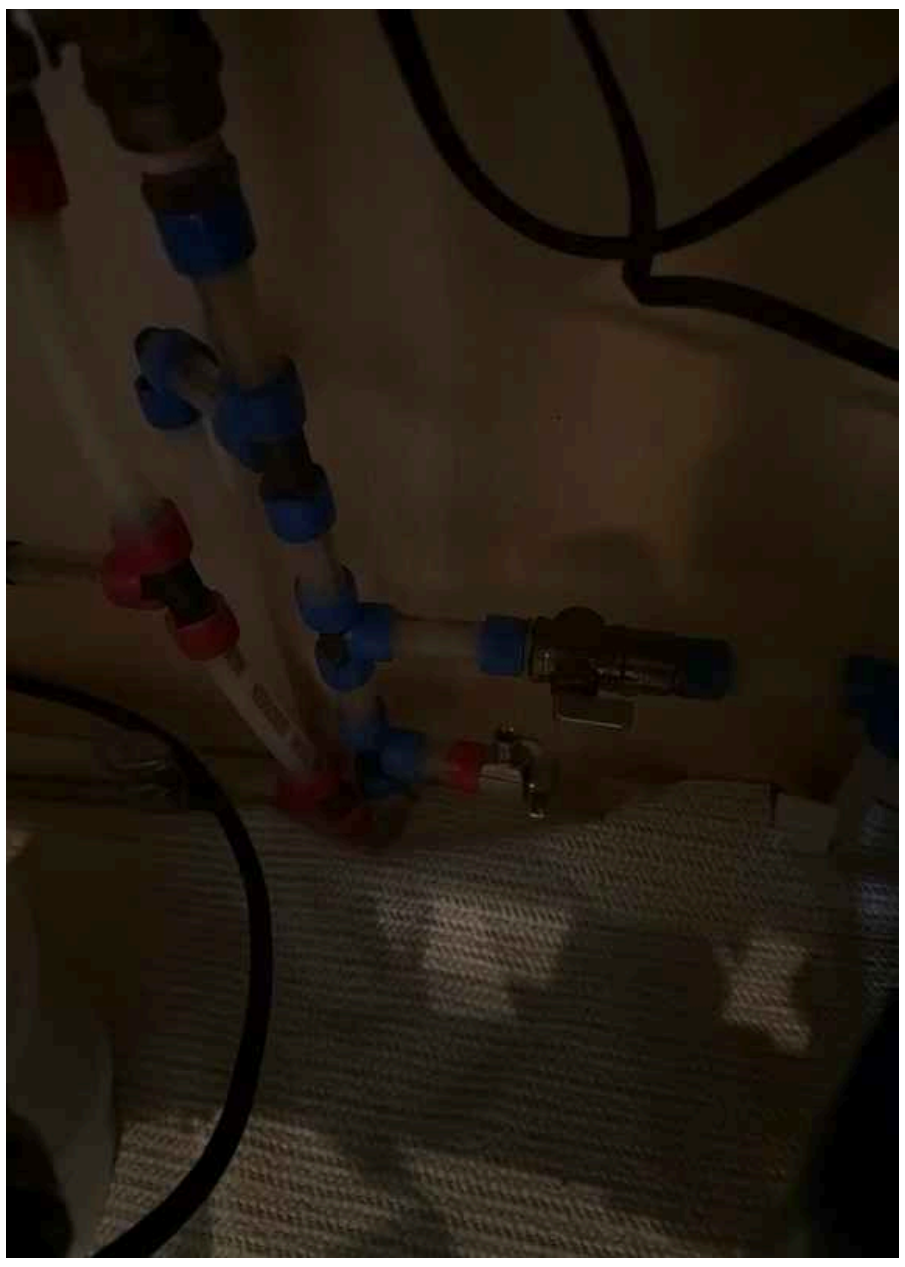
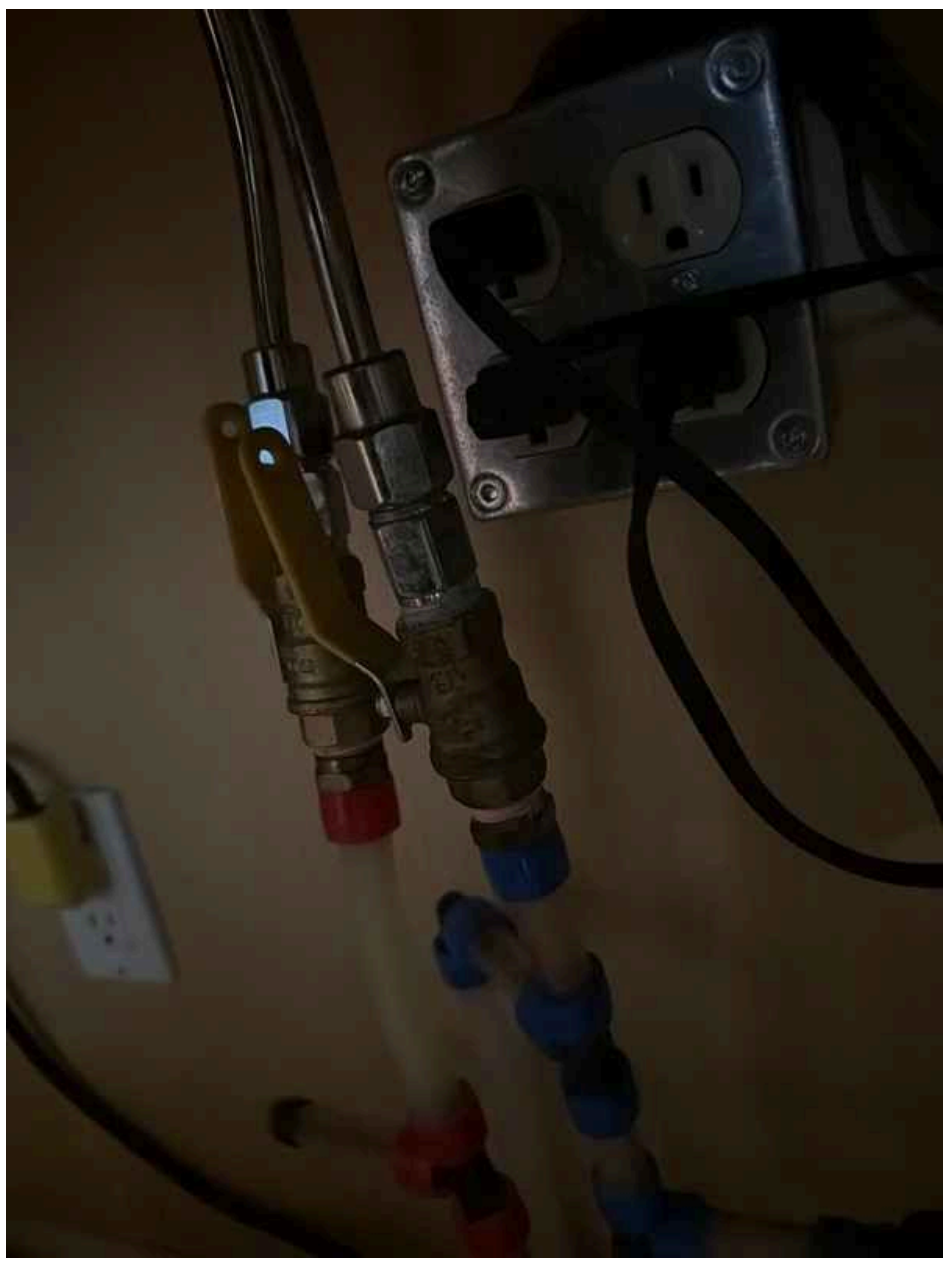
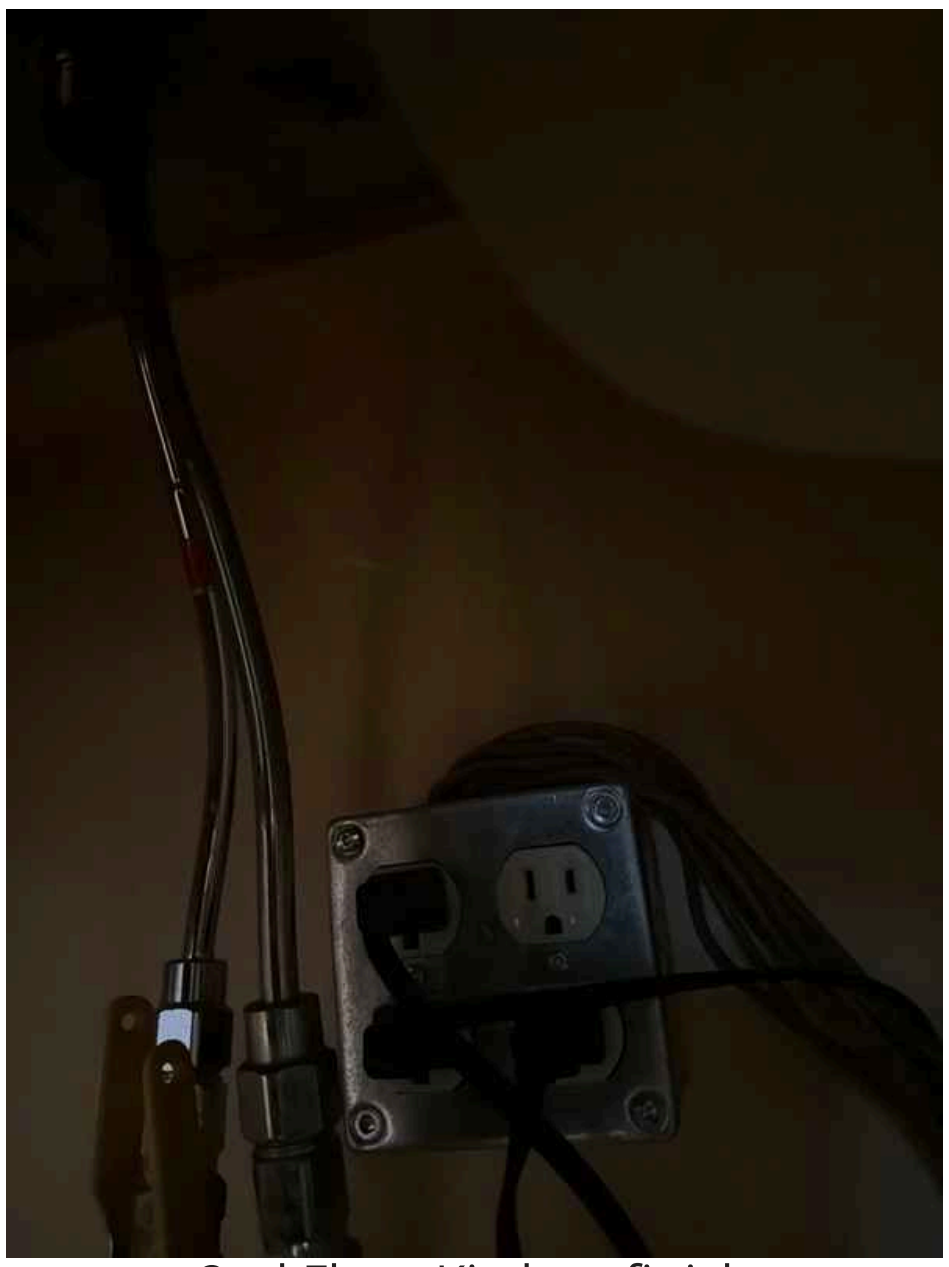

2nd Floor Kitchen finish

2nd Floor small bathroom start







2nd Floor small bathroom finish

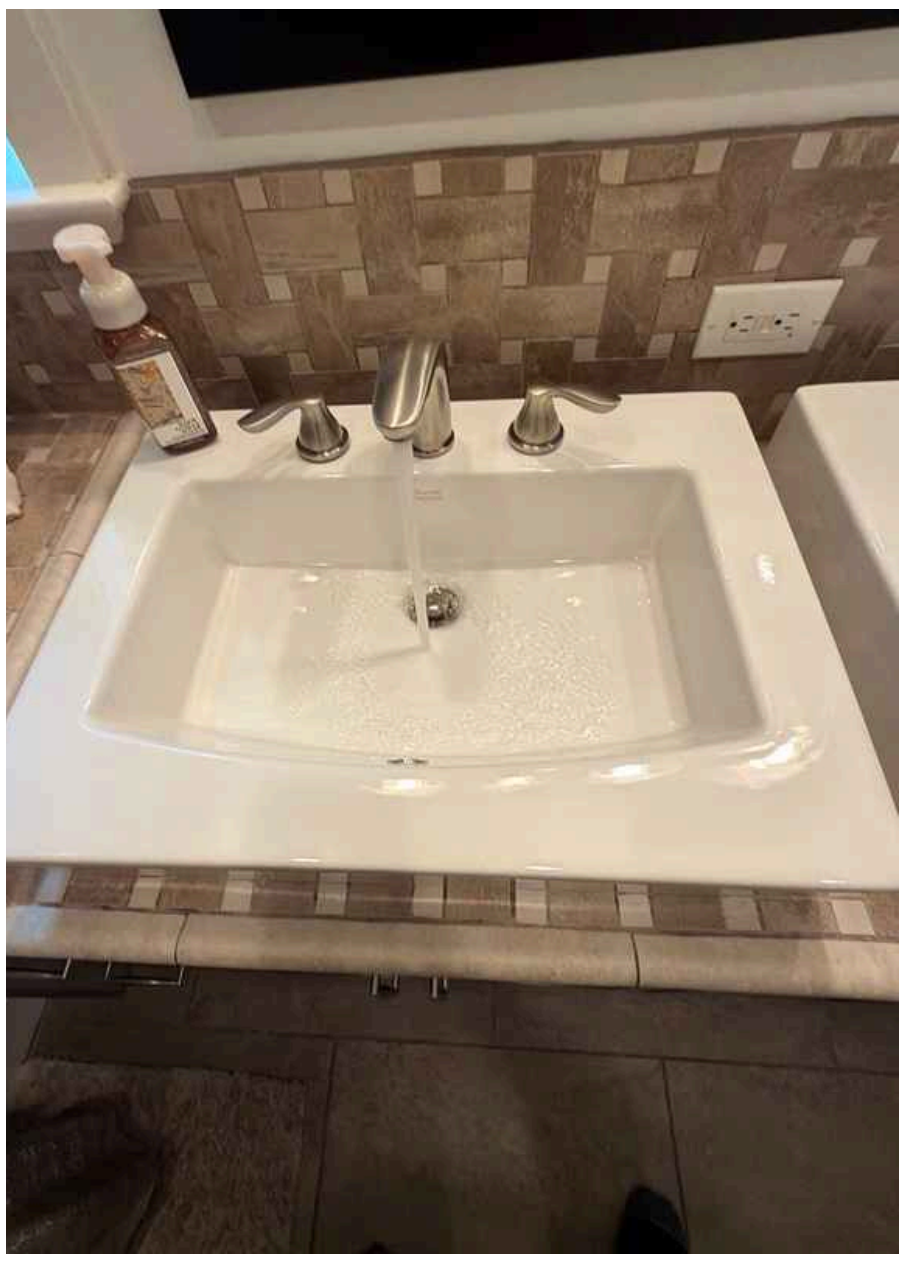
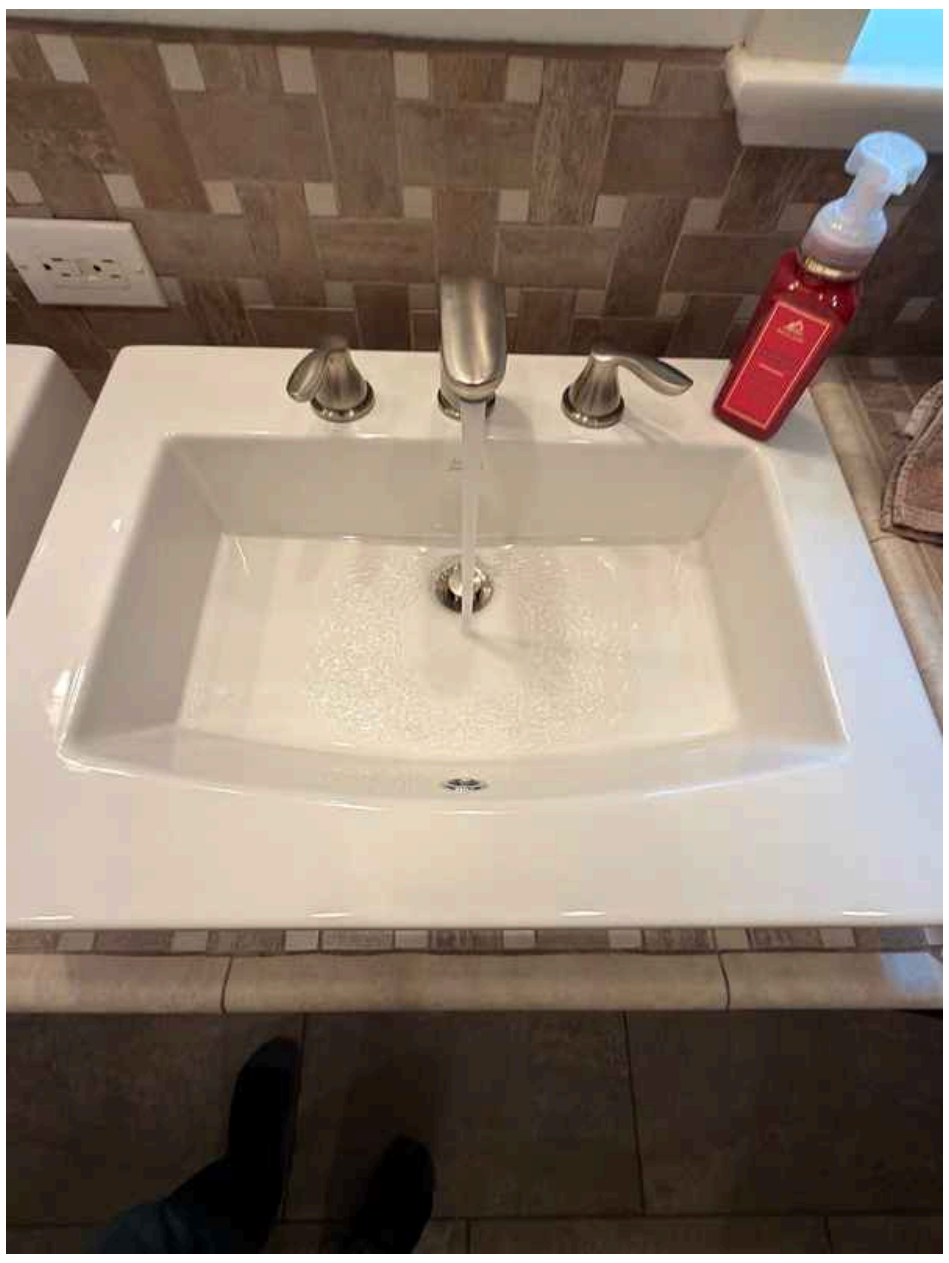


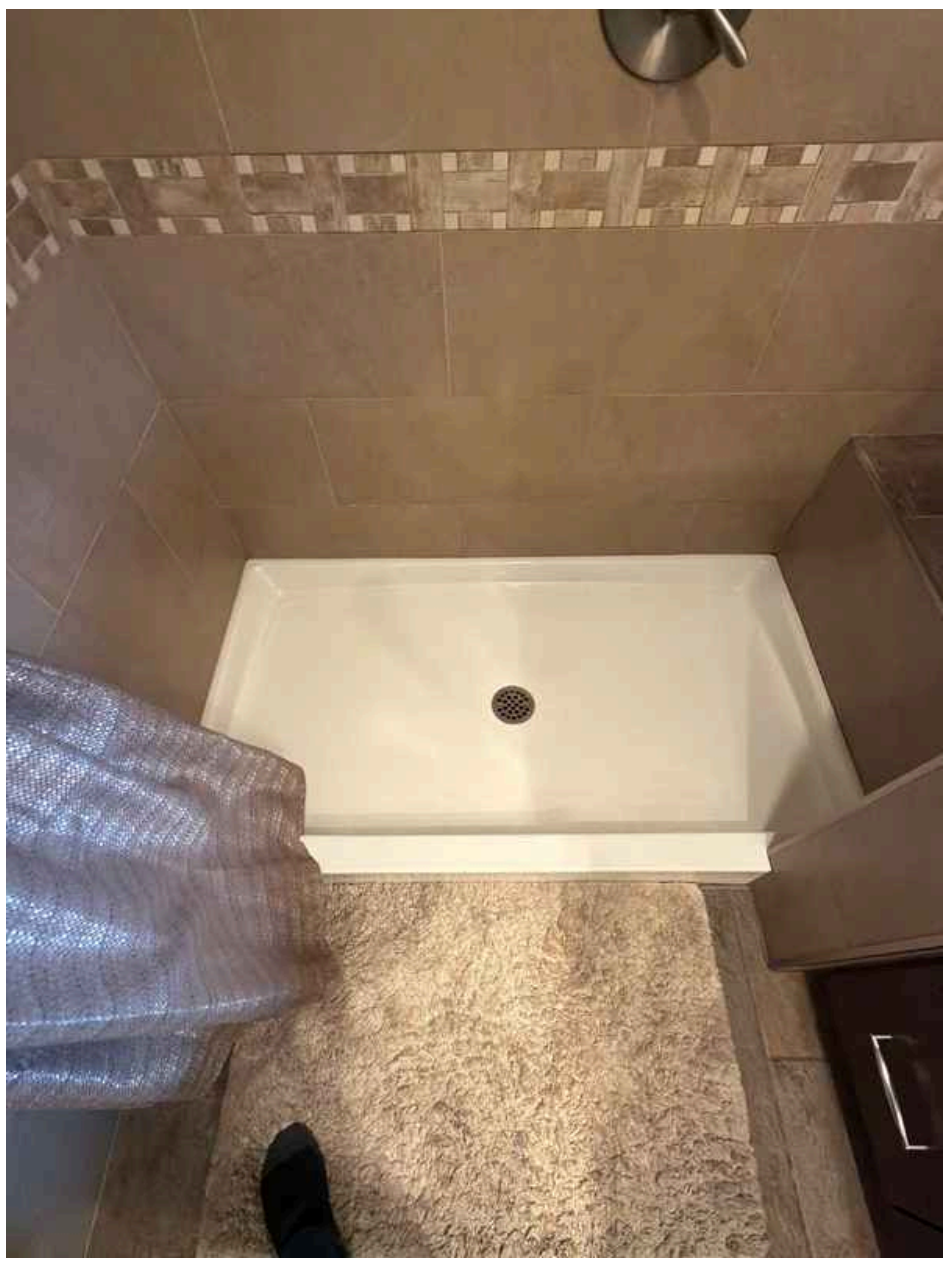

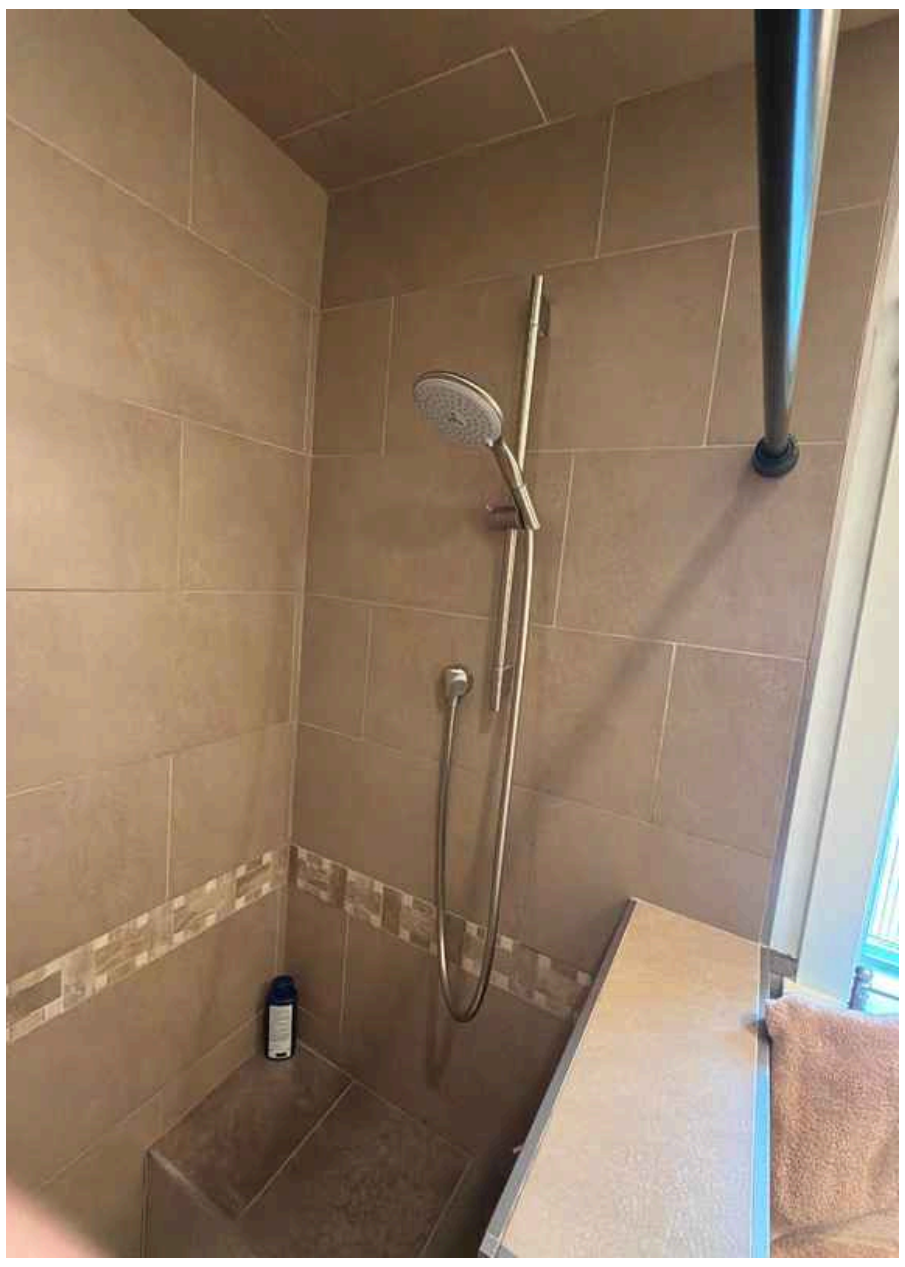

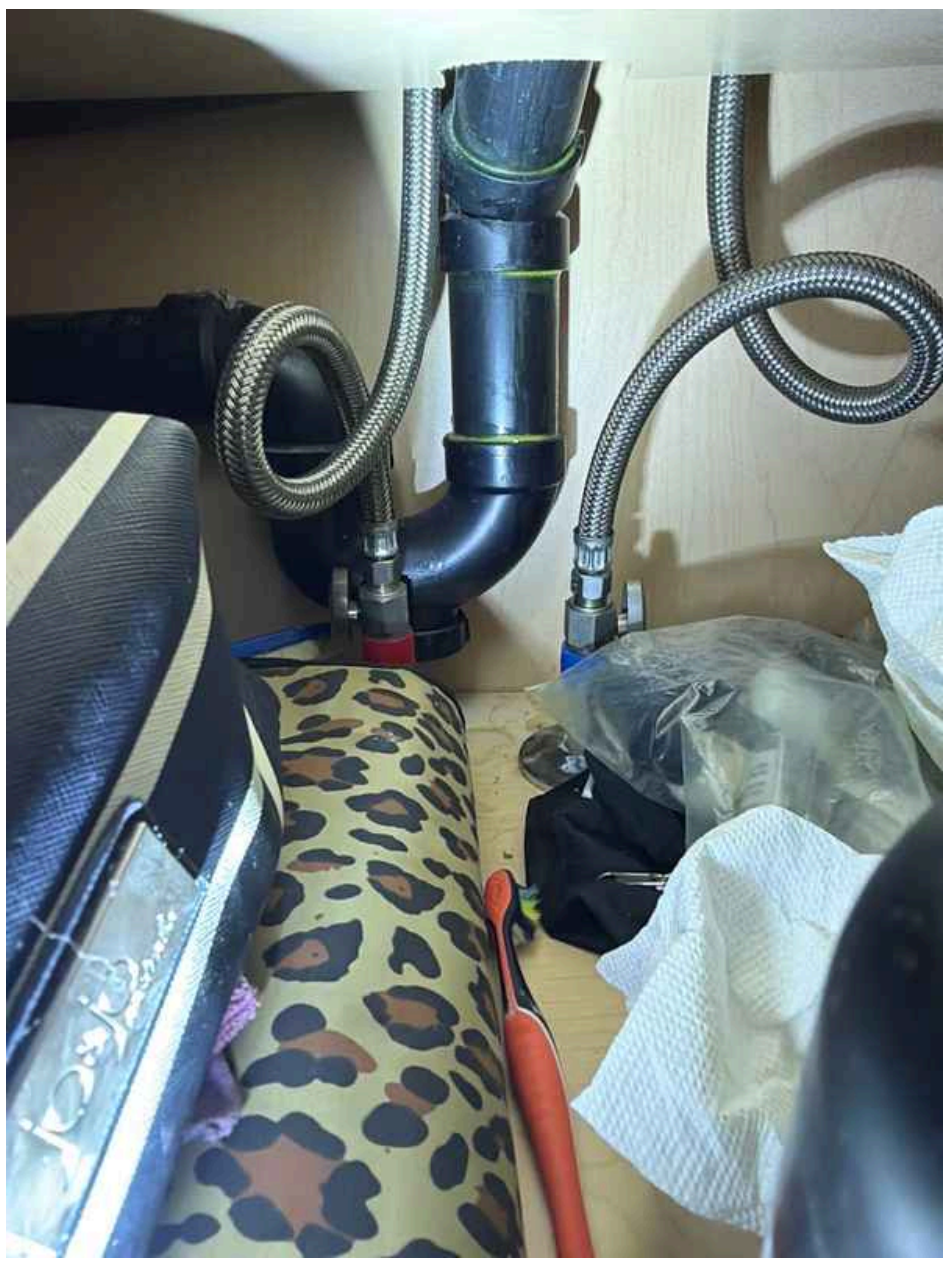


SHOWER

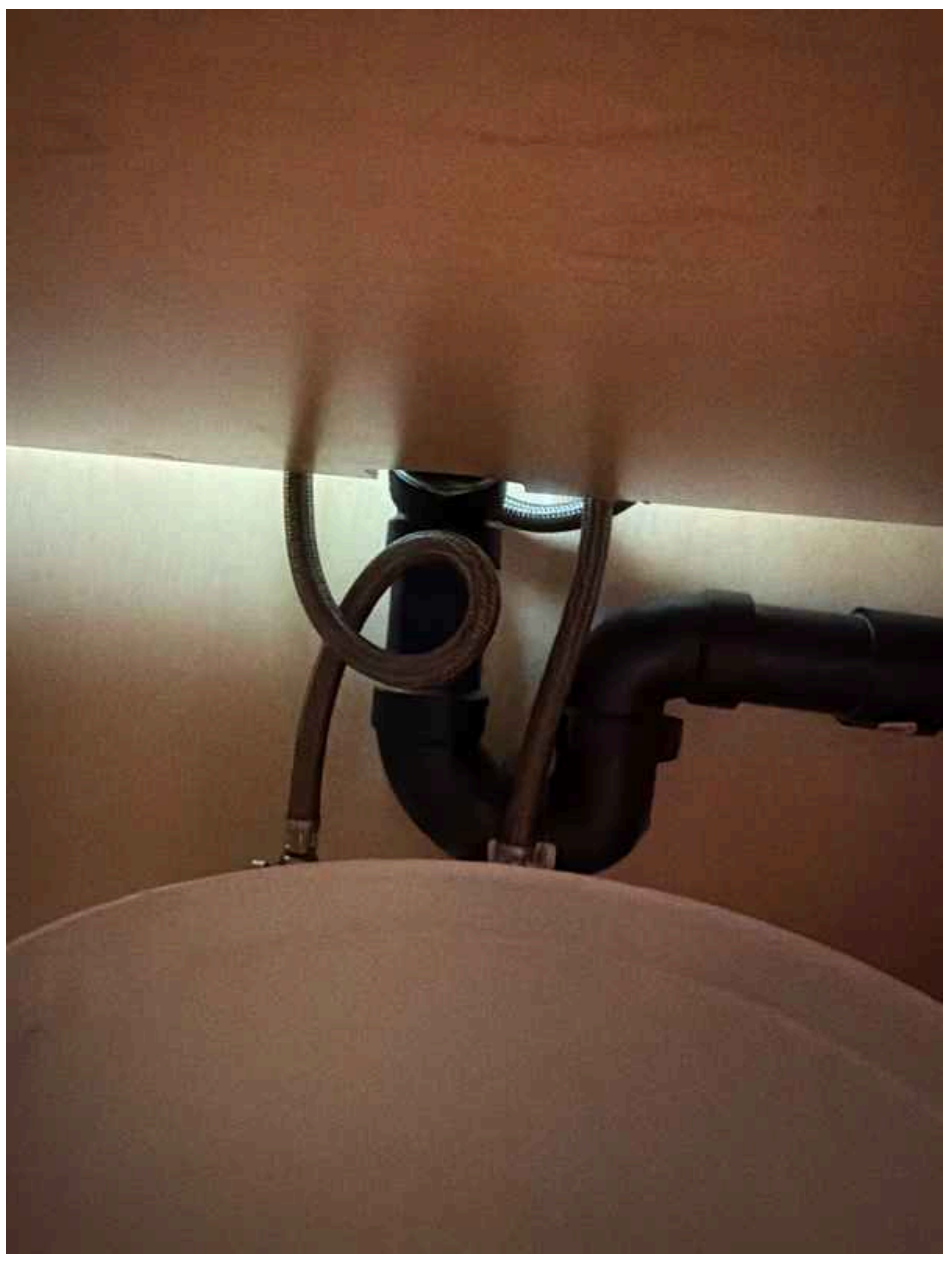


FAST
ORANGE
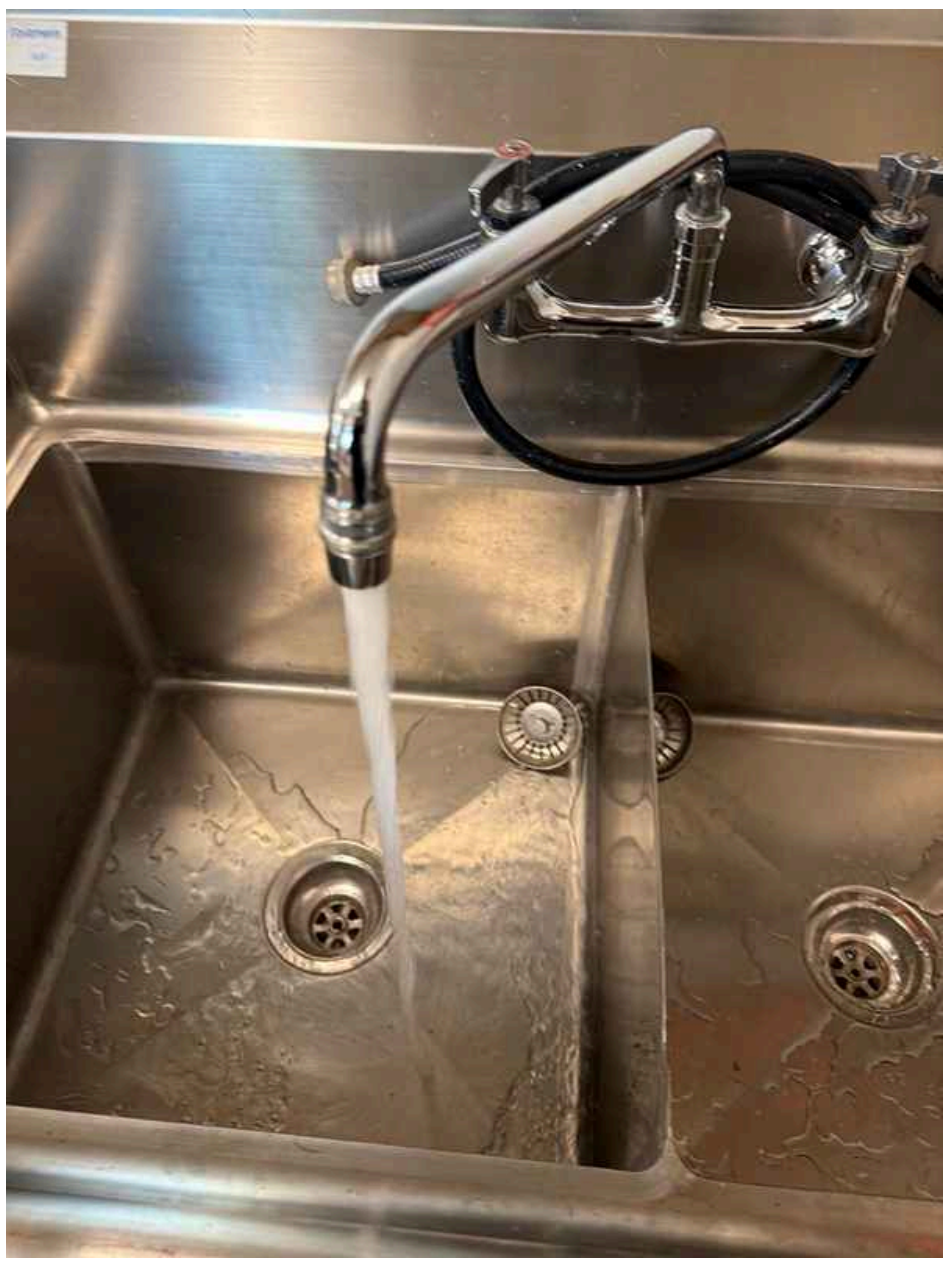

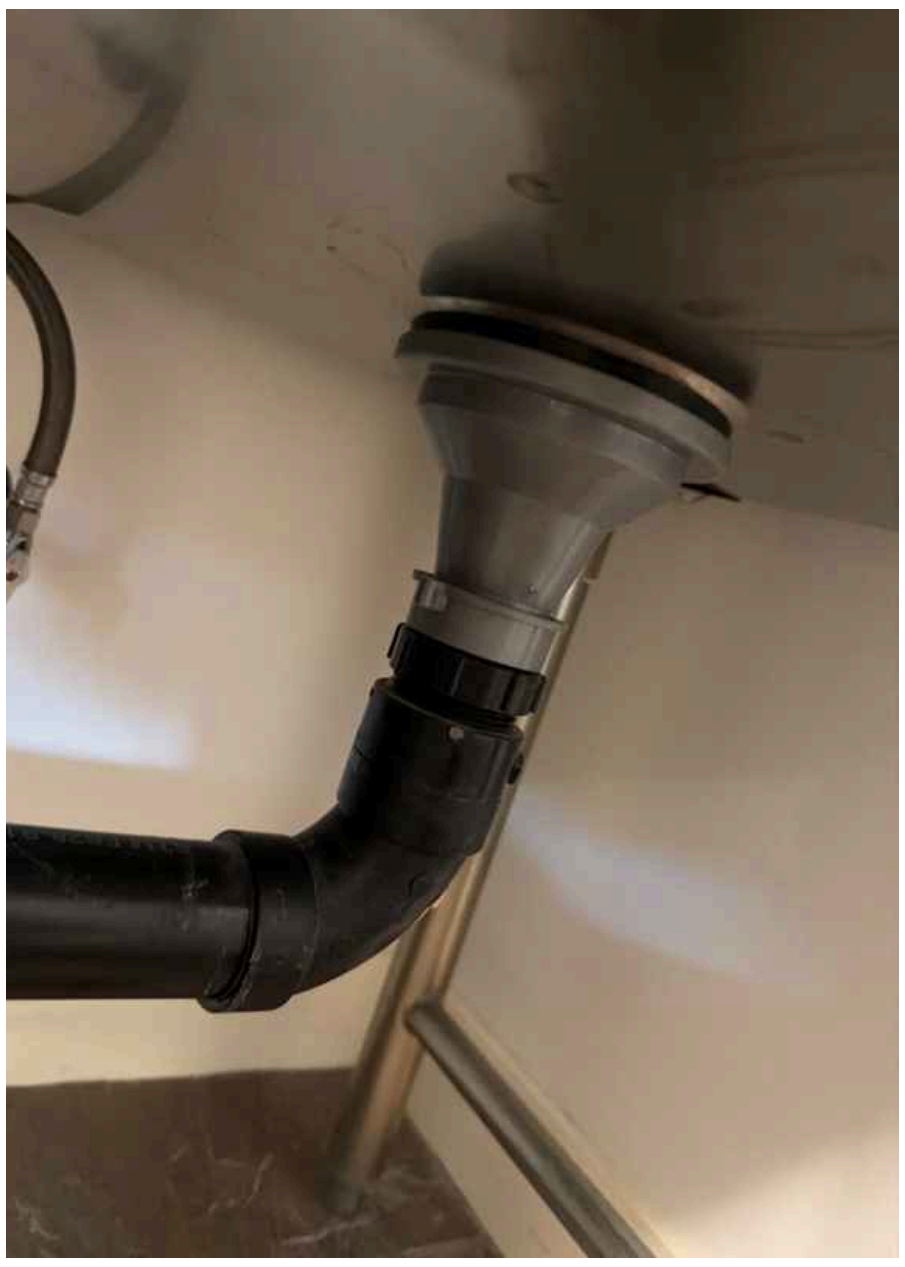
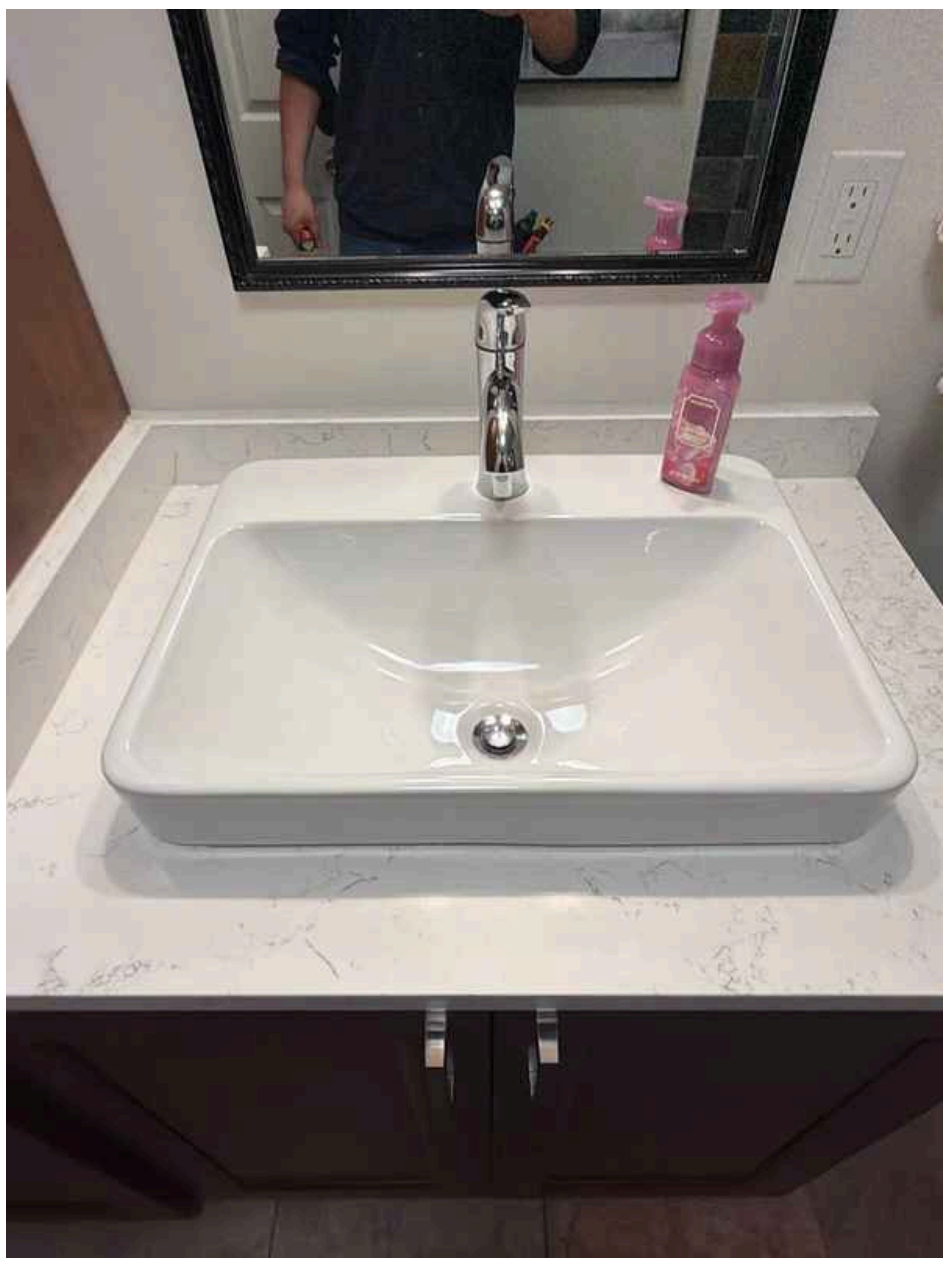



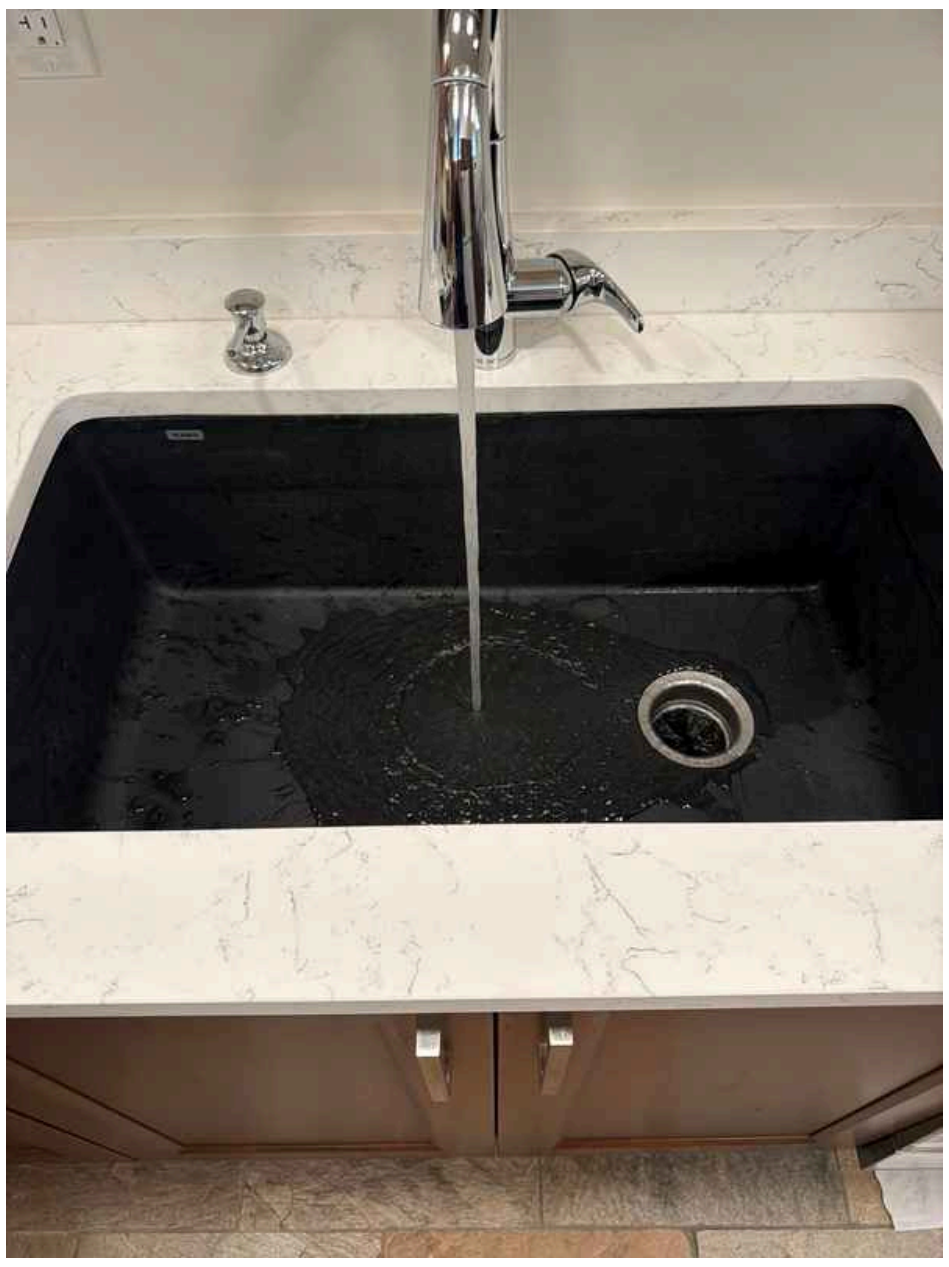


badger
1

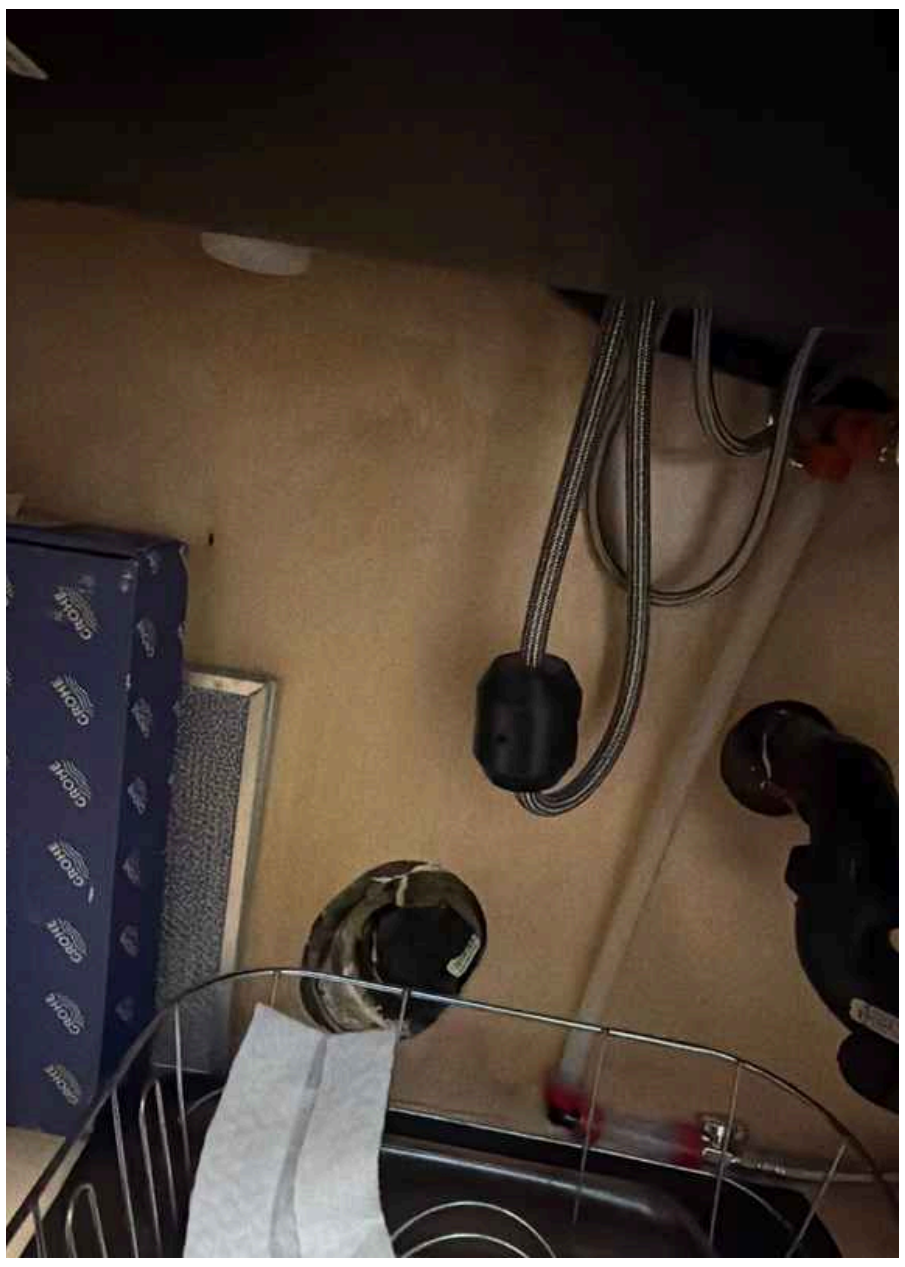

Main Water Shut-off Device: **Location**

Laundry room


Drain, Waste, & Vent Systems: **Drain Size**

1 1/2"

Drain, Waste, & Vent Systems: **Material**

ABS

Drain, Waste, & Vent Systems: **Sump Pit**

A sump pit is a below-grade collection basin designed to gather groundwater and surface water that accumulates around a home's foundation. Water in the pit is typically pumped out by a sump pump to direct it away from the structure, helping prevent basement flooding and water damage. The pit's condition, pump functionality, and drainage effectiveness are important factors in managing moisture control around the foundation.

Water Supply, Distribution Systems & Fixtures: **Distribution Material**

Pex

Water Supply, Distribution Systems & Fixtures: **Water Supply Material**

Pex

Hot Water Systems, Controls, Flues & Vents: Capacity

50 gallons

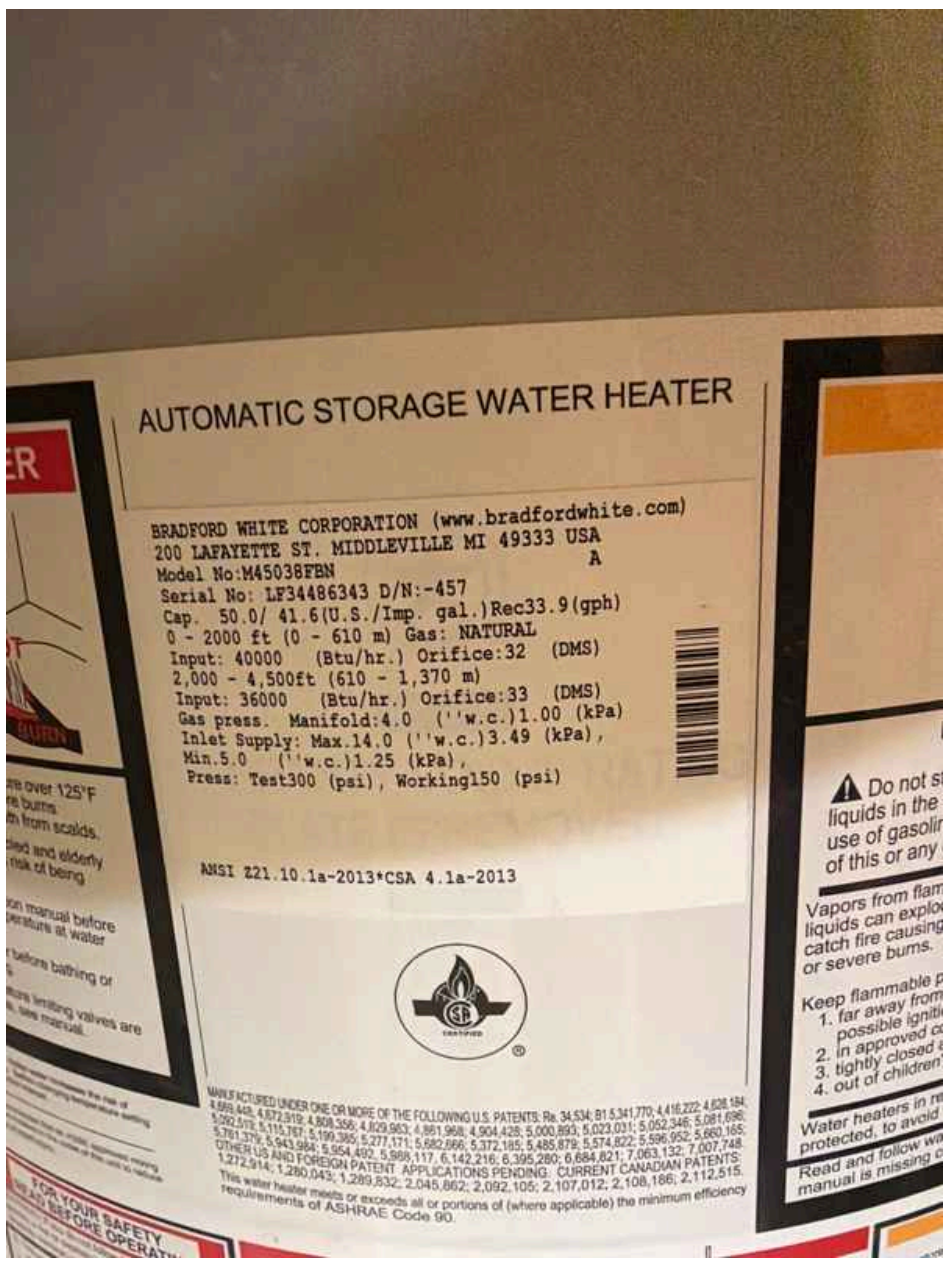

Hot Water Systems, Controls, Flues & Vents: Location

Utility Room

Hot Water Systems, Controls, Flues & Vents: Manufacturer

Bradford & White

I recommend flushing & servicing your water heater tank annually for optimal performance. Water temperature should be set to at least 120 degrees F to kill microbes and no higher than 130 degrees F to prevent scalding.

Here is a nice maintenance guide from Lowe's to help.

Hot Water Systems, Controls, Flues & Vents: Power Source/Type

Gas

Fuel Storage & Distribution Systems: Main Gas Shut-off Location

Gas Meter

Limitations

Fuel Storage & Distribution Systems

GAS BBQ LINE NOT TESTED

The gas supply line for the BBQ was not connected during the inspection, preventing testing of the fuel distribution system. This limitation means the condition and functionality of the gas line connection cannot be verified at this time. Recommend having the line connected and inspected by a qualified professional before use.

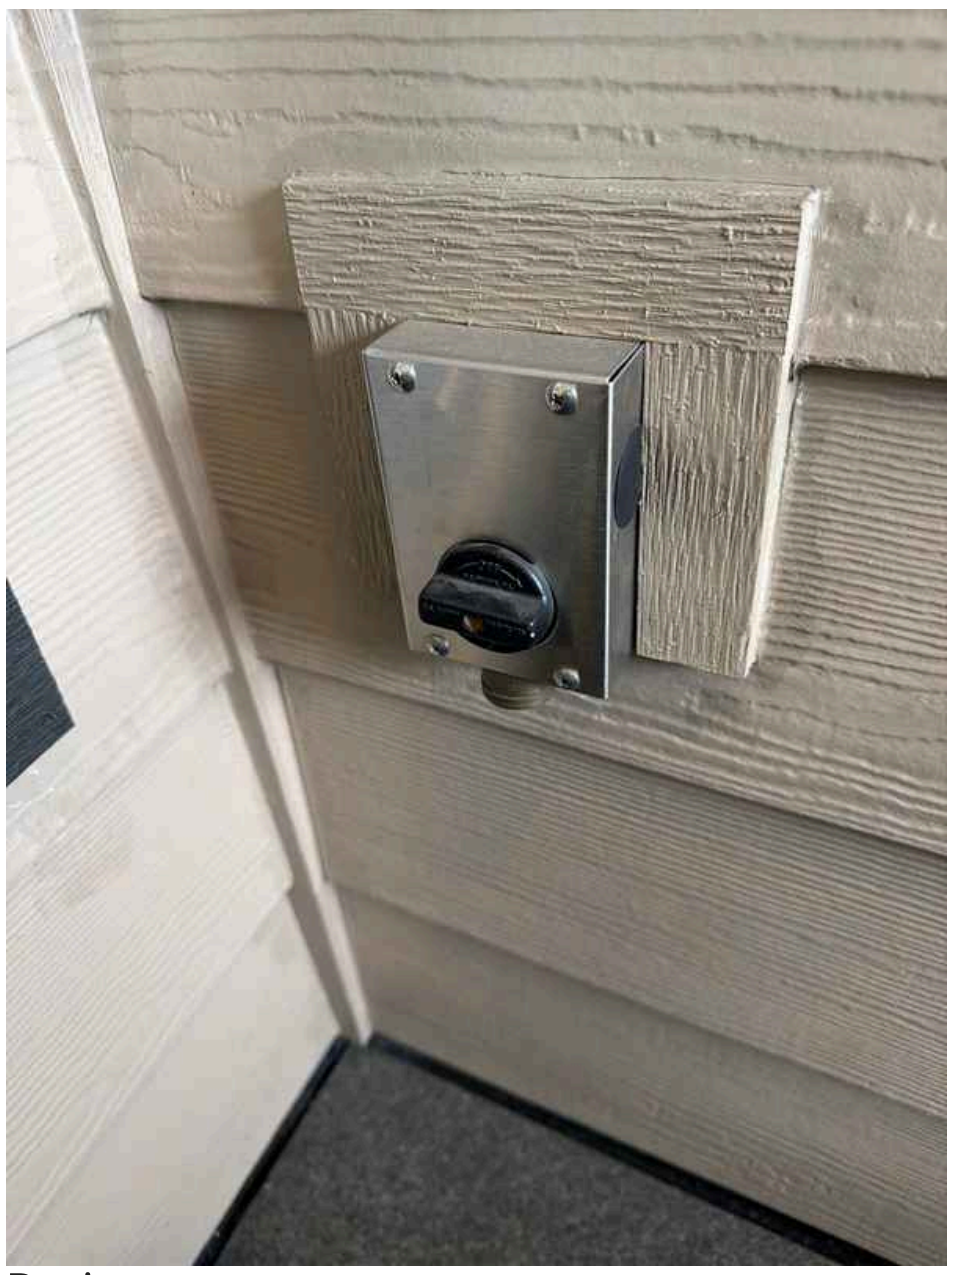

Patio

Deficiencies

6.4.1 Hot Water Systems, Controls, Flues & Vents

Recommendation

WATER HEATER AT END OF LIFE EXPECTANCY

The water heater has reached or exceeded its typical life expectancy. Water heaters generally last 8-12 years depending on usage, water quality, and maintenance. As systems age, efficiency declines, repair costs increase, and failure risk rises significantly. Plan for professional evaluation and potential replacement to avoid unexpected breakdowns and maintain reliable hot water supply.

Recommendation

Contact a qualified professional.

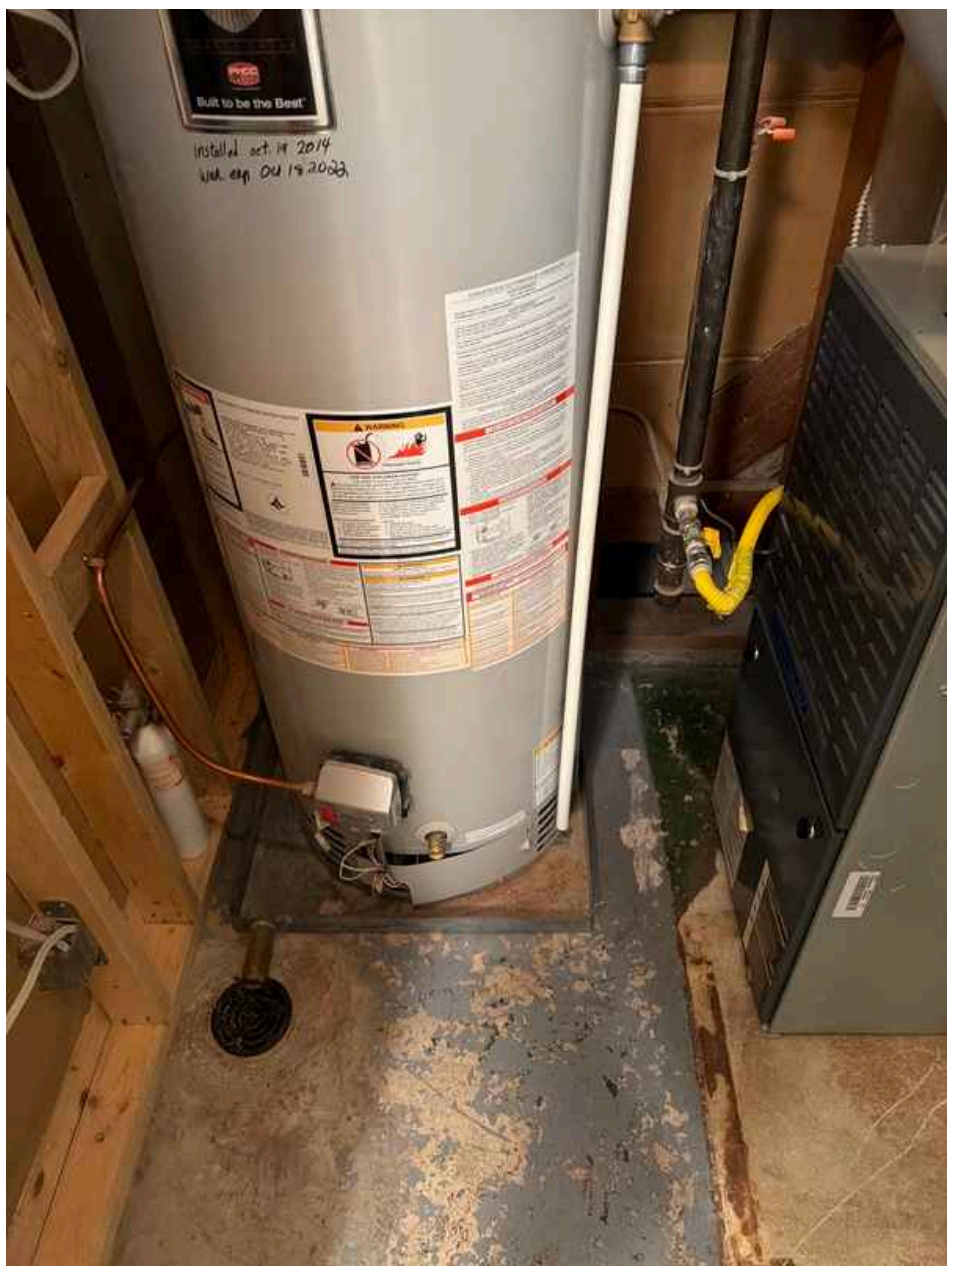

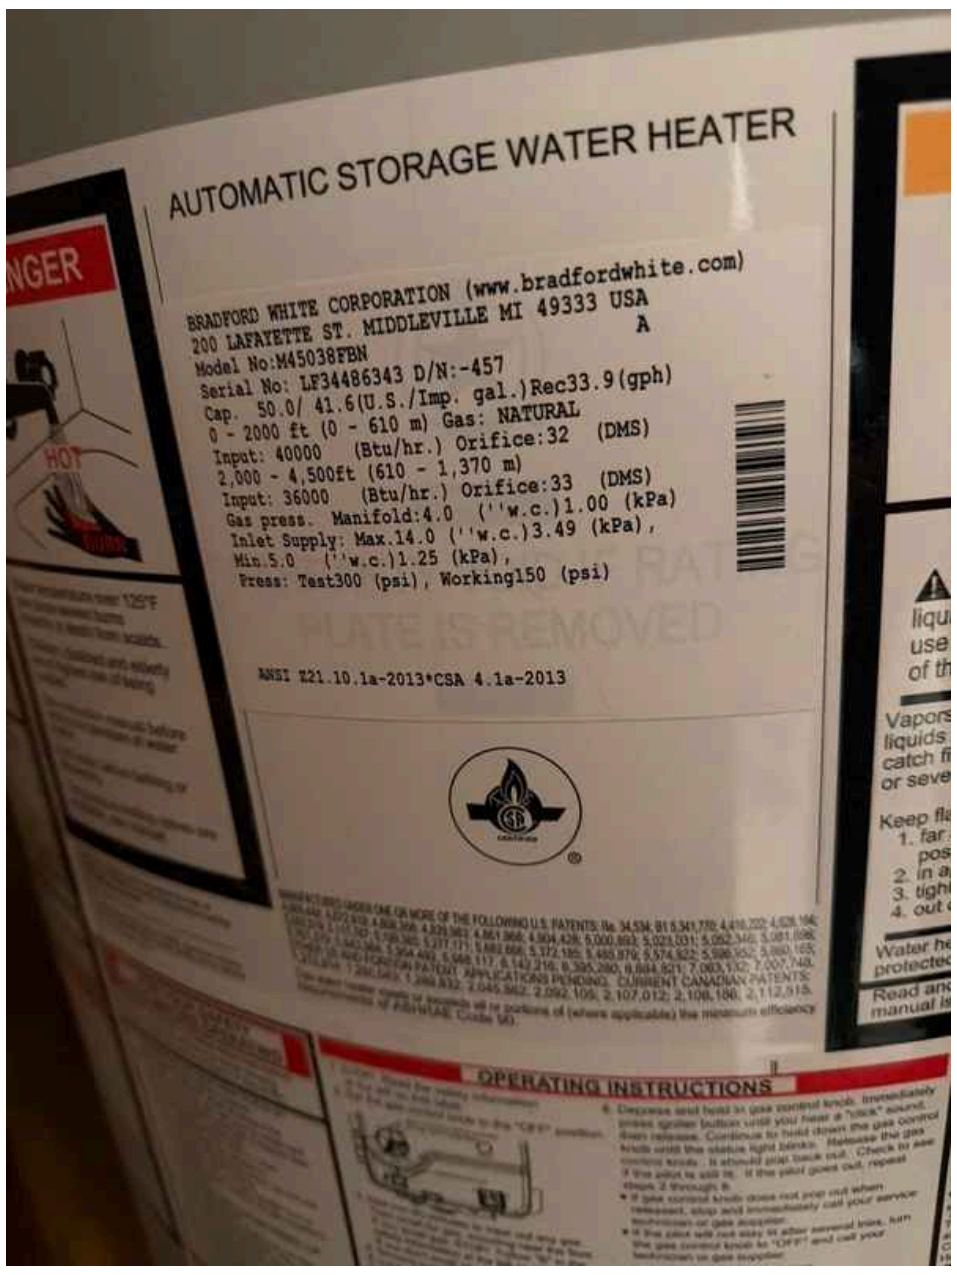

6.6.1 Sinks, faucets, toilets, bathtubs, showers

Maintenance Item

CAULKING AND SILICONE MAINTENANCE NEEDED

Caulking and silicone sealants around sinks, faucets, bathtubs, and showers require attention. These seals prevent water infiltration behind fixtures and into wall cavities. Deteriorated or missing caulk allows moisture to penetrate, potentially causing water damage, mold growth, and structural issues. Recaulk all gaps and joints around fixtures with appropriate waterproof caulk or silicone sealant.

Recommendation

Contact a qualified professional.

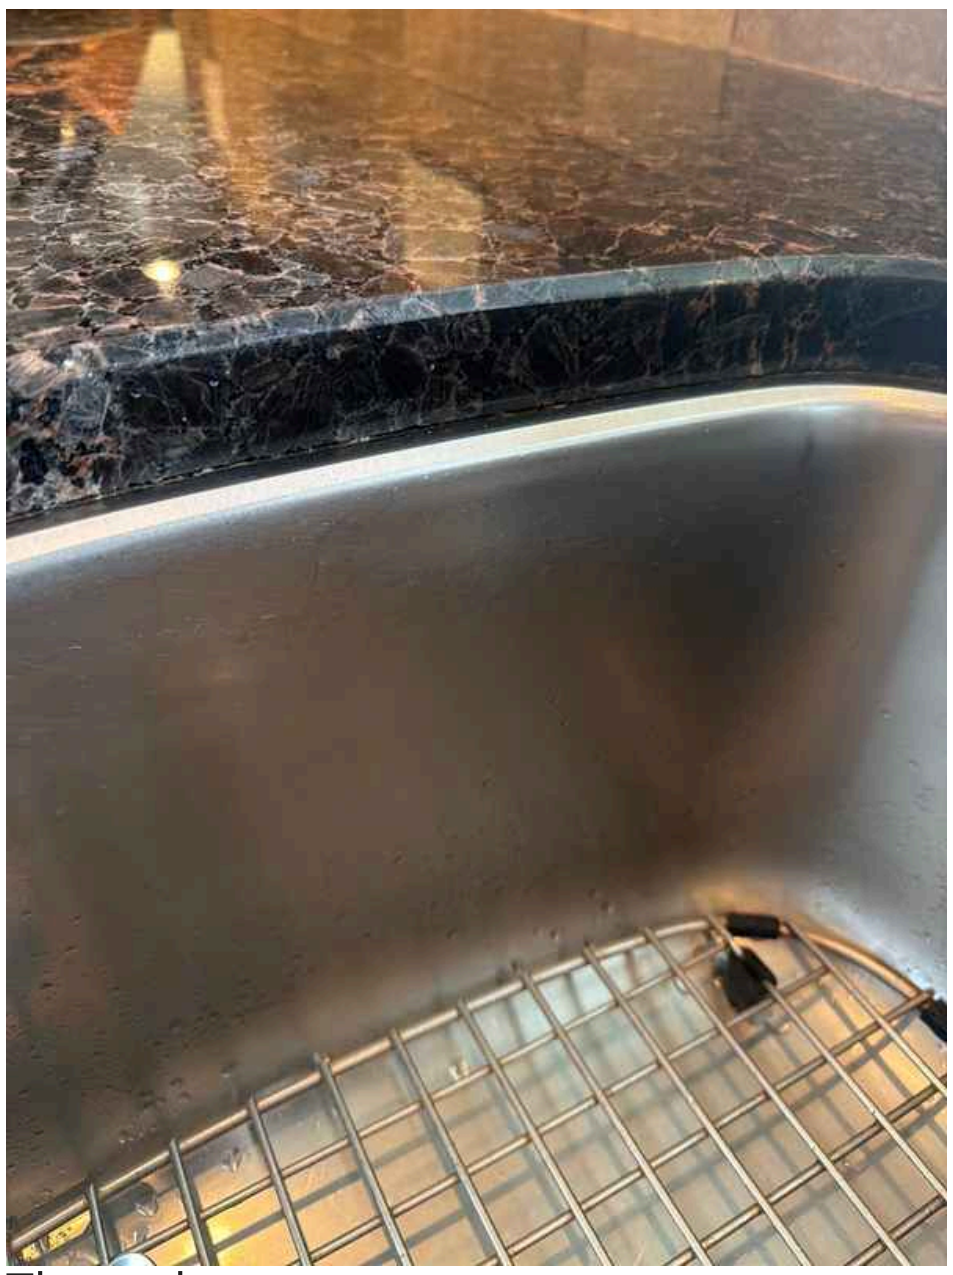
Throughout

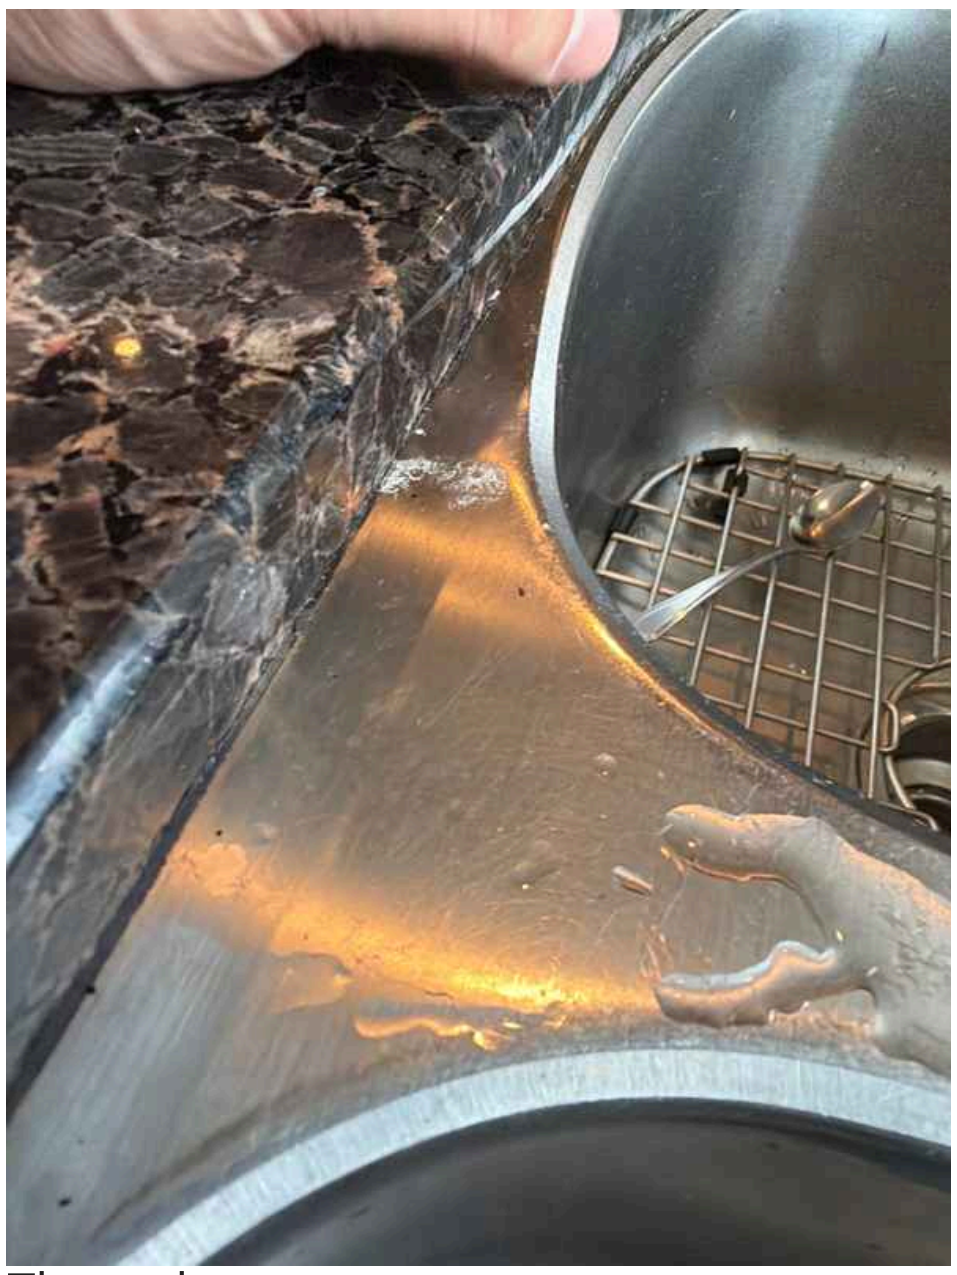
Throughout

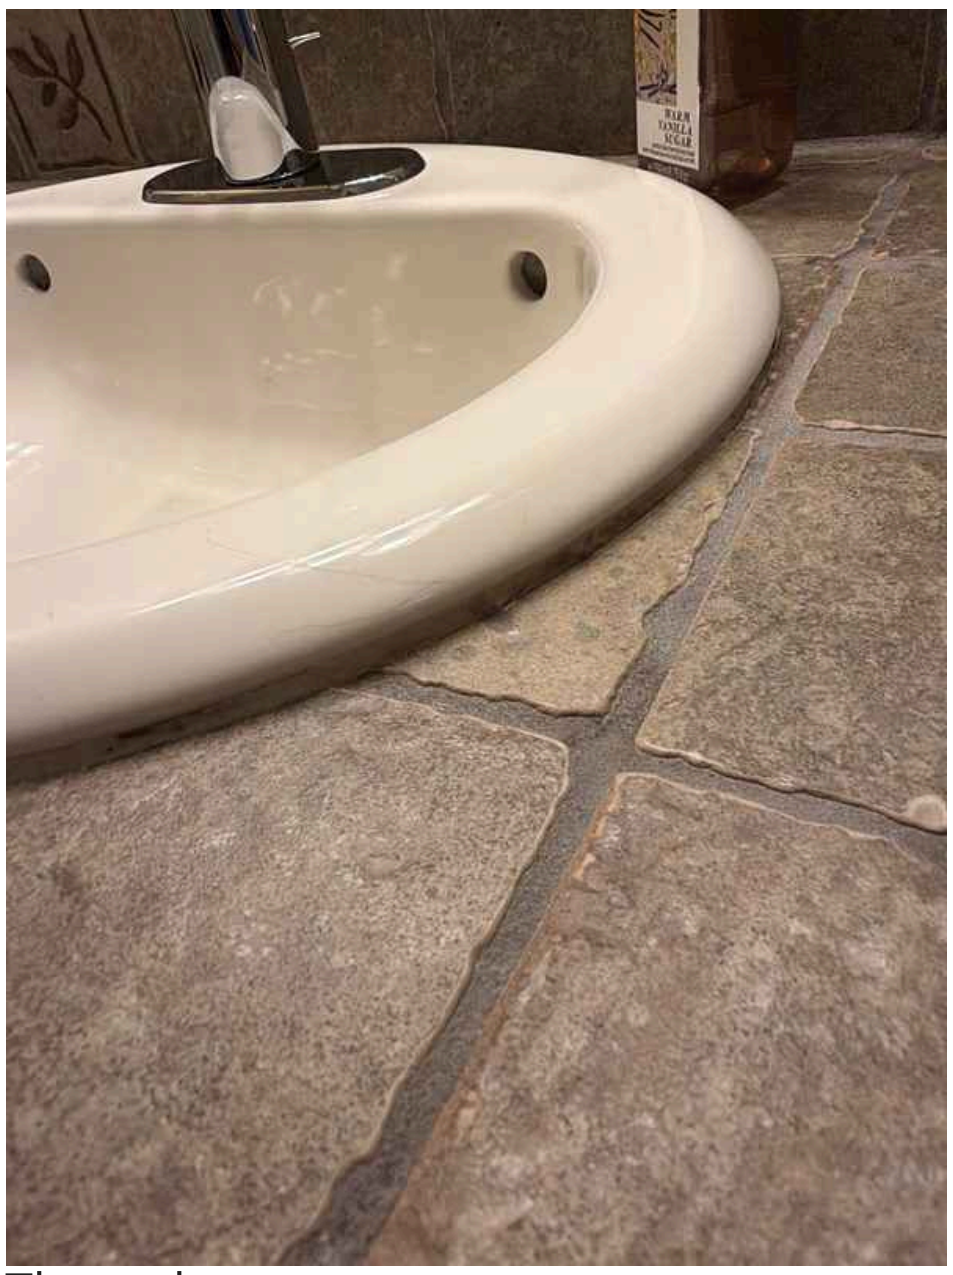
Throughout

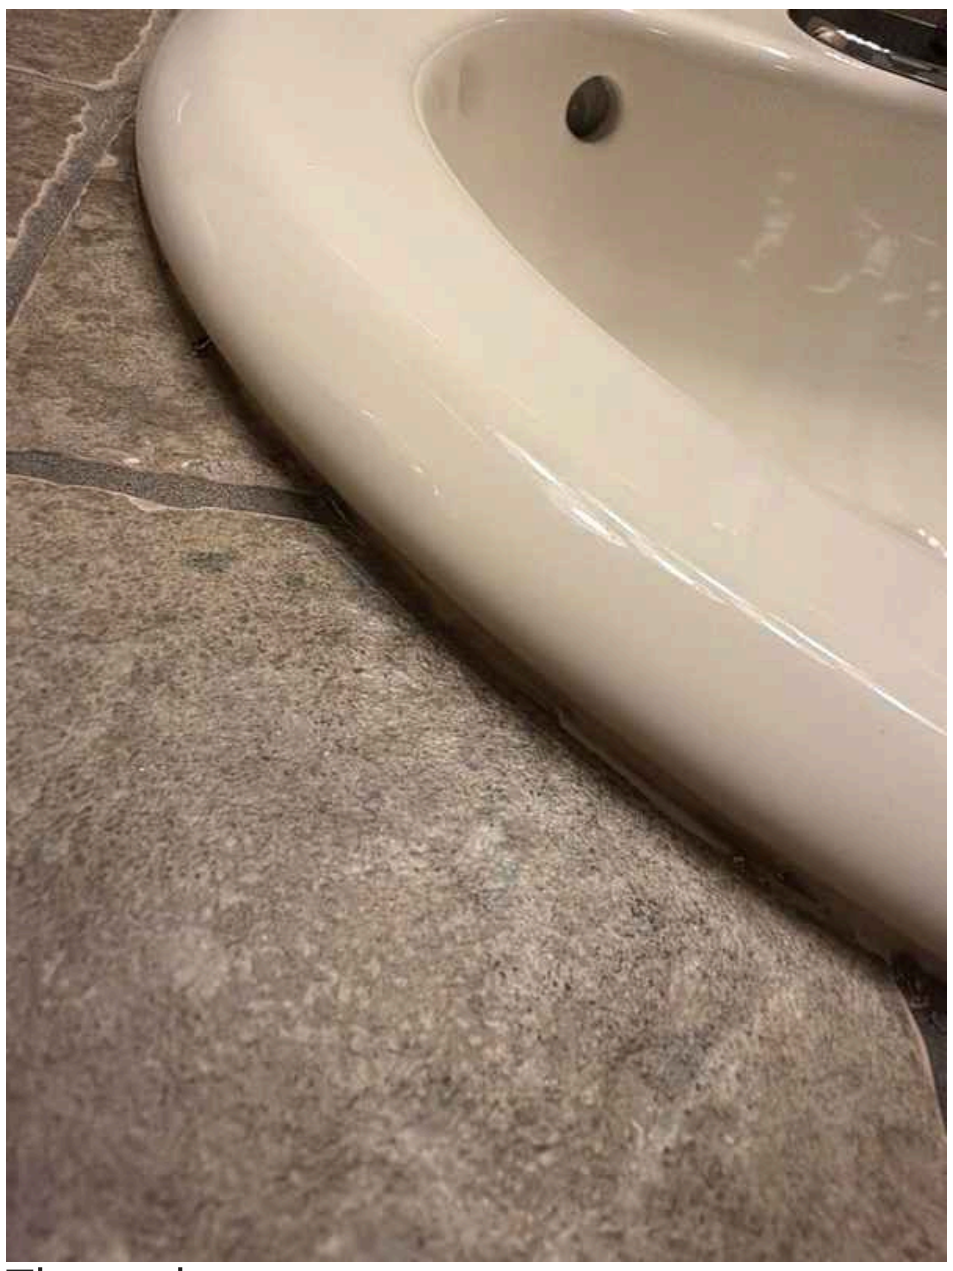
Throughout

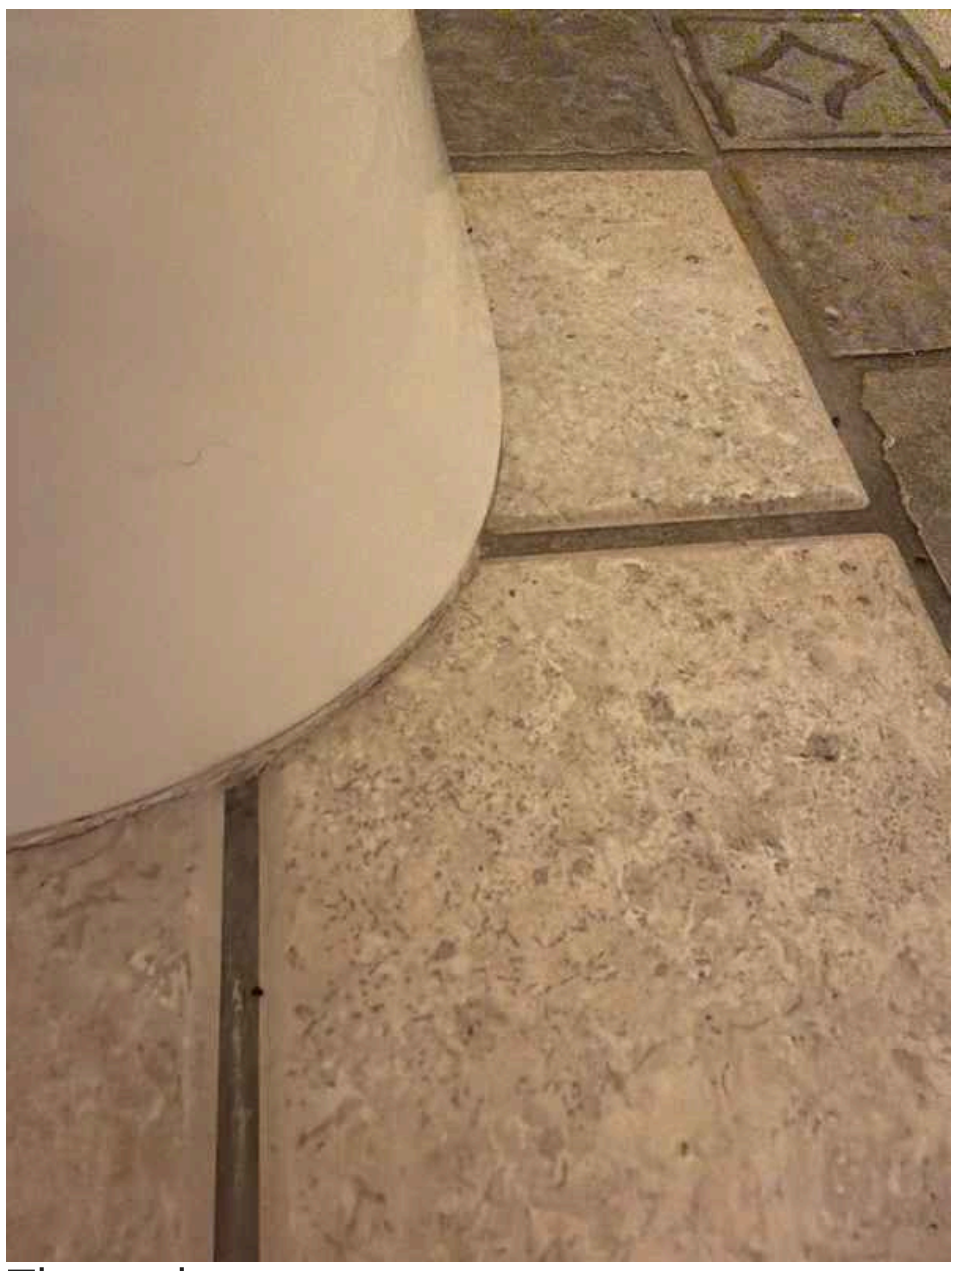
Throughout


Throughout


Throughout


Throughout

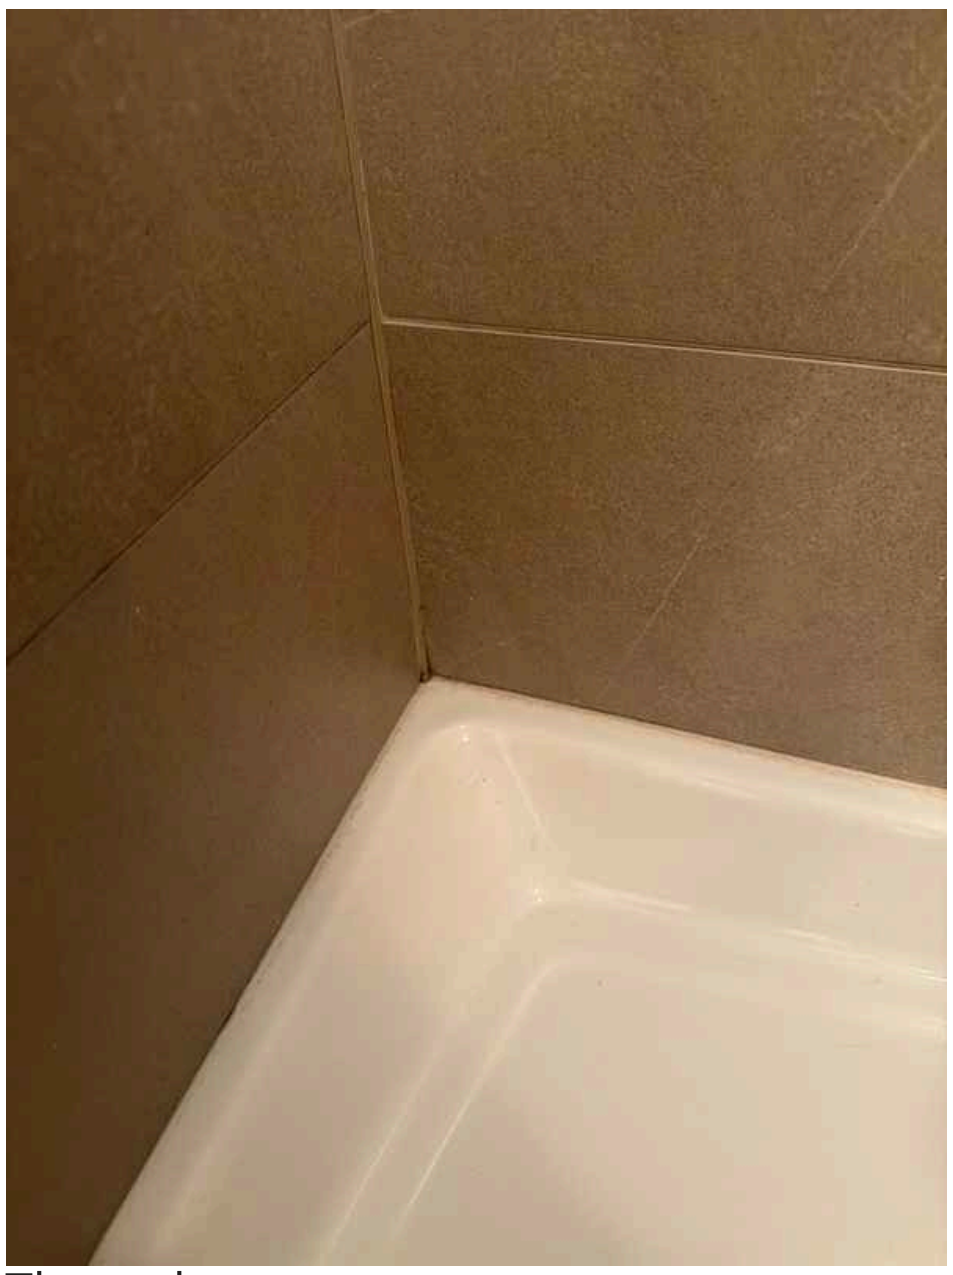
Throughout

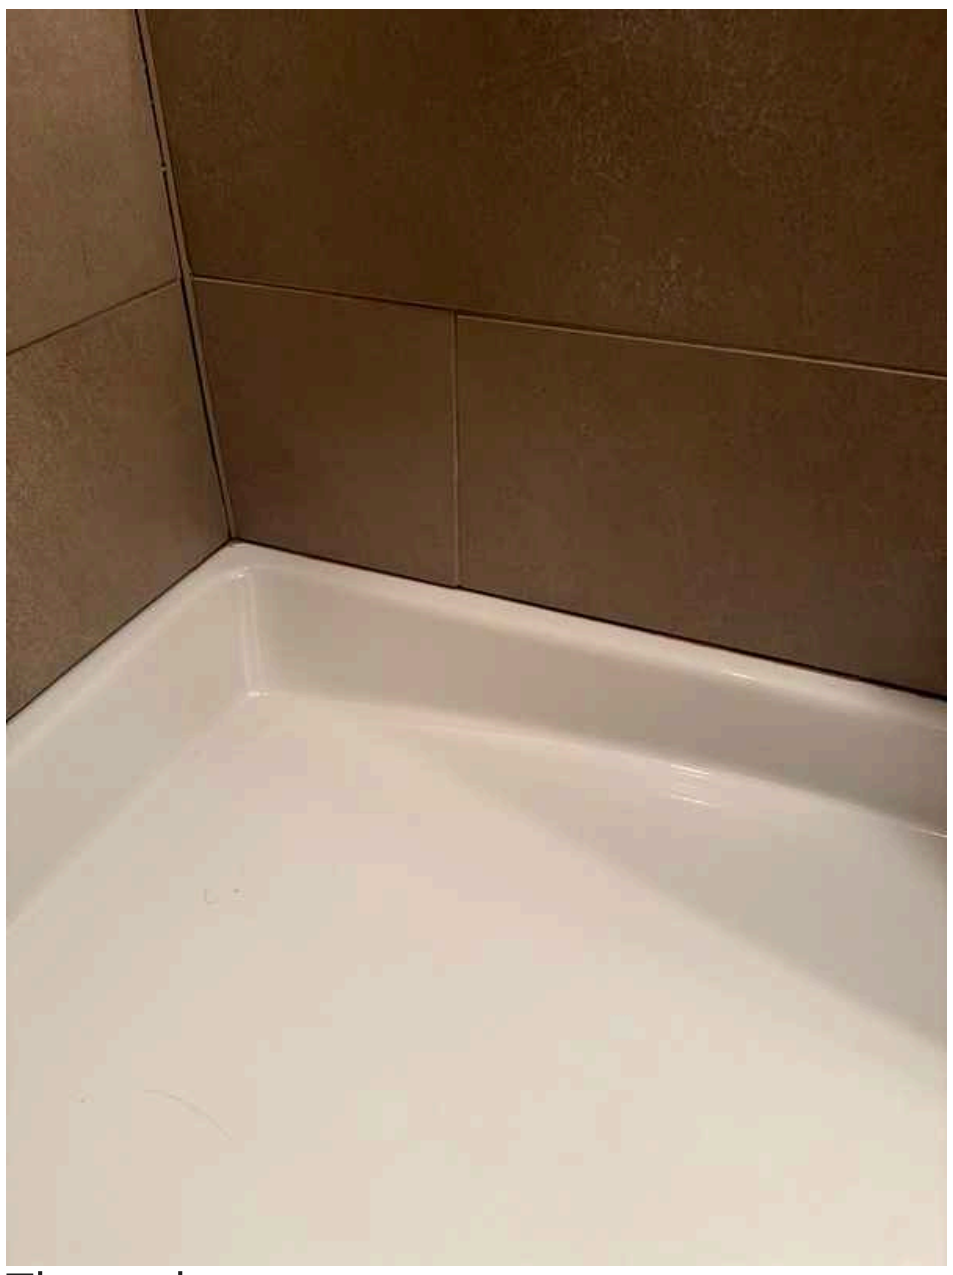
Throughout

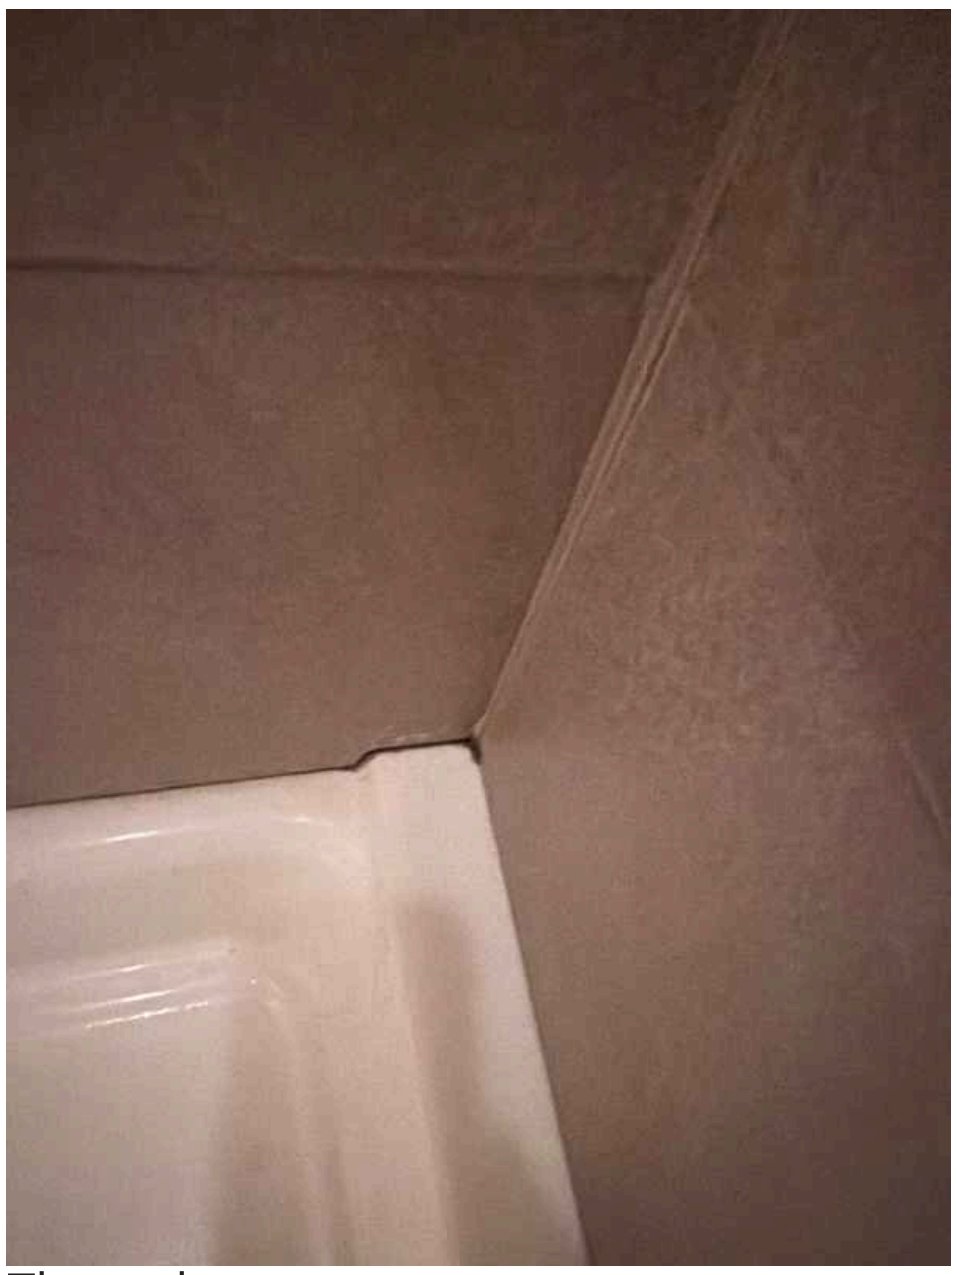
Throughout

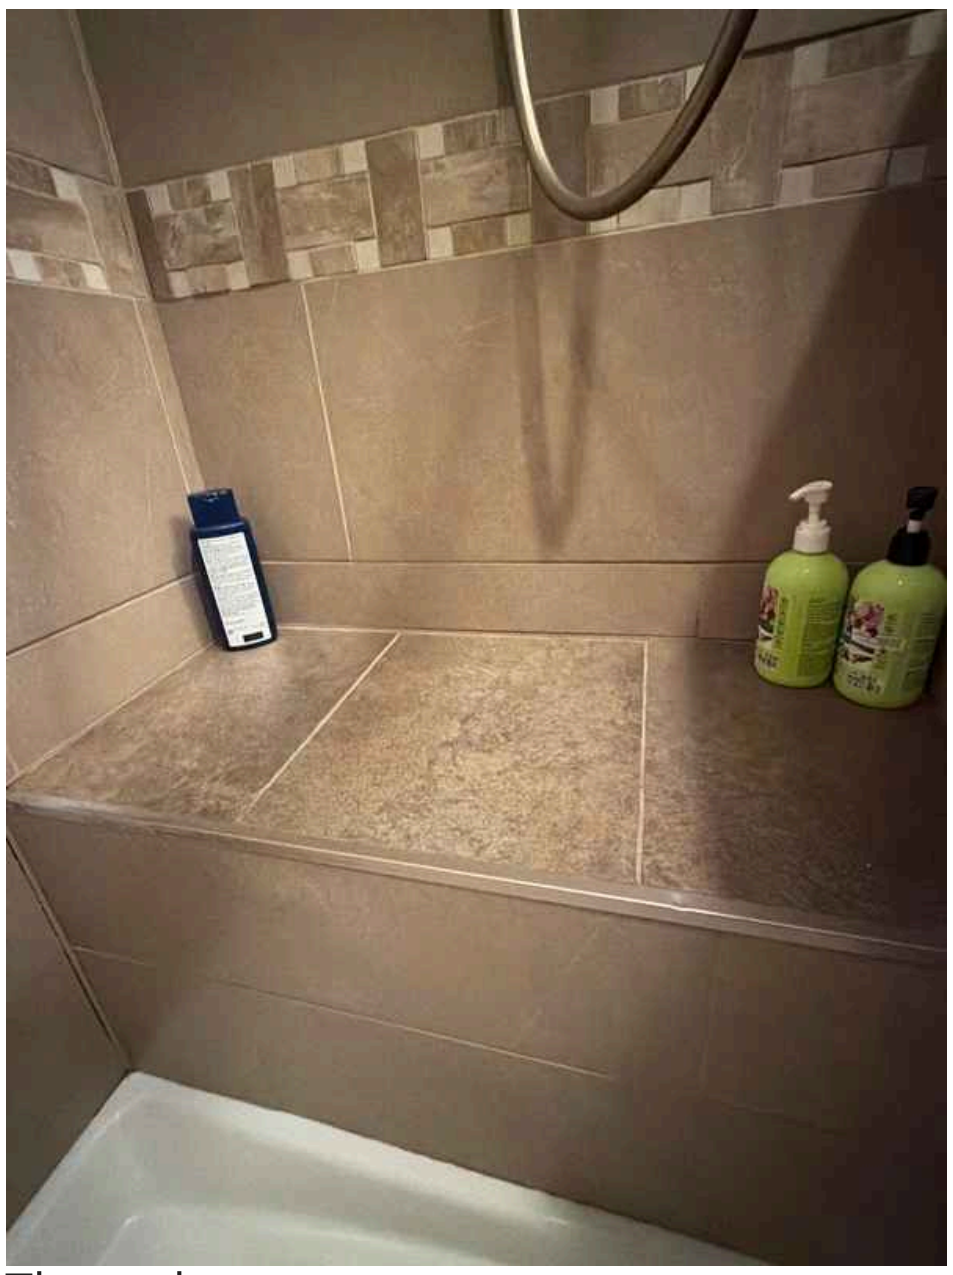
Throughout

6.6.2 Sinks, faucets, toilets, bathtubs, showers

Recommendation

NON-FUNCTIONAL SINK PLUG

The sink drain plug does not operate properly. This prevents the user from retaining water in the sink for washing or soaking tasks. A plumbing contractor should inspect the plug mechanism and drain assembly to determine whether repair or replacement is needed.

Recommendation

Contact a qualified professional.

6.6.3 Sinks, faucets, toilets, bathtubs, showers

Recommendation

LEAKING SHOWER HANDLE

Water is leaking from the shower handle during operation. This indicates worn internal seals or valve components that require replacement. A plumbing contractor should evaluate the handle assembly and replace defective parts to stop the leak and prevent water damage.

Recommendation

Contact a qualified professional.

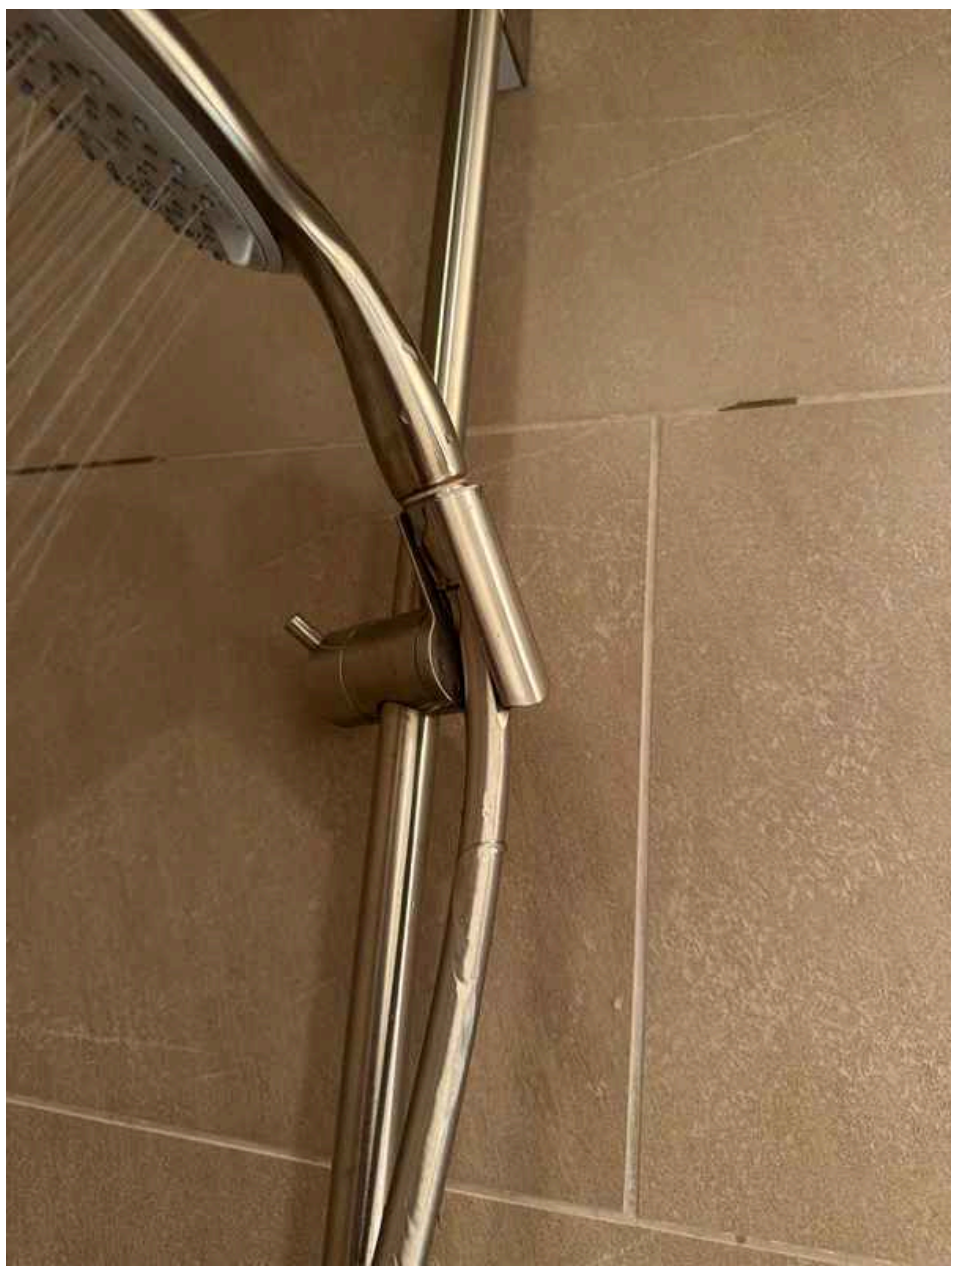

6.6.4 Sinks, faucets, toilets, bathtubs, showers

Recommendation

STIFF FAUCET HANDLES

Faucet handles are difficult to operate, requiring excessive force to turn on or off. This condition may result from mineral buildup, corrosion, or internal valve issues. A plumber should evaluate the faucet to determine if cleaning, repair, or replacement is needed.

Recommendation

Contact a qualified professional.

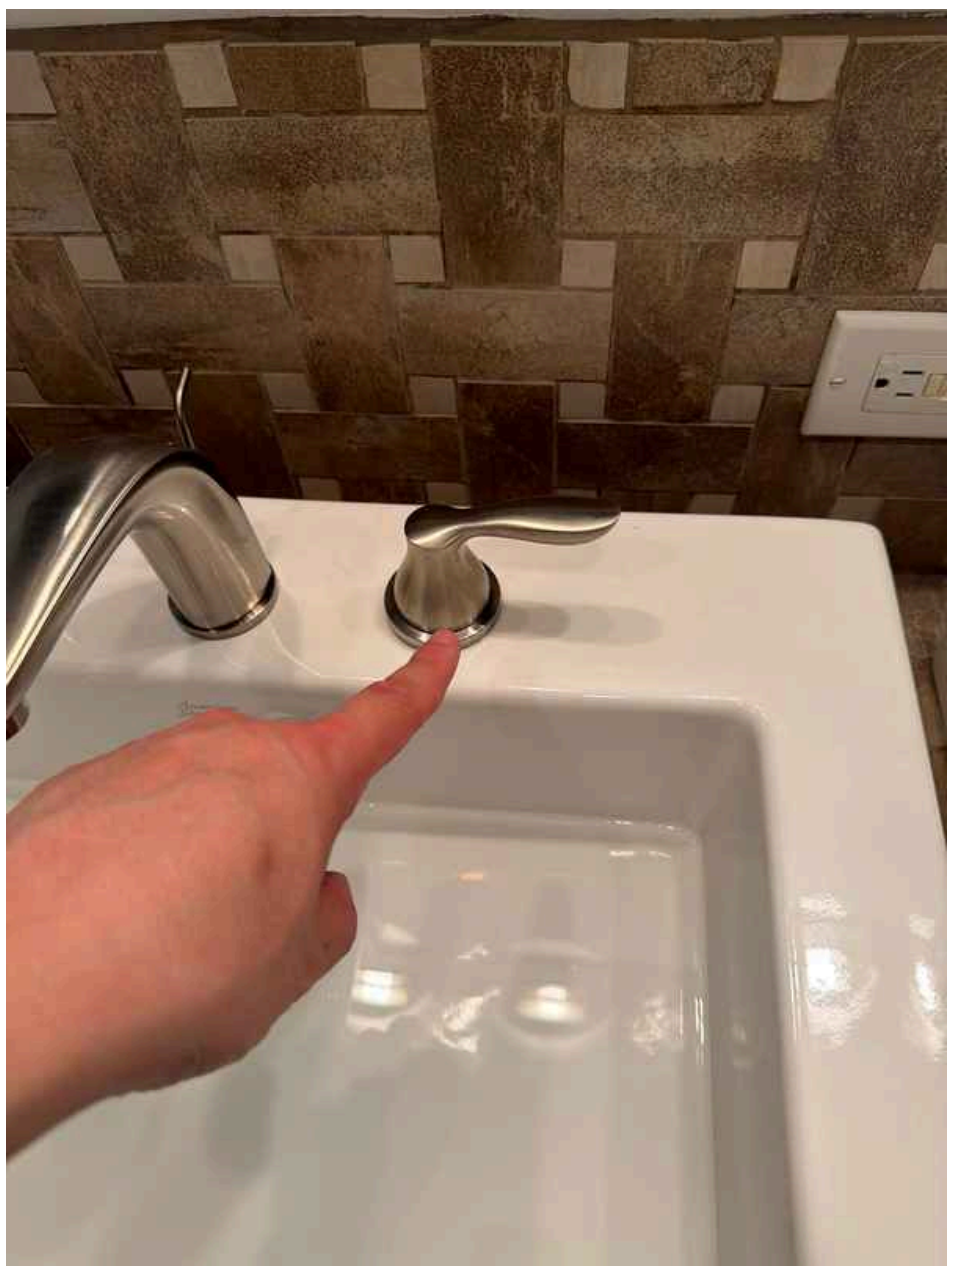

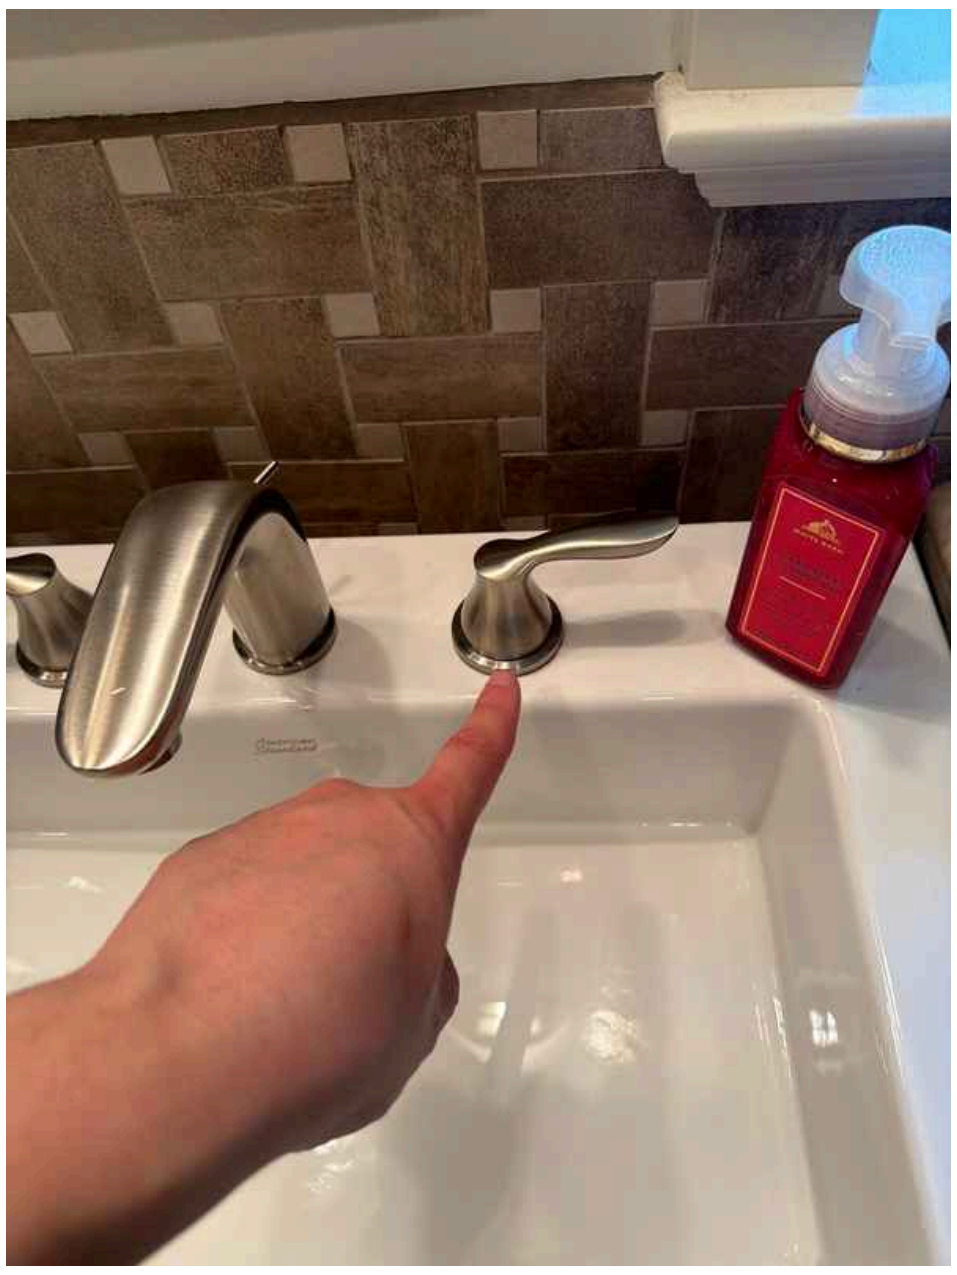

7: ELECTRICAL

Information

Service Entrance Conductors:
Electrical Service Conductors
Overhead

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Main Panel Location

First floor living room

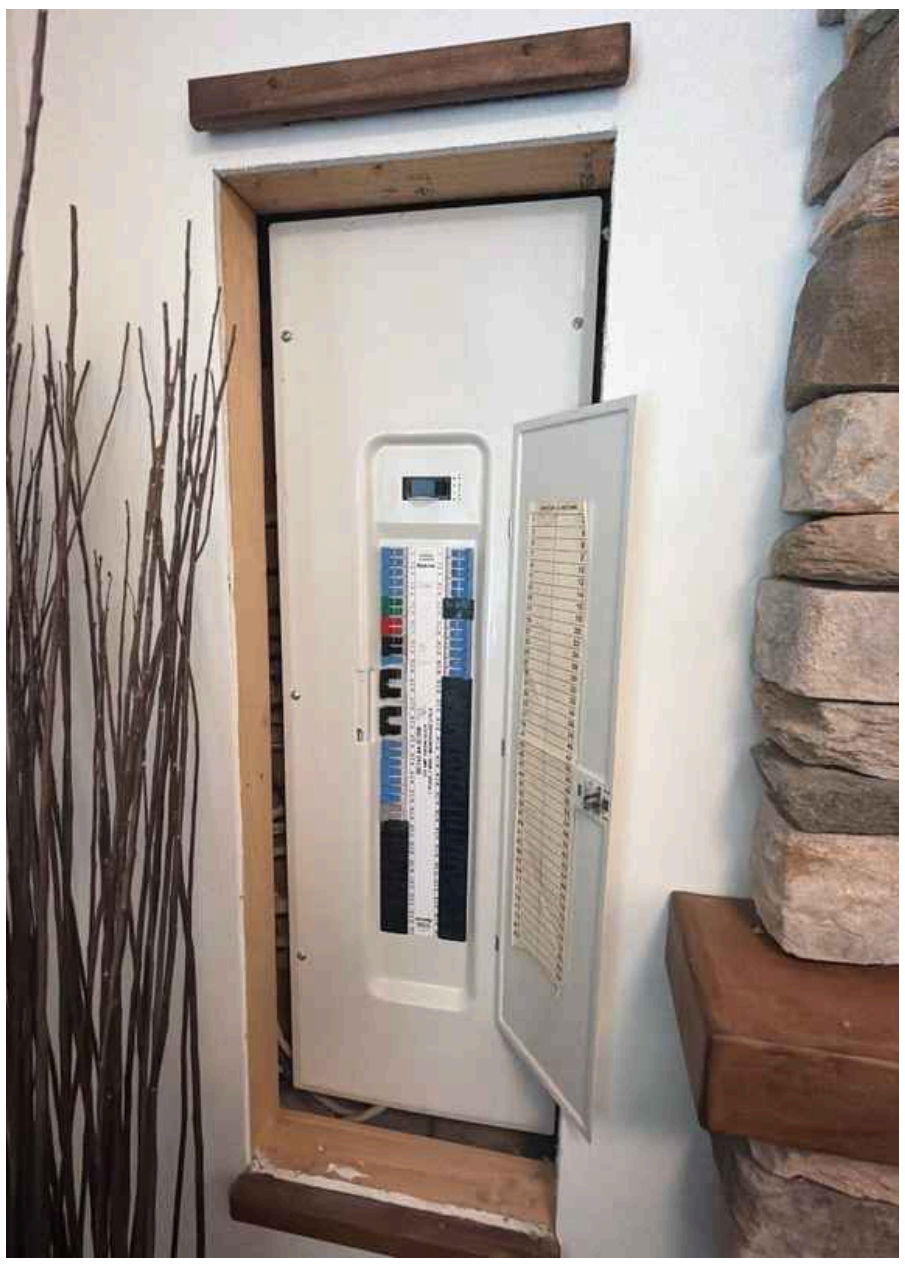

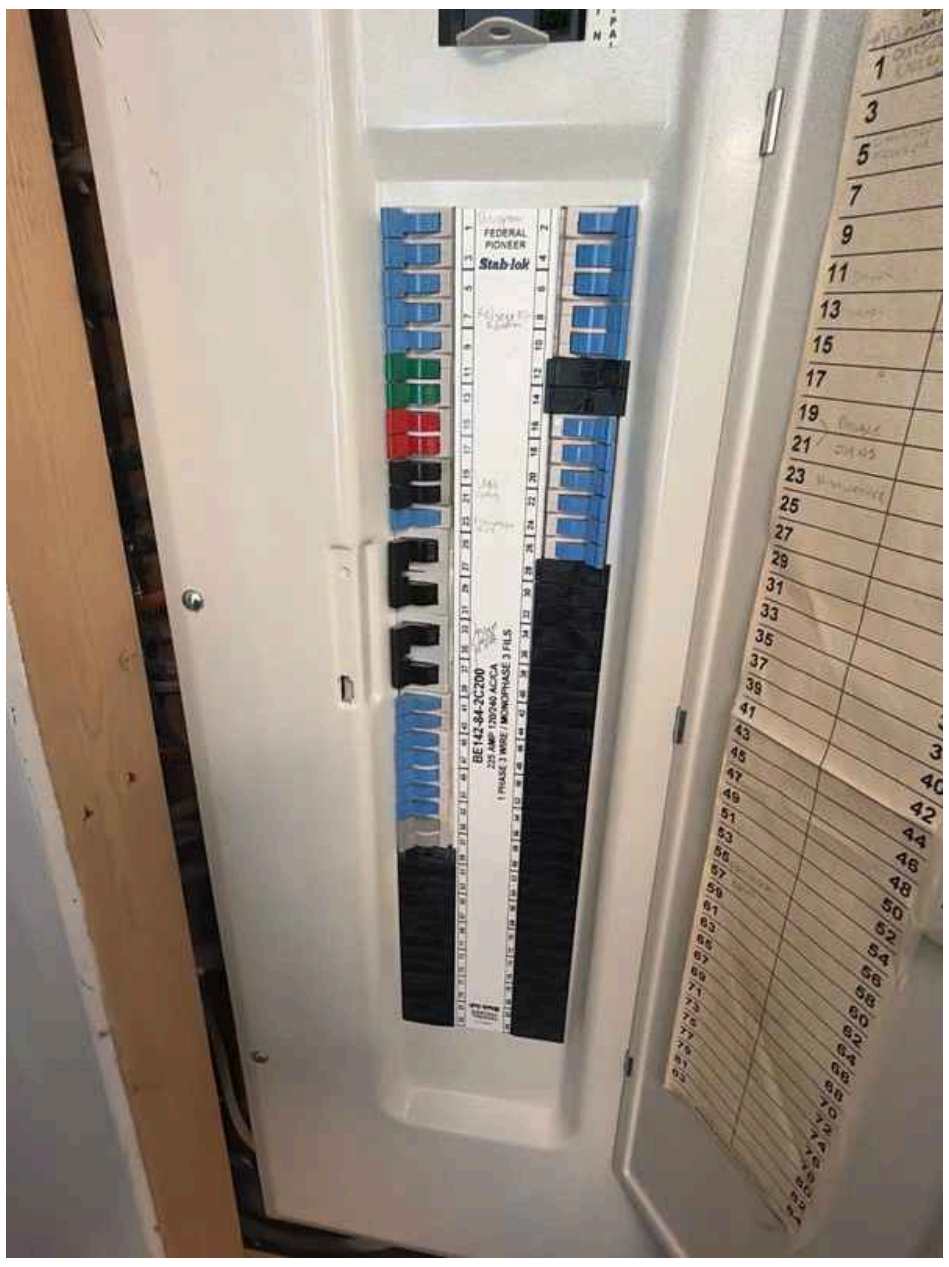

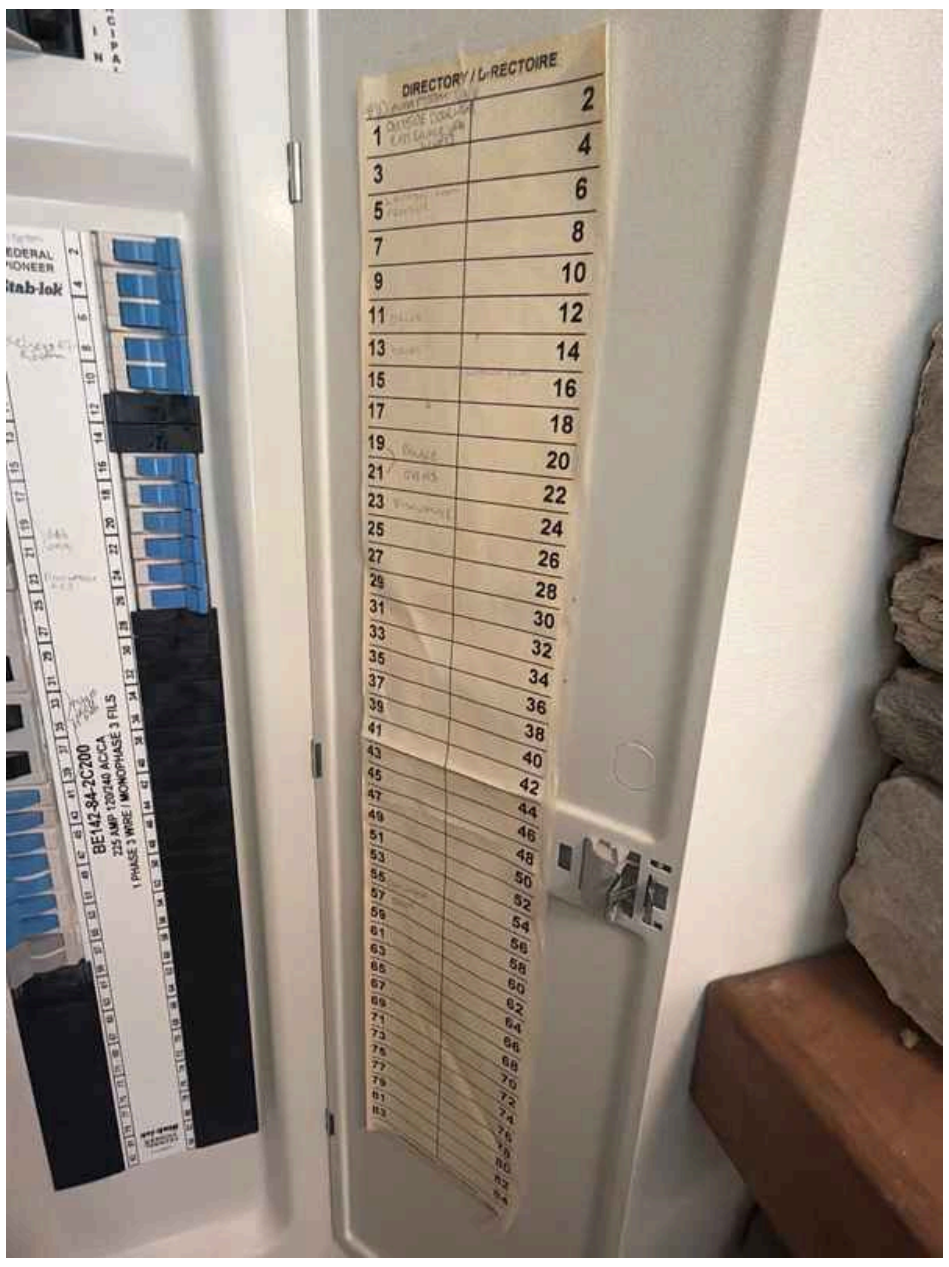

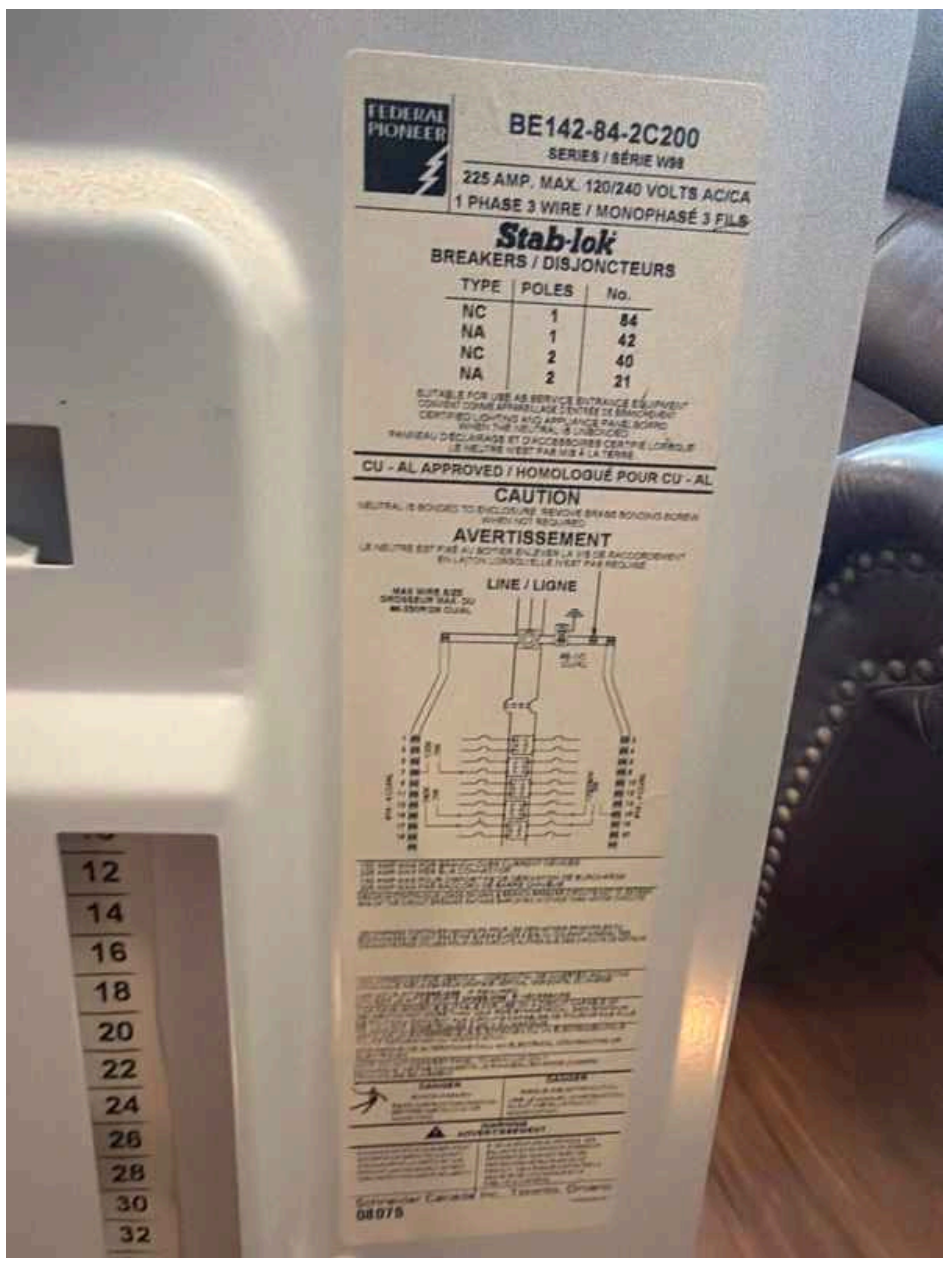

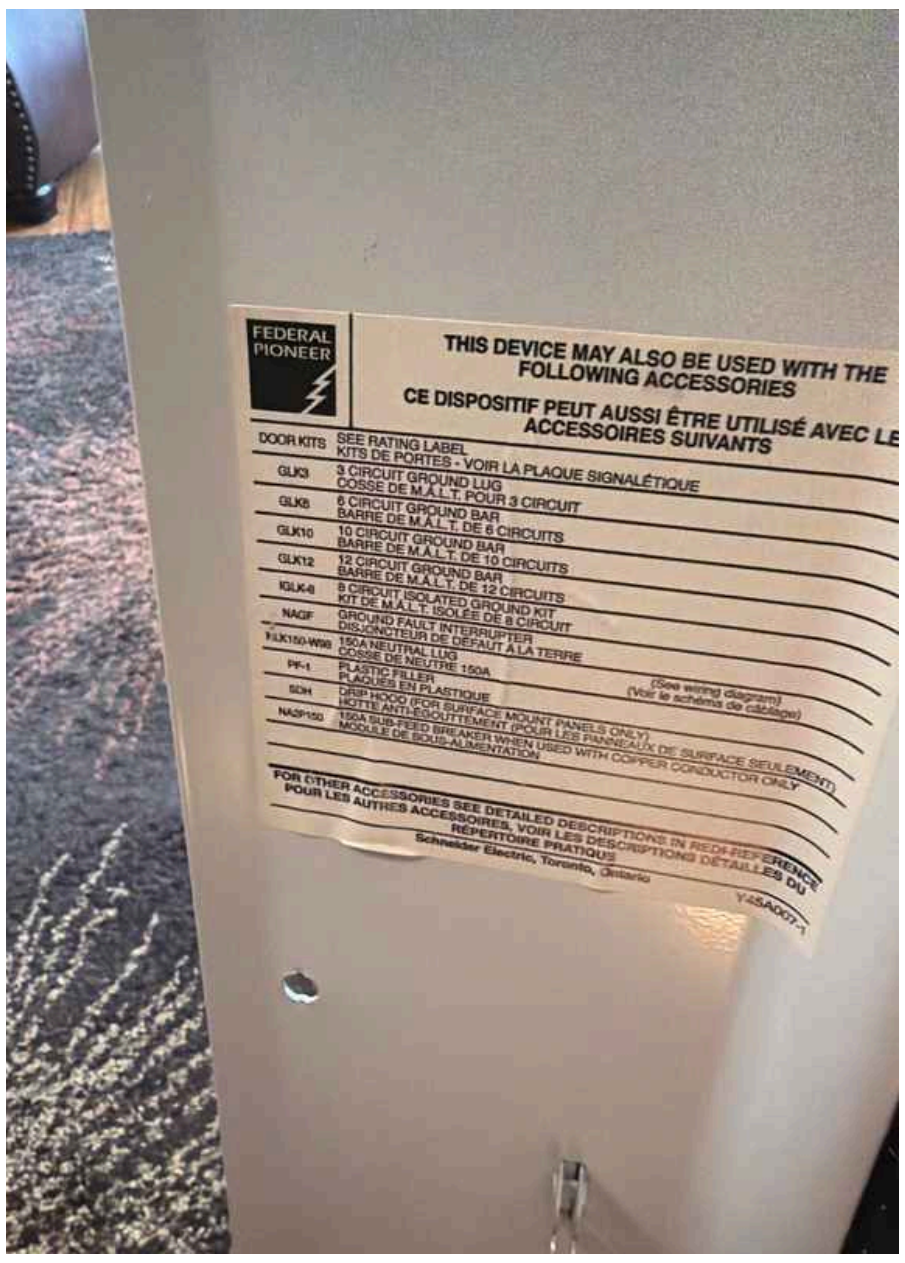

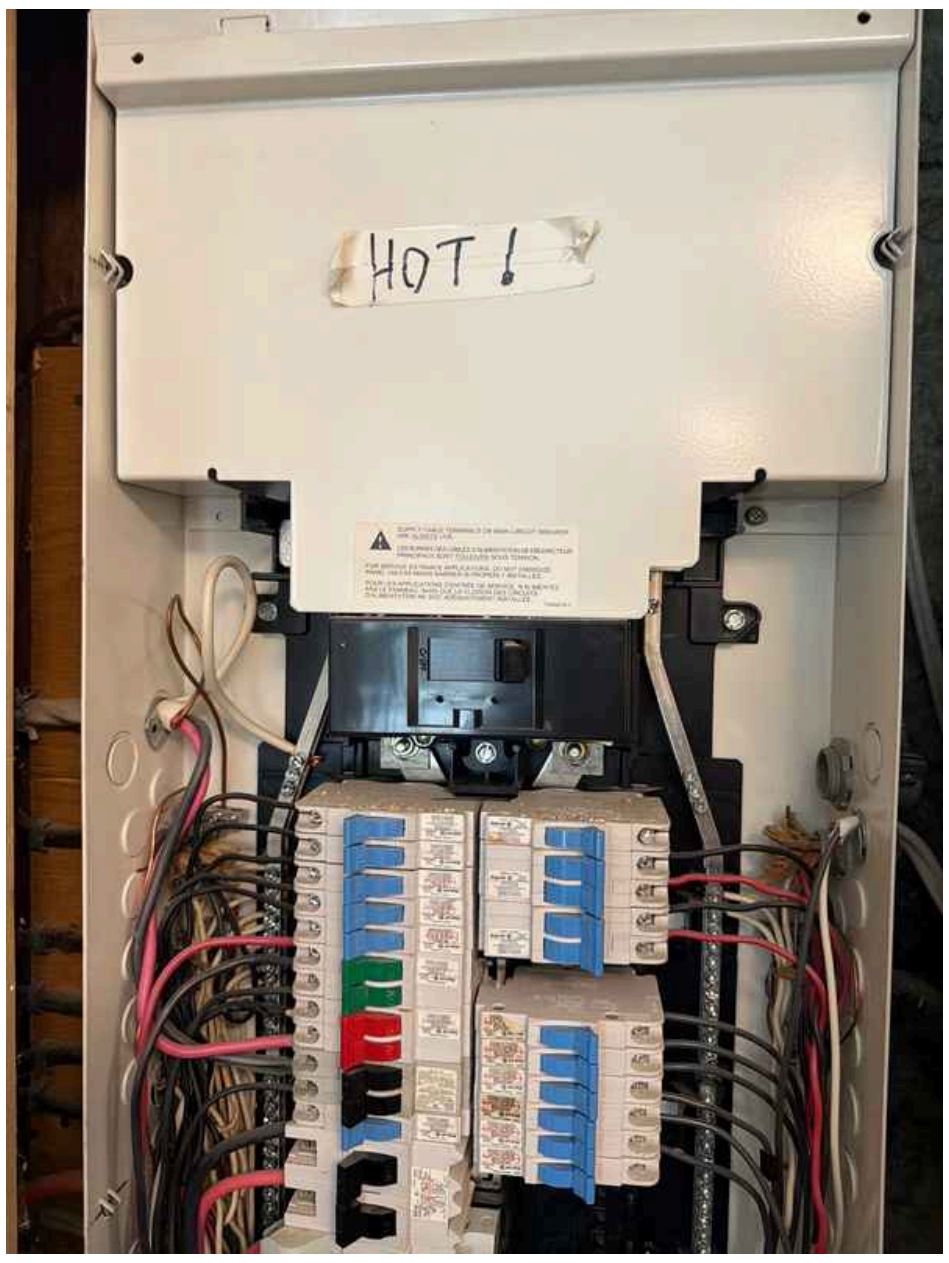

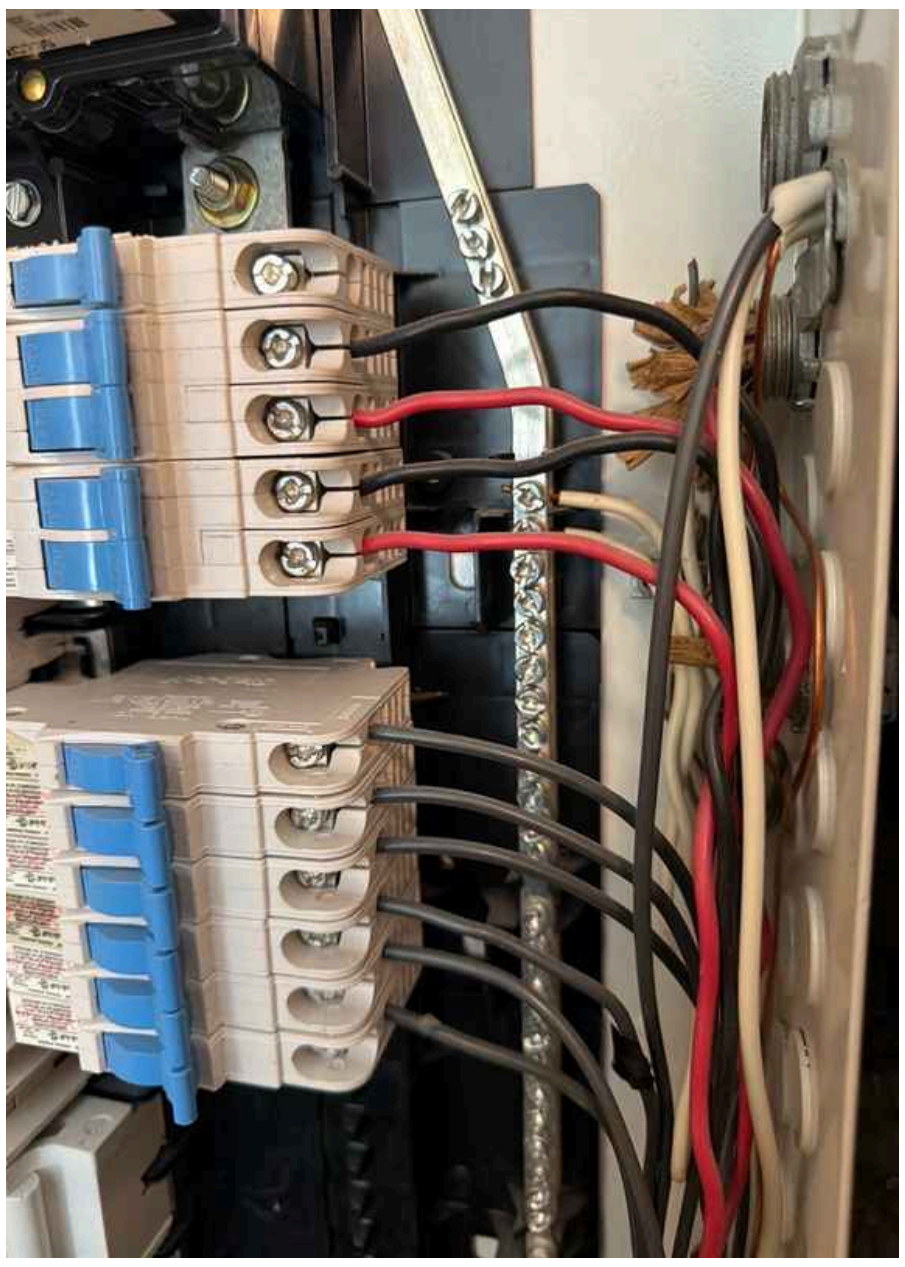
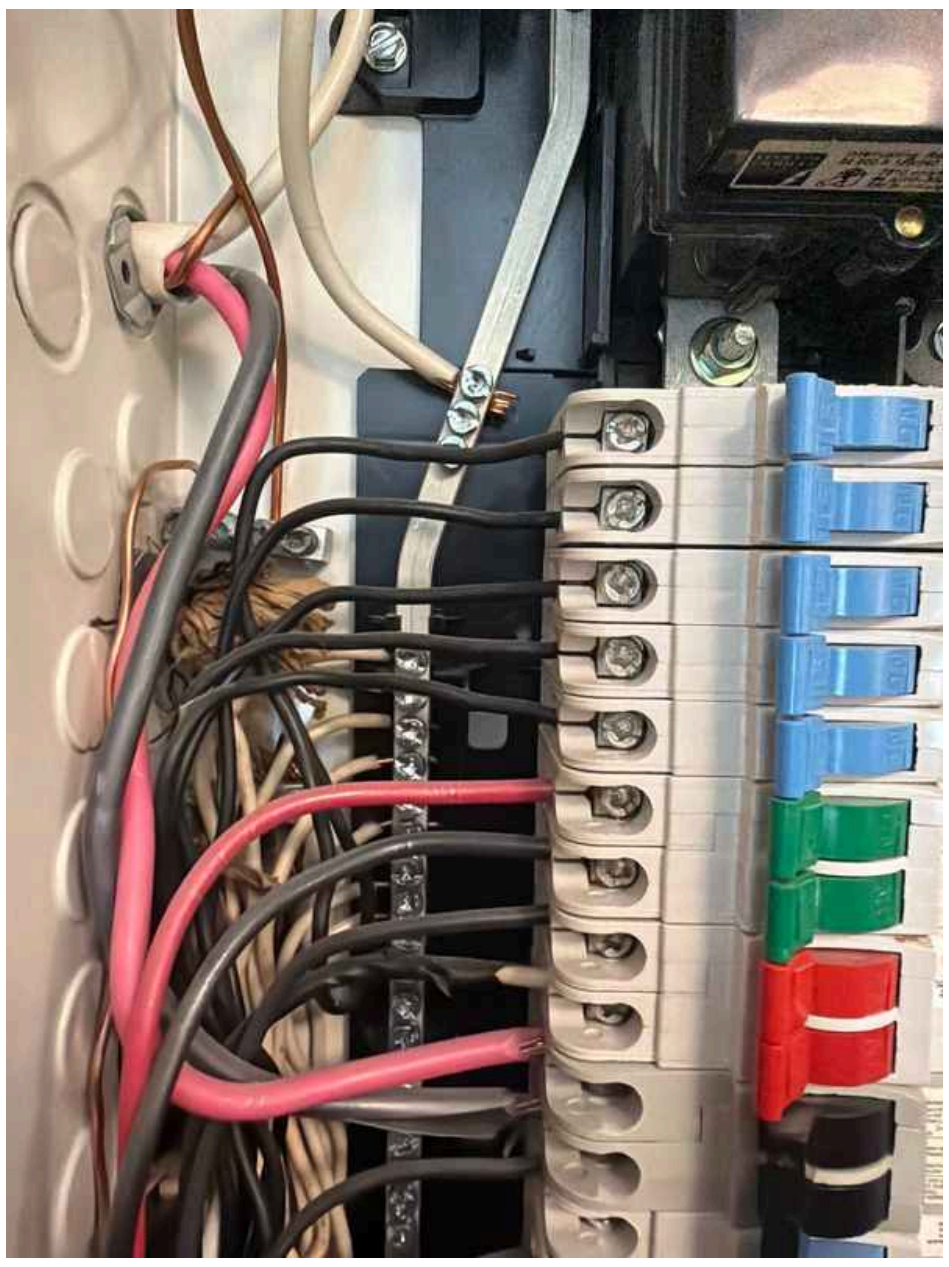
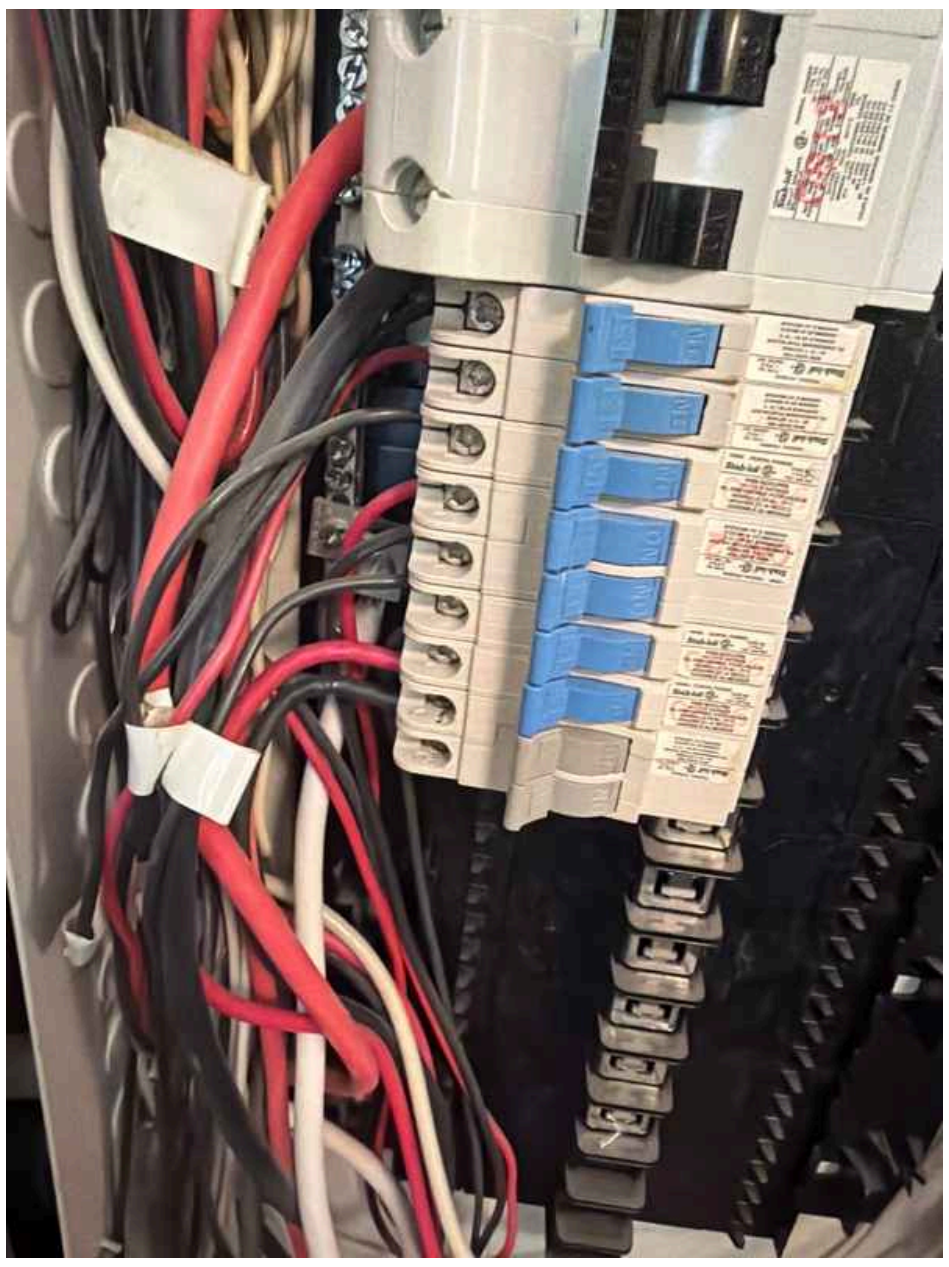
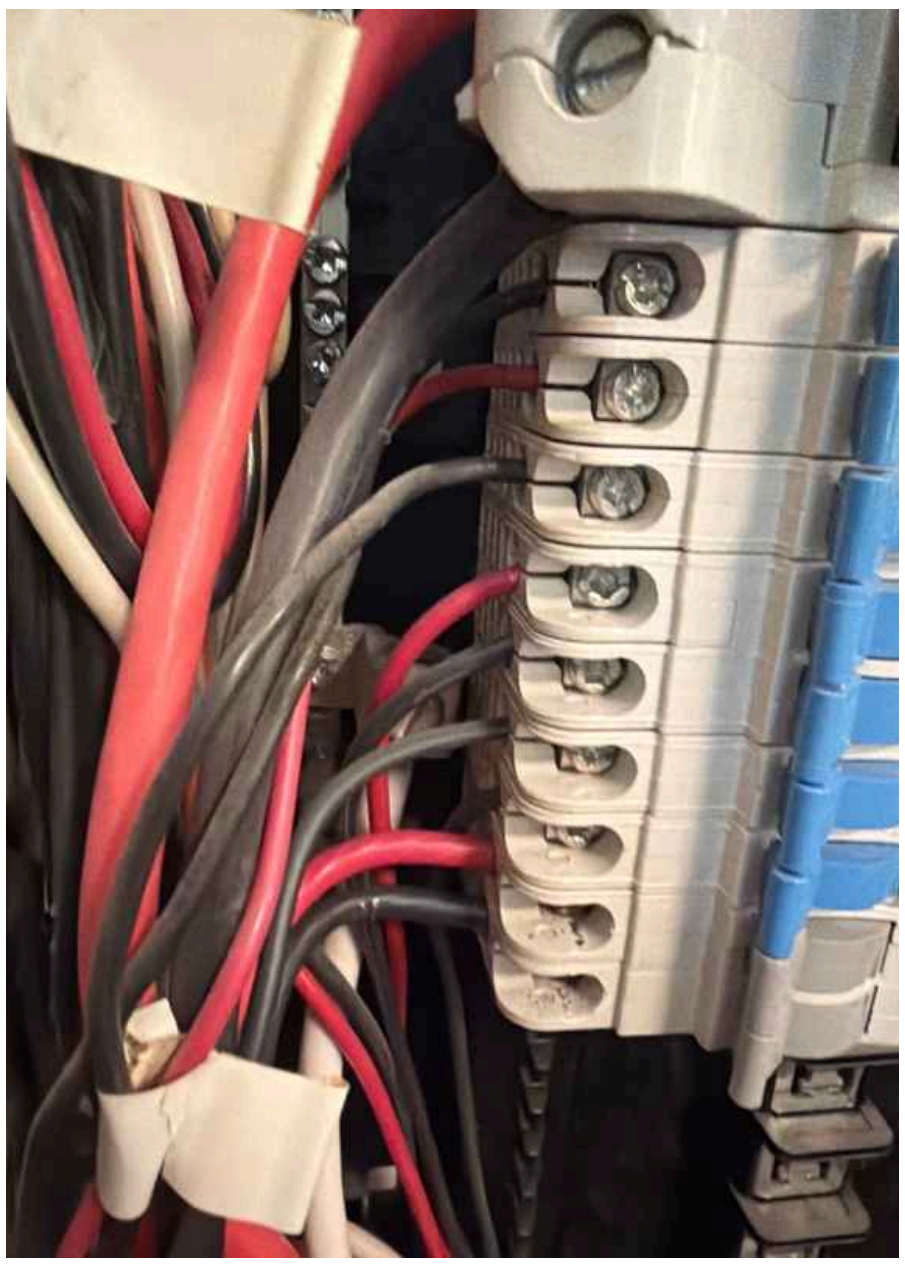
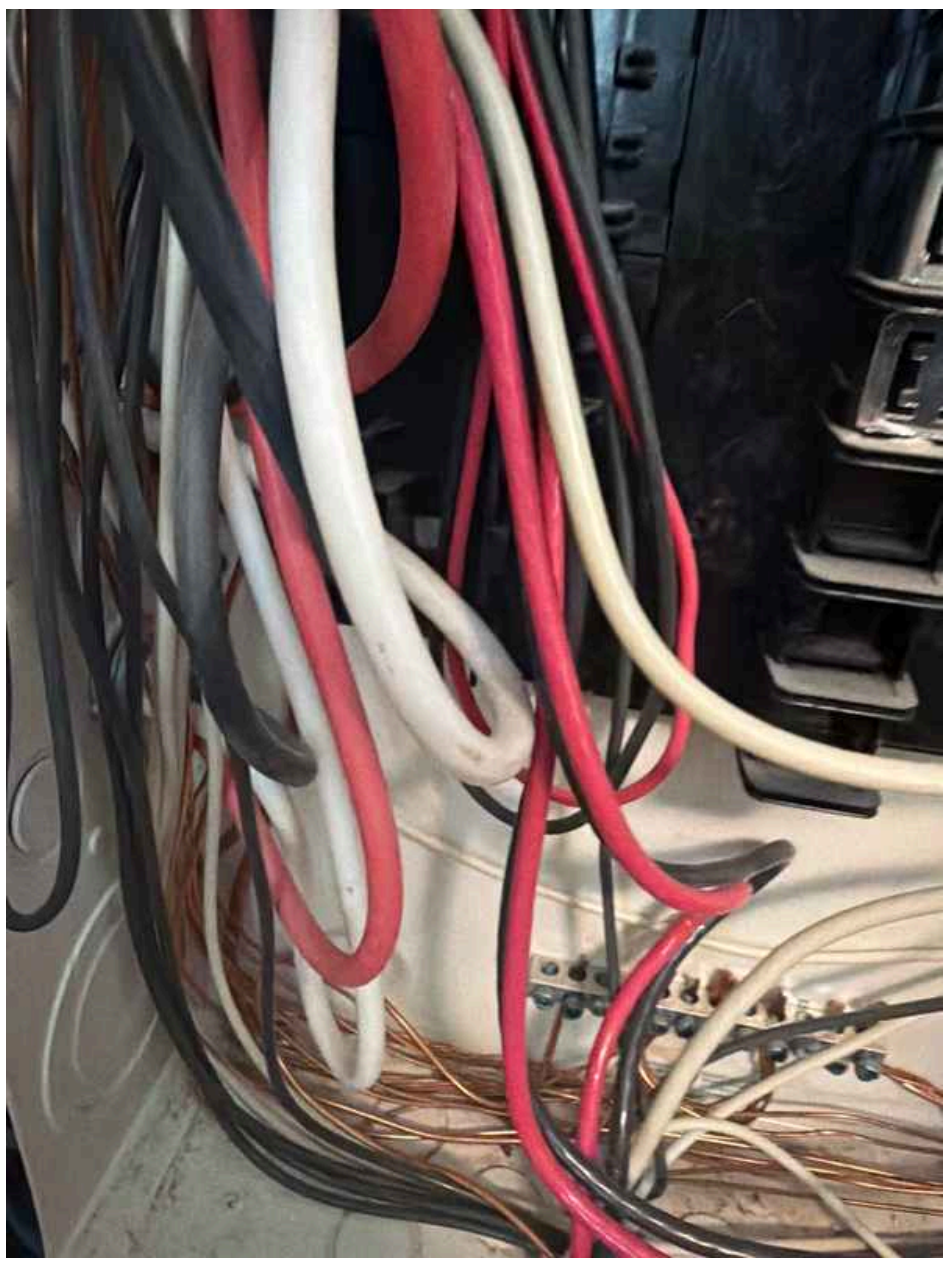

Main & Subpanels, Service & Grounding, Main Overcurrent Device: **Panel Capacity**
200 AMP

Main & Subpanels, Service & Grounding, Main Overcurrent Device: **Panel Manufacturer**
Federal Pioneer

Main & Subpanels, Service & Grounding, Main Overcurrent Device: **Panel Type**
Circuit Breaker

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Sub Panel Location

Garage, Utility room

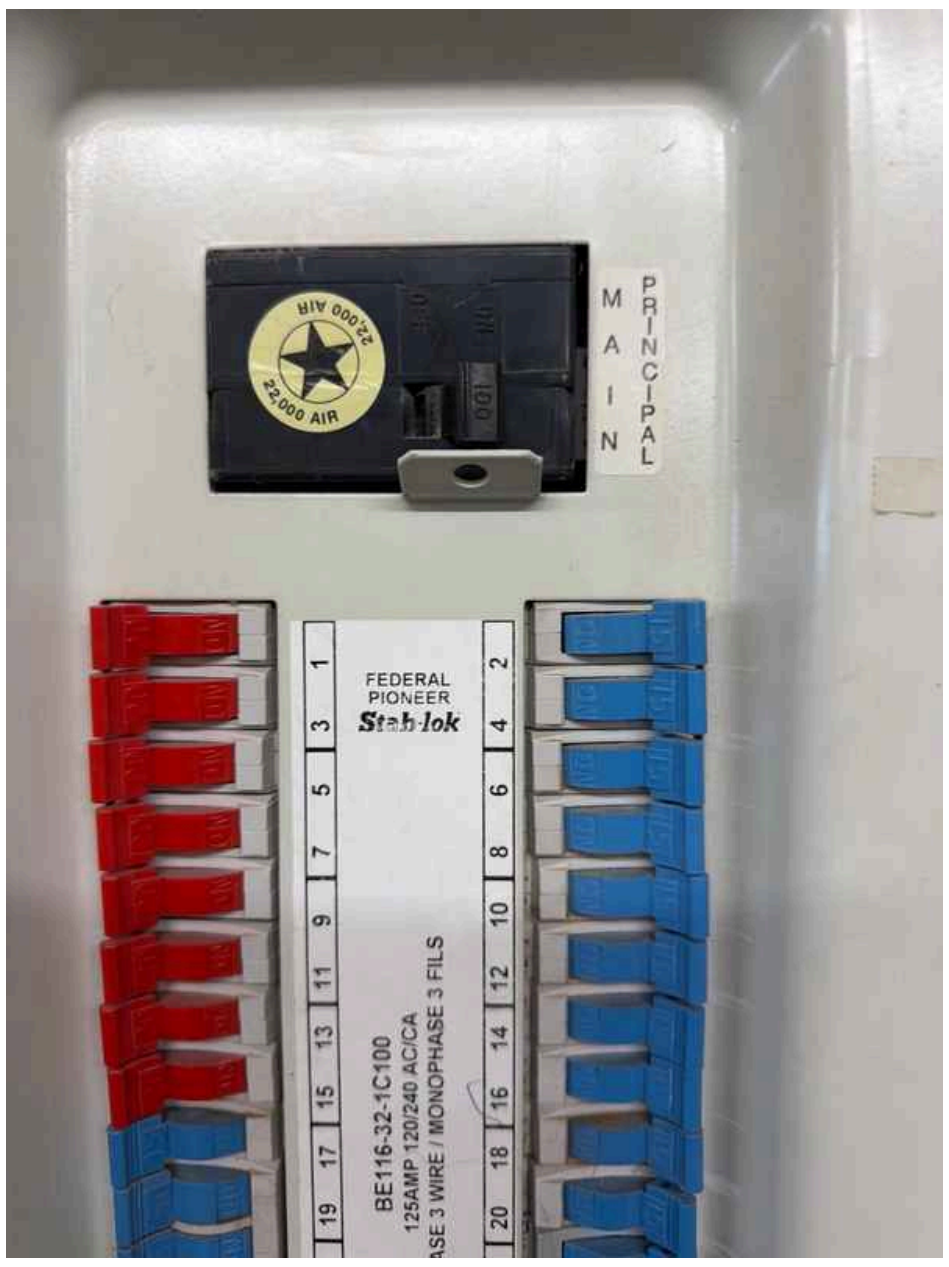

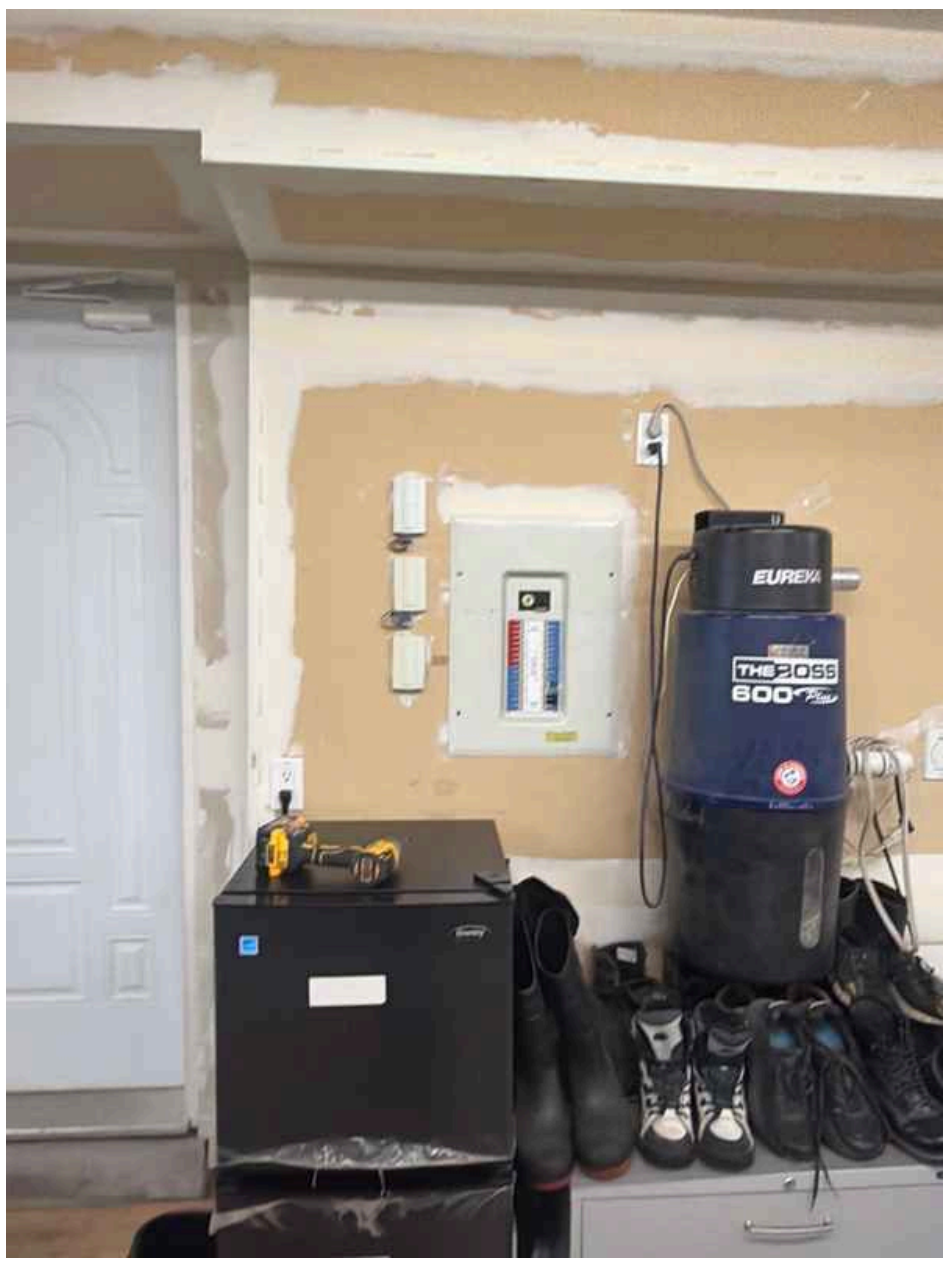

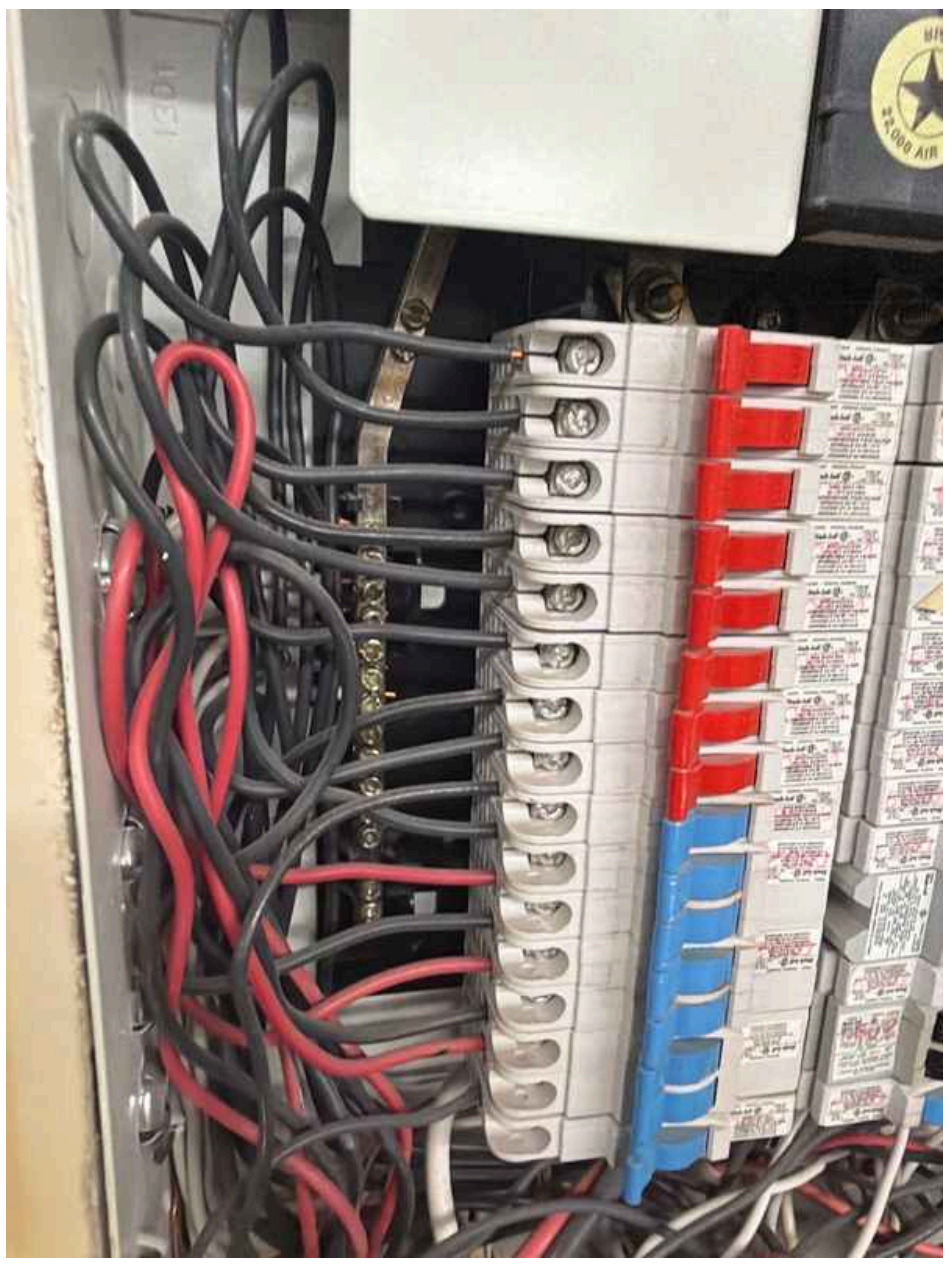

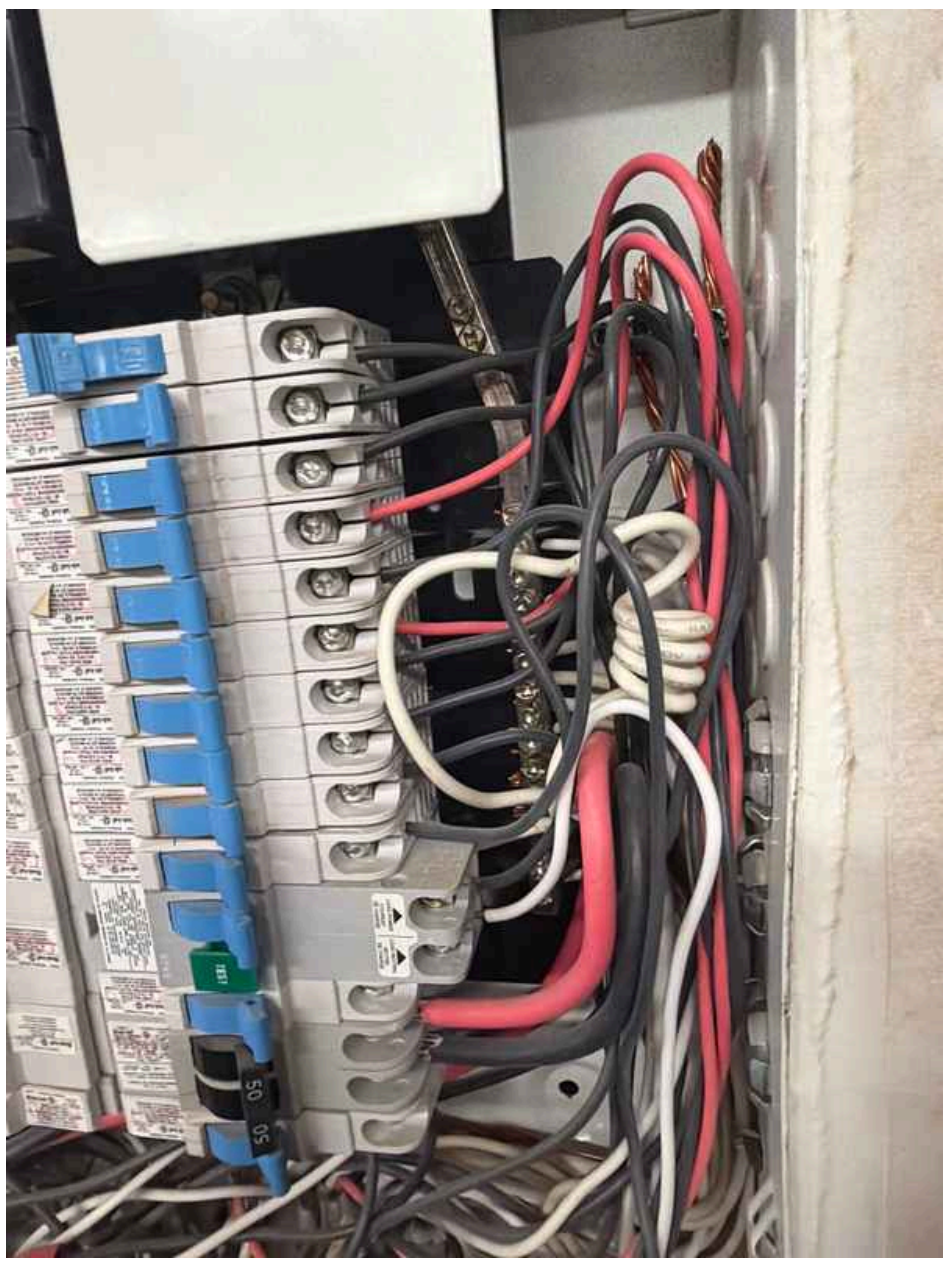

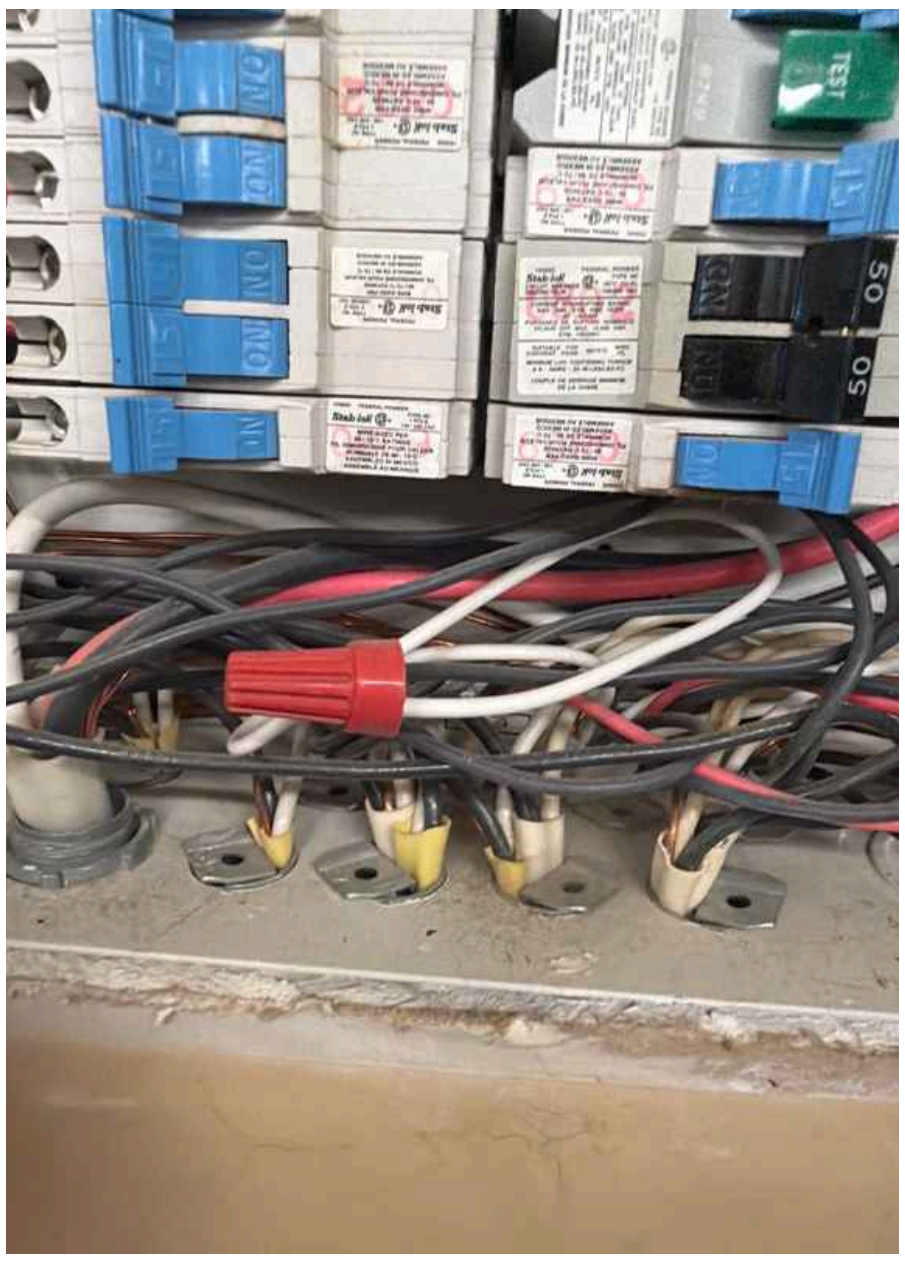

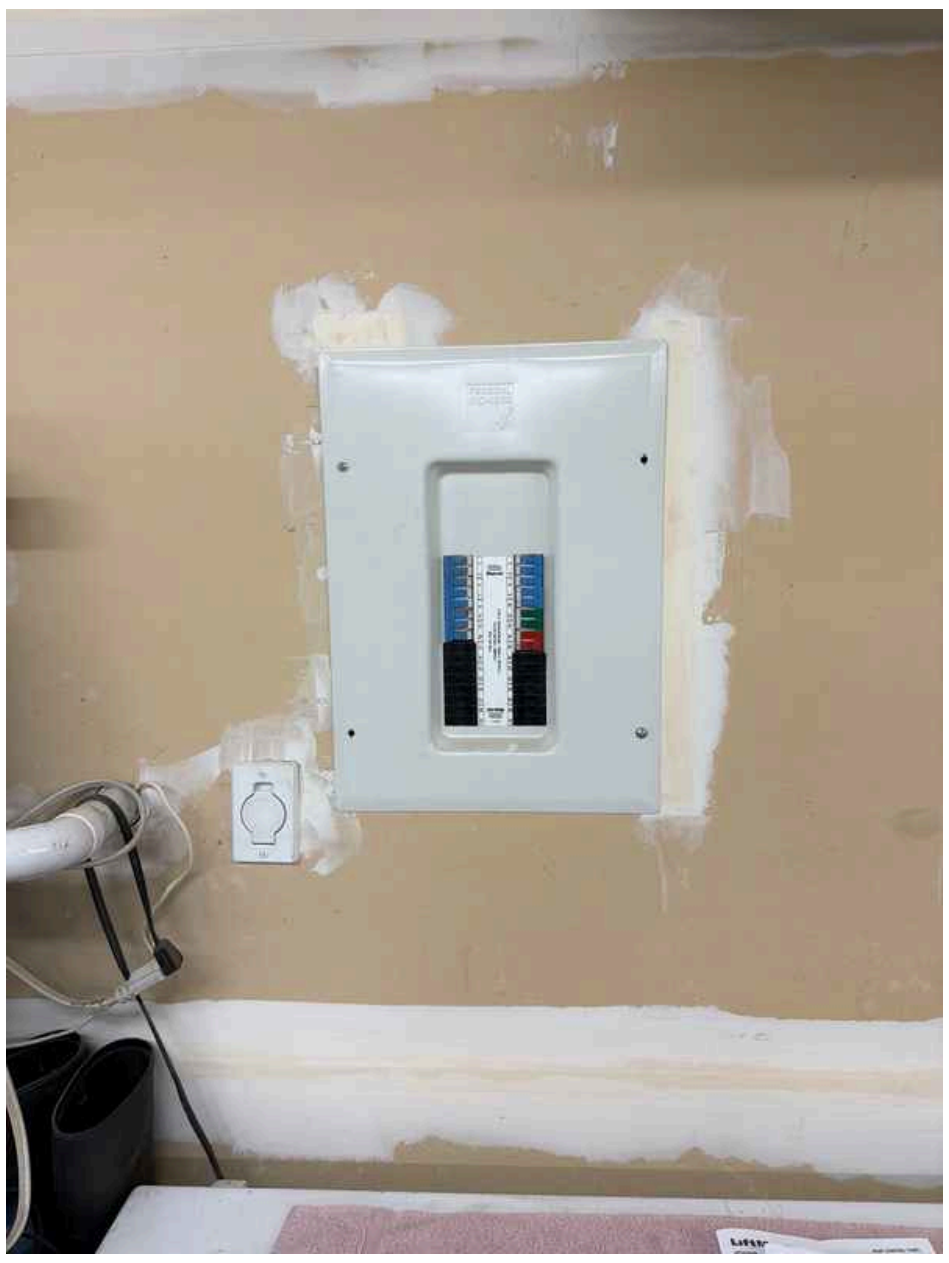

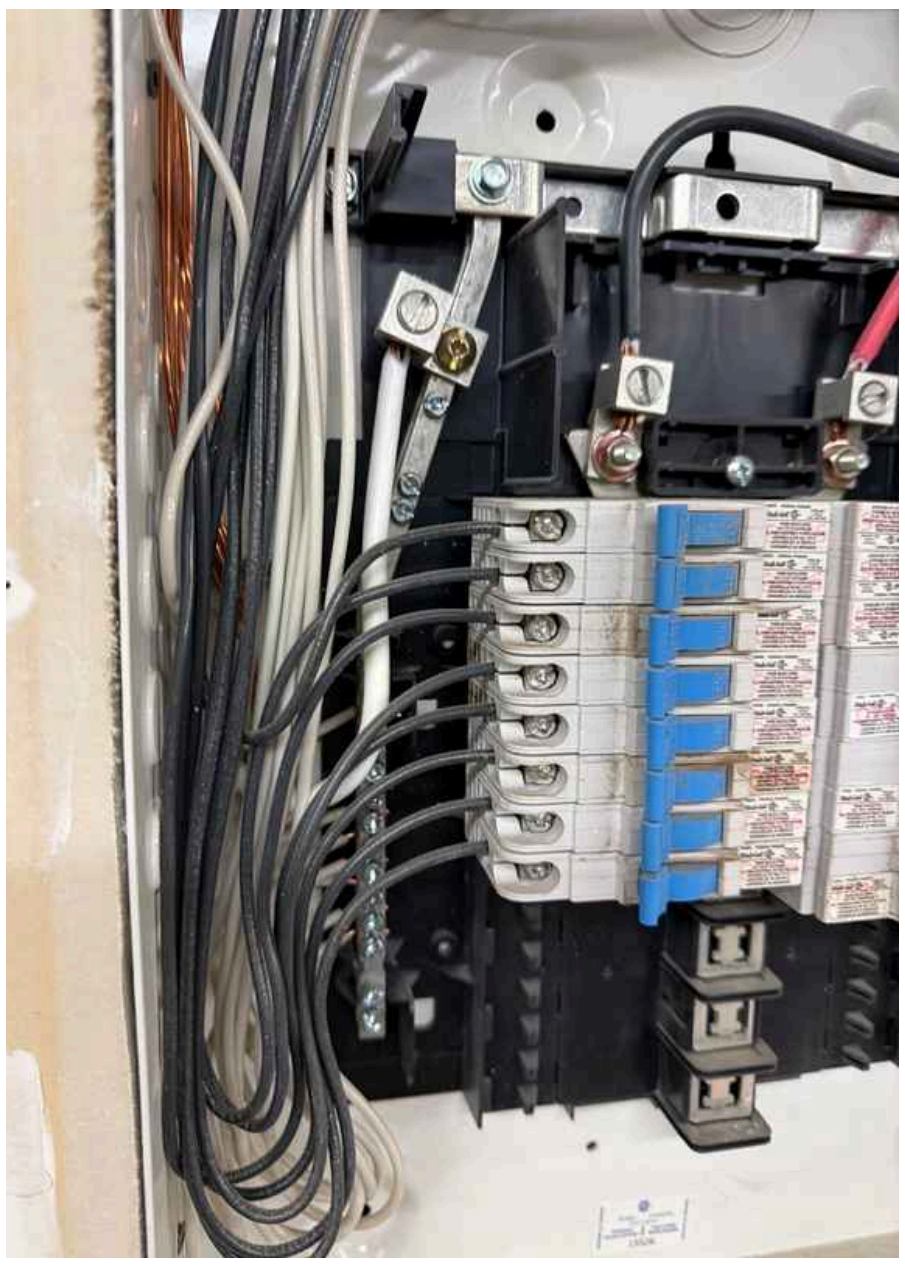

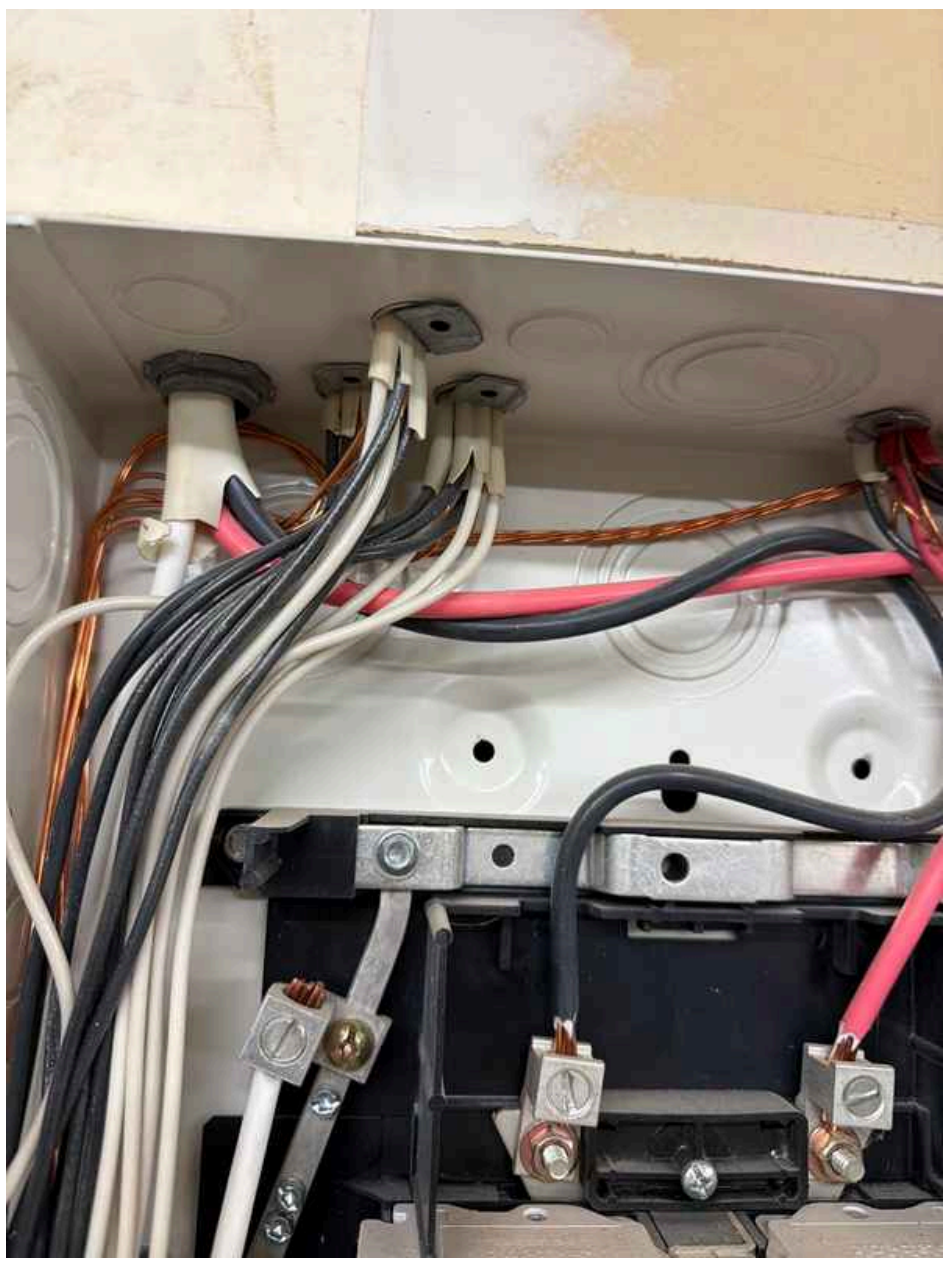

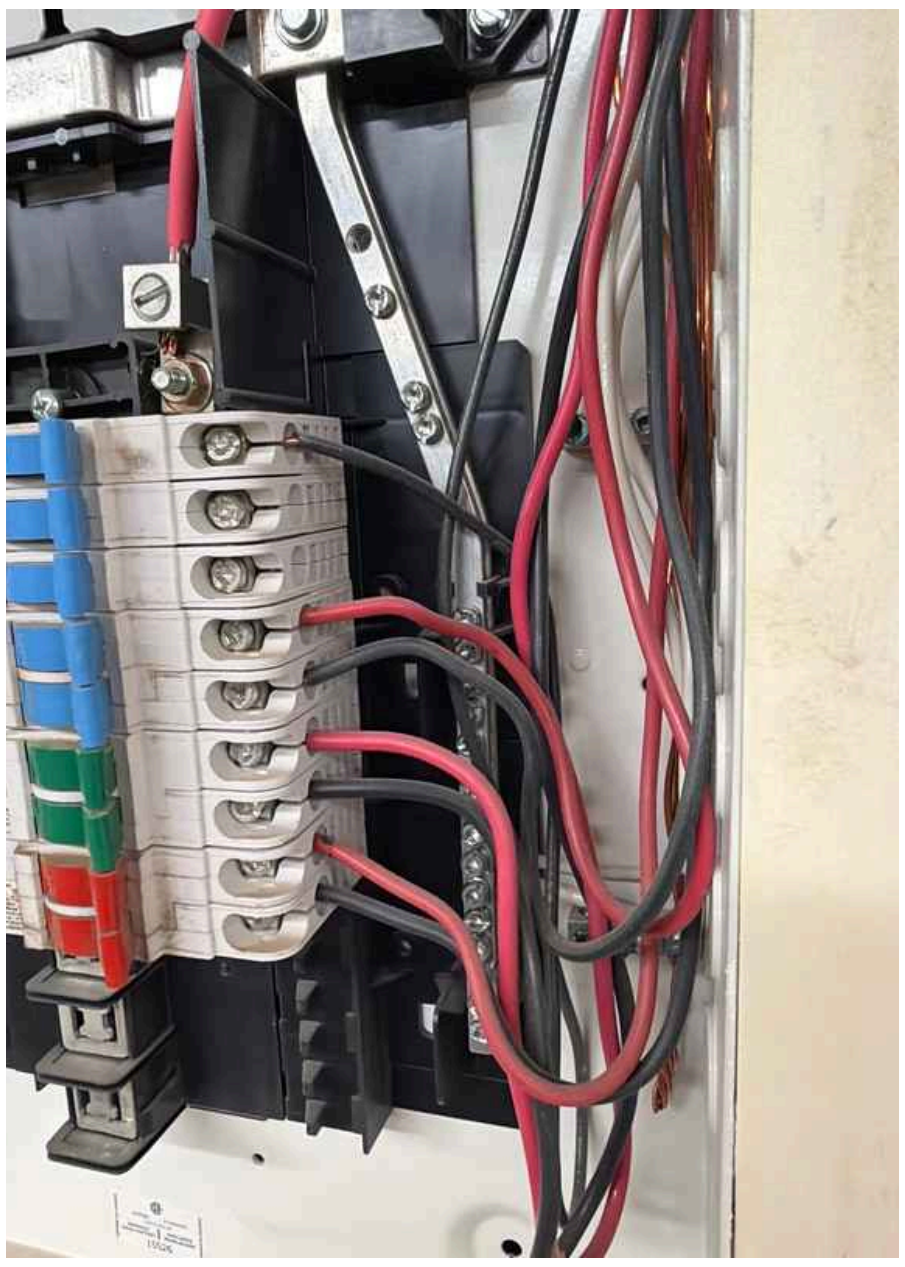


ON

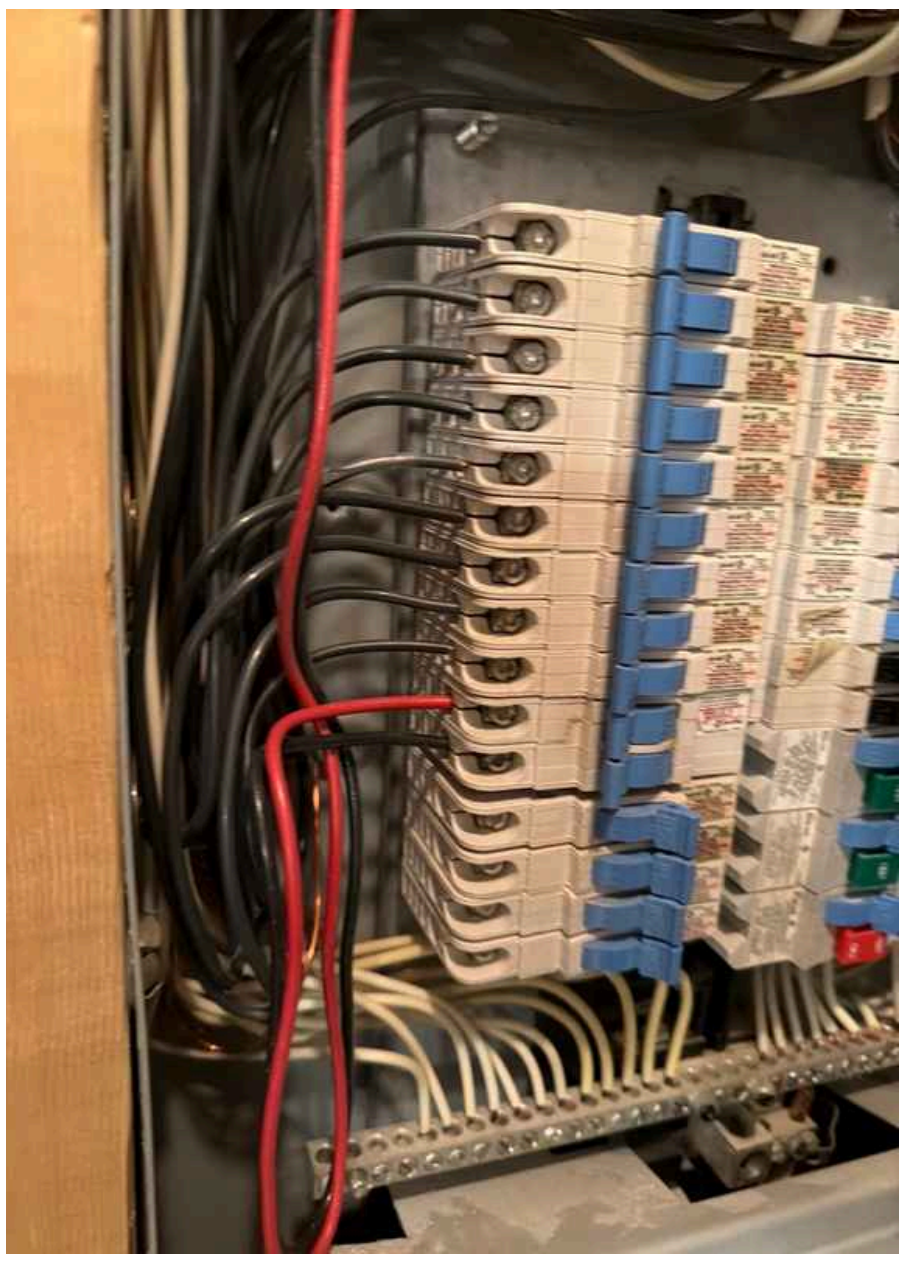

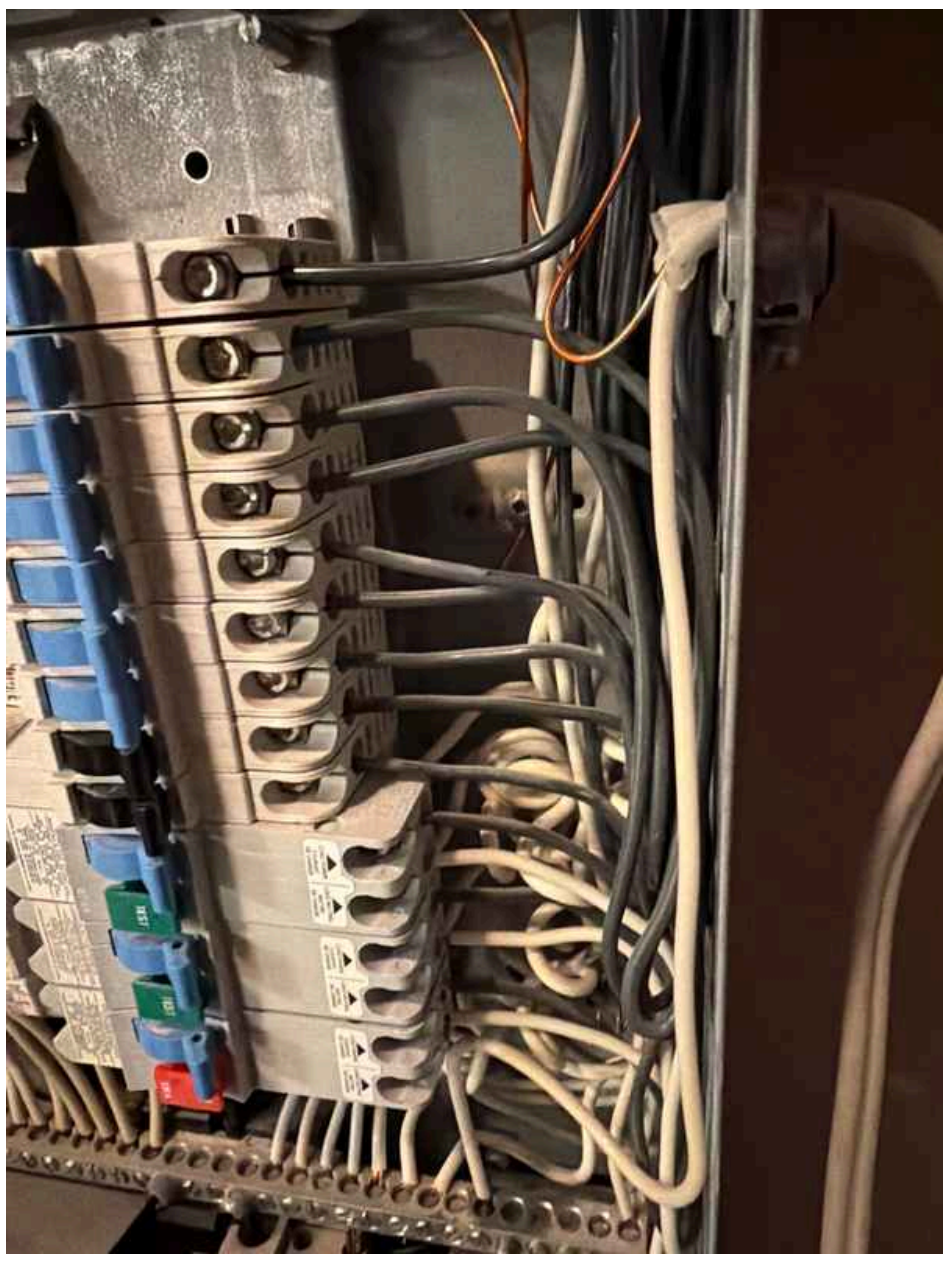

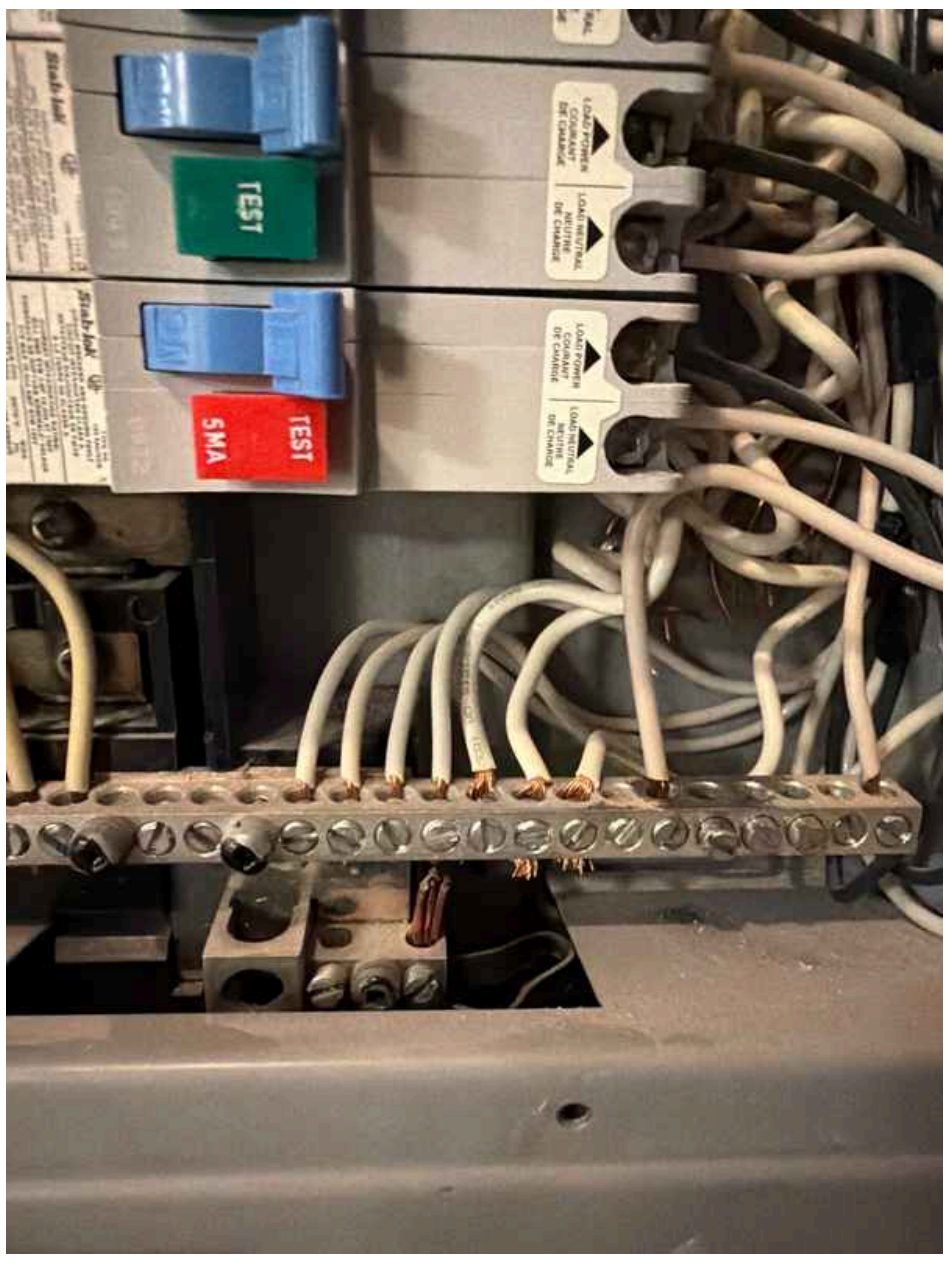
TEST
TEST
5MA

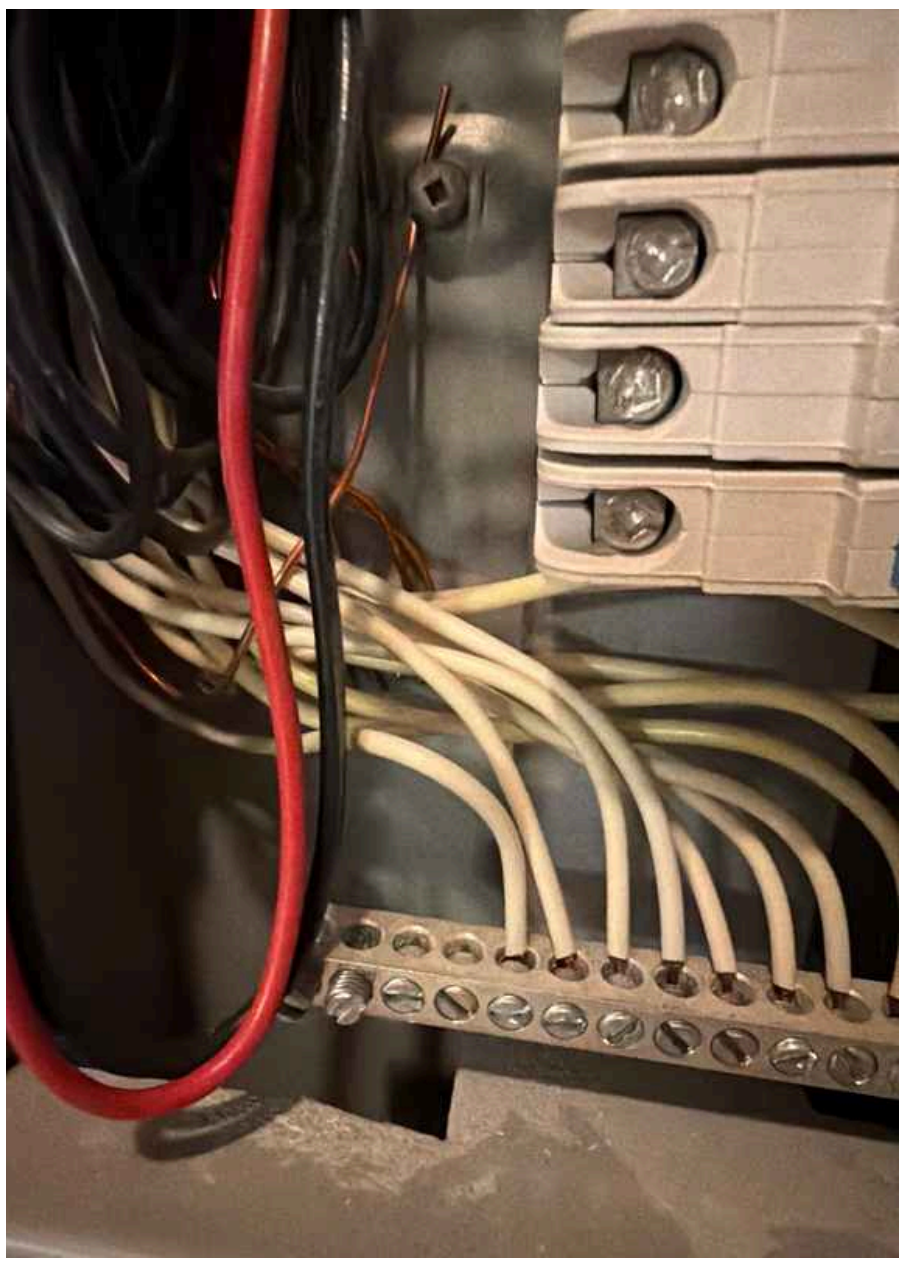

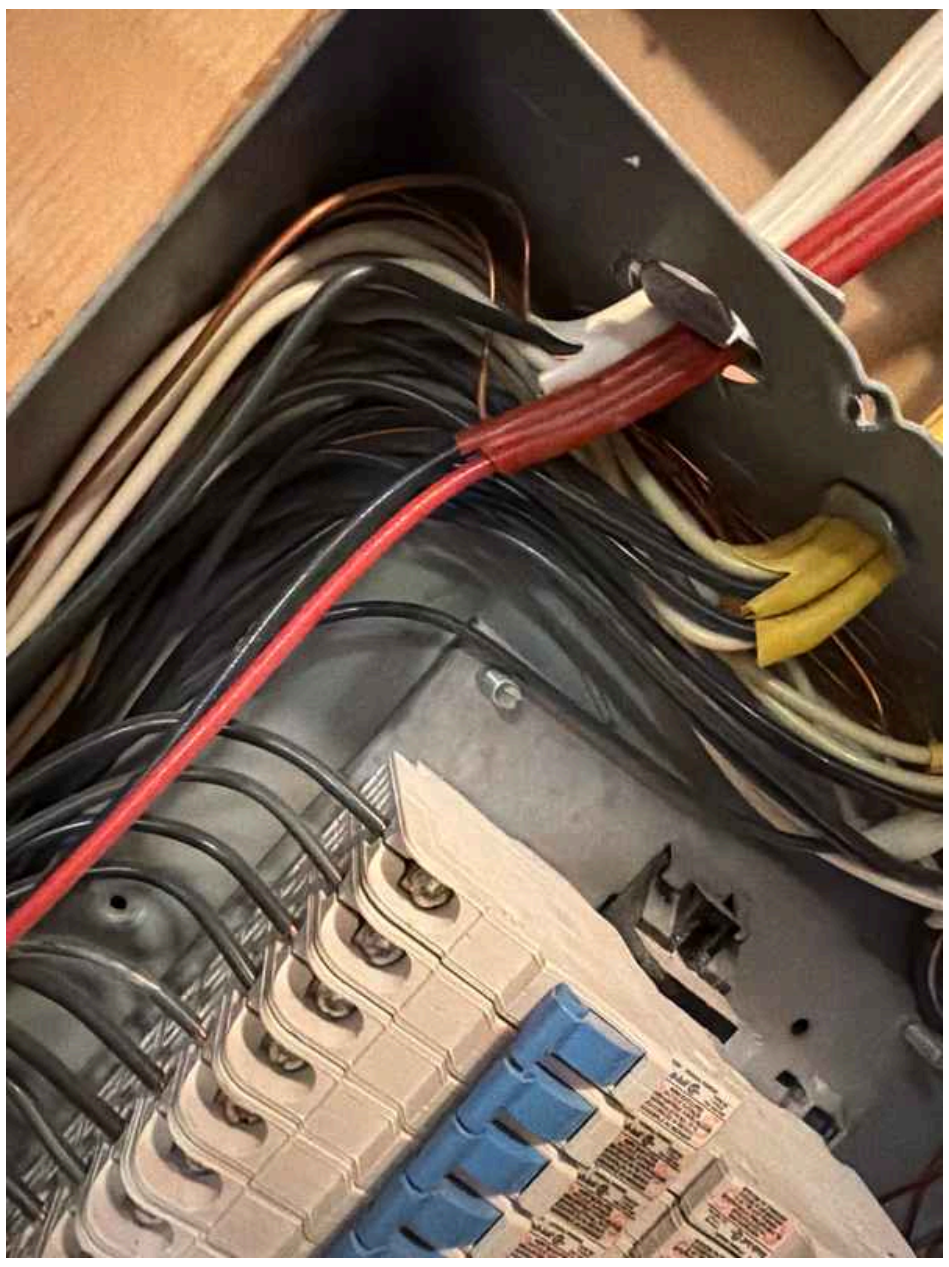

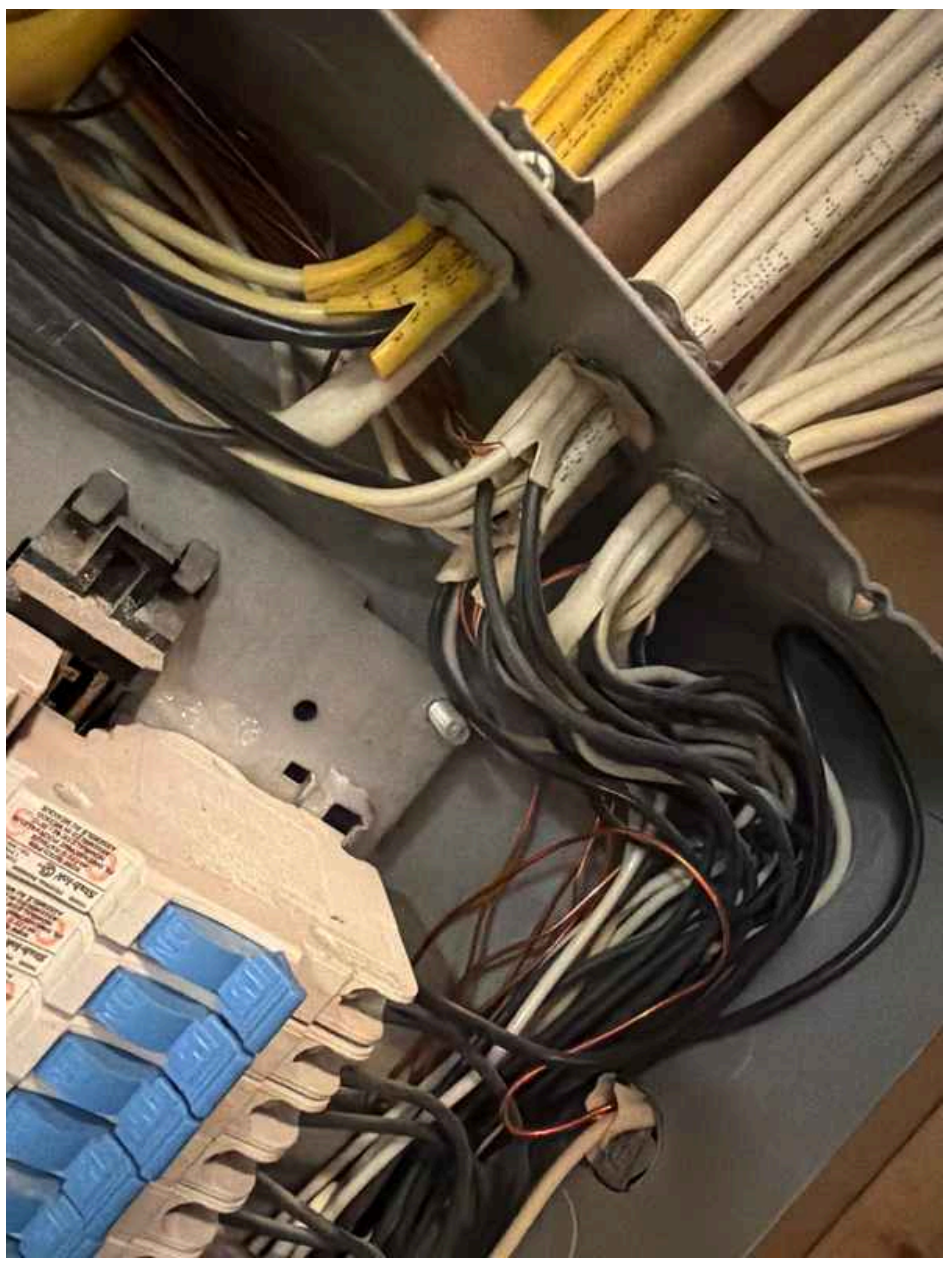

Branch Wiring Circuits, Breakers & Fuses: **Branch Wire 15 and 20 AMP**

Copper

Branch Wiring Circuits, Breakers & Fuses: **Wiring Method**

Not Visible, Romex

Fire smoke detectors CO detectors: Smoke and Carbon Monoxide Detectors Need Replacement

Smoke detectors and carbon monoxide detectors are present throughout the home but have reached or exceeded their manufacturer-recommended replacement dates according to the labels. These devices protect occupants from fire and gas hazards by providing early warning of dangerous conditions. Detectors typically require replacement every 5-10 years depending on type and manufacturer specifications to ensure reliable operation.

Deficiencies

7.2.1 Main & Subpanels, Service & Grounding, Main Overcurrent Device

NO LEGEND ON MAIN PANEL

Recommendation

The main electrical panels lack legends or labeling systems identifying which circuit control which areas of the home. Without proper circuit identification, it becomes difficult to locate and isolate specific circuits during maintenance, troubleshooting, or emergencies. A qualified electrician should create a comprehensive circuit map and affix it to the inside of the panel door for future reference and safety.

Recommendation

Contact a qualified professional.

8: FIREPLACE

Information

Type
Gas



9: ATTIC, INSULATION & VENTILATION

Information

Dryer Vent
Unknown

Flooring Insulation
No visible

Attic Access and Visibility

Attic

The attic was inspected through the access hatch, allowing visual observation of the attic space from that vantage point. This method provides a view of the attic structure, insulation, ventilation, and framing but may limit the ability to inspect all areas of the attic, particularly sections that are not visible from the hatch opening or that are obstructed by stored items, ductwork, or other components.


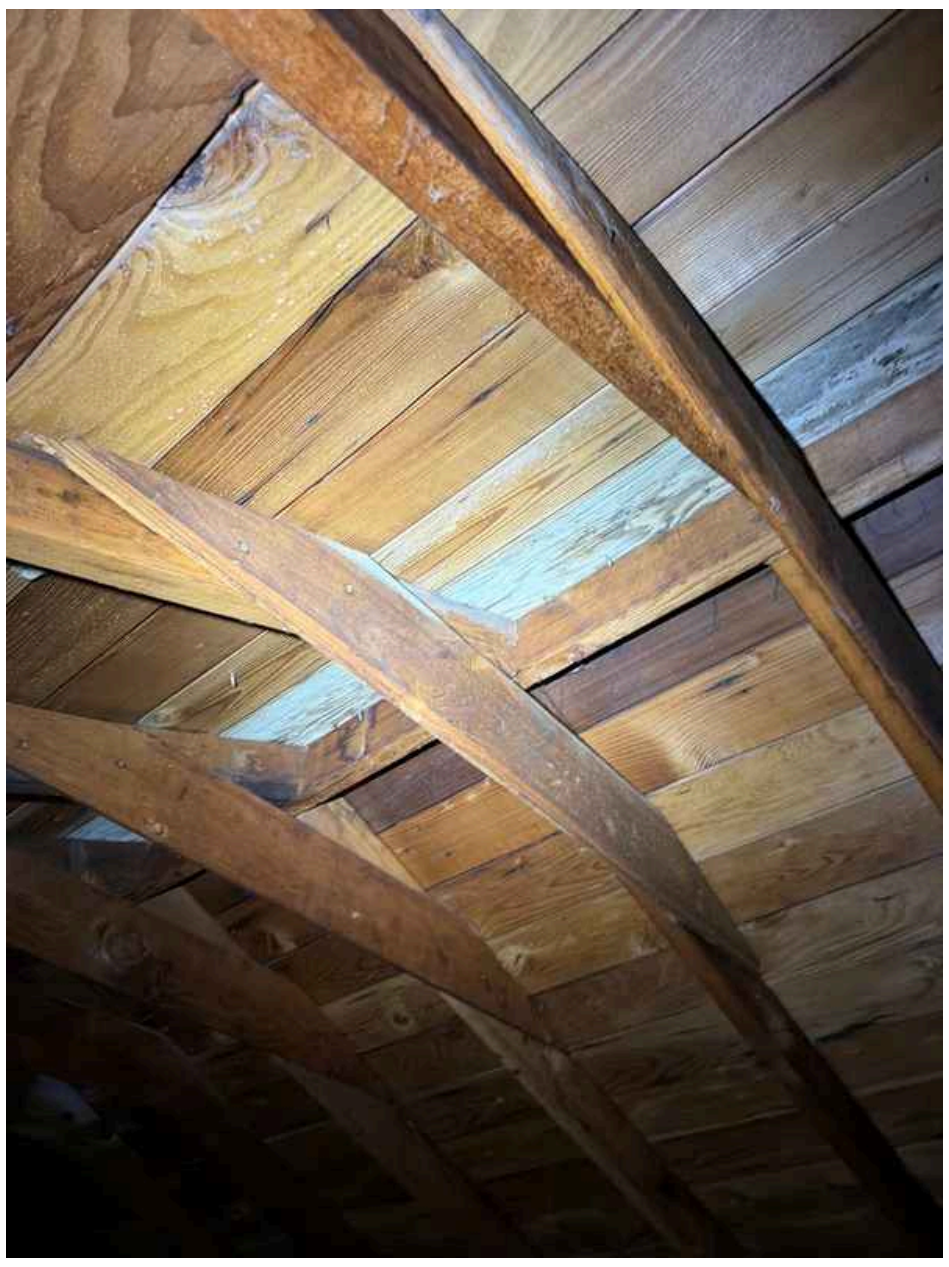







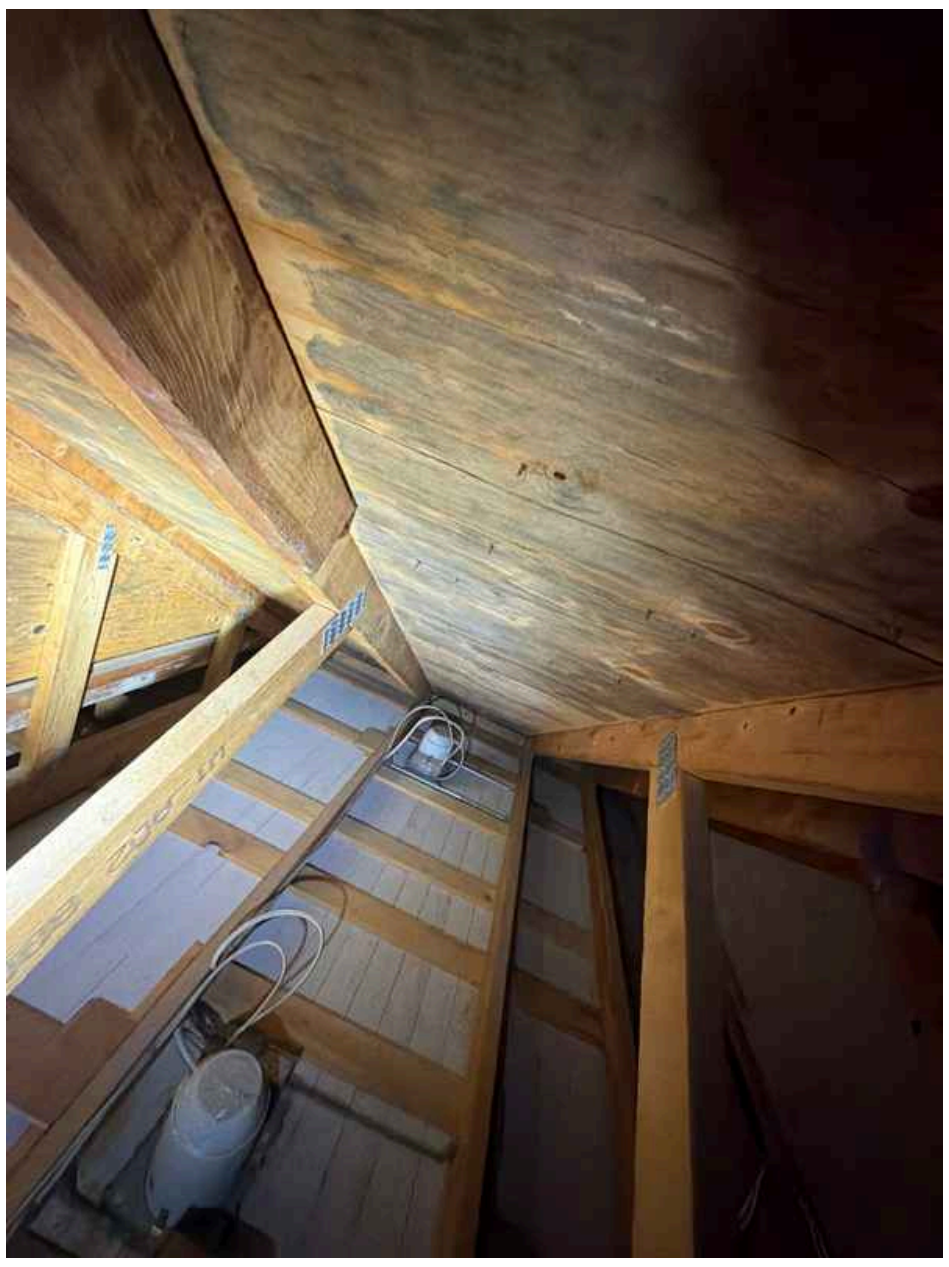
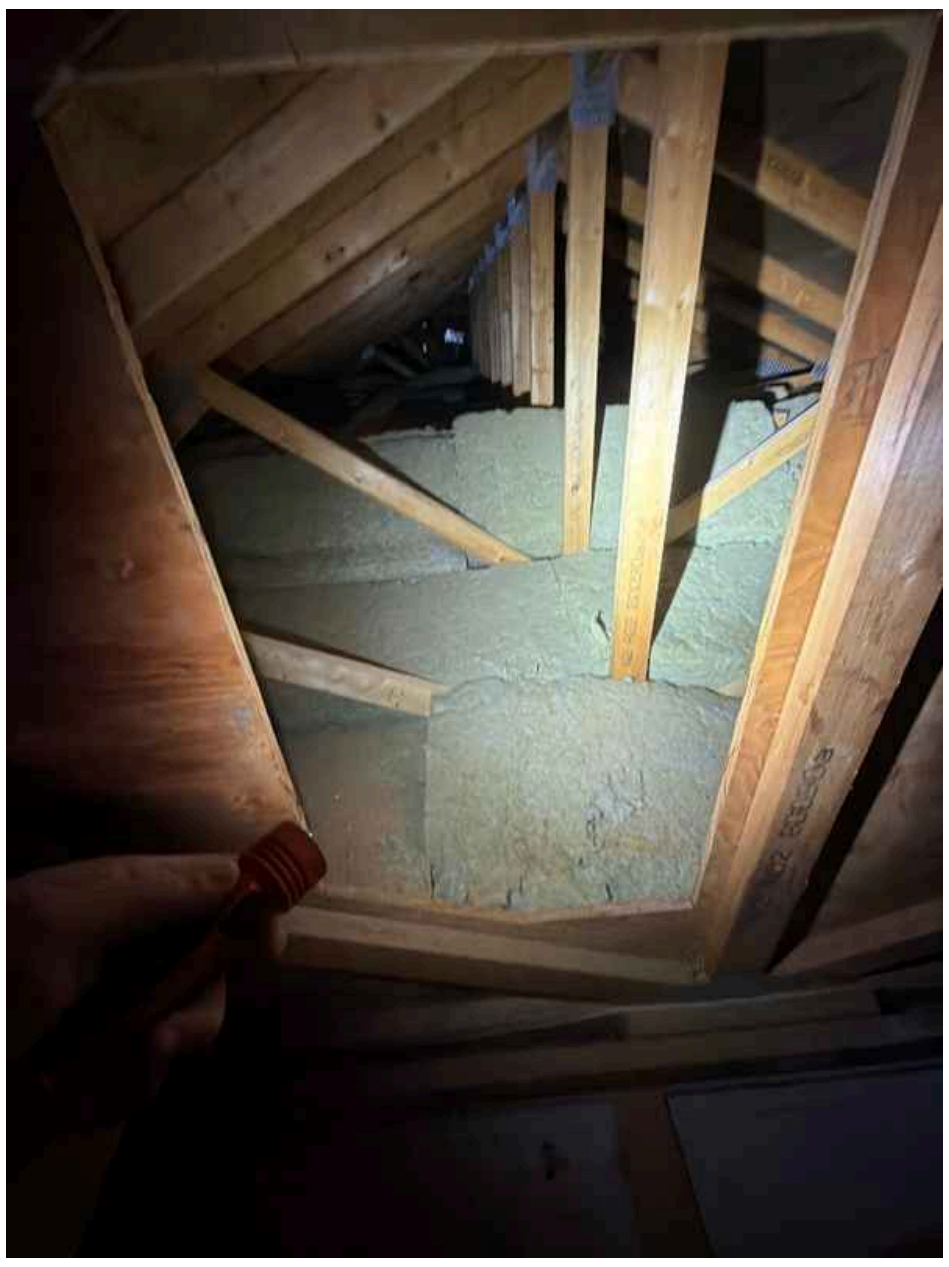


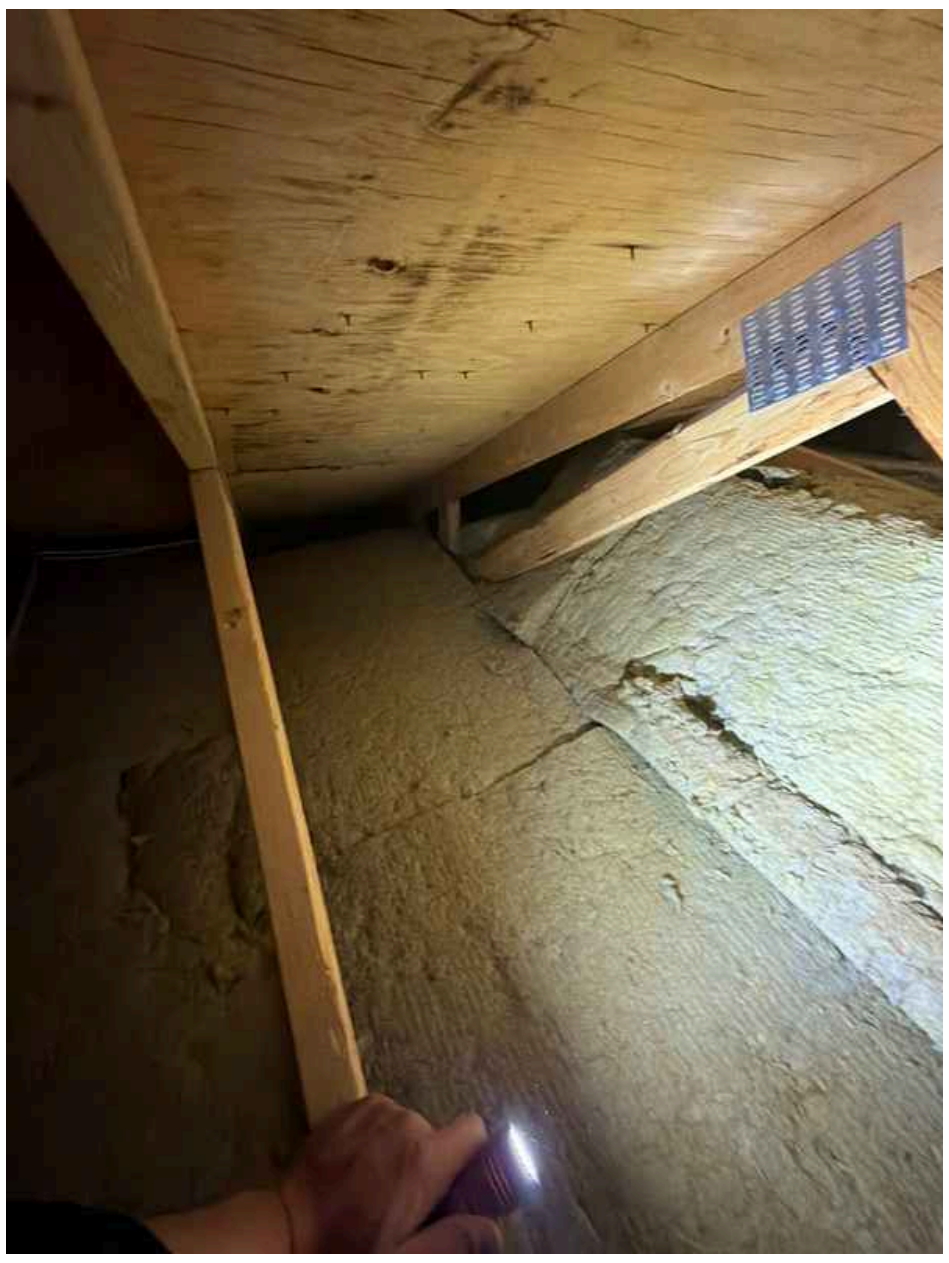

Attic Insulation: **Insulation Type**

Blown

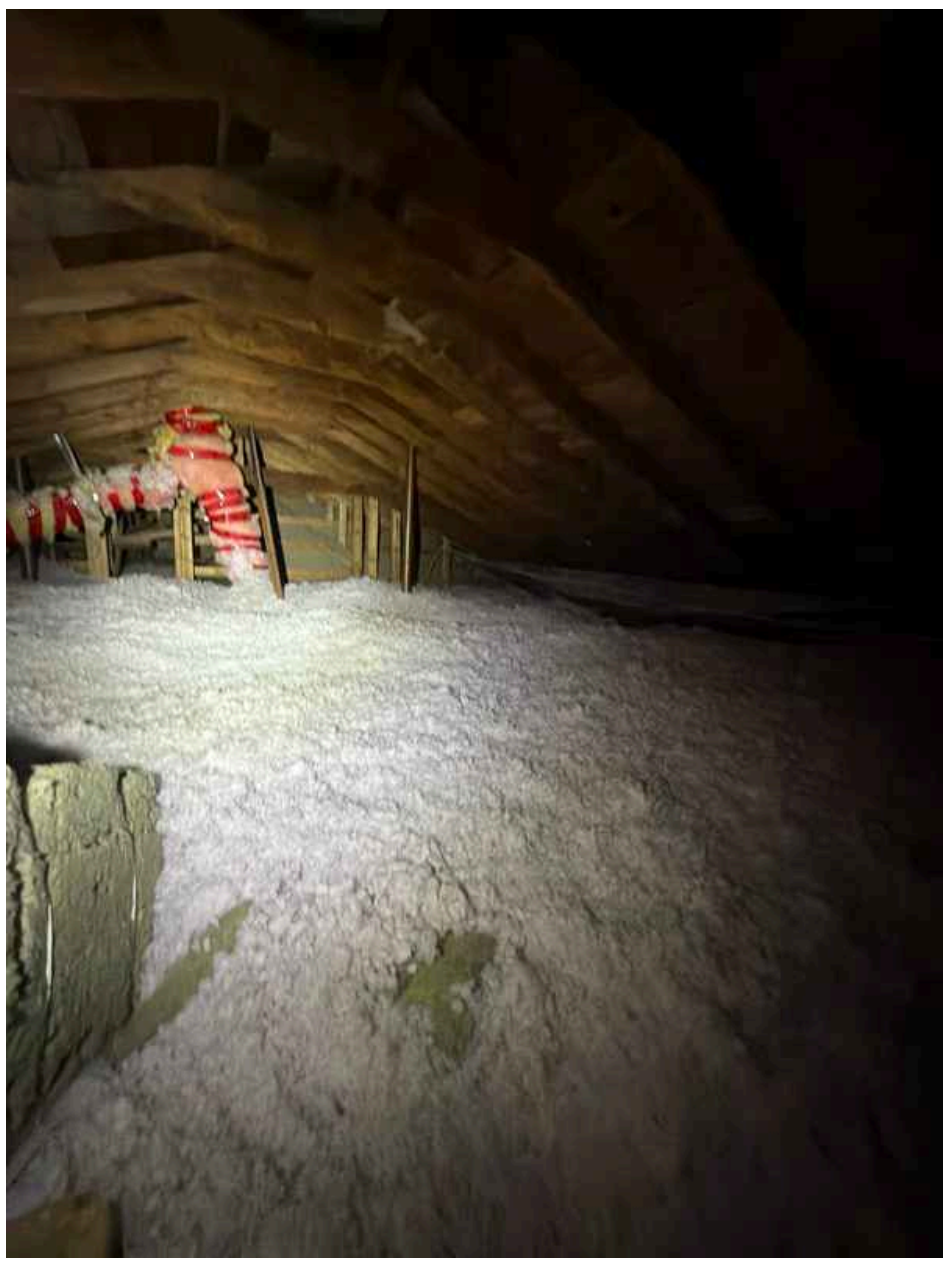

Ventilation: **Ventilation Type**

Soffit Vents

Exhaust Systems: **Exhaust Fans**

Fan Only, Fan with Light, Makeup air unit

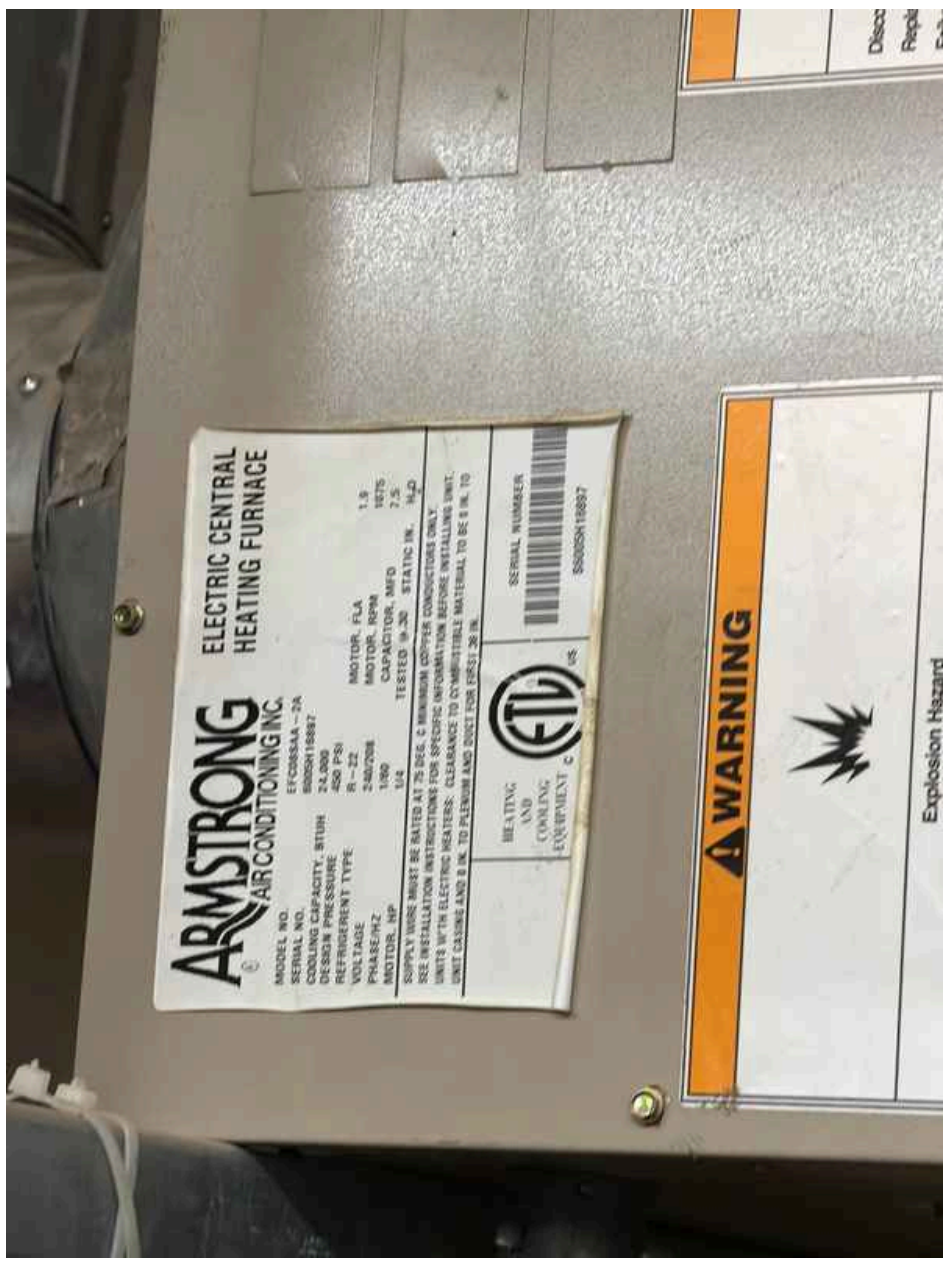

Limitations

Attic Insulation

ATTIC INSULATION INSPECTION LIMITED

ATTIC

The attic insulation could not be fully inspected during this evaluation. Limited visibility, restricted access, or obstructed areas prevented a complete assessment of insulation coverage, condition, and R-value adequacy throughout the attic space.



Deficiencies

9.4.1 Exhaust Systems

Recommendation

WEAK BATHROOM EXHAUST FAN

BATHROOM

The bathroom exhaust fan is operating at reduced capacity. Weak exhaust performance can lead to inadequate moisture removal, potentially causing humidity buildup, mold growth, and structural damage over time. The fan should be inspected for blockages, duct obstructions, or motor degradation, and cleaned or replaced as needed.

Recommendation

Contact a qualified professional.

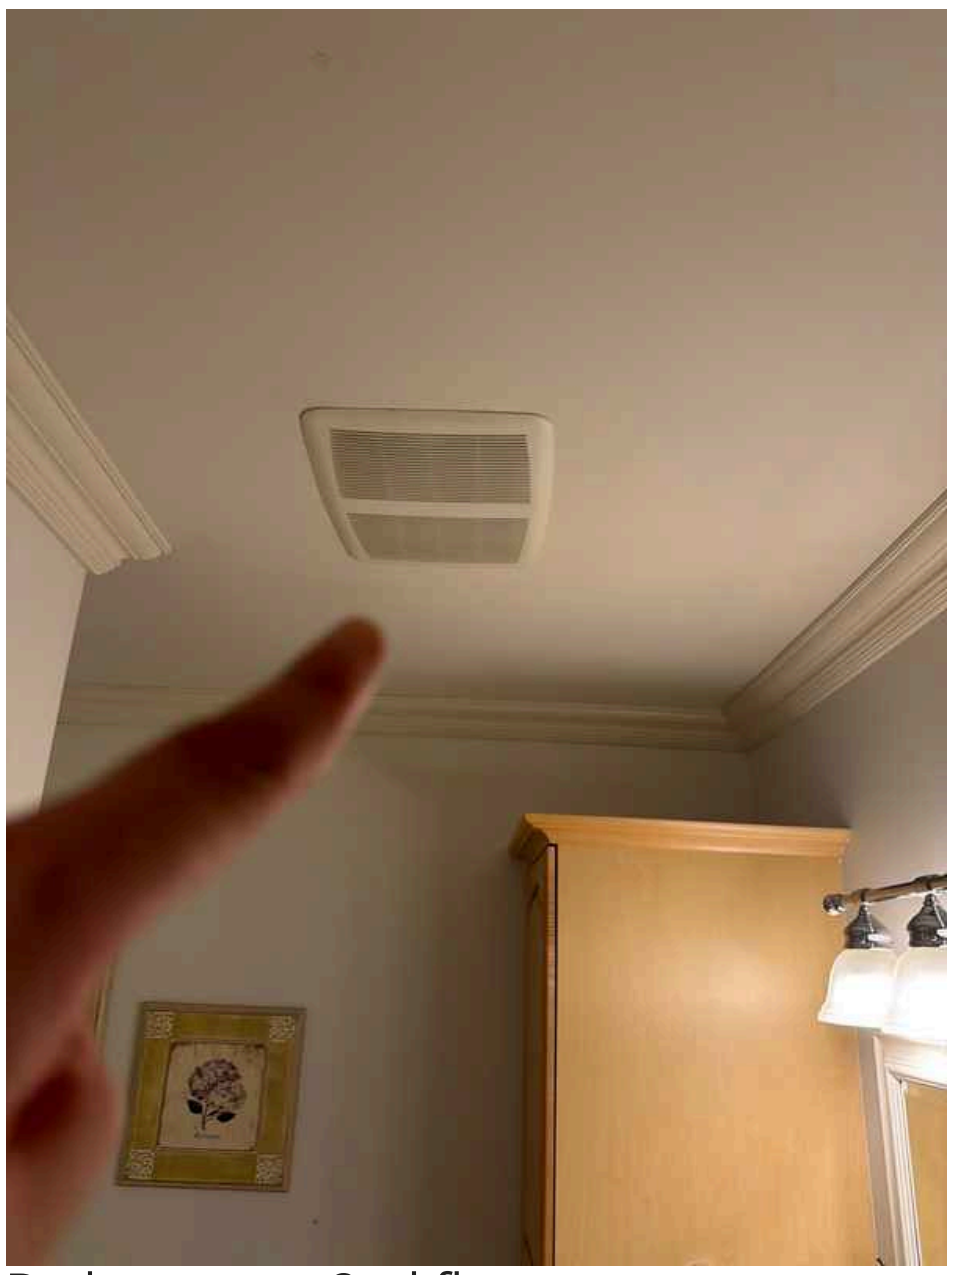
Bathroom on 2nd floor

10: DOORS, WINDOWS & INTERIOR

Information

Interior Views

The interior of the property provides visibility into the layout, finishes, and general condition of living spaces. Interior views during inspection help assess the overall maintenance level, functionality of systems and components, and any visible defects or concerns affecting the home's habitability and value.


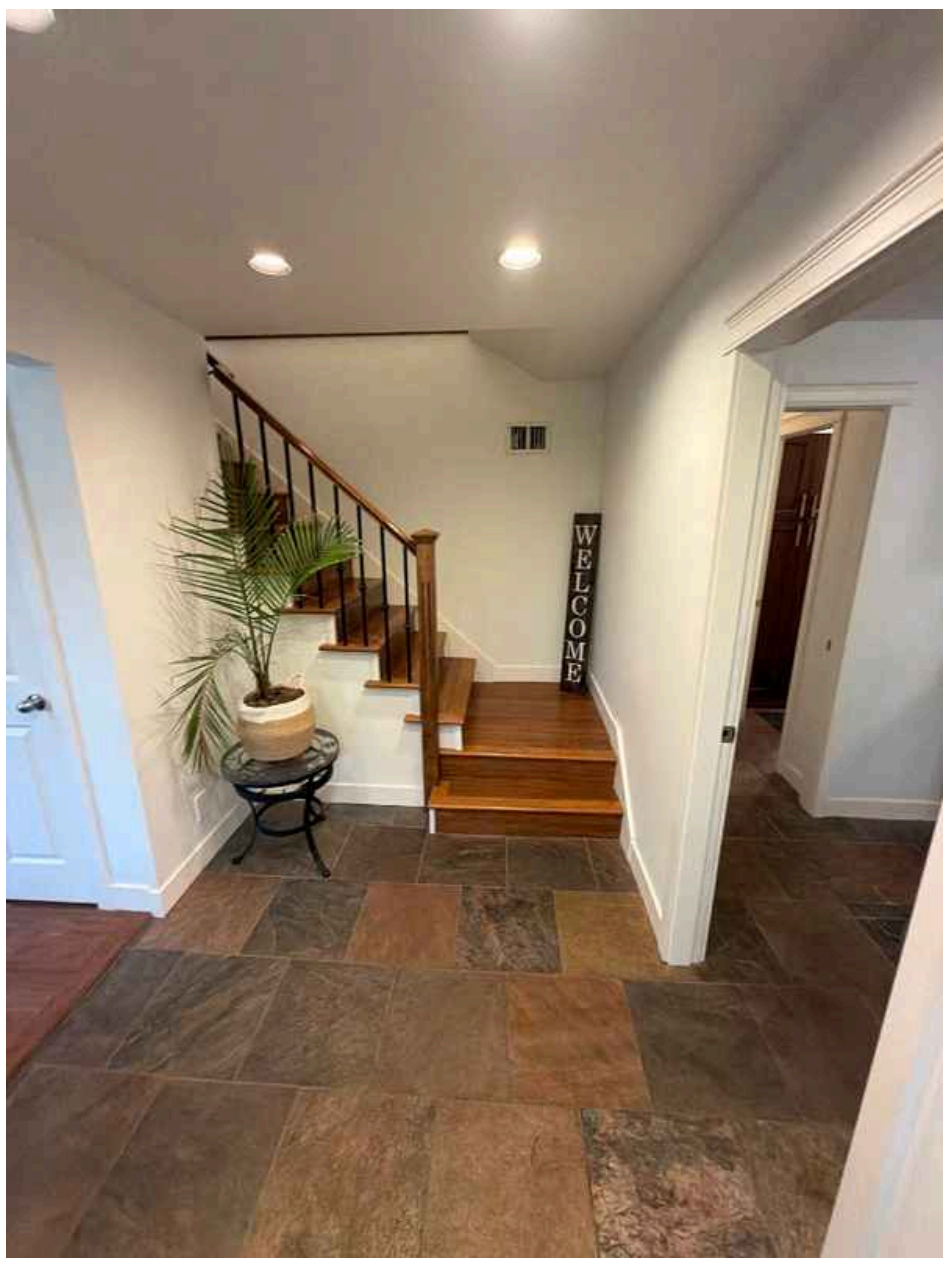






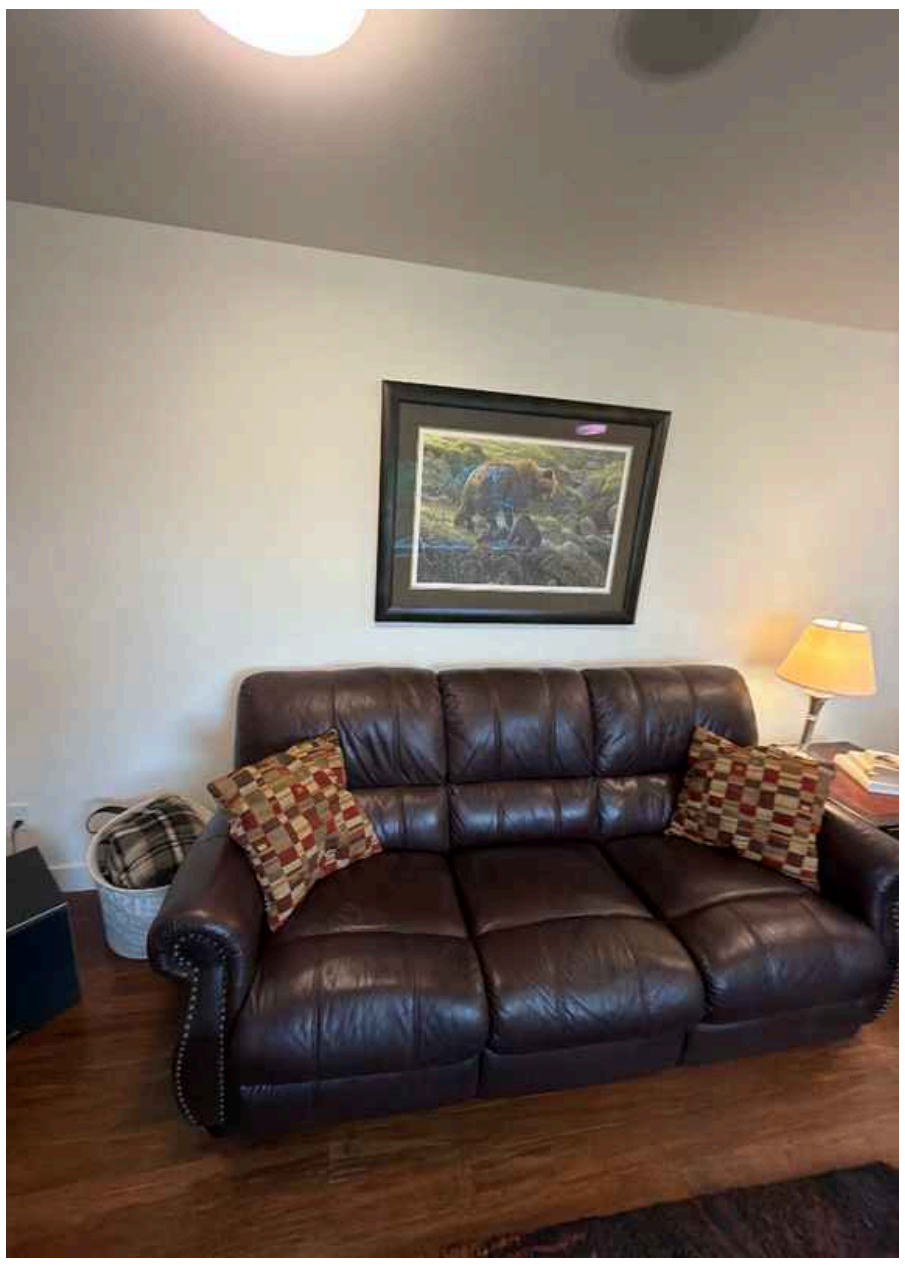
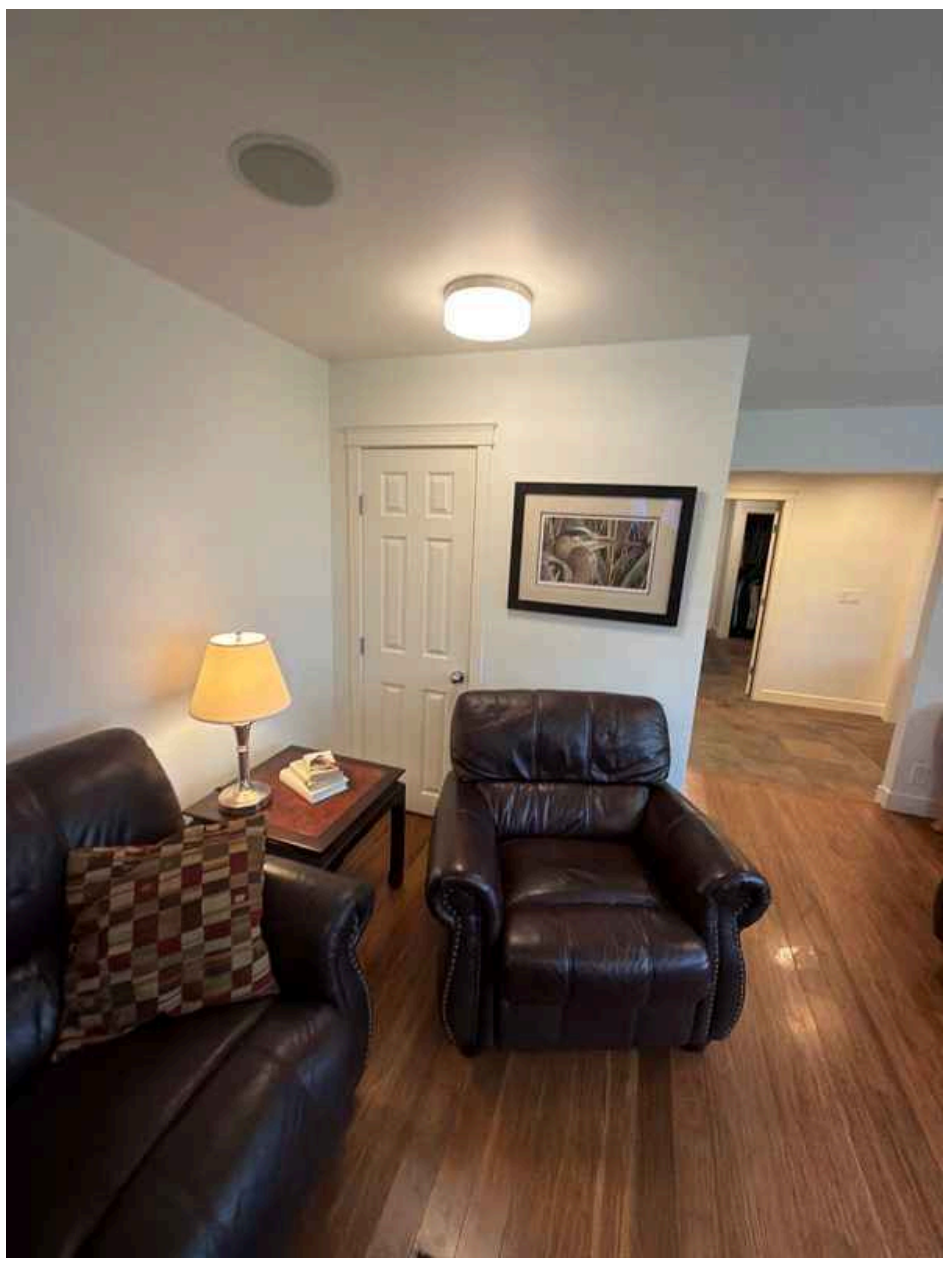
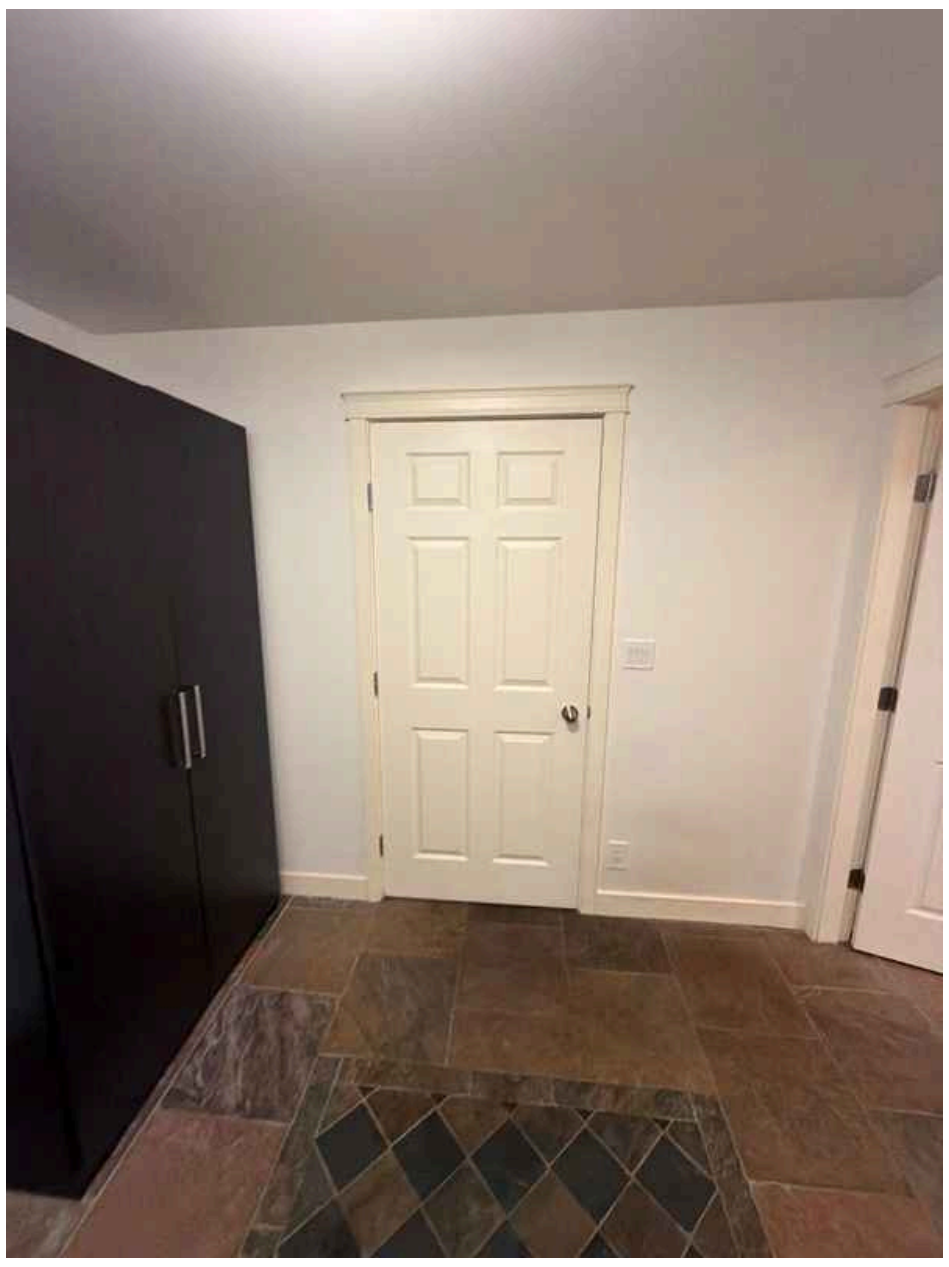
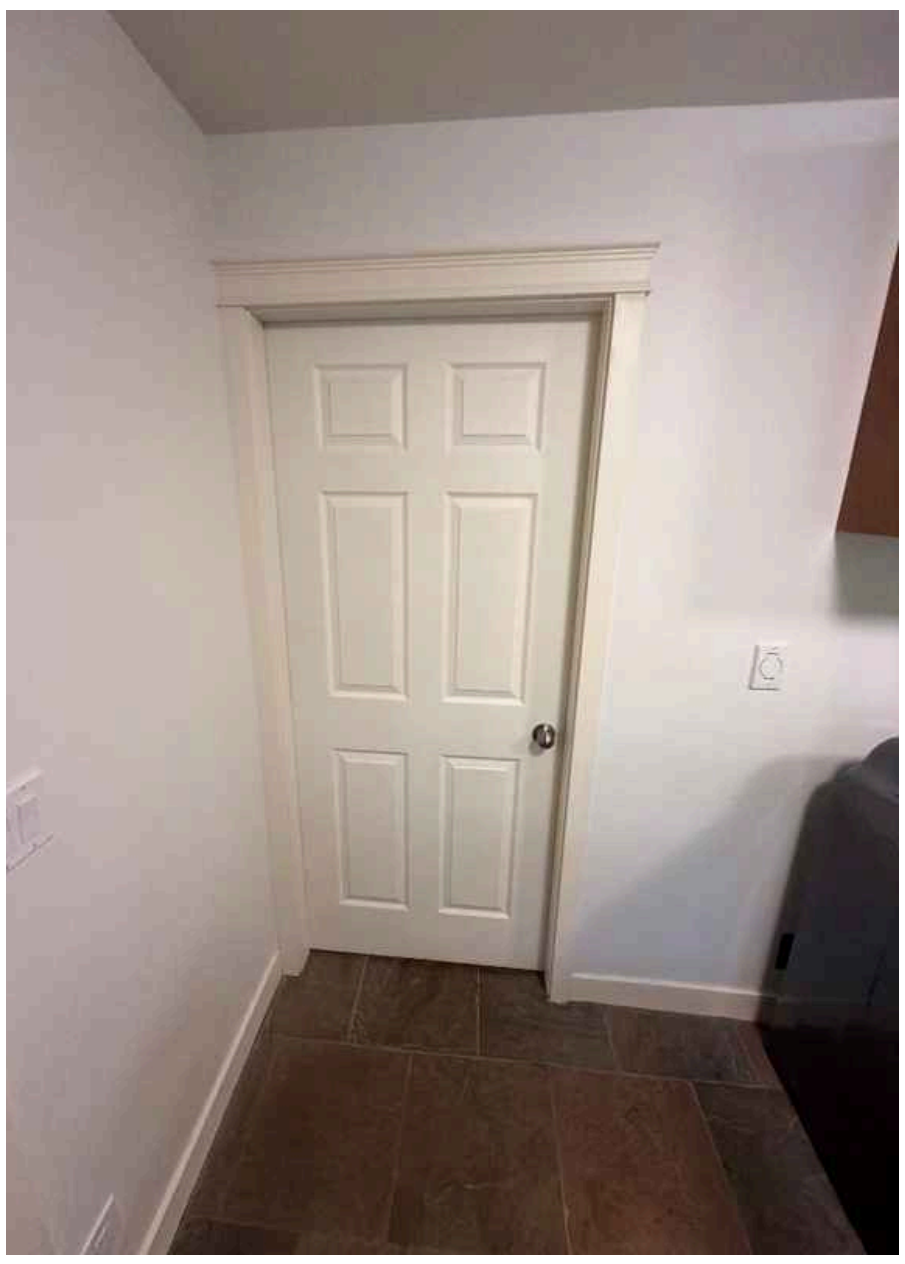
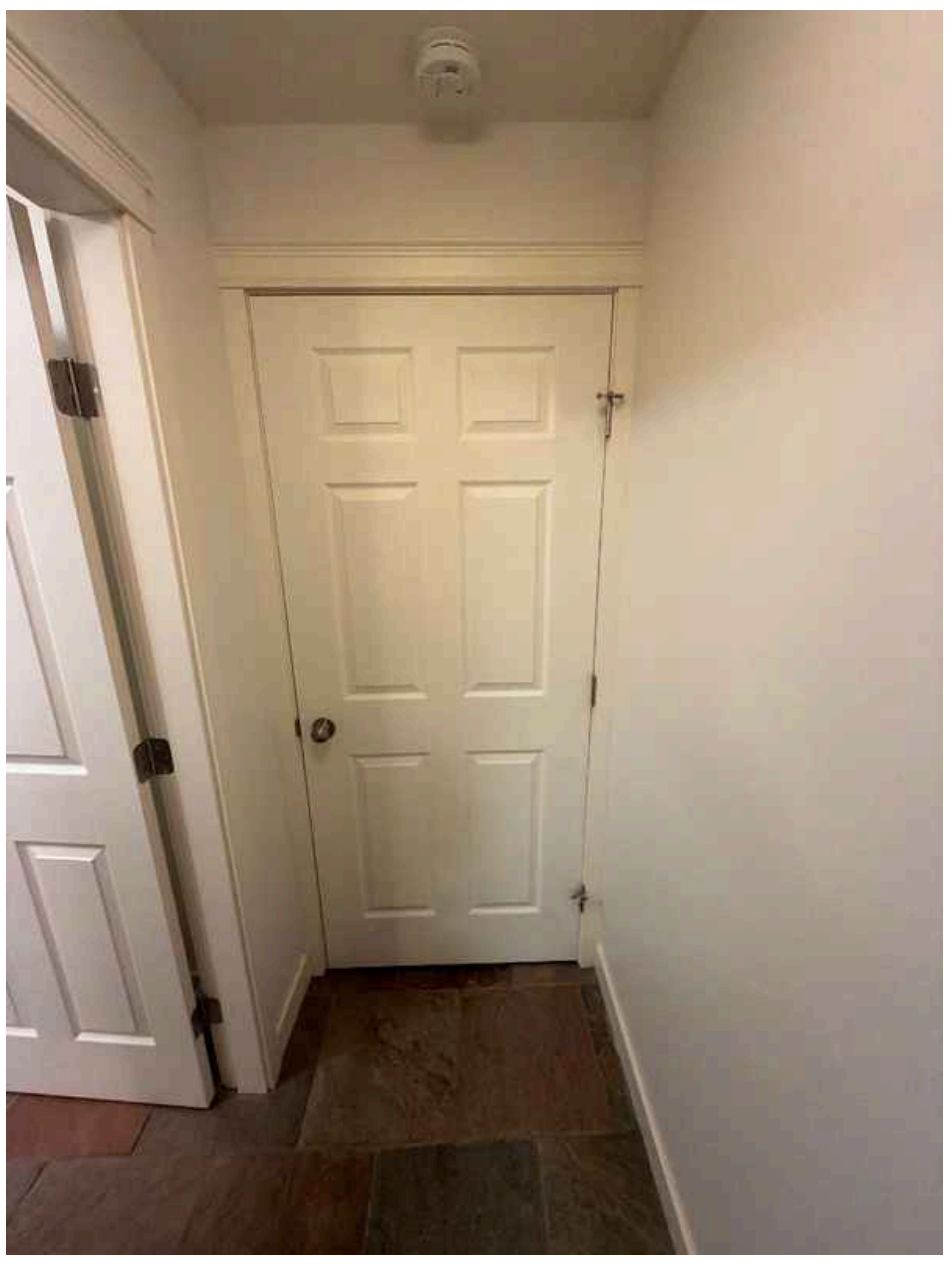
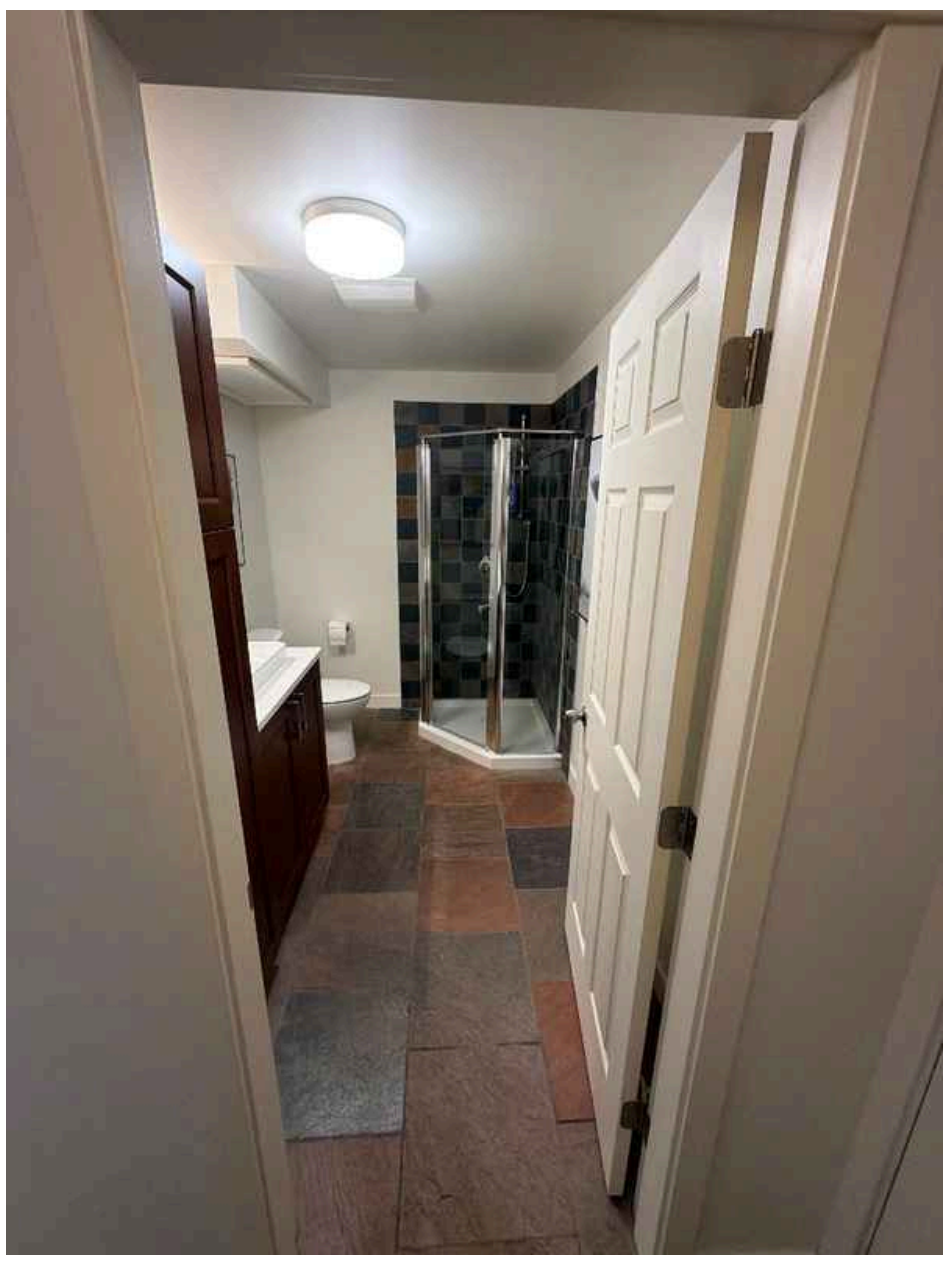



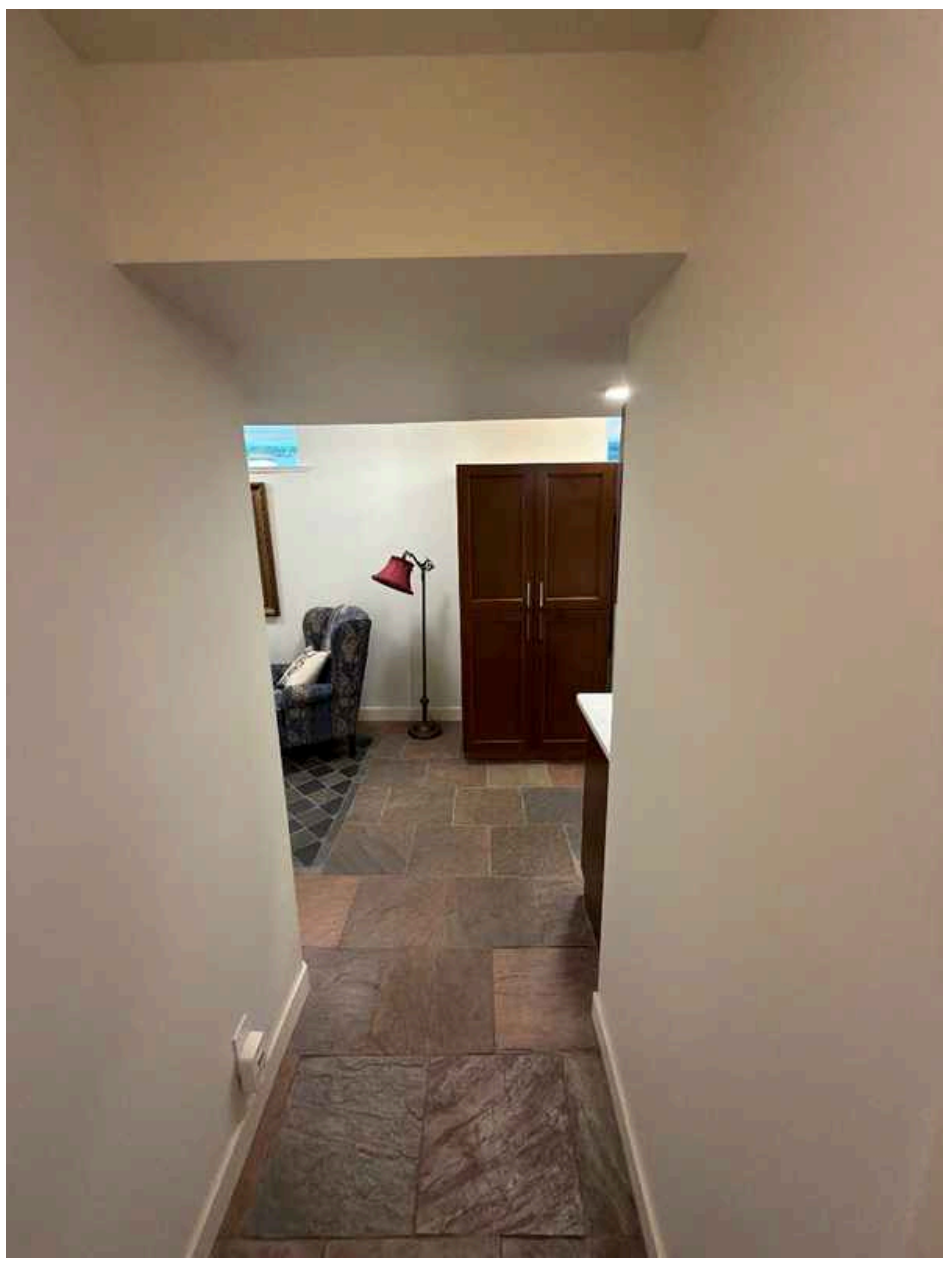




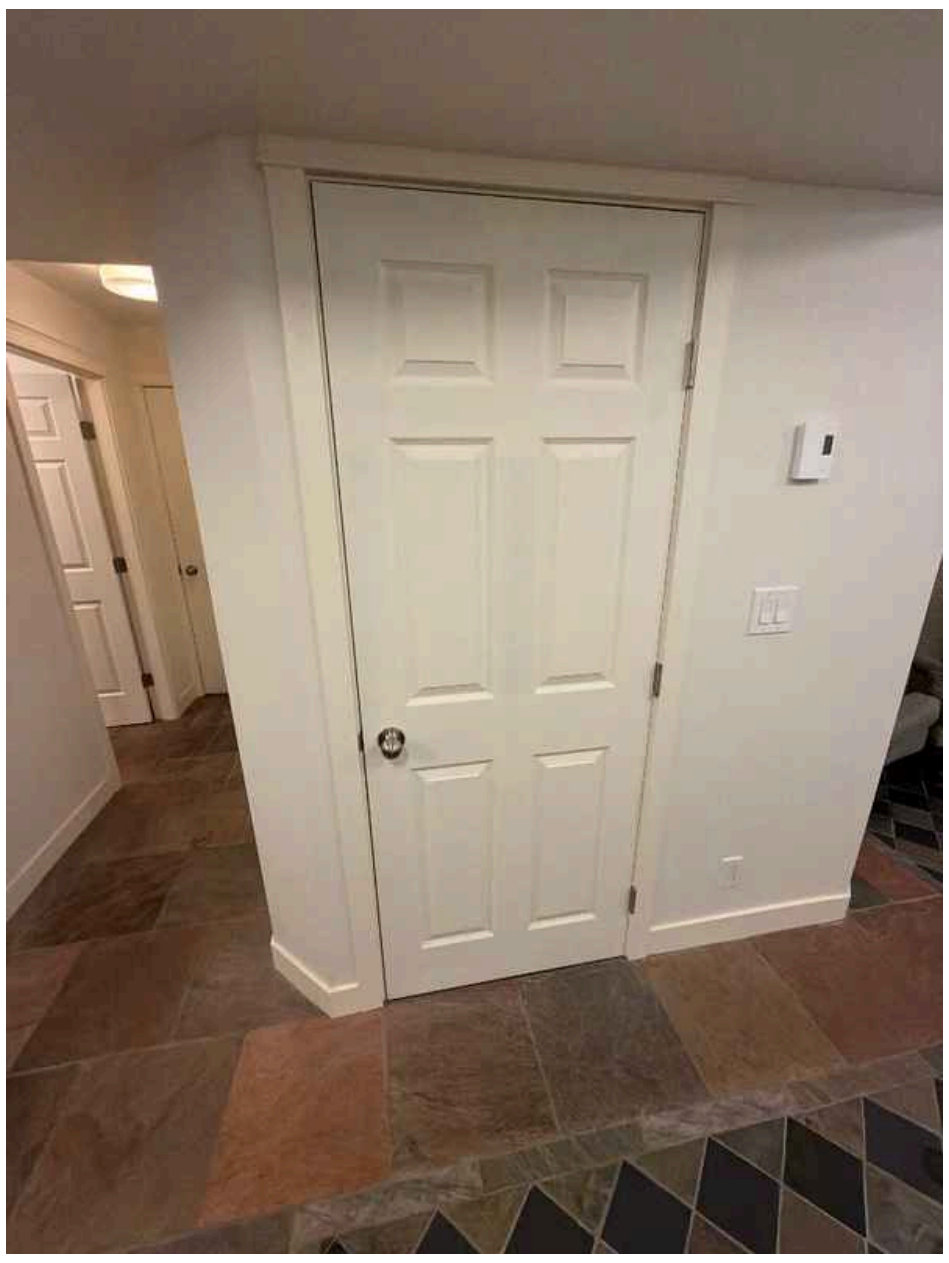




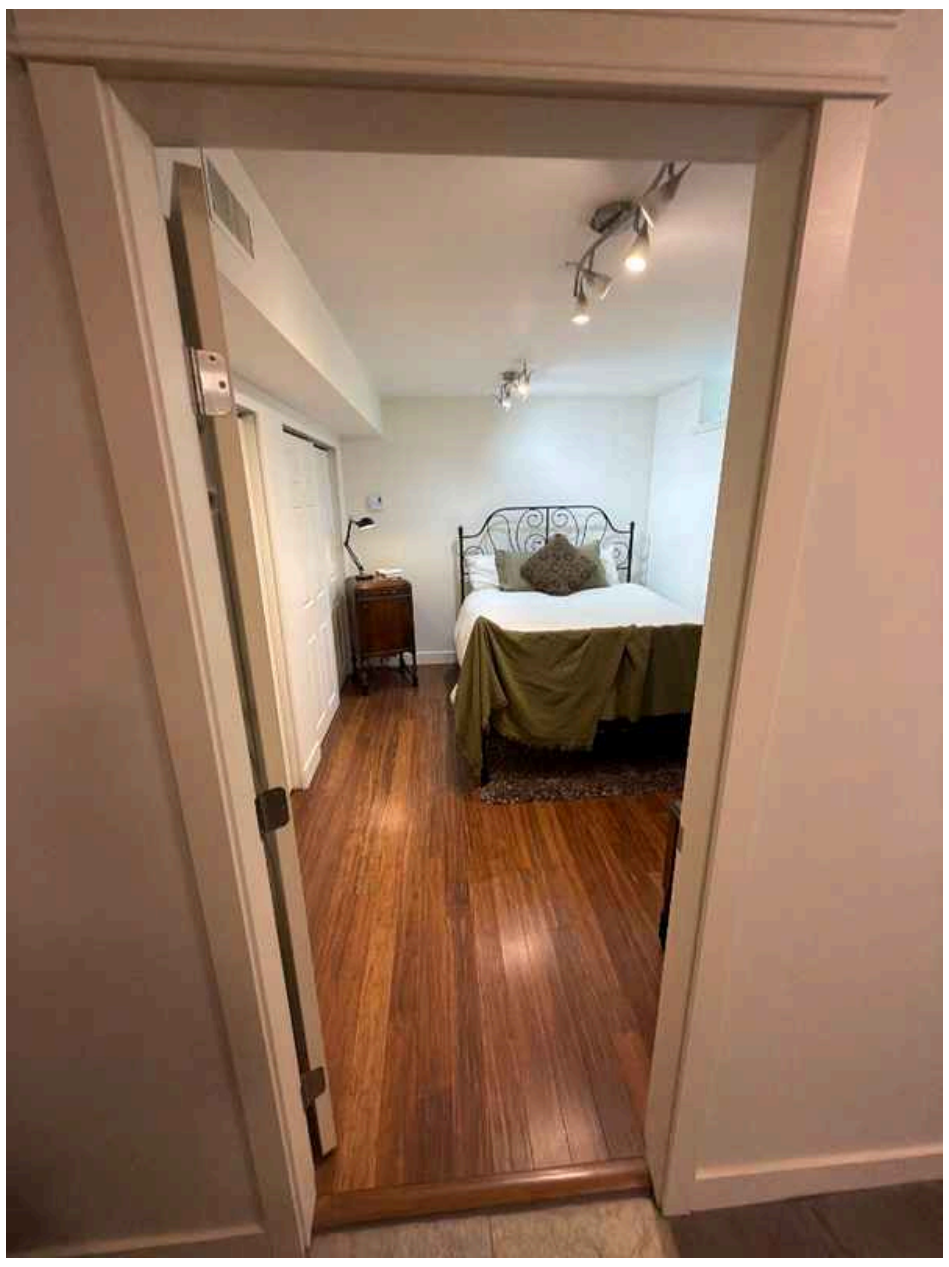
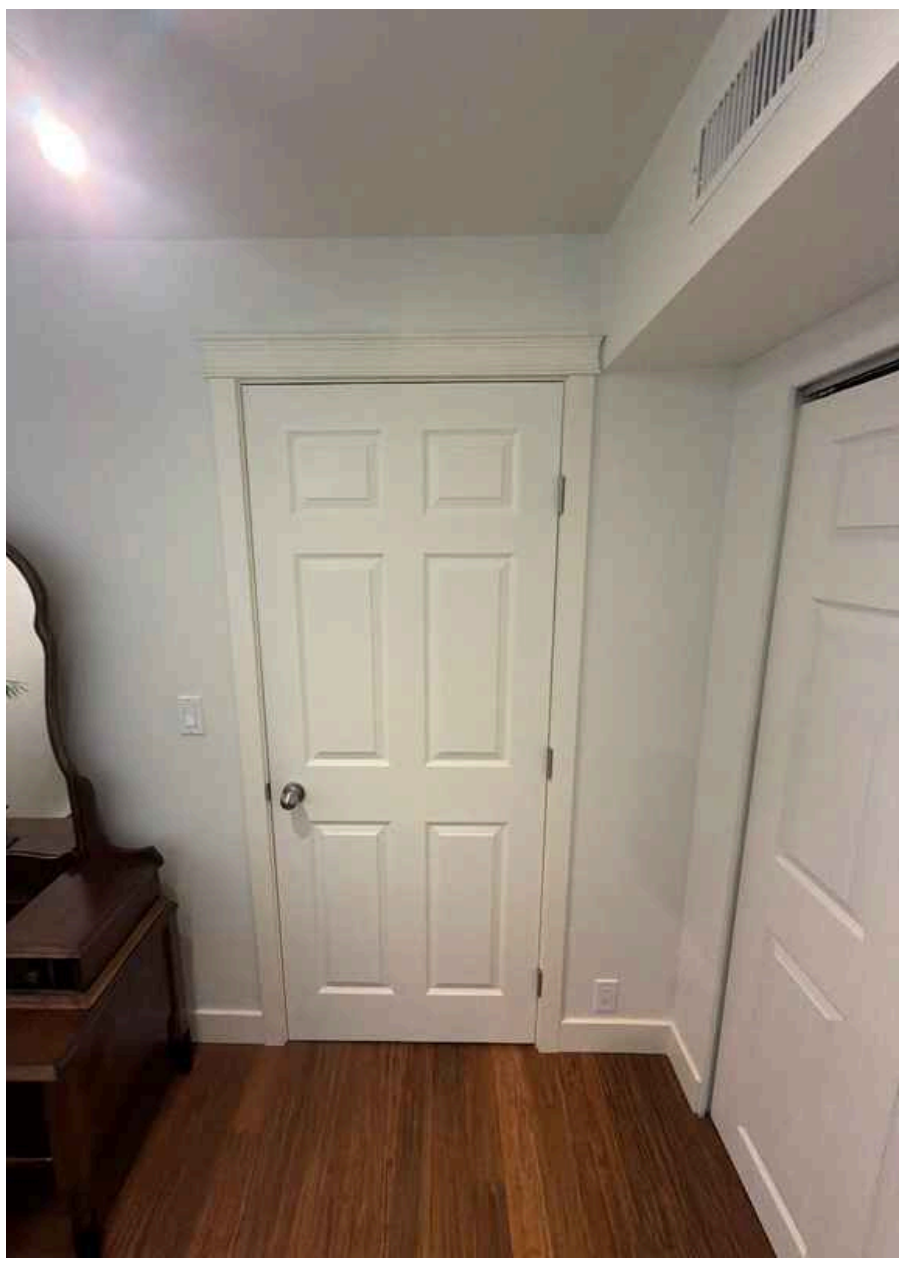
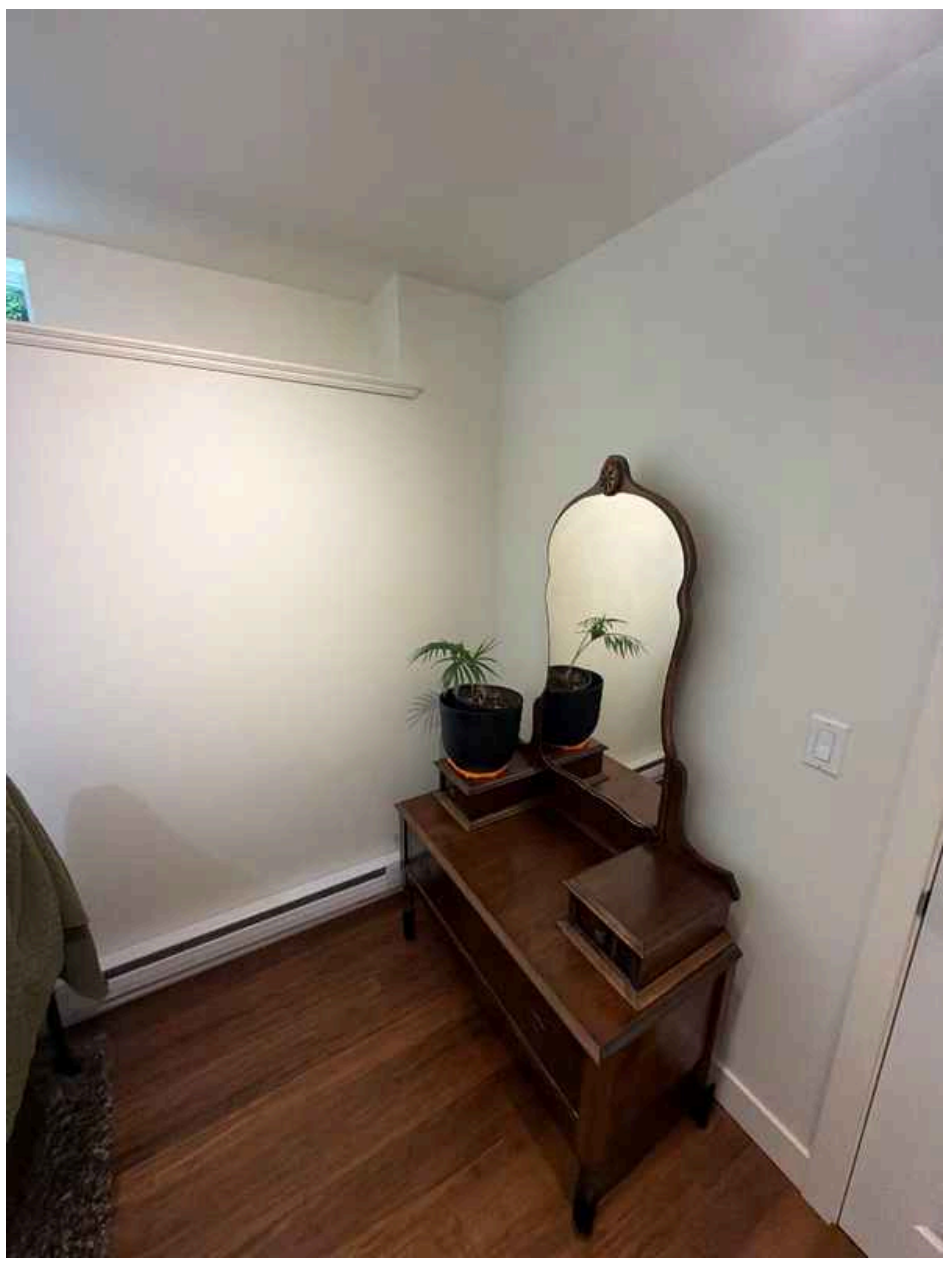
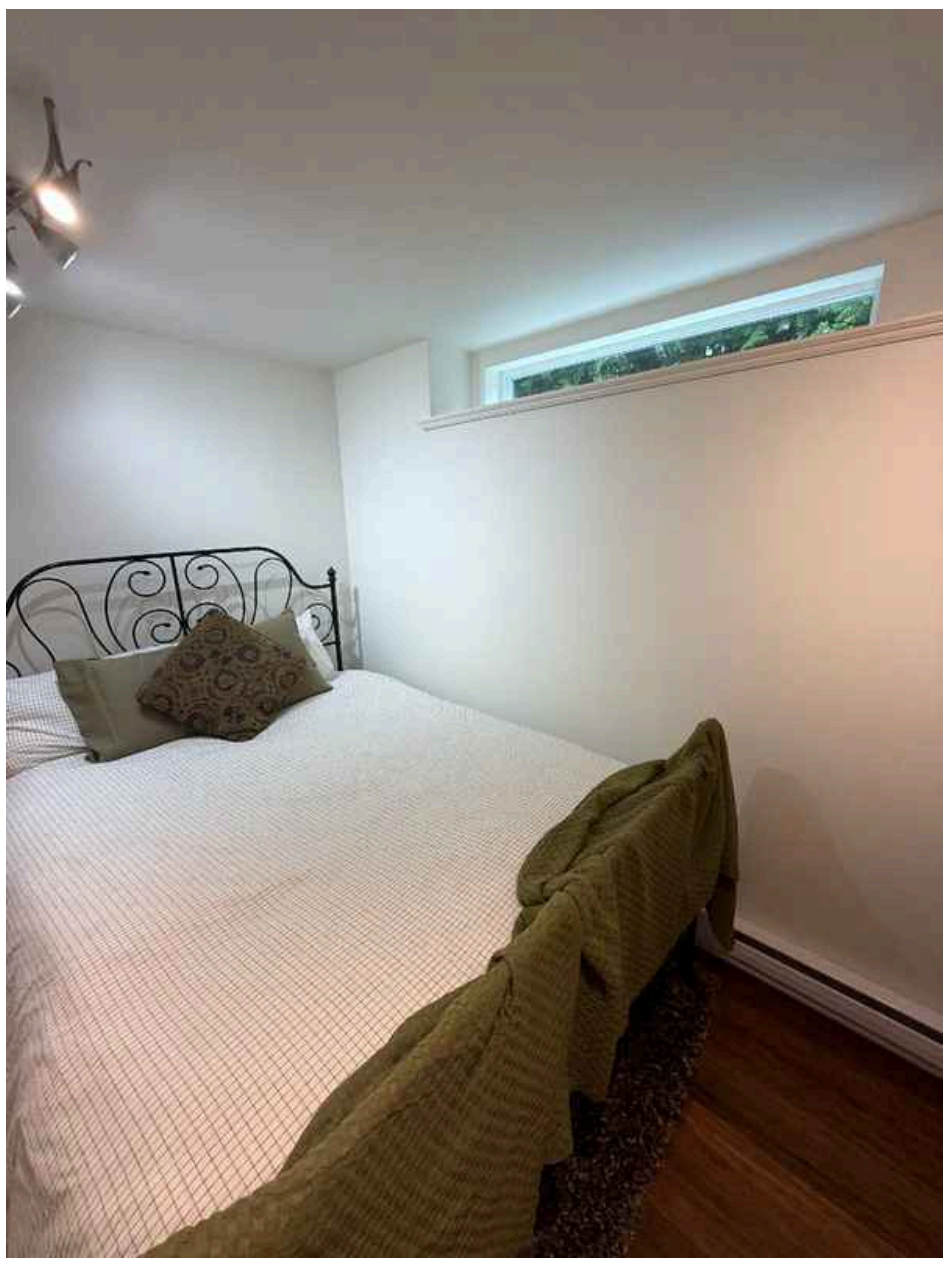
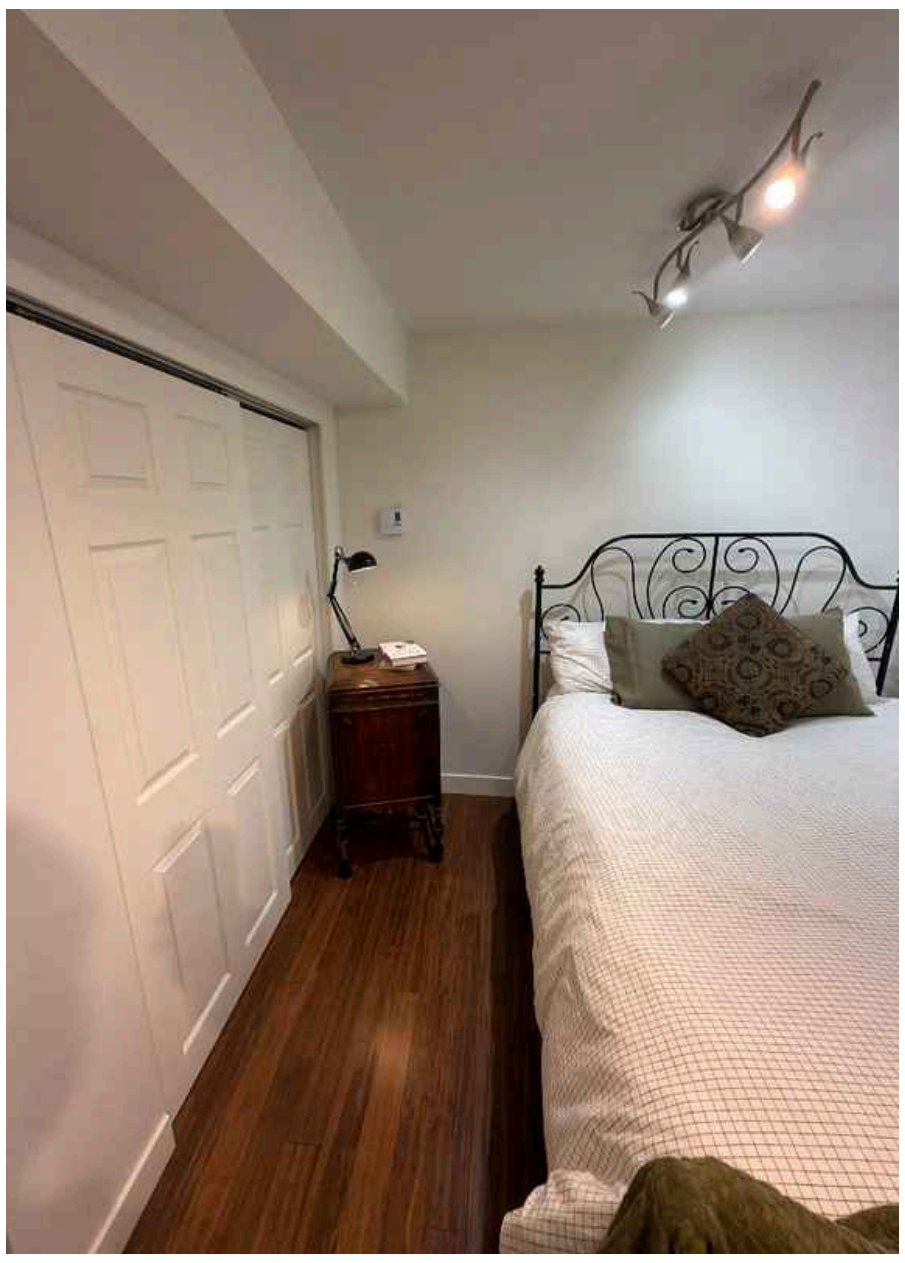
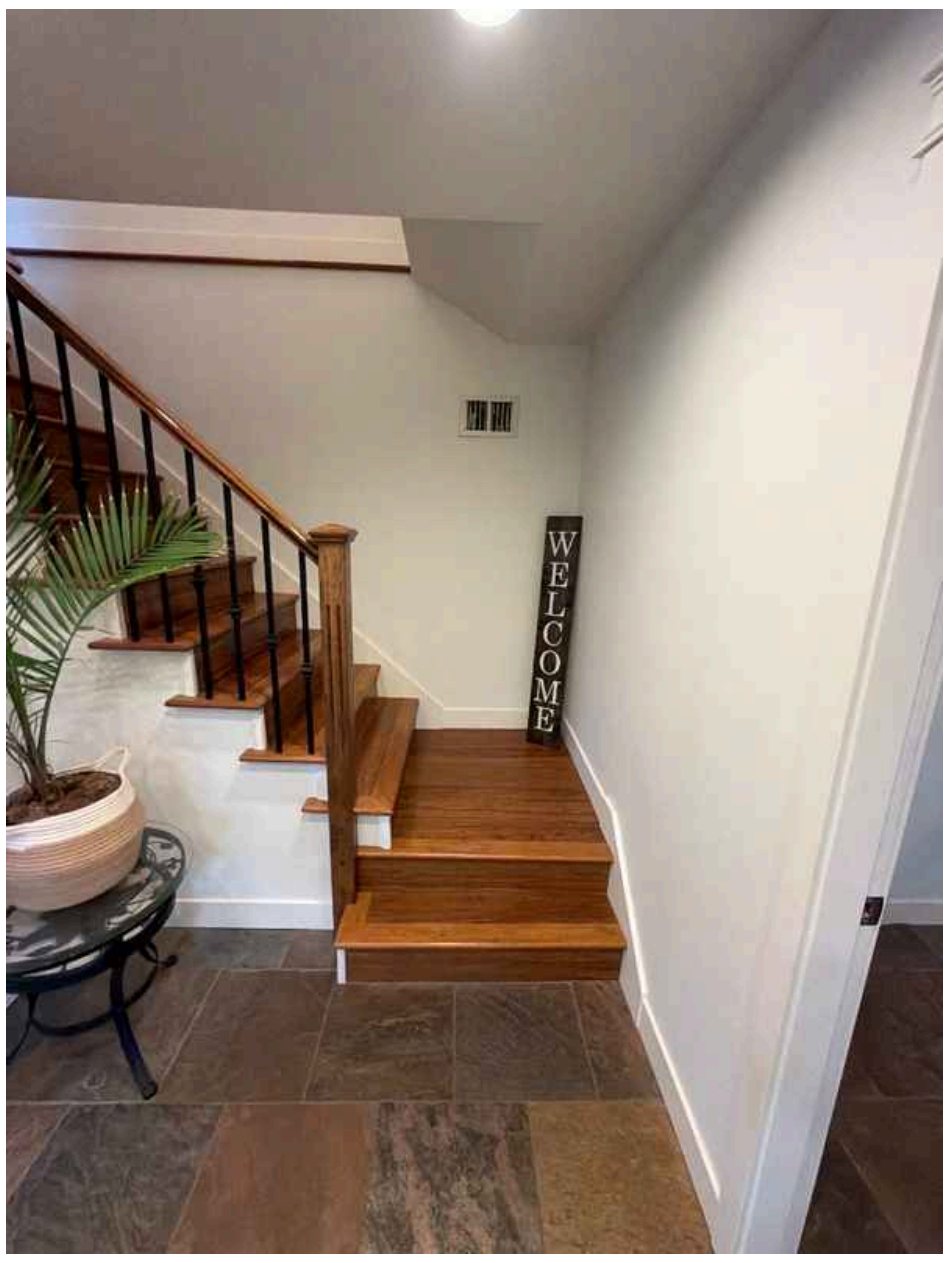
WELCOME


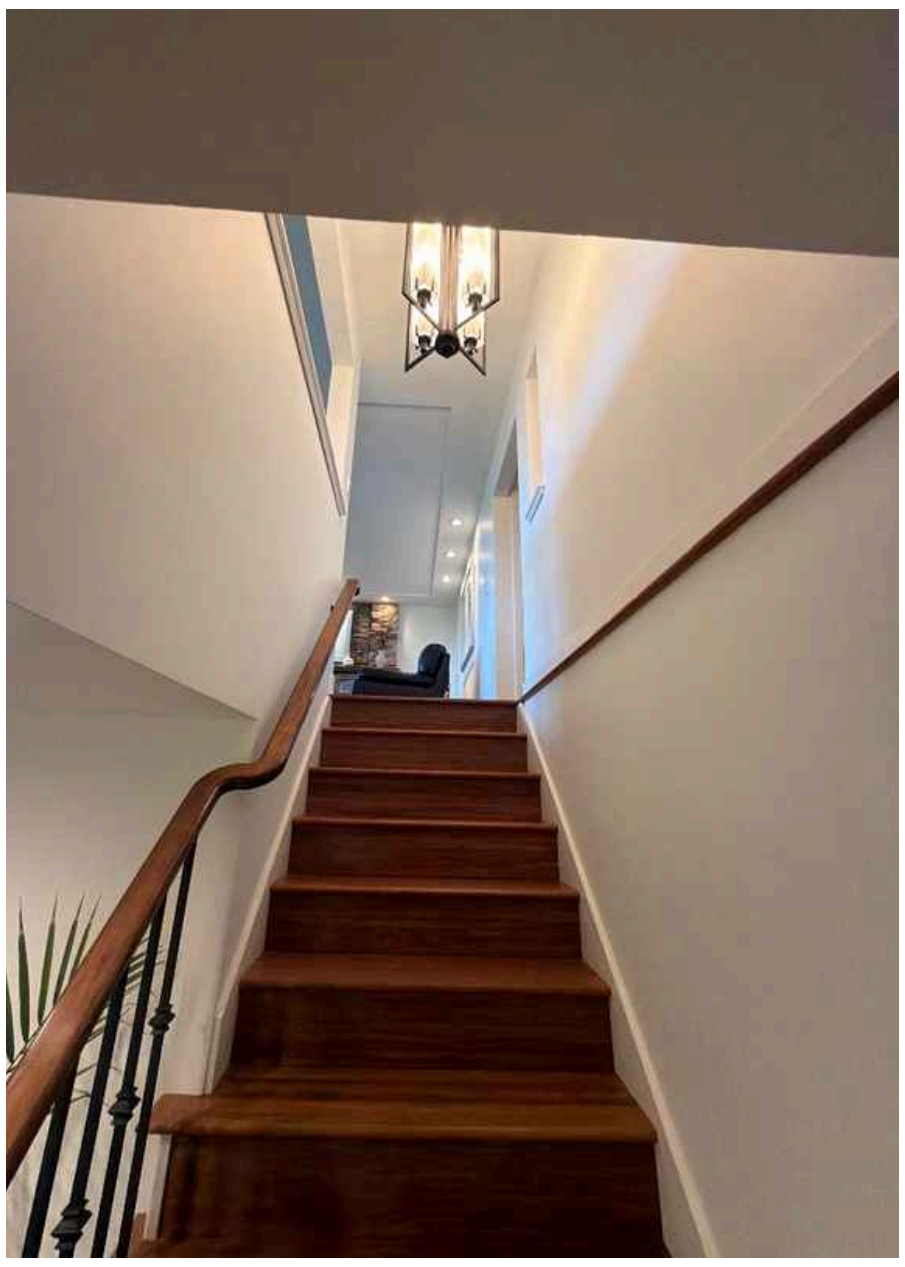
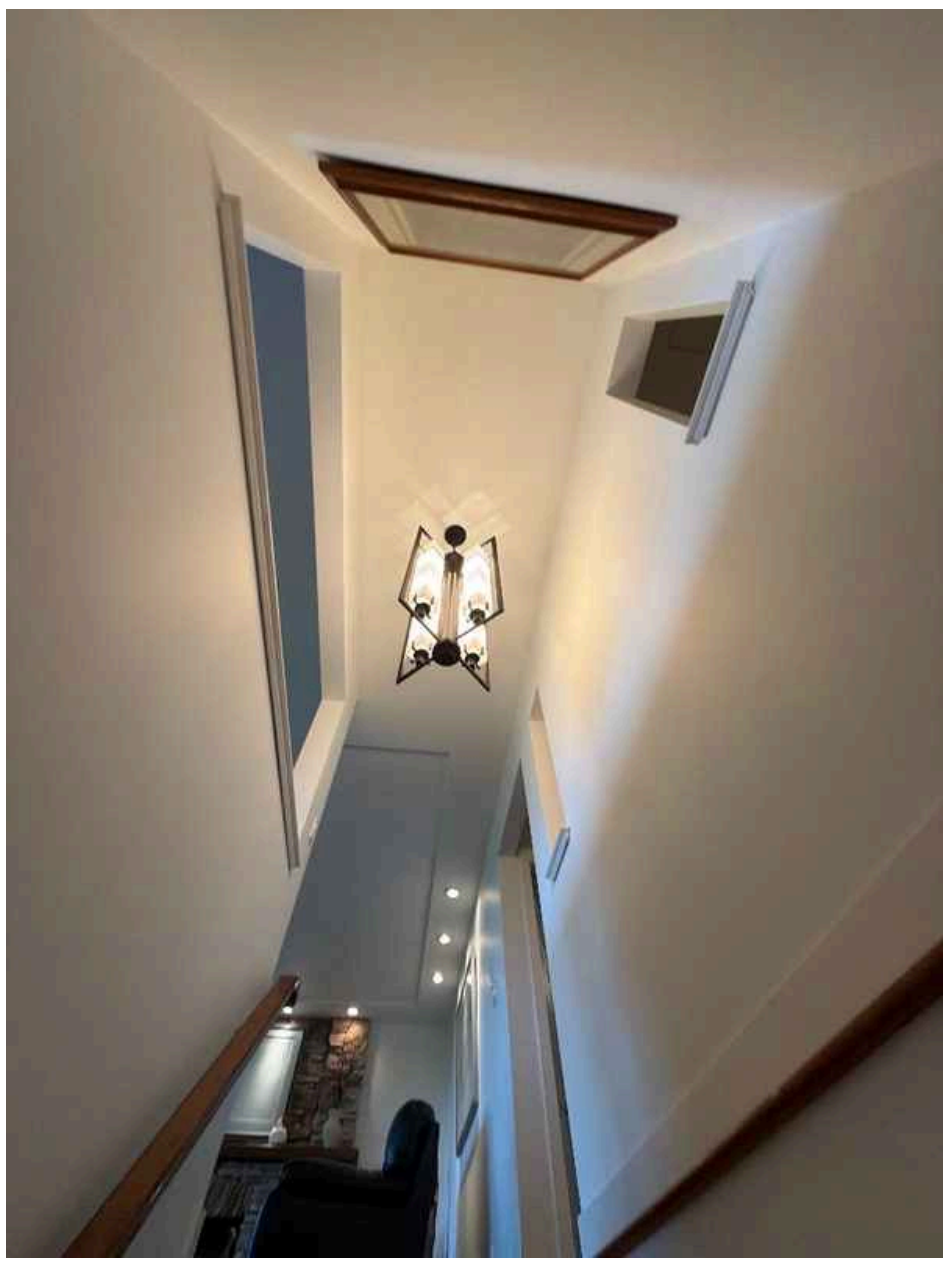
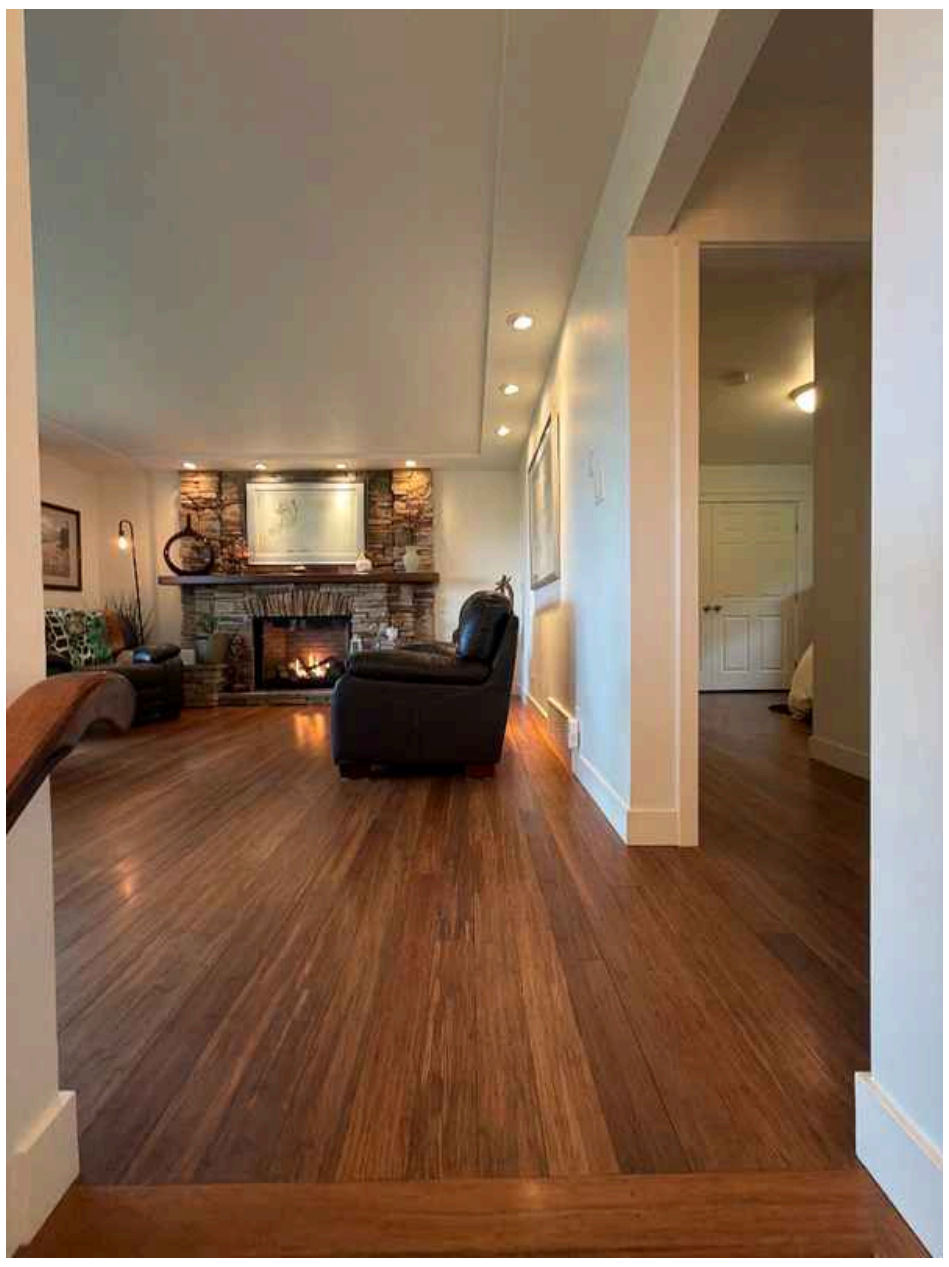

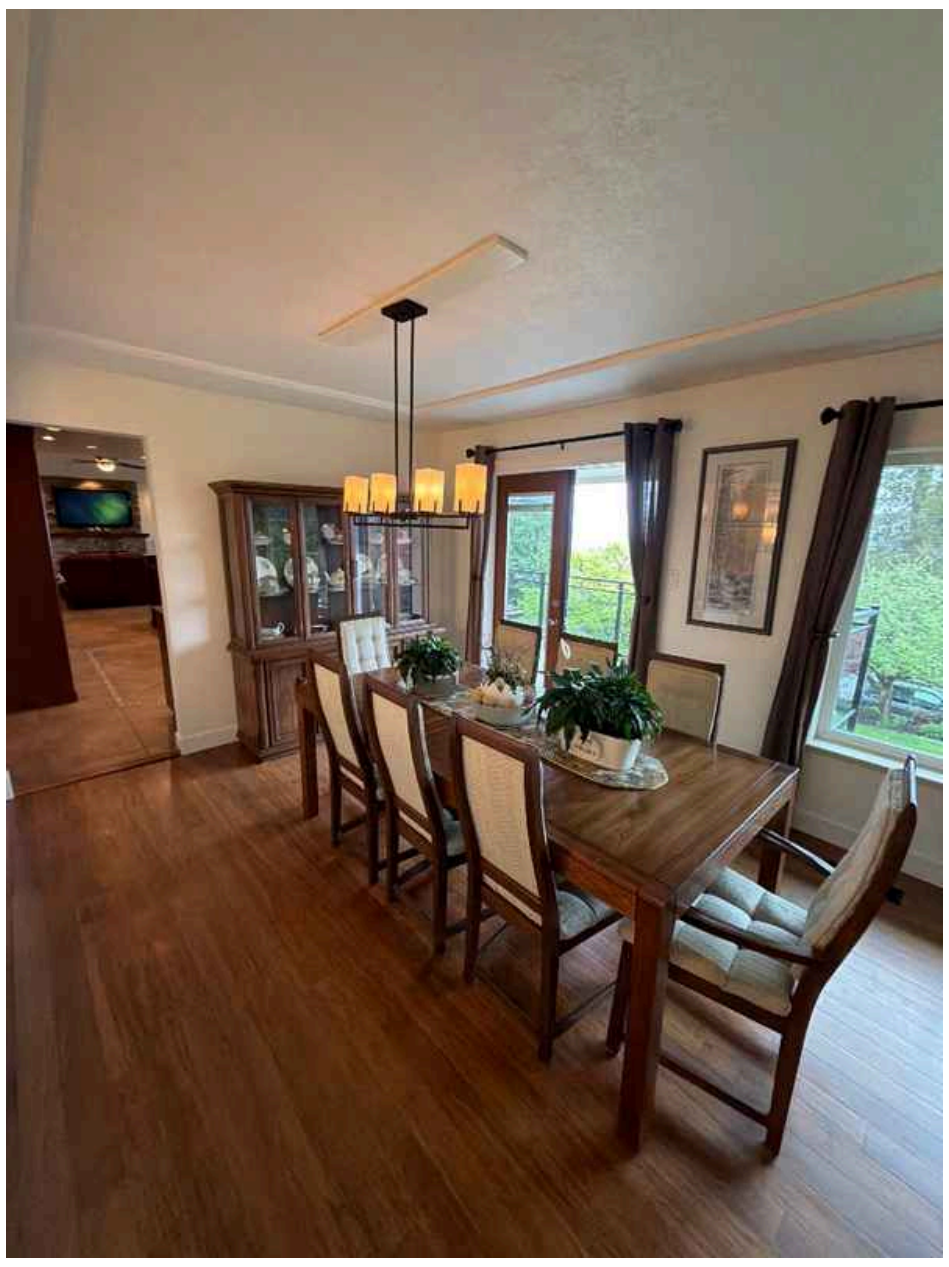
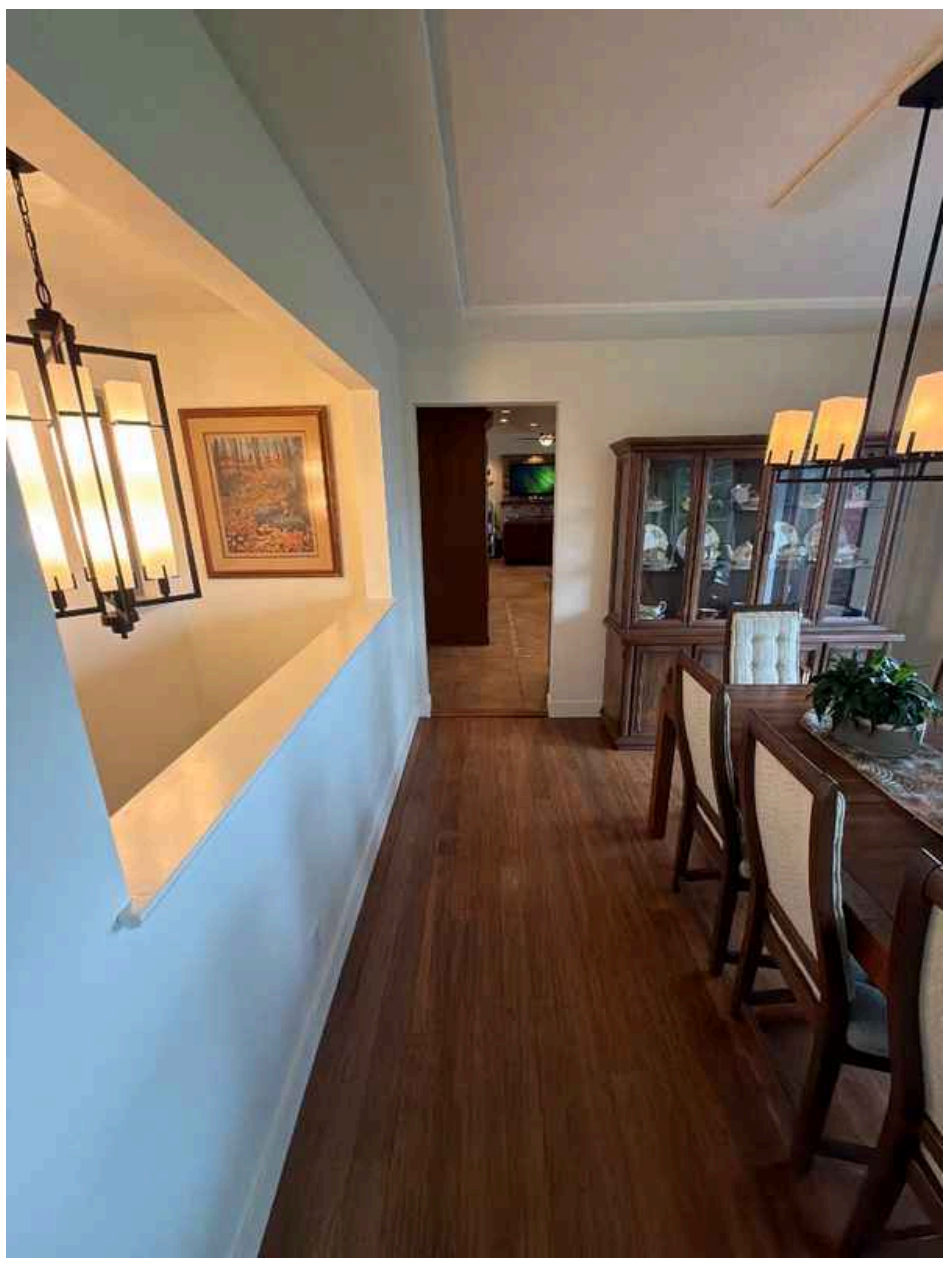

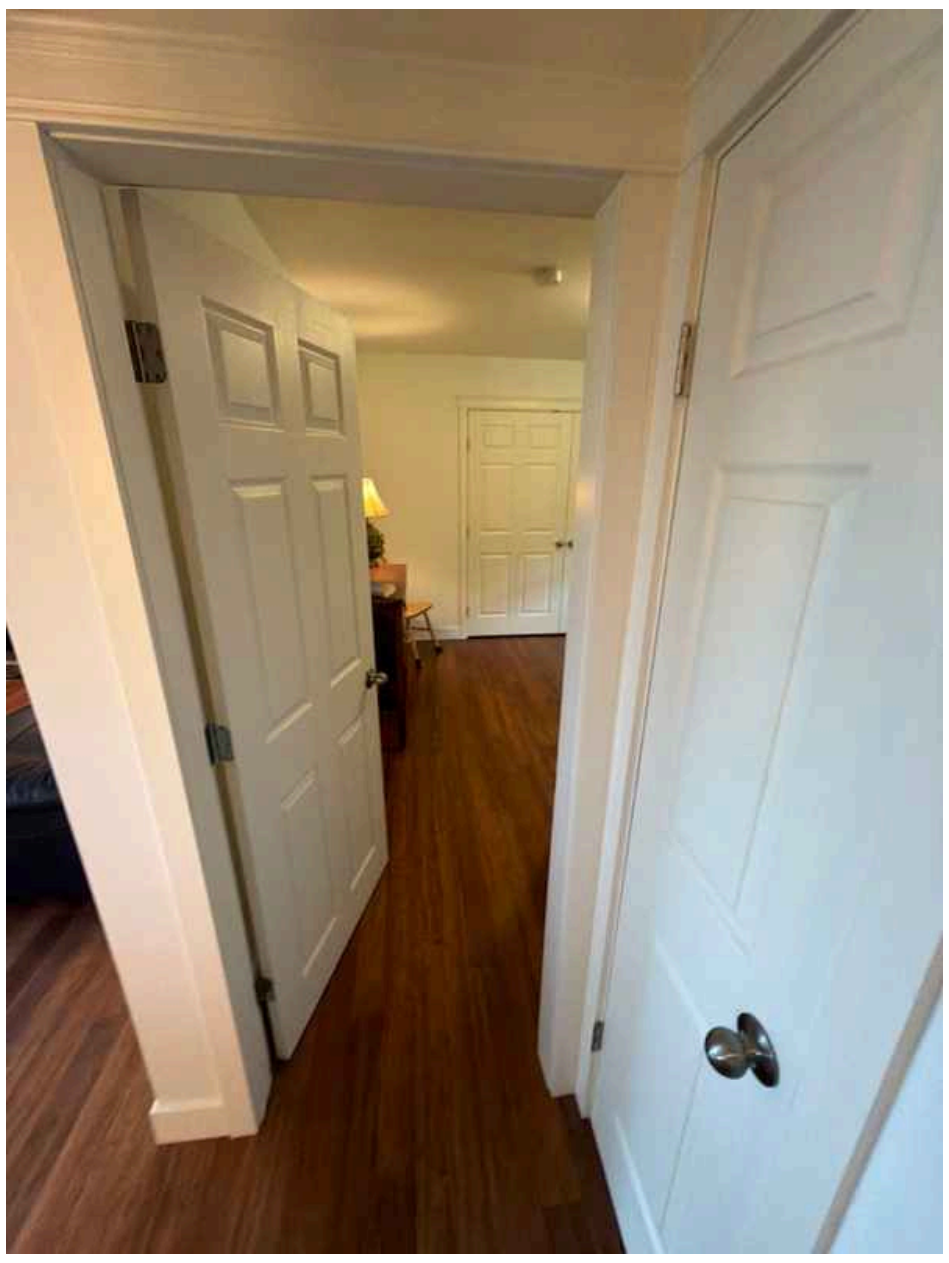


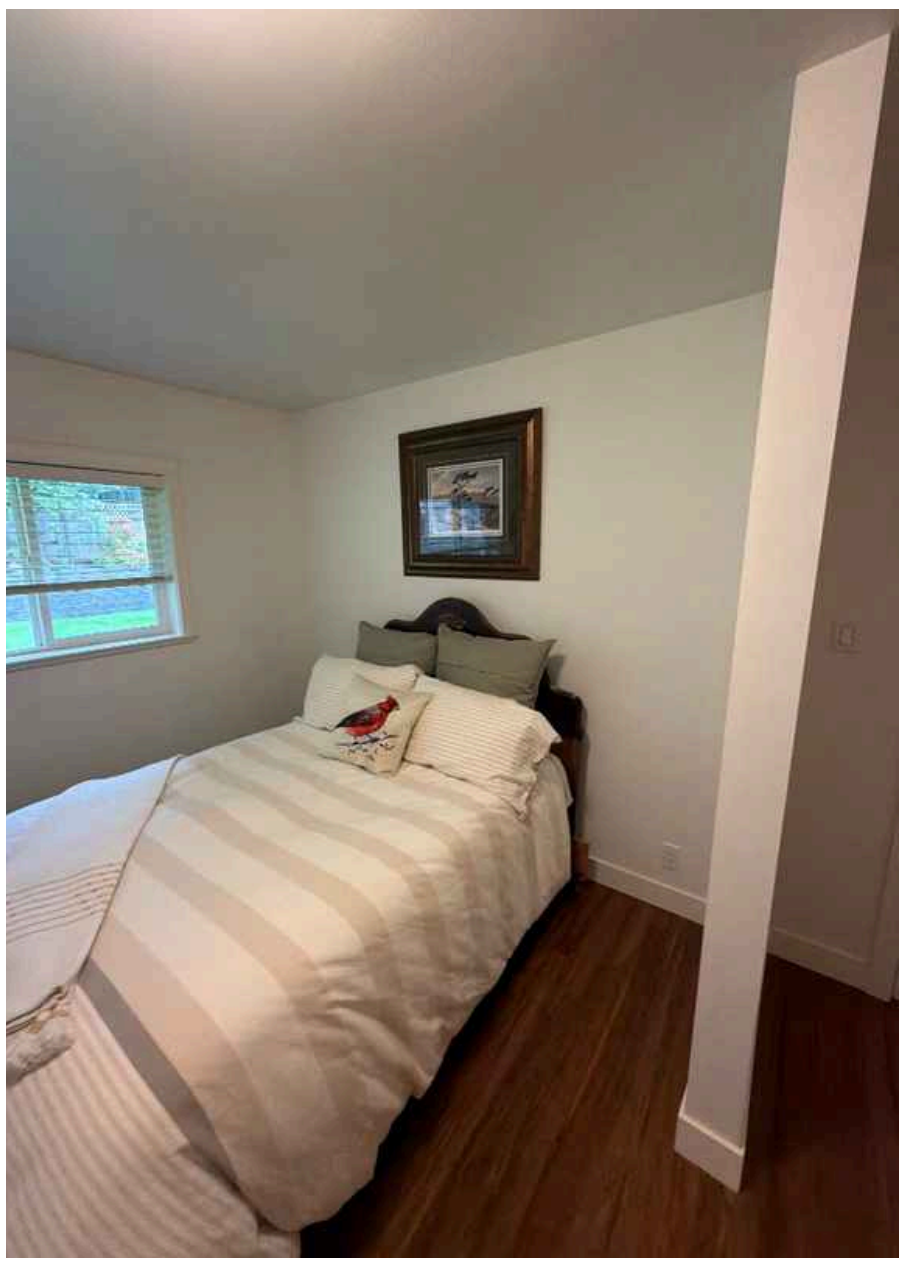
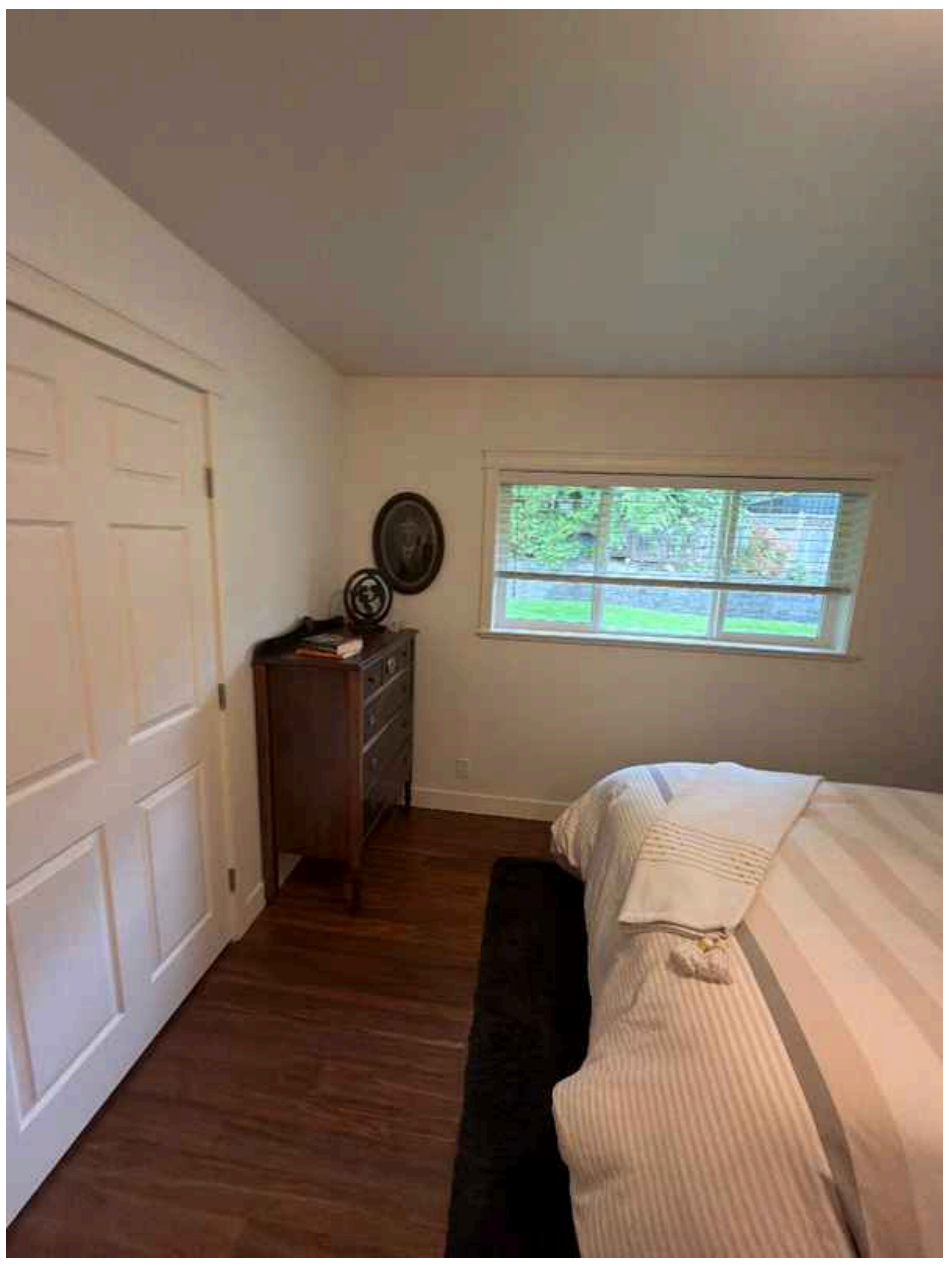
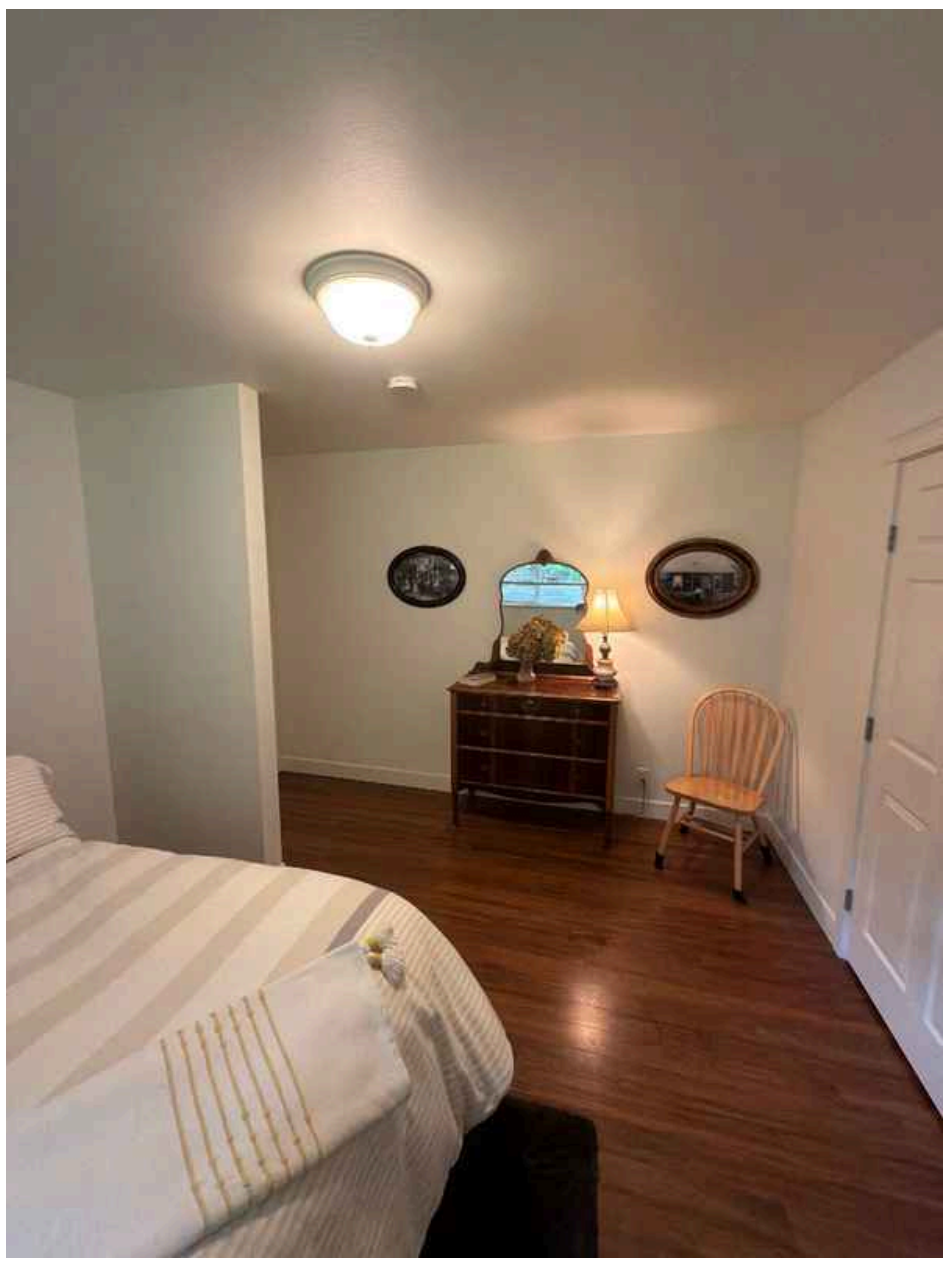

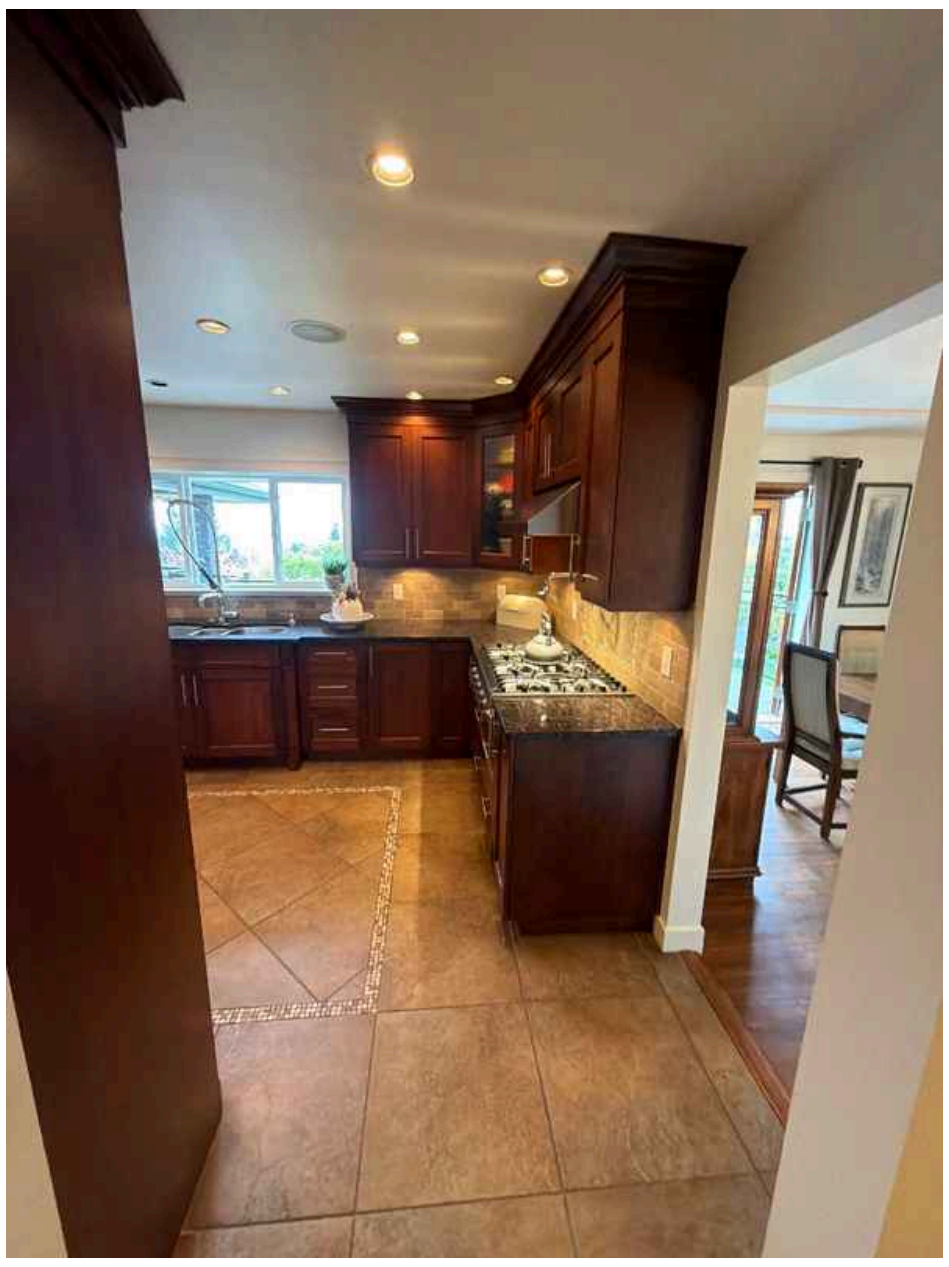



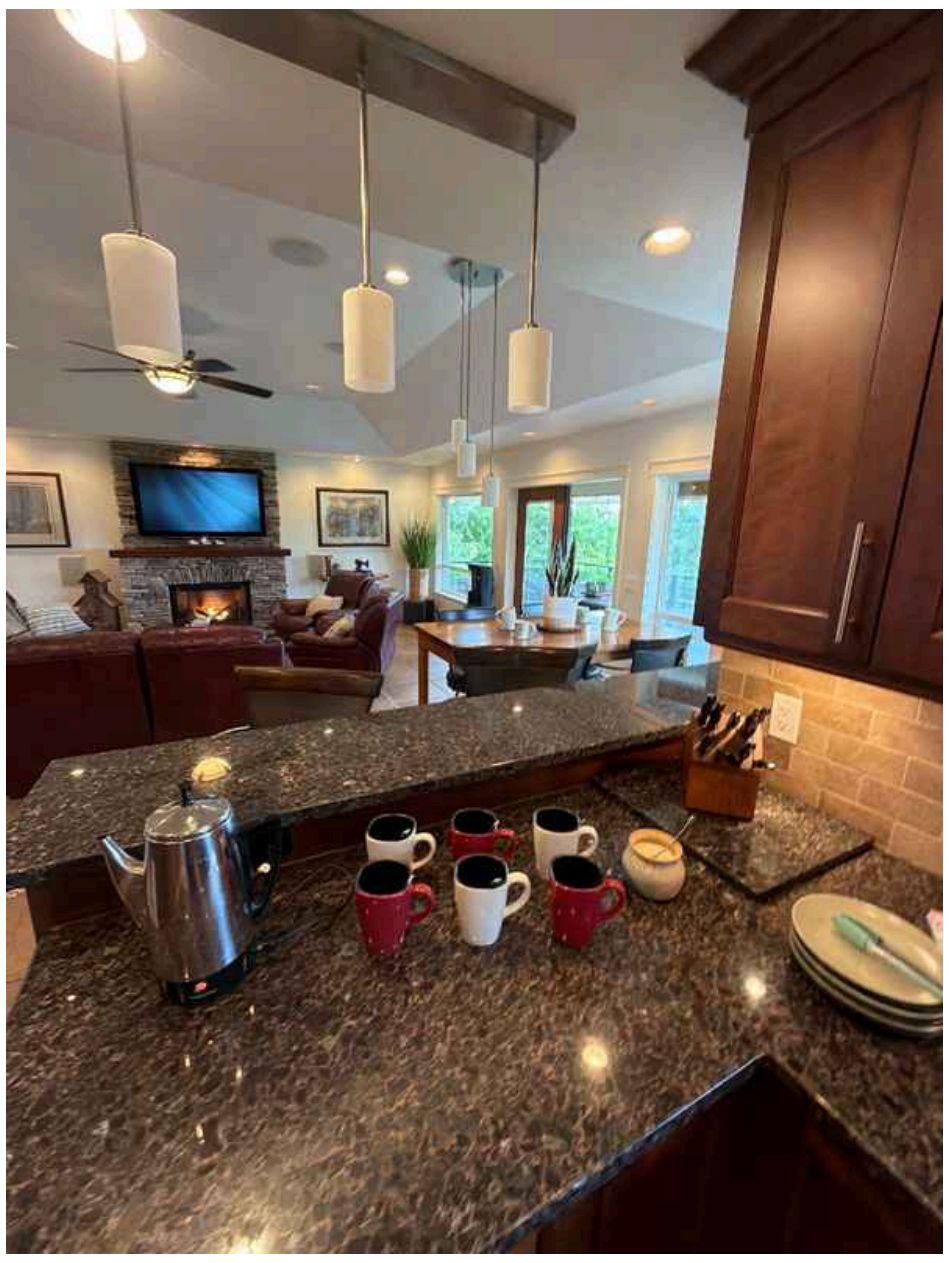

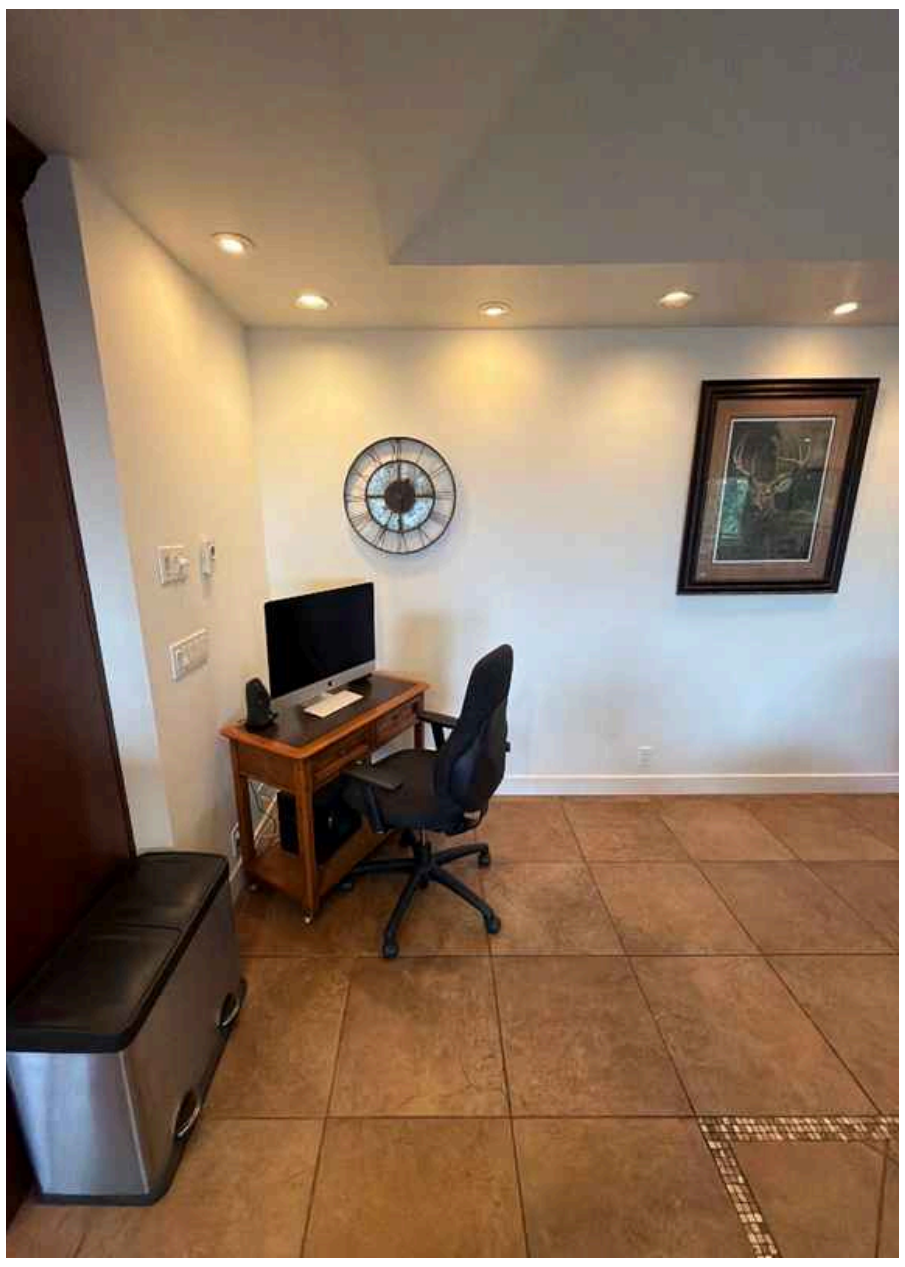


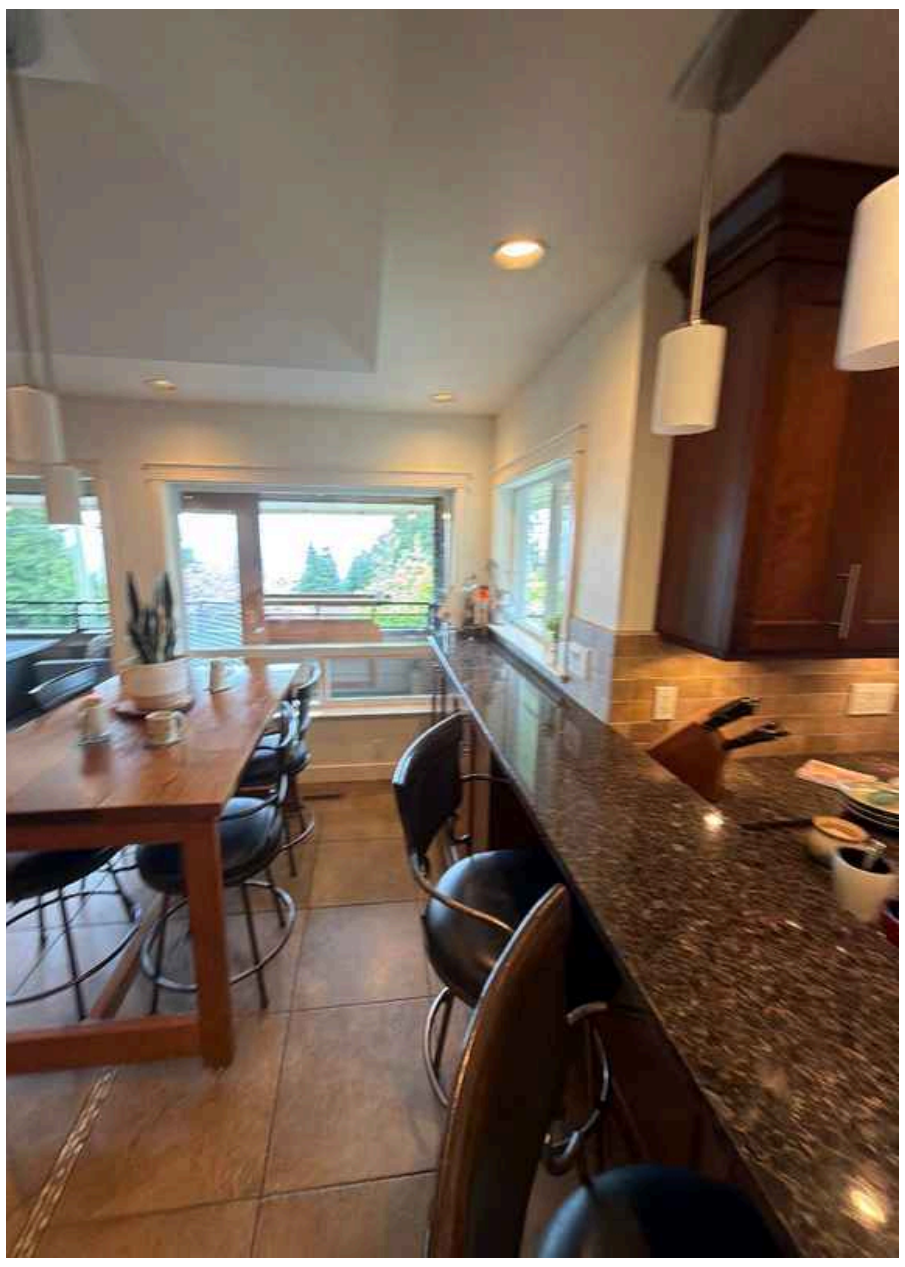
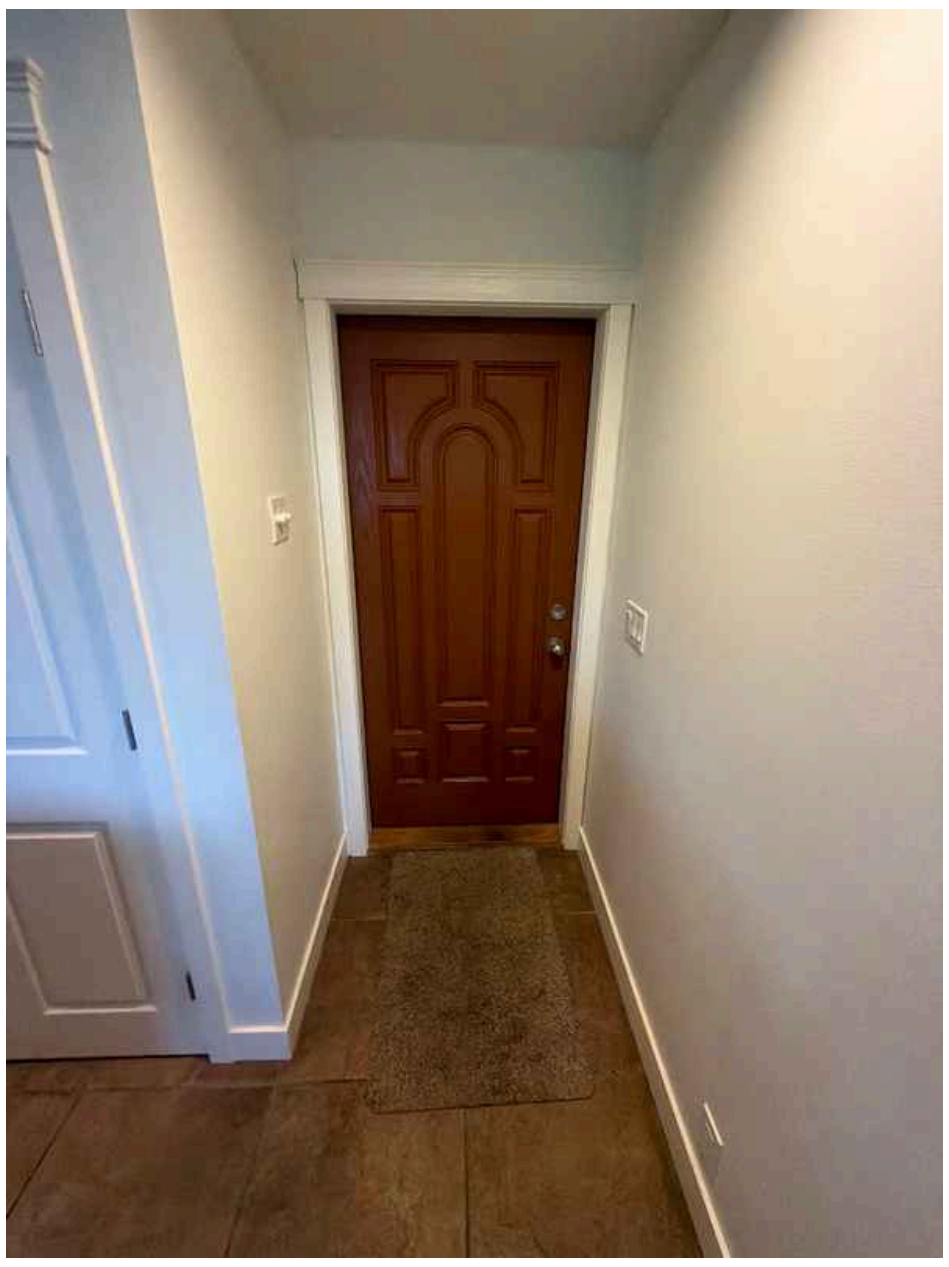
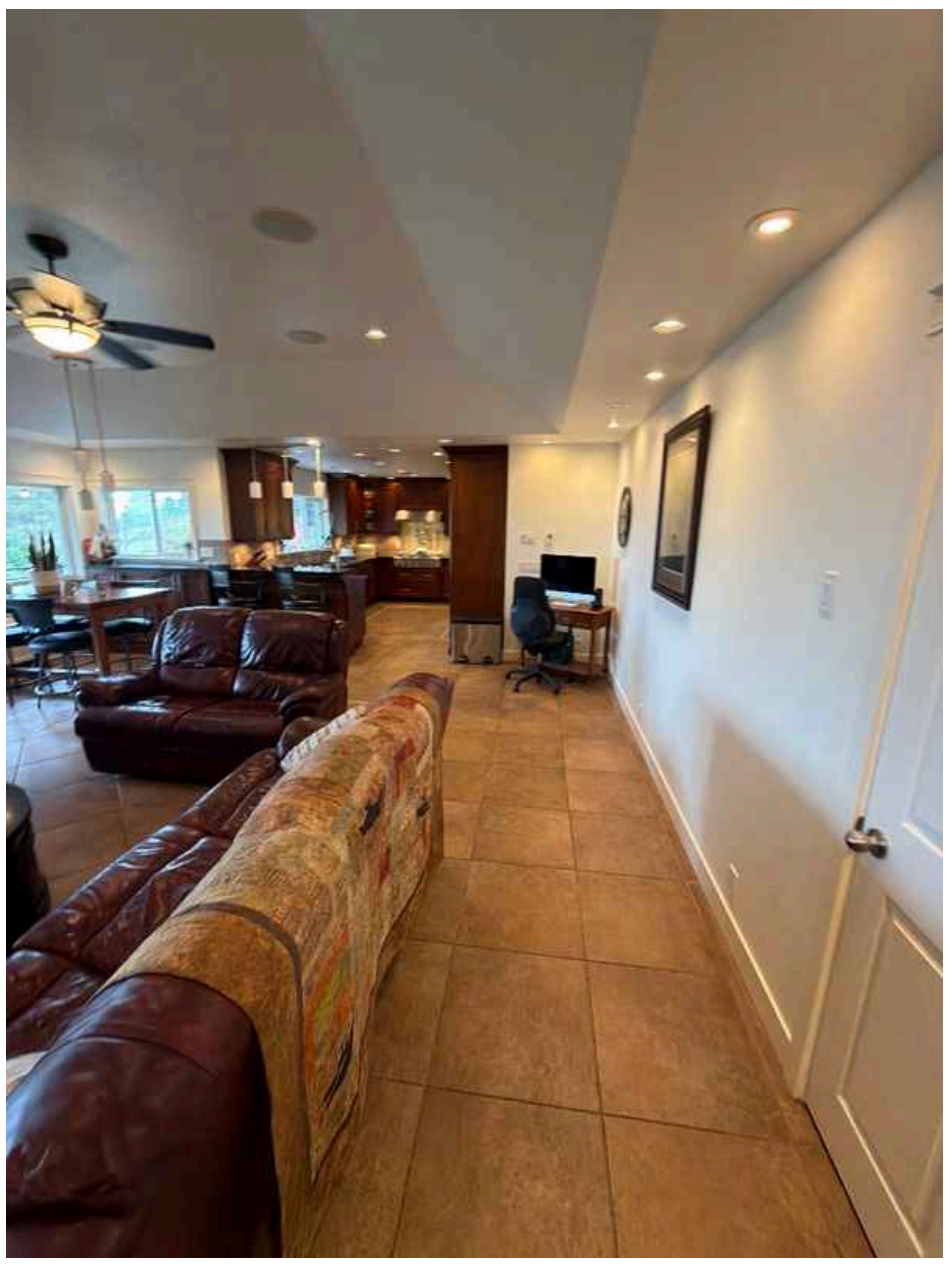


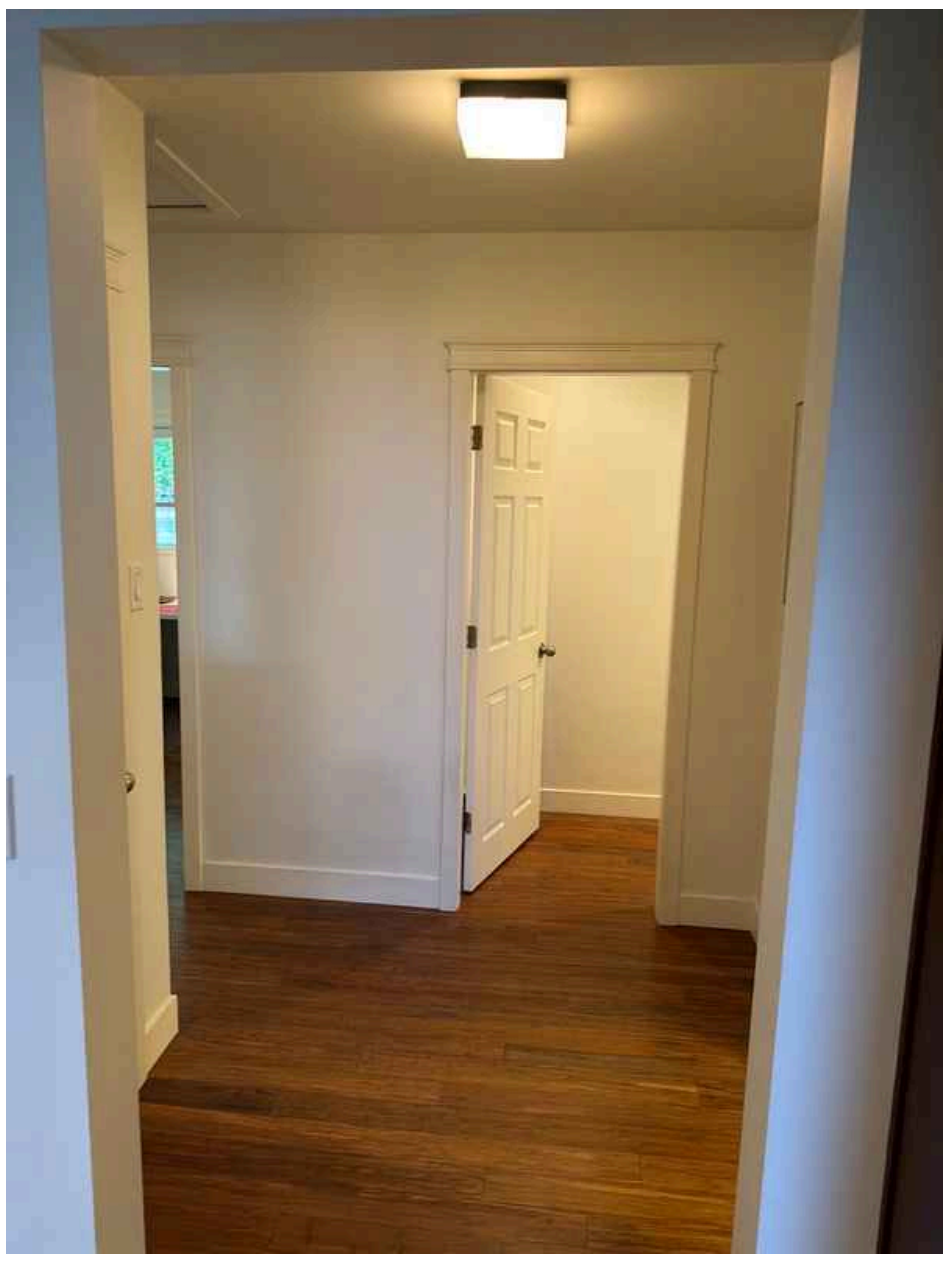

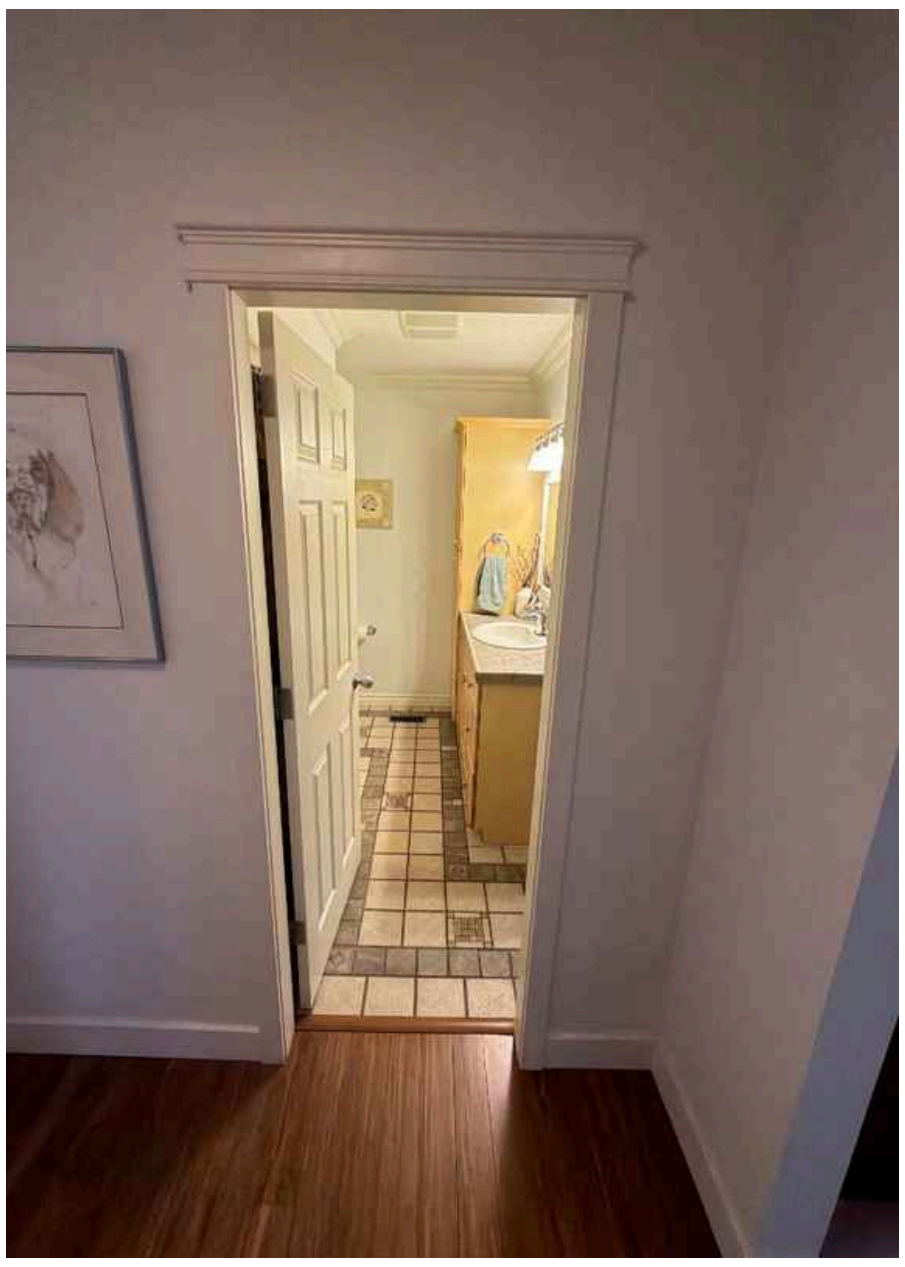
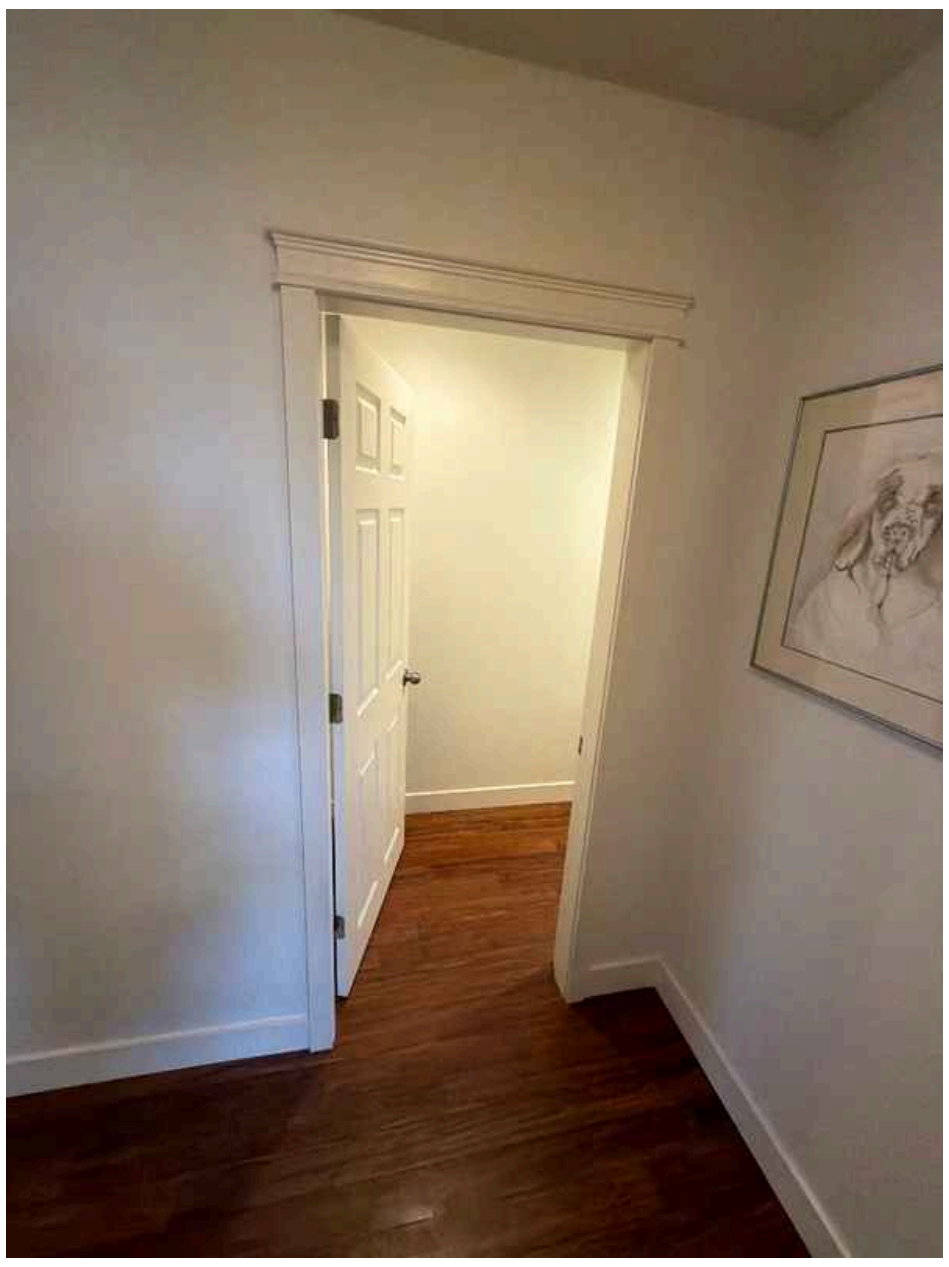
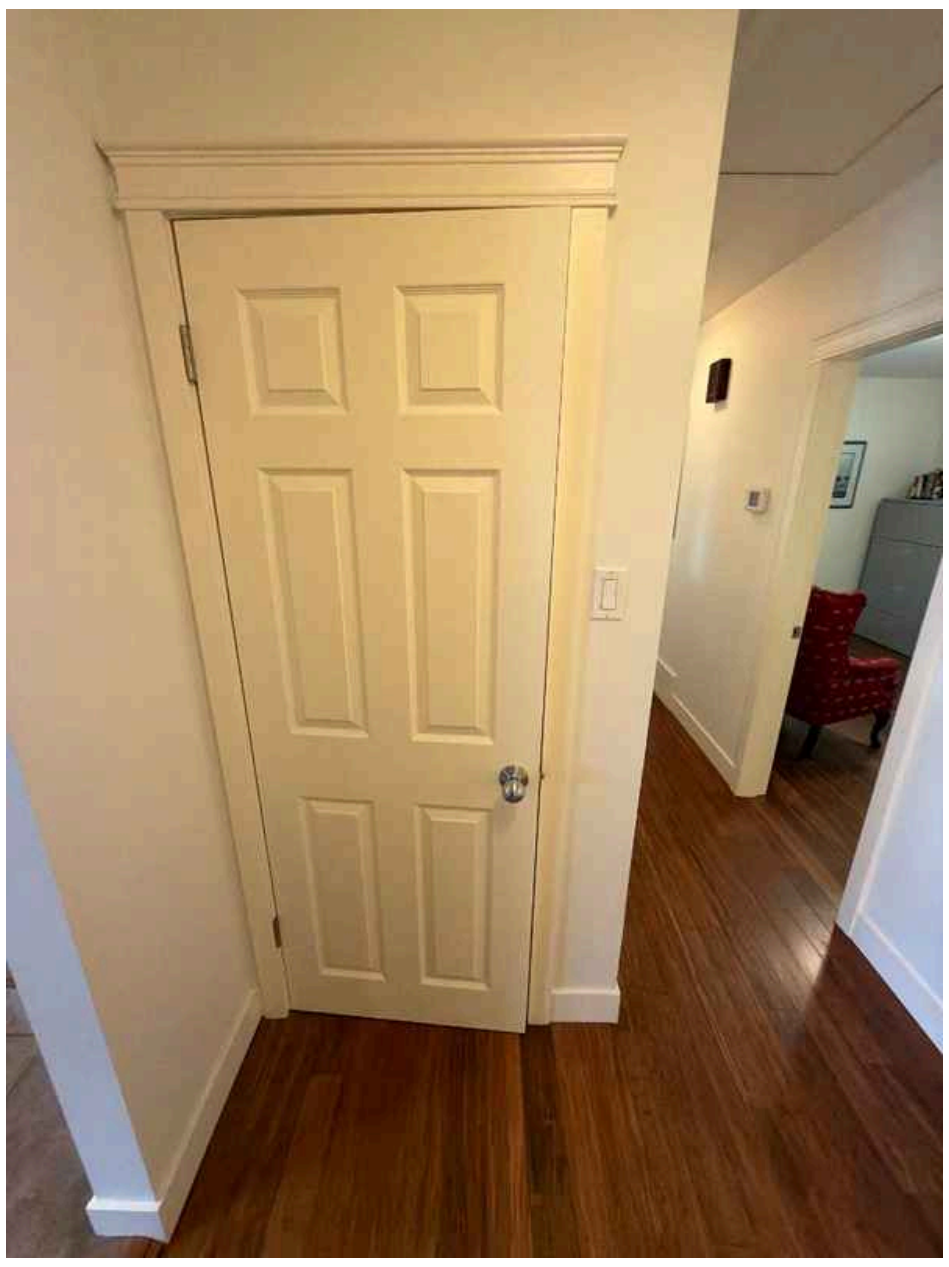
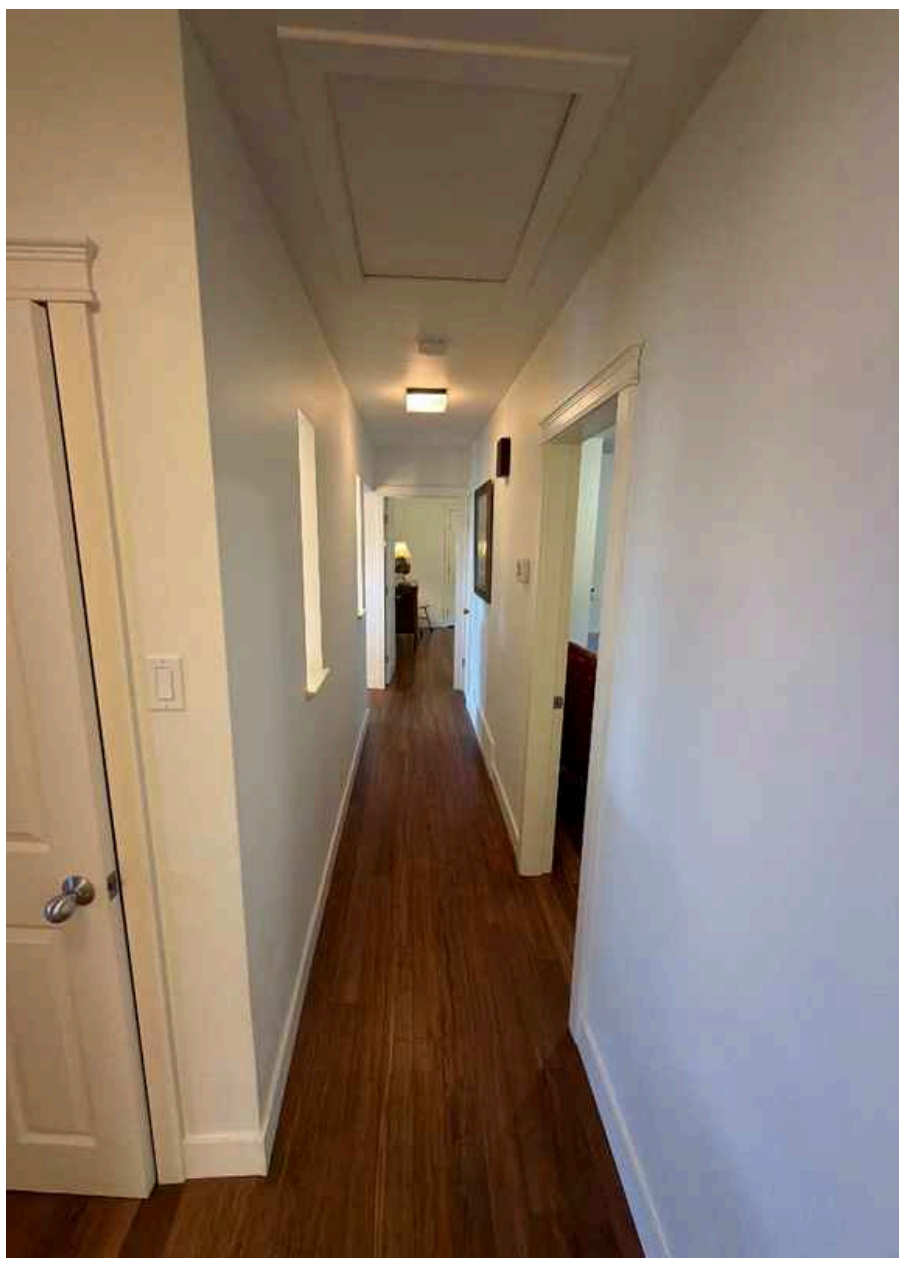
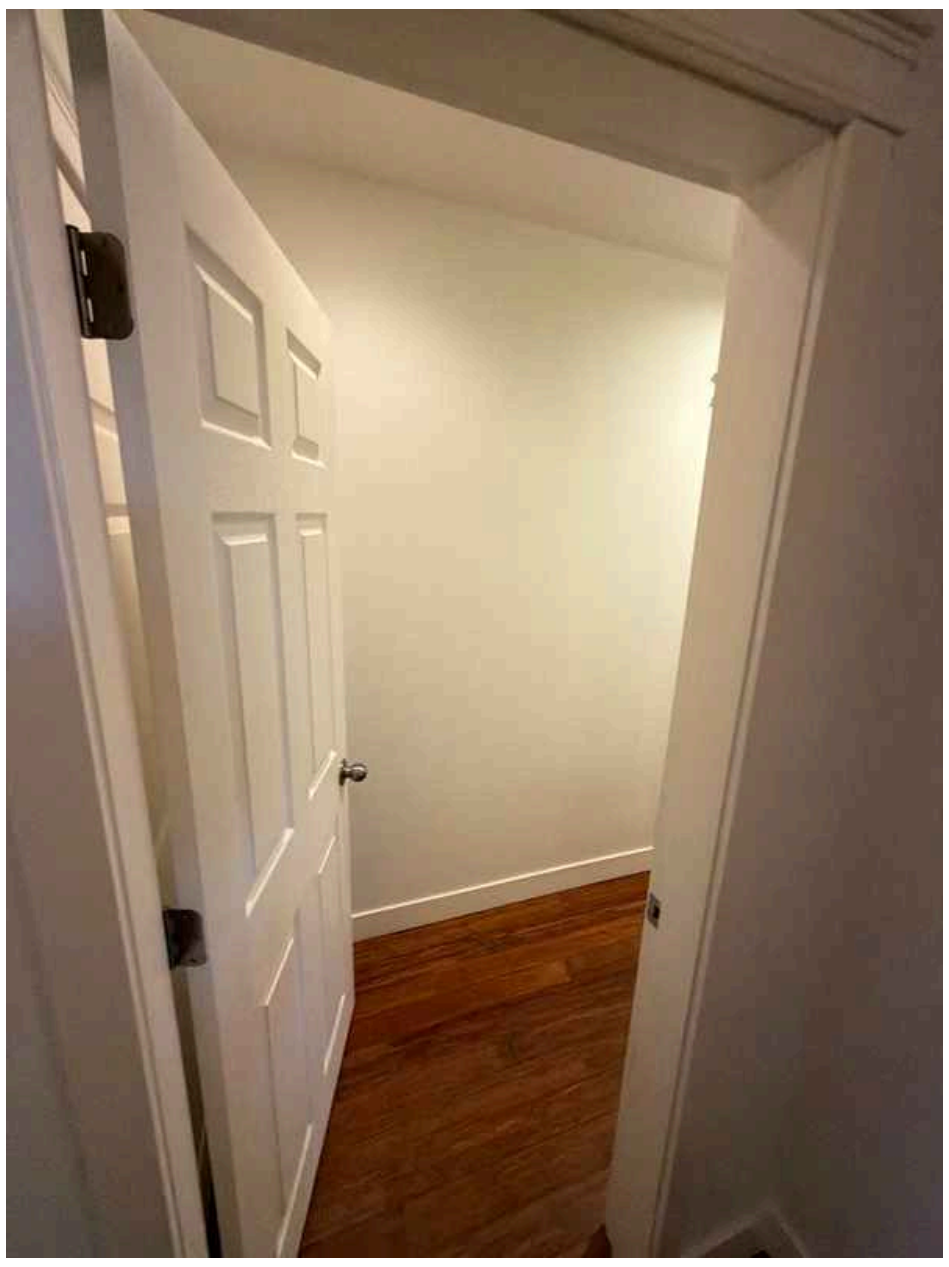
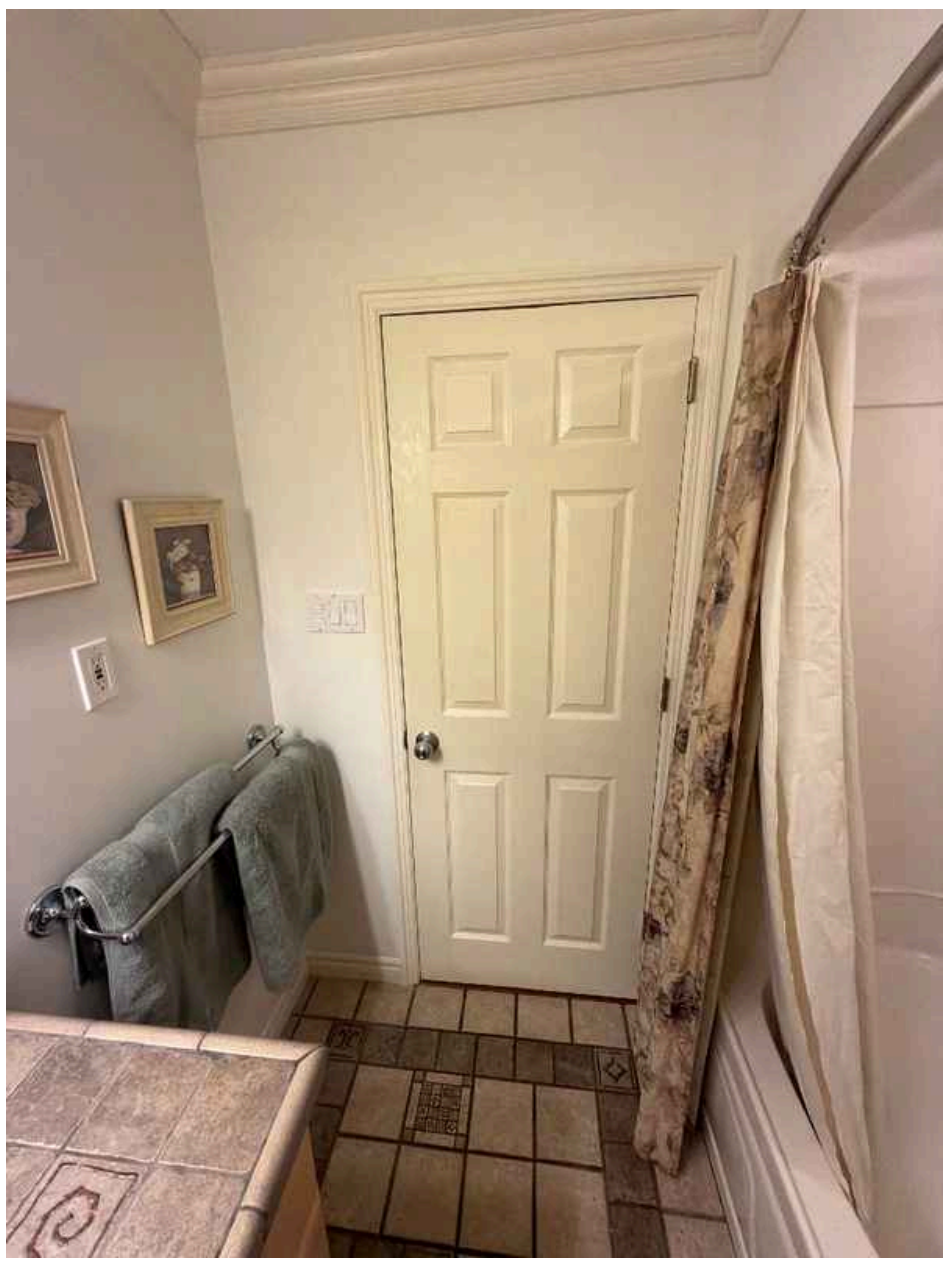
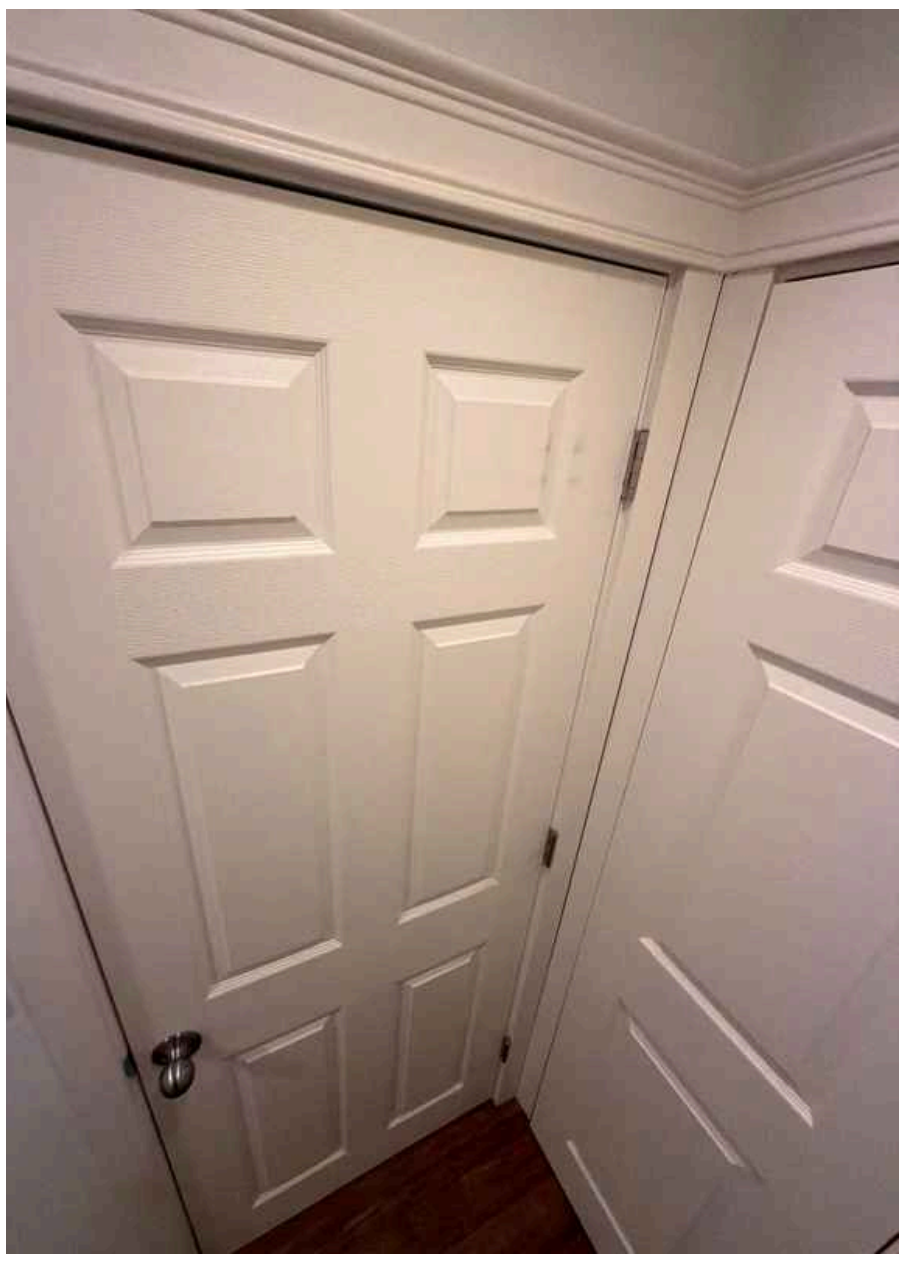
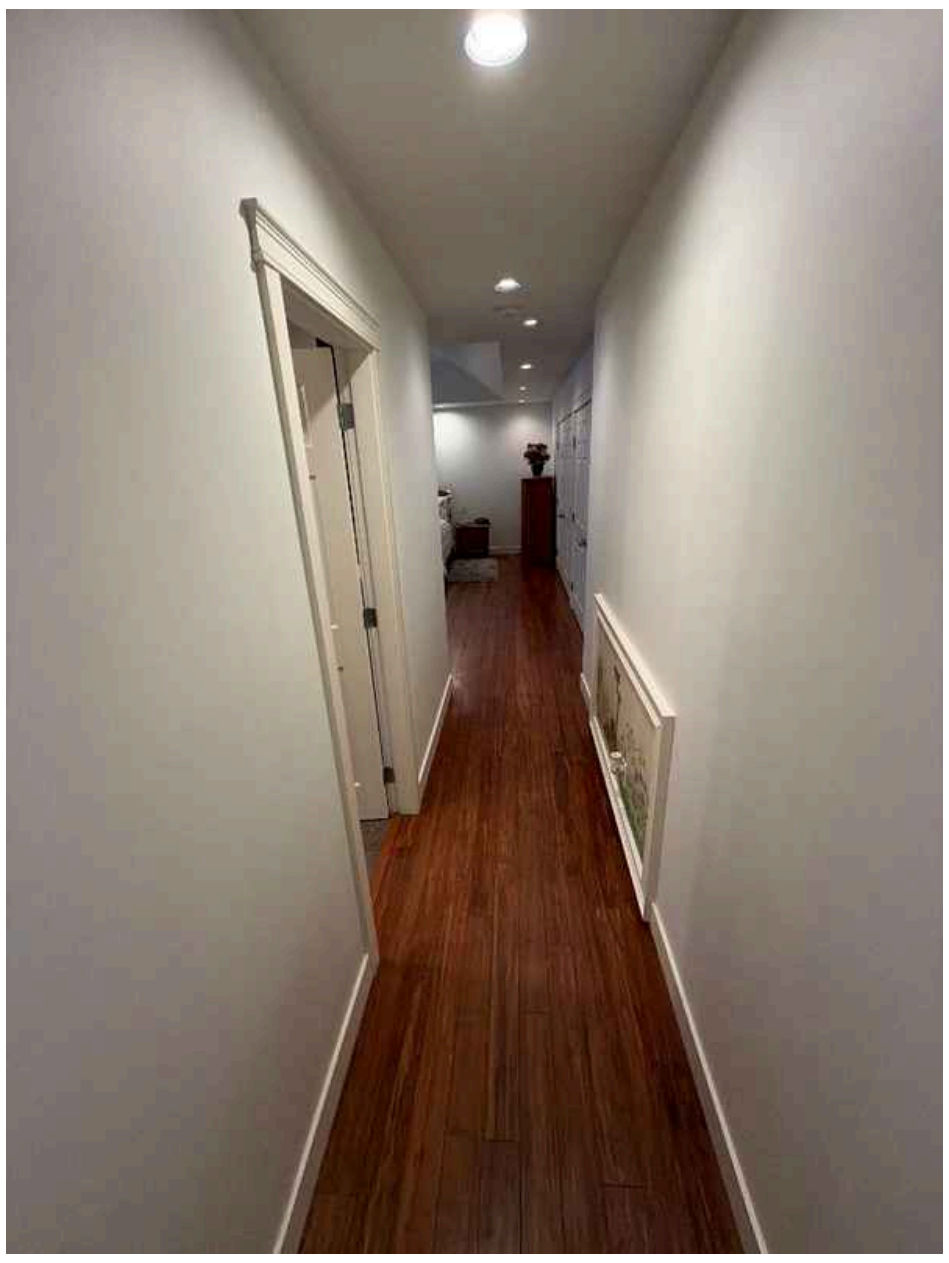
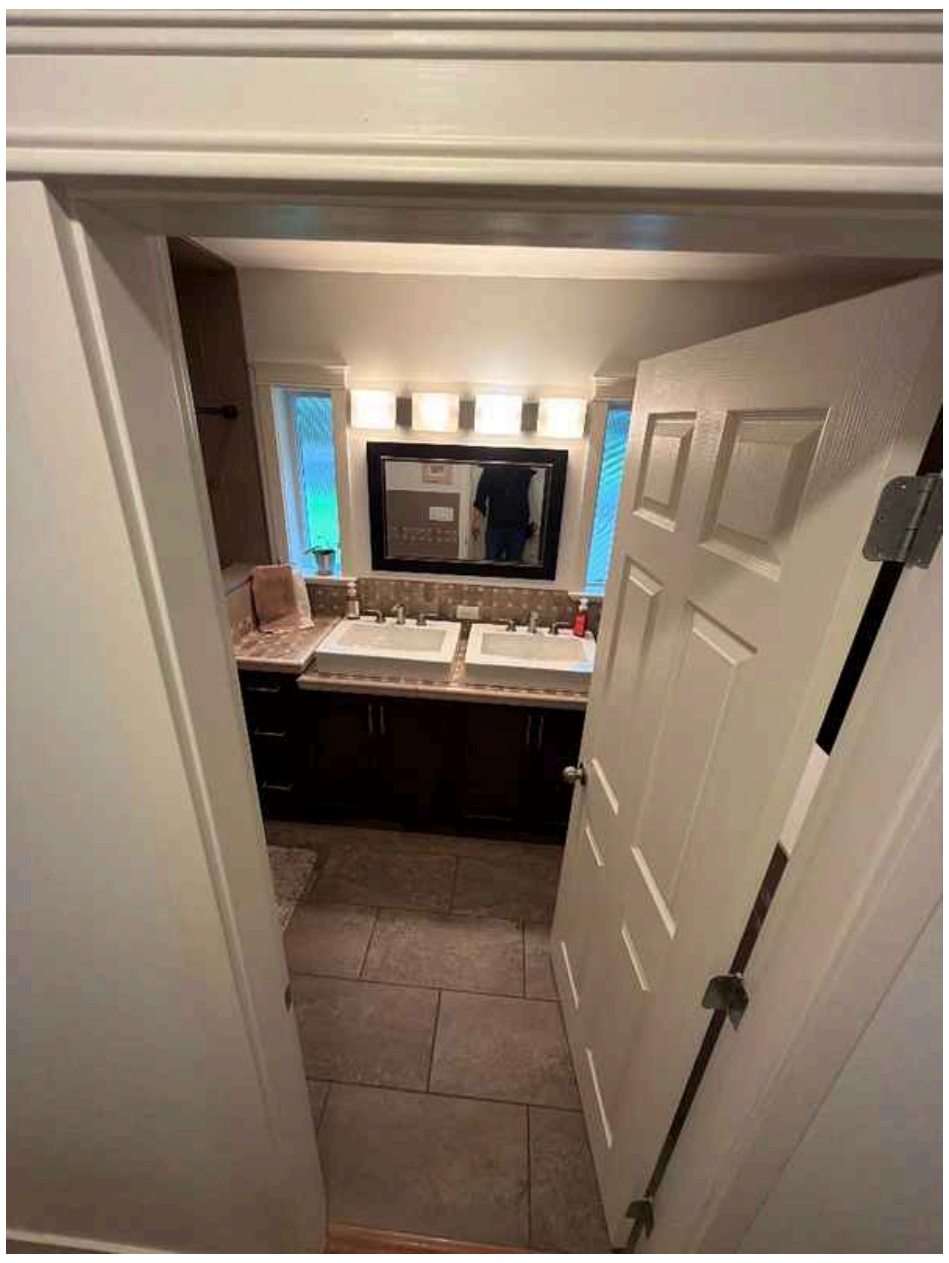

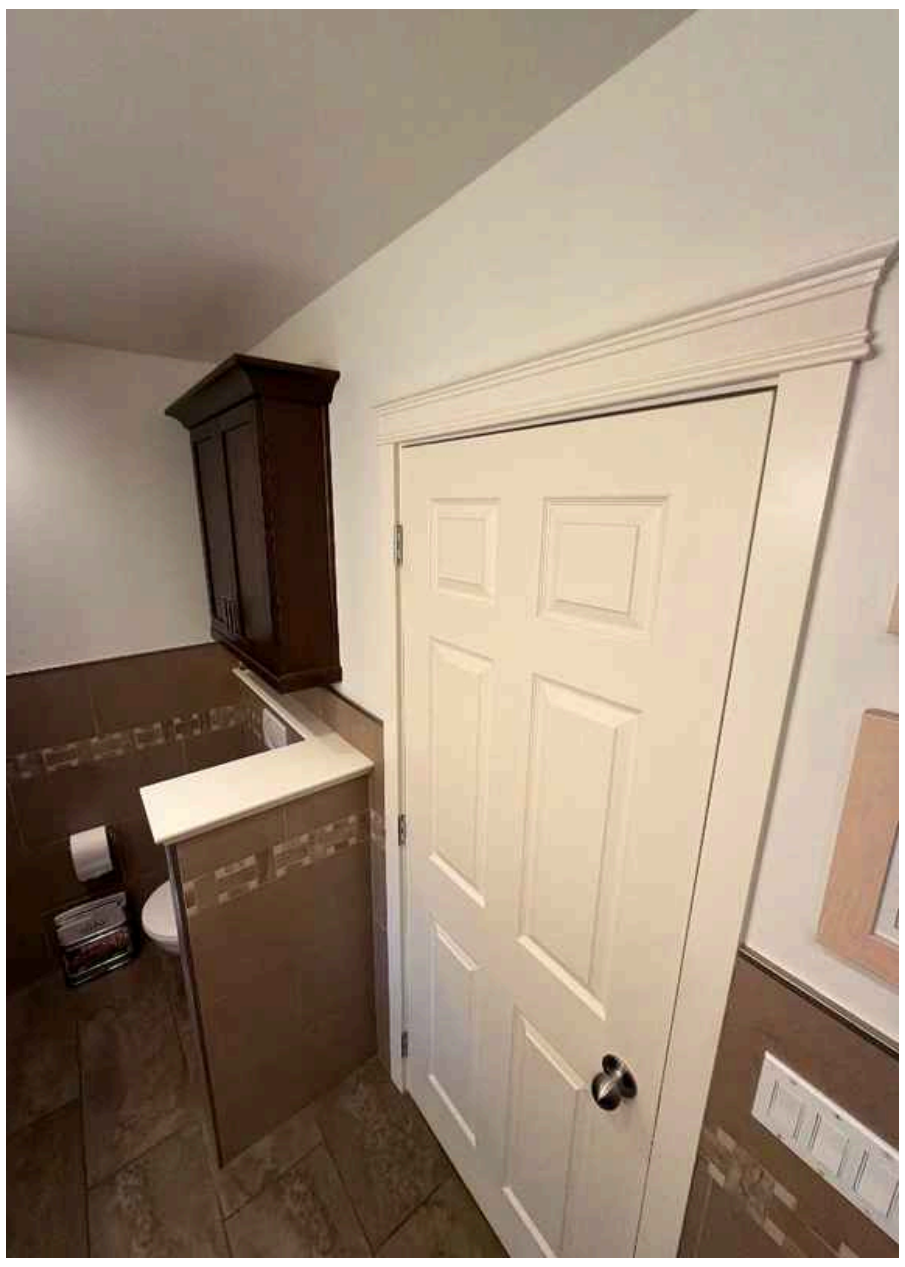
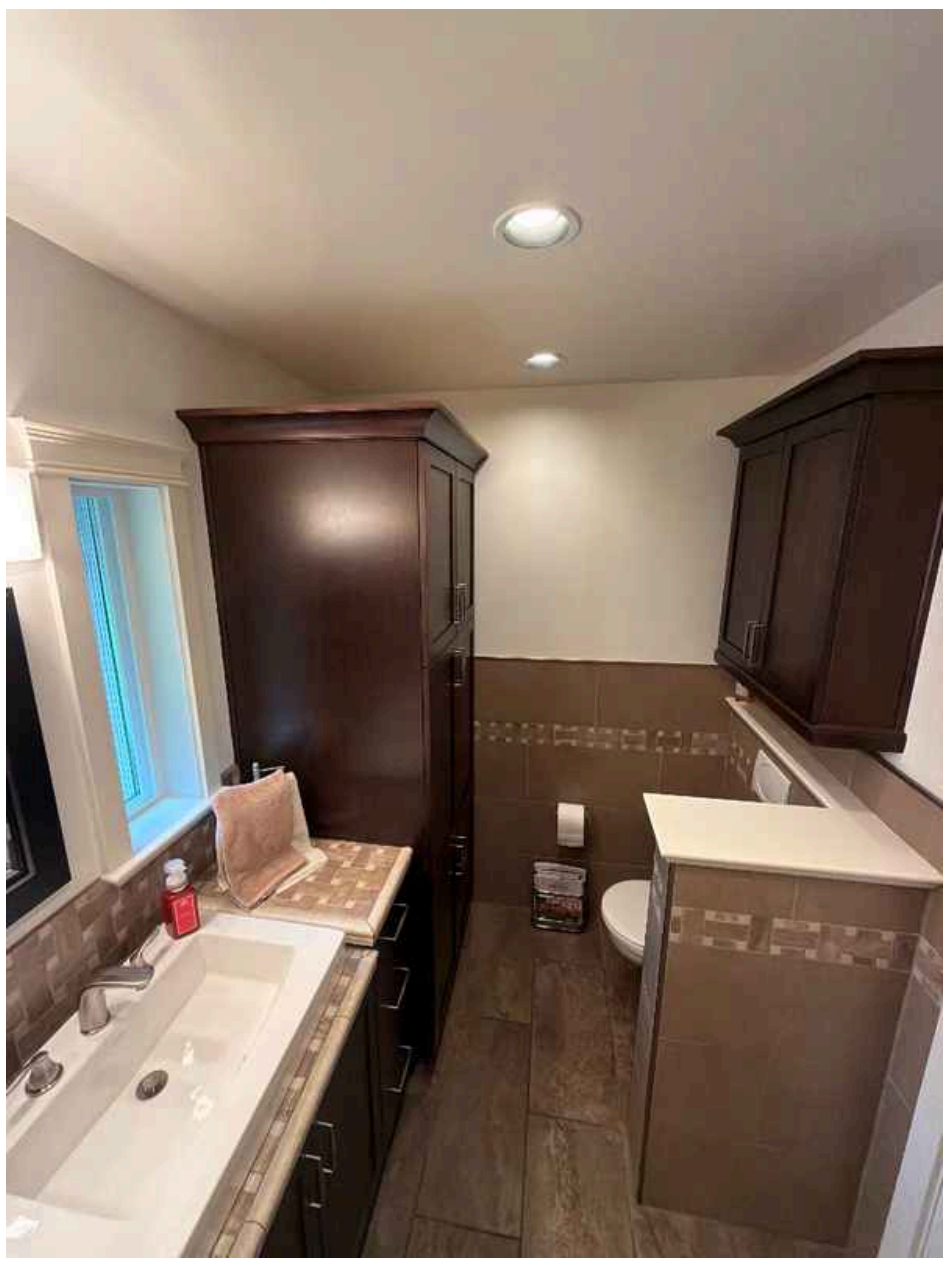
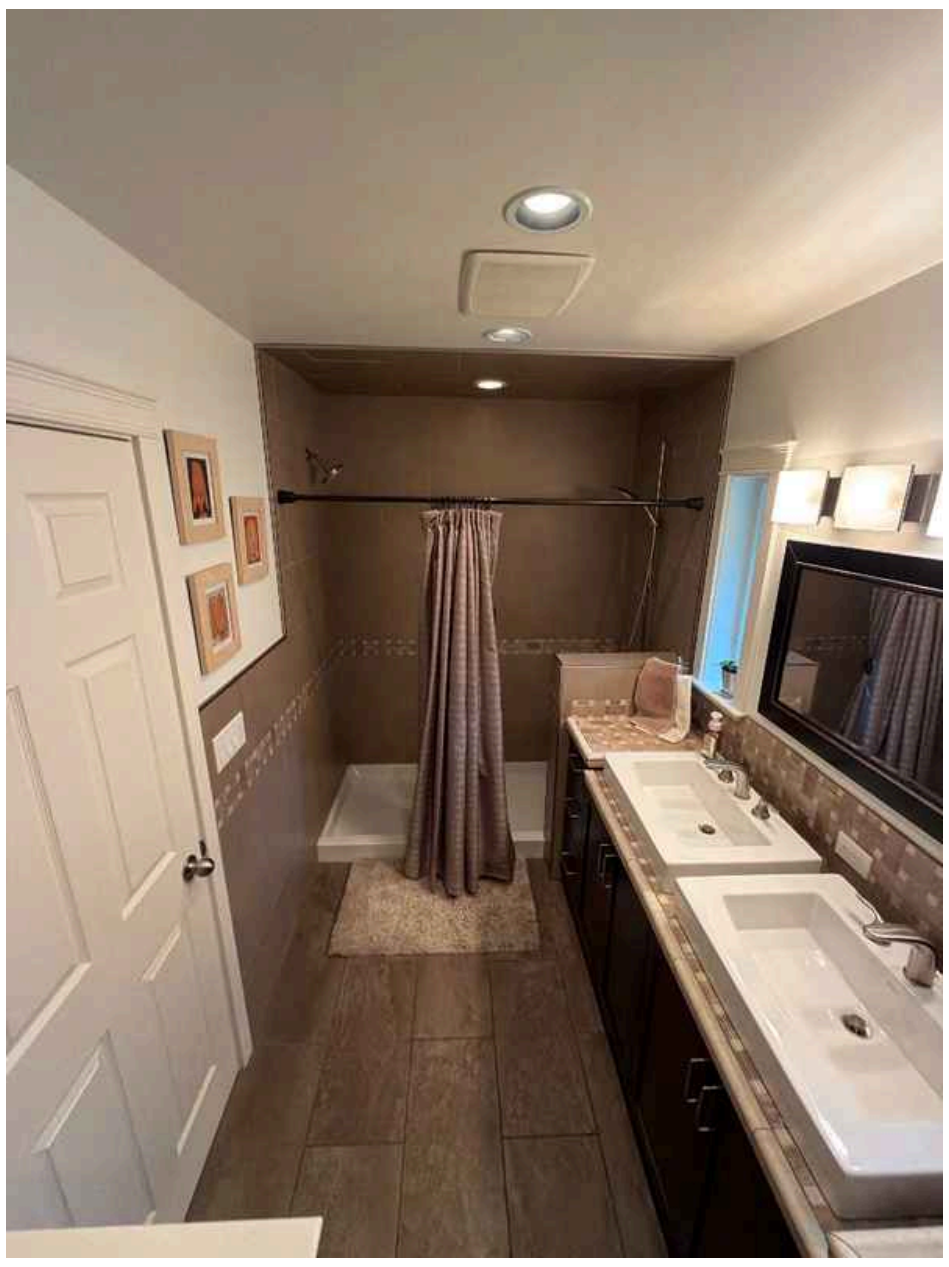
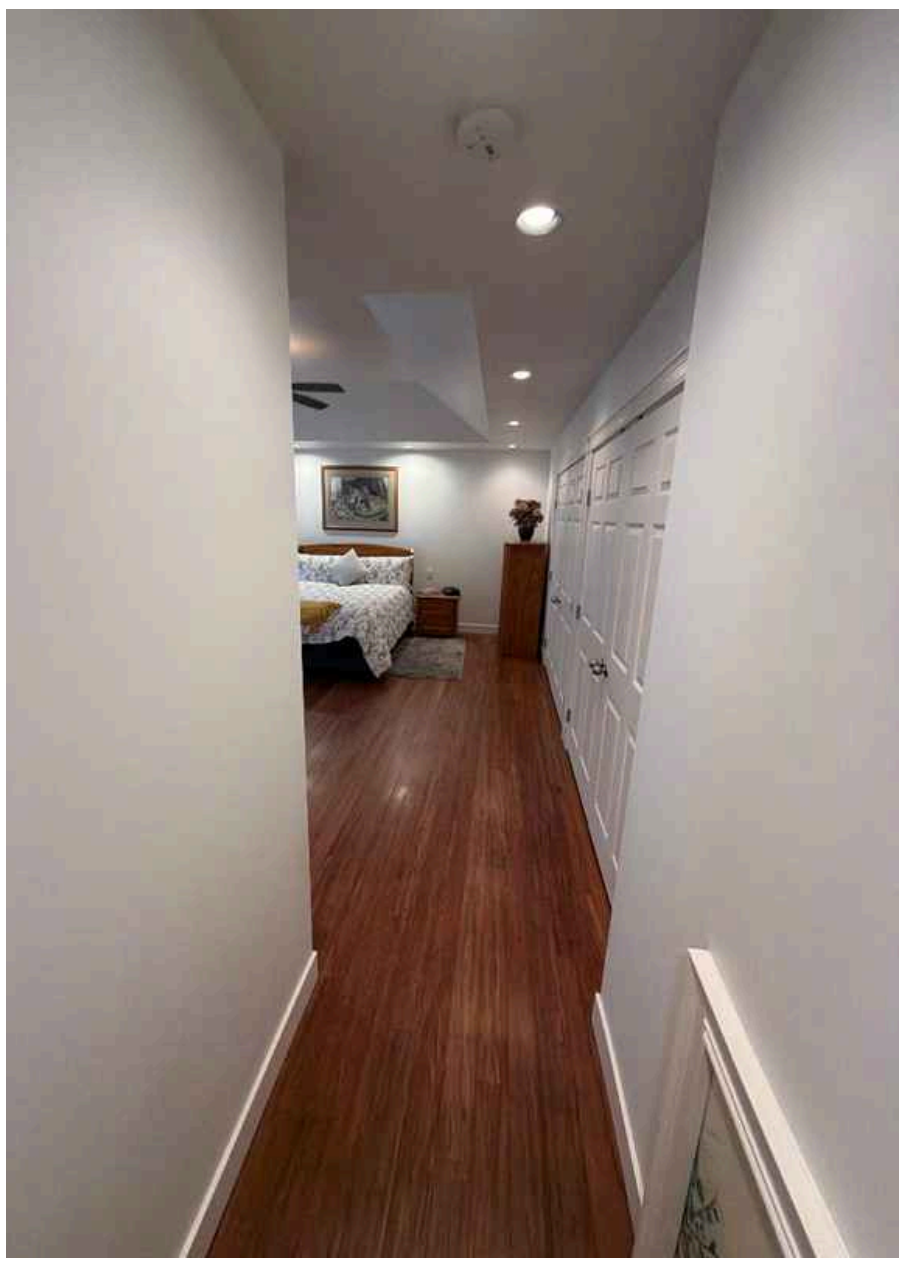
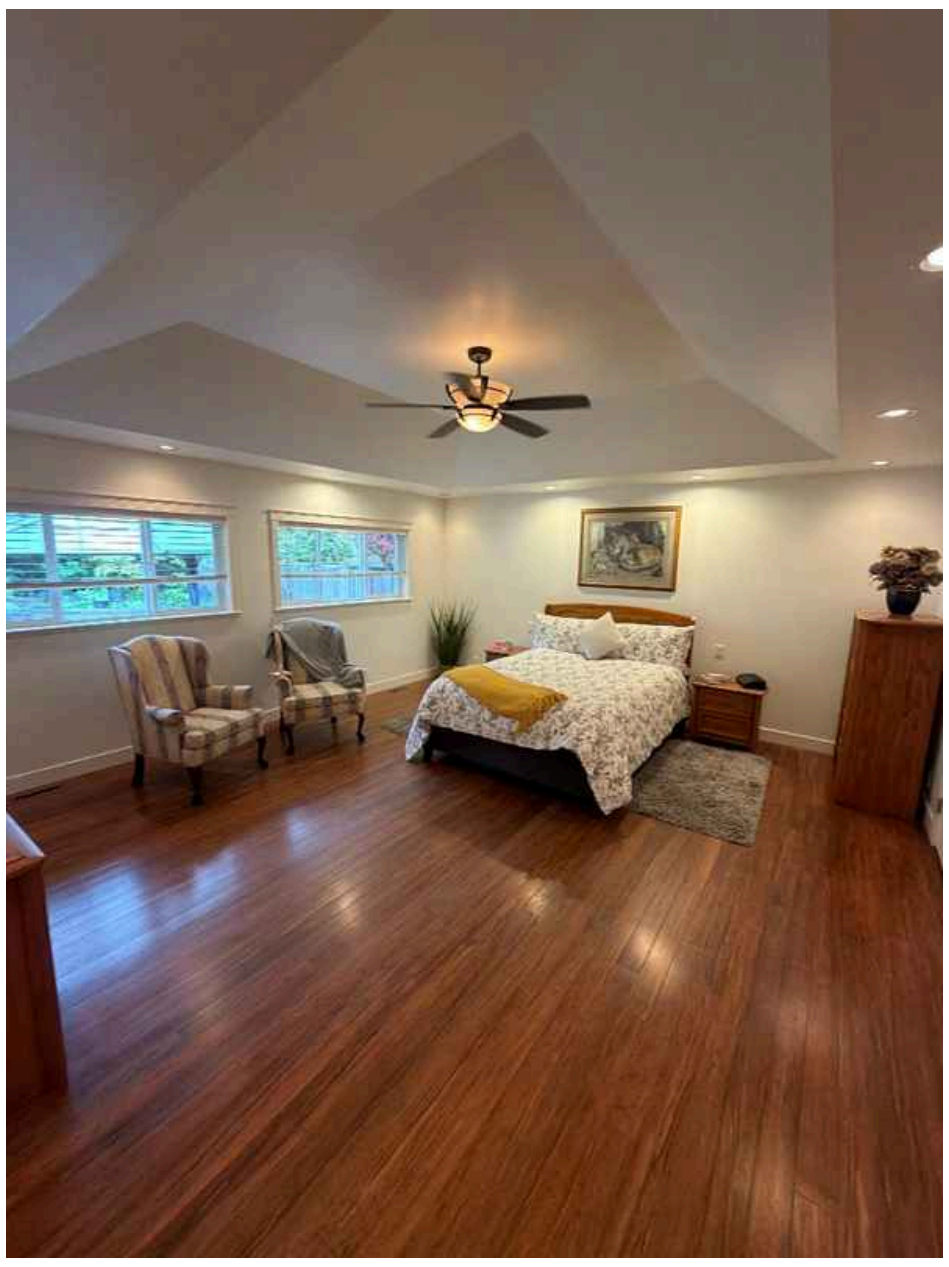
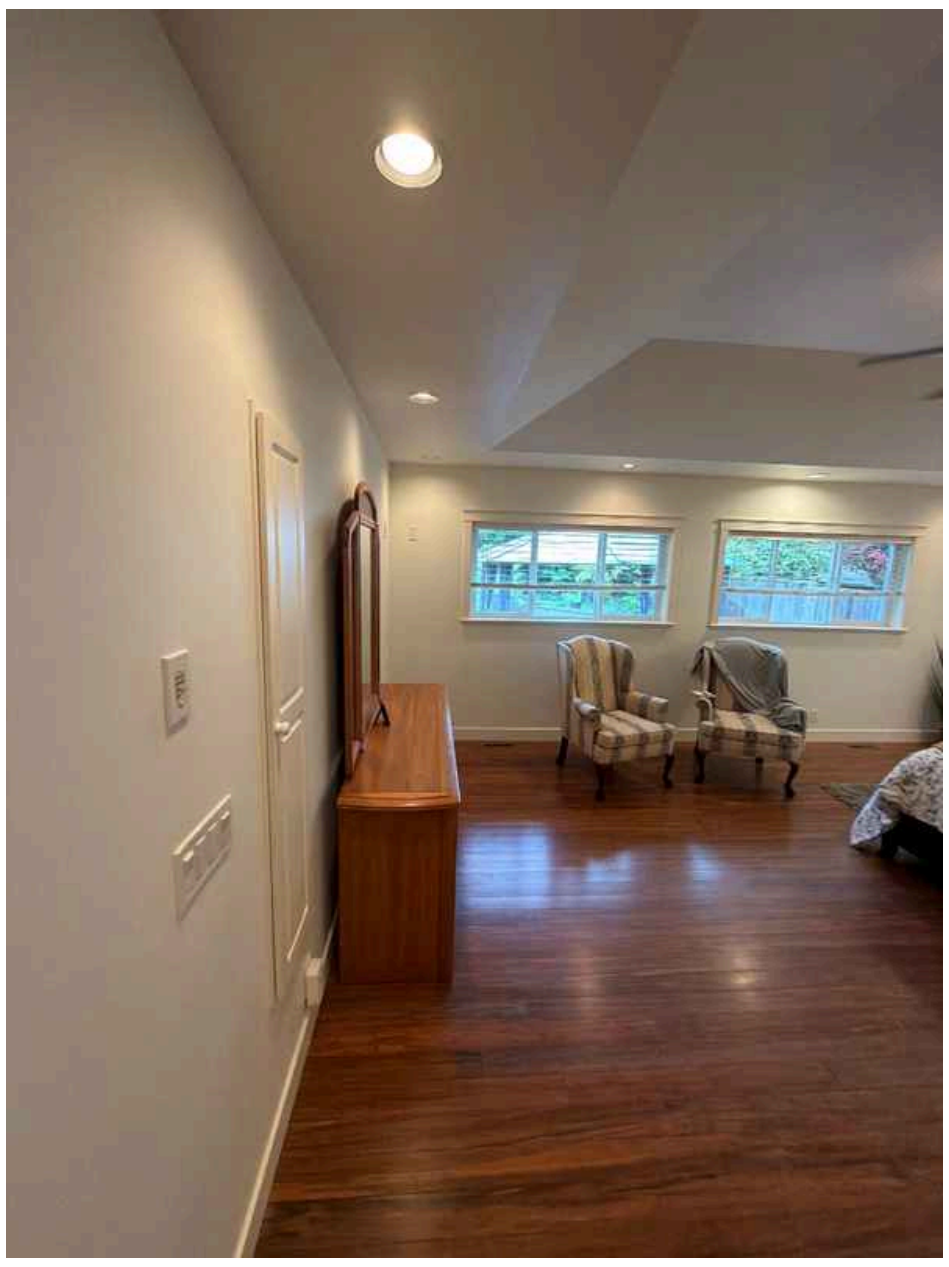

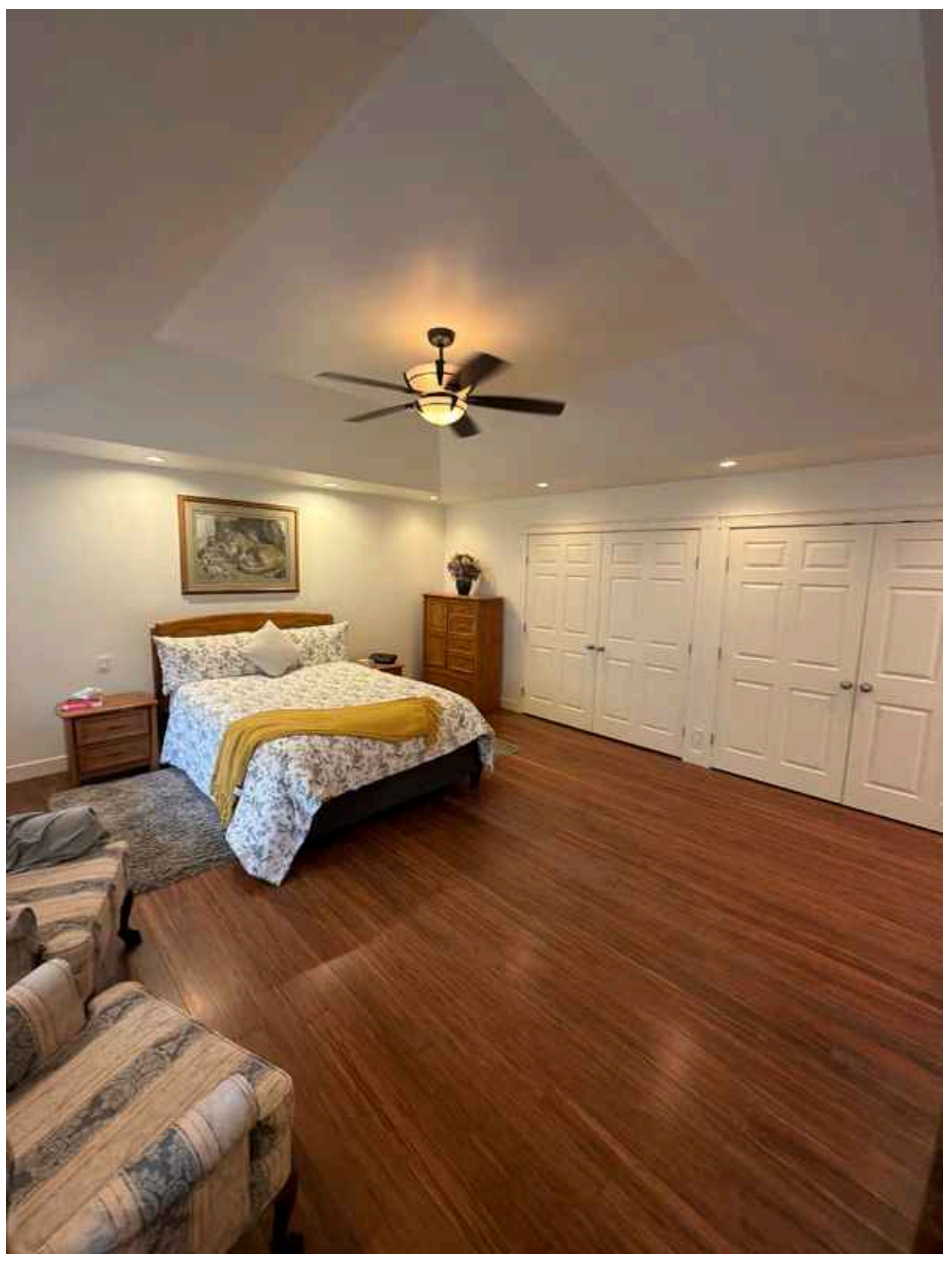



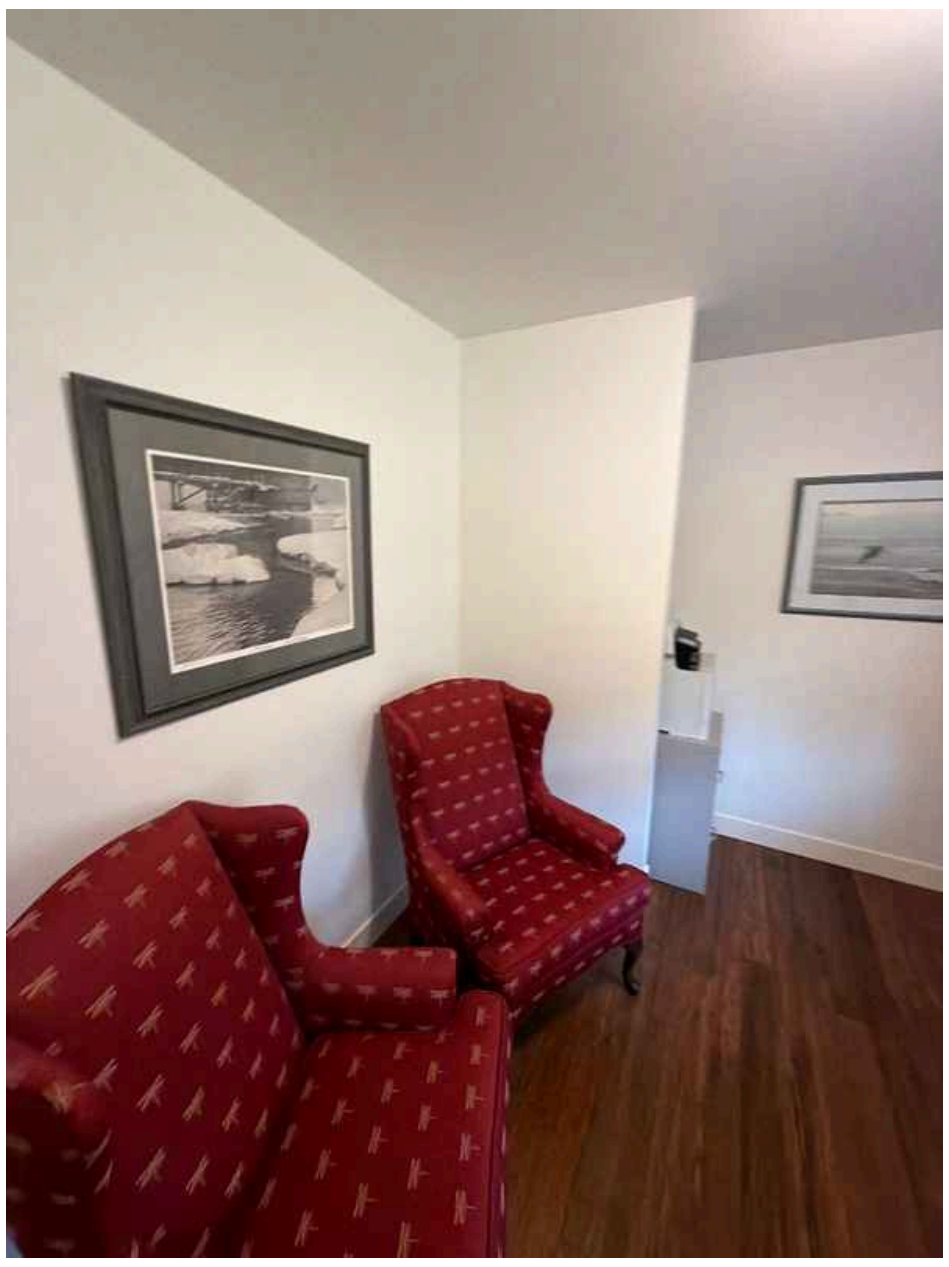
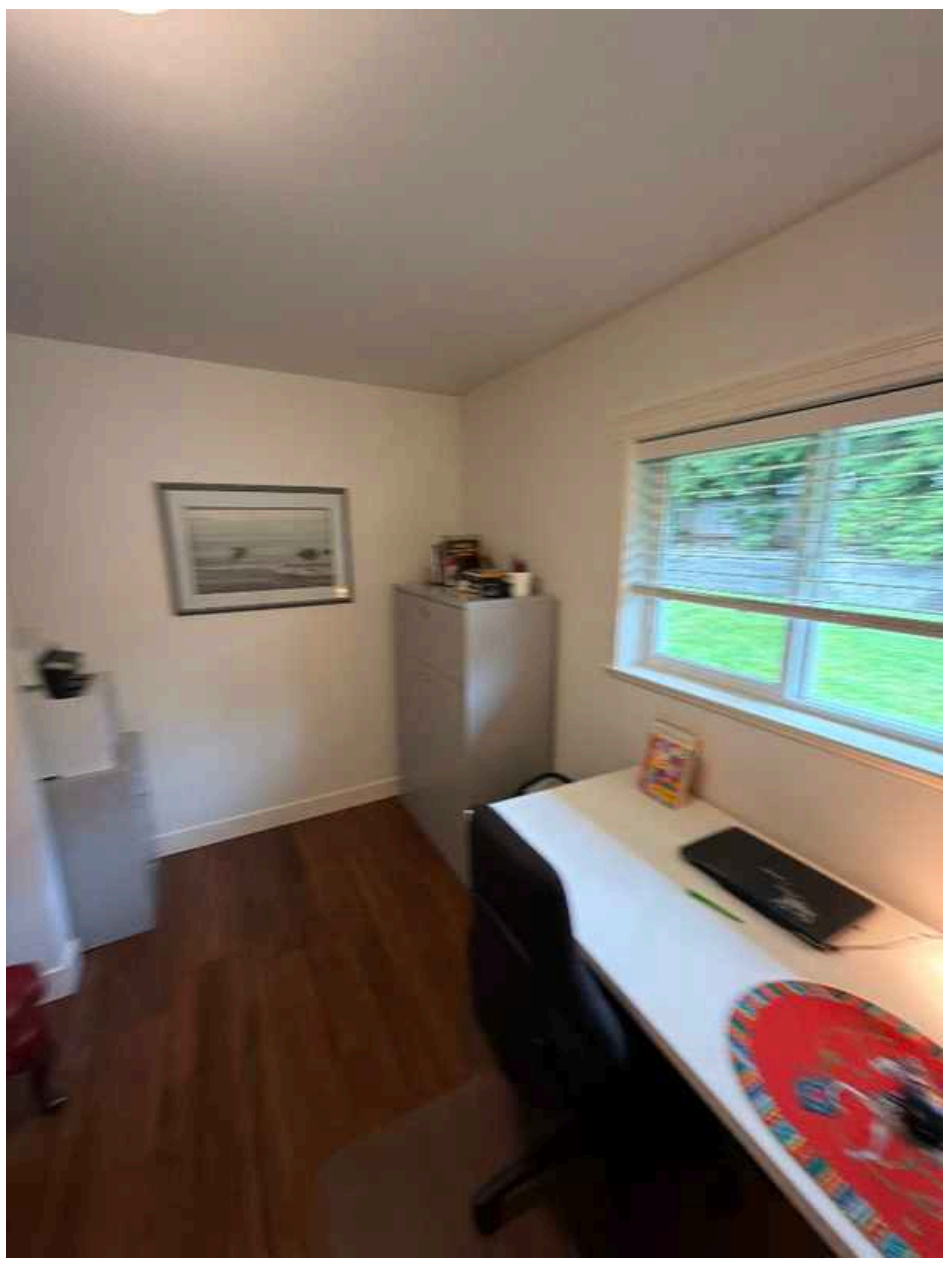
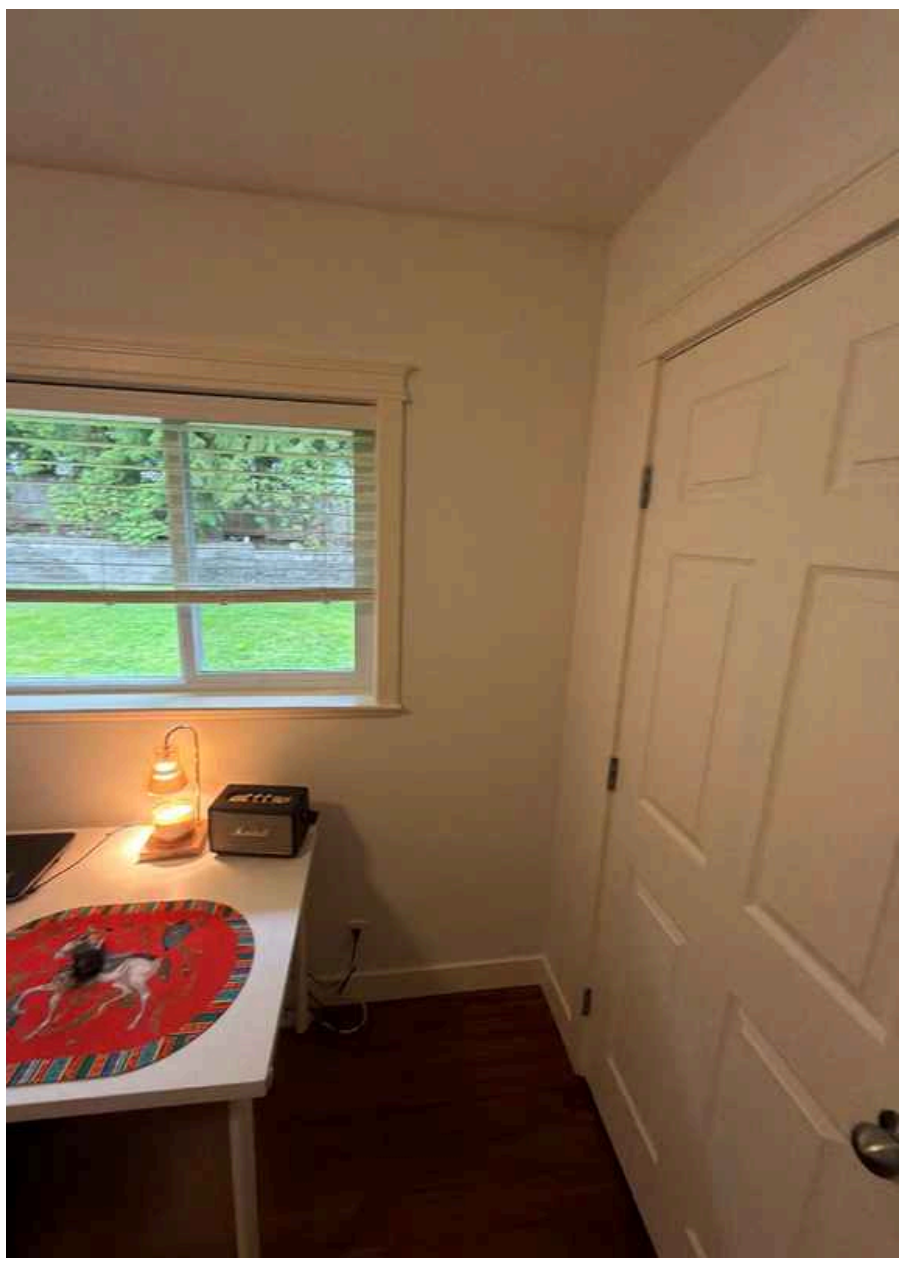


Windows: Window Manufacturer
Unknown

Windows: Window Type
Sliders, Casement

Floors: Floor Coverings
Laminate, Tile

Walls: Wall Material
Drywall

Ceilings: Ceiling Material
Gypsum Board

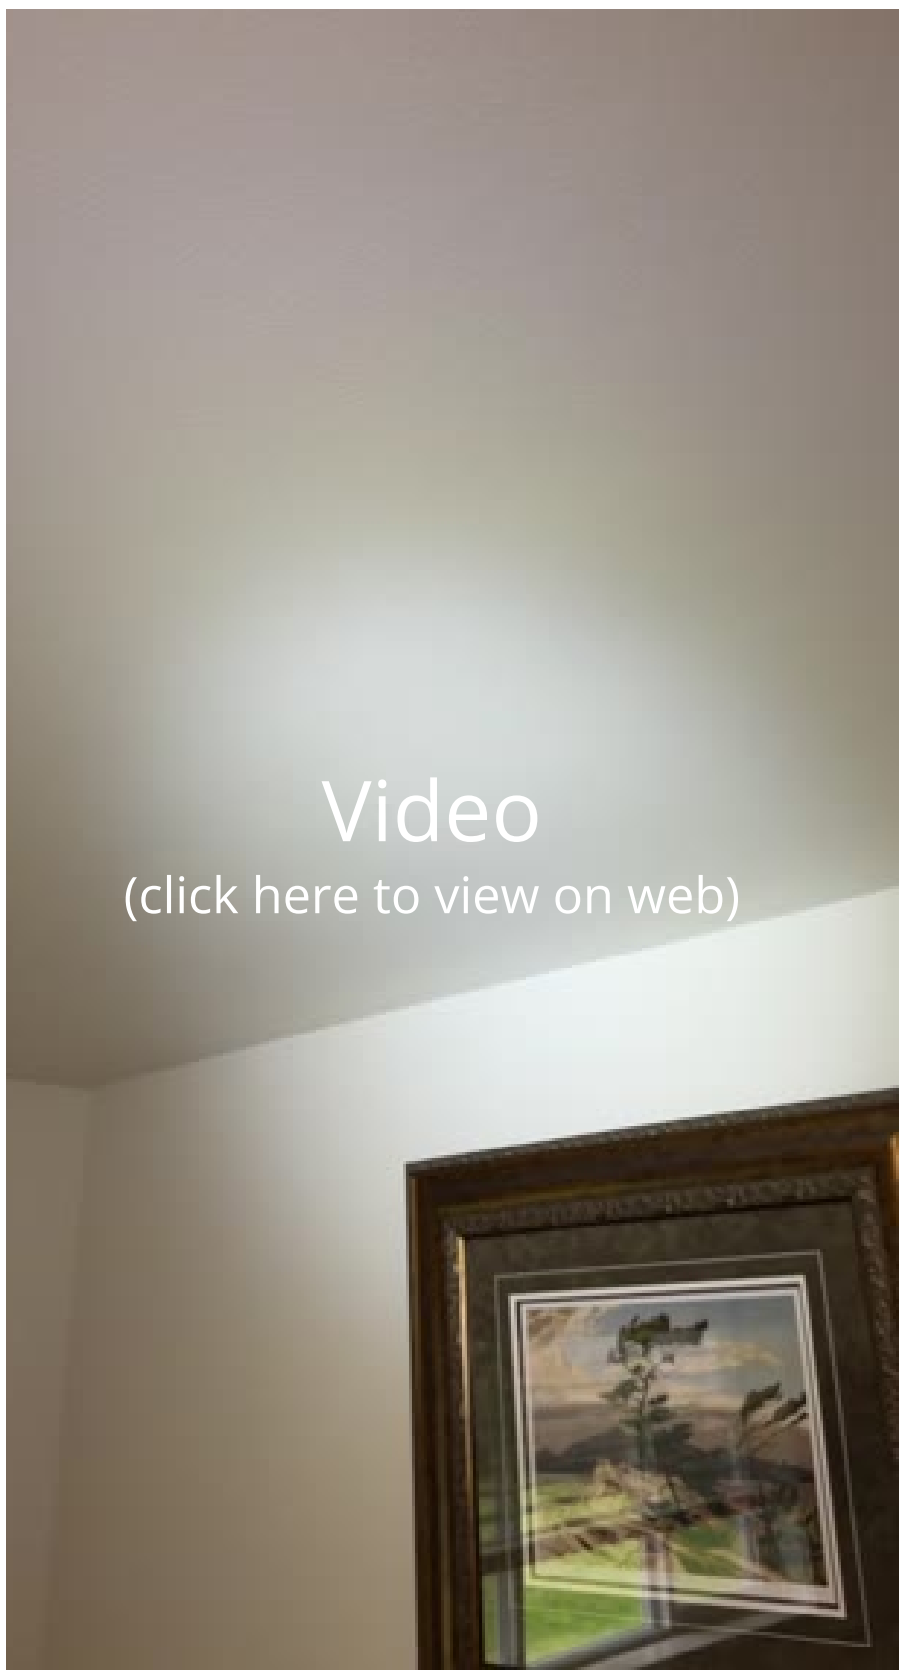

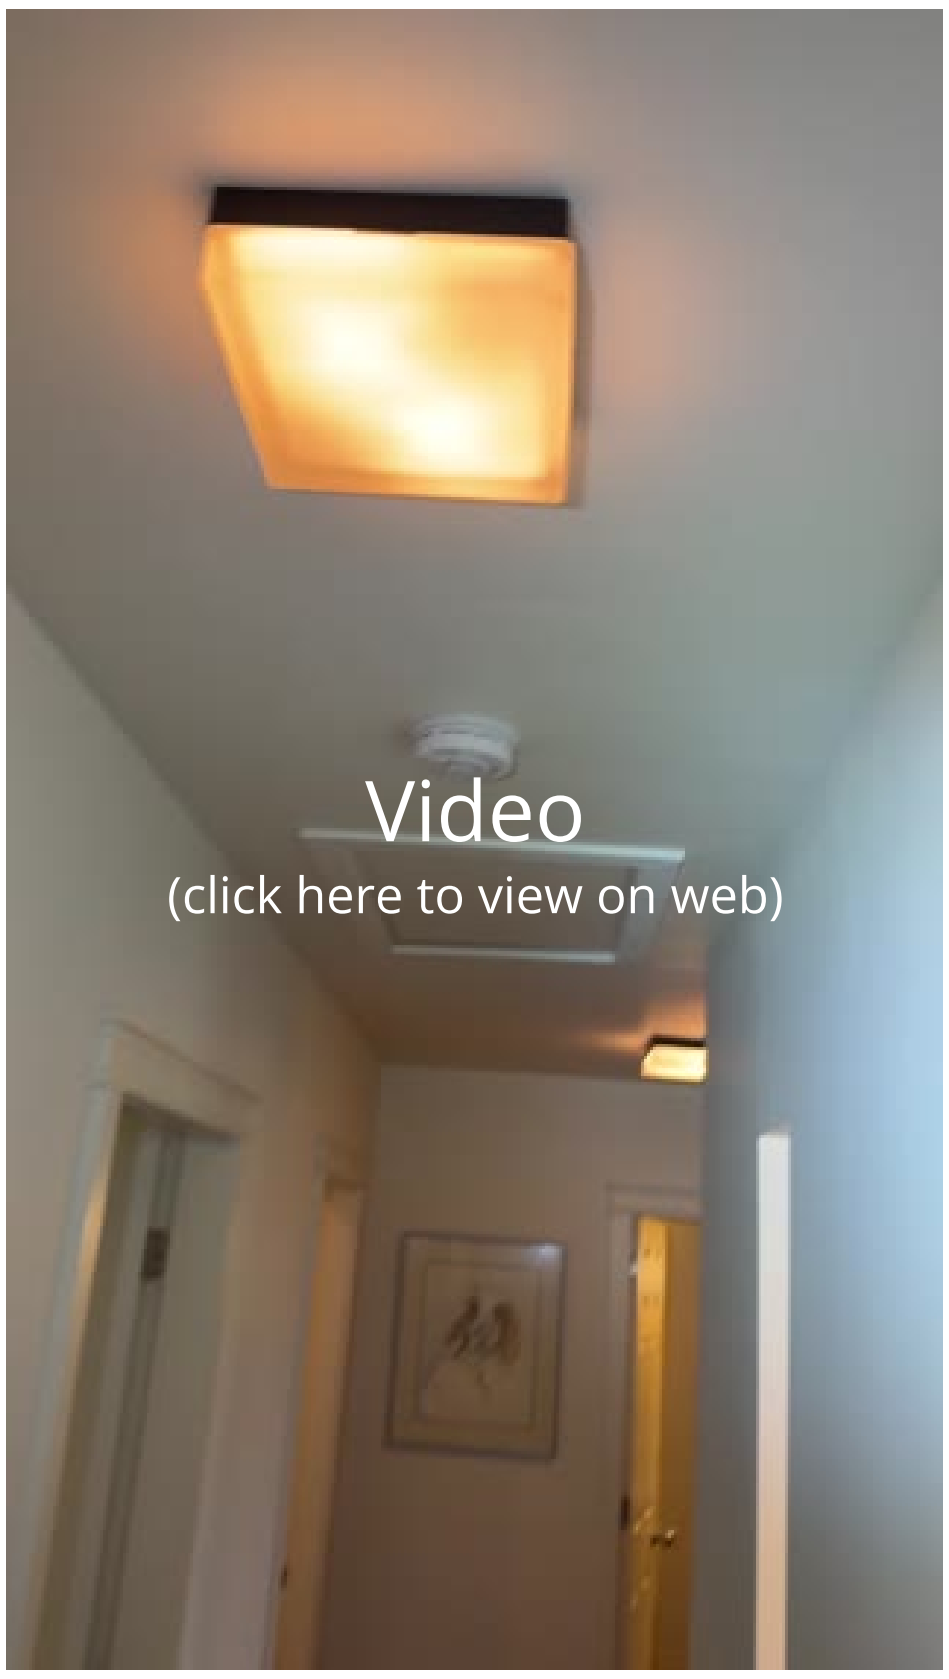

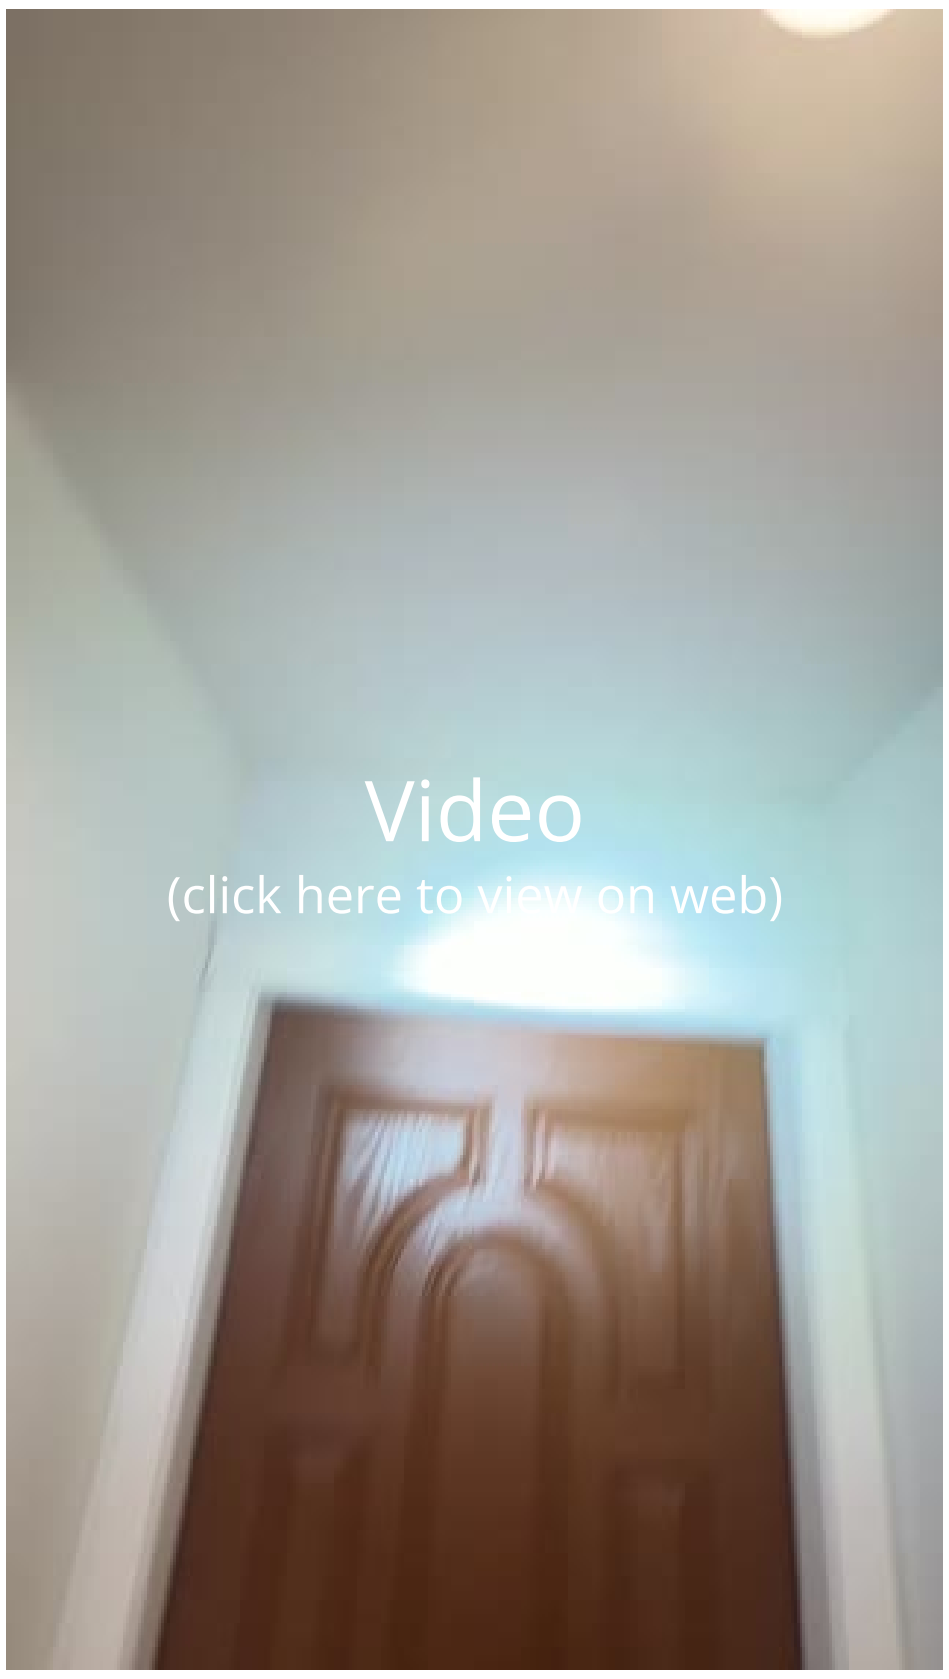

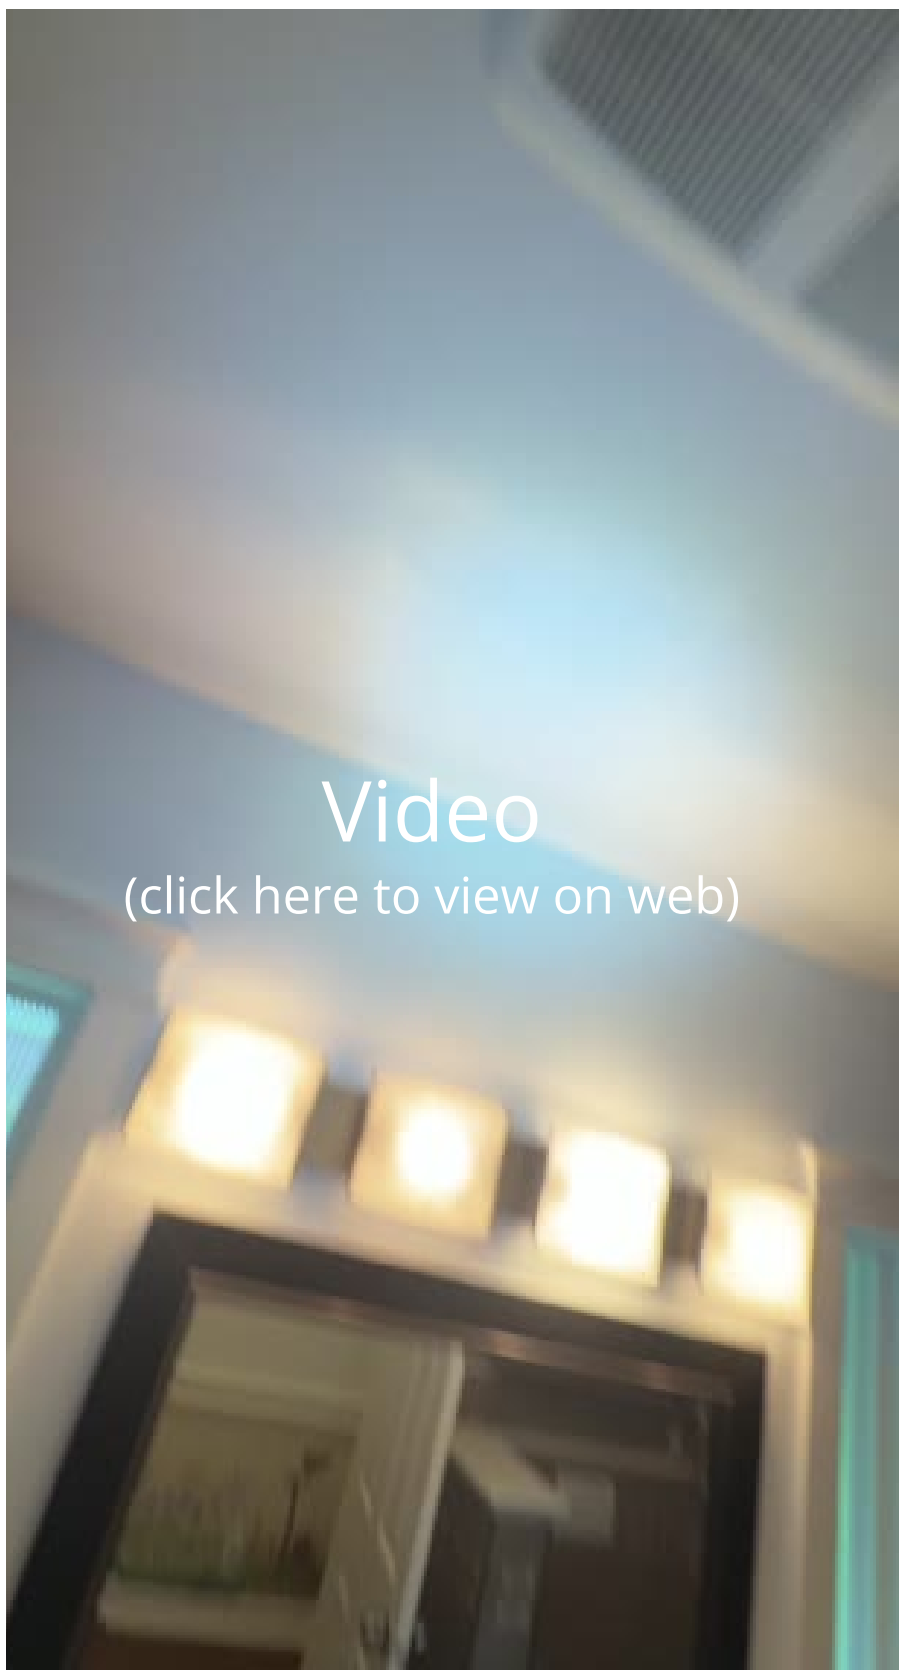

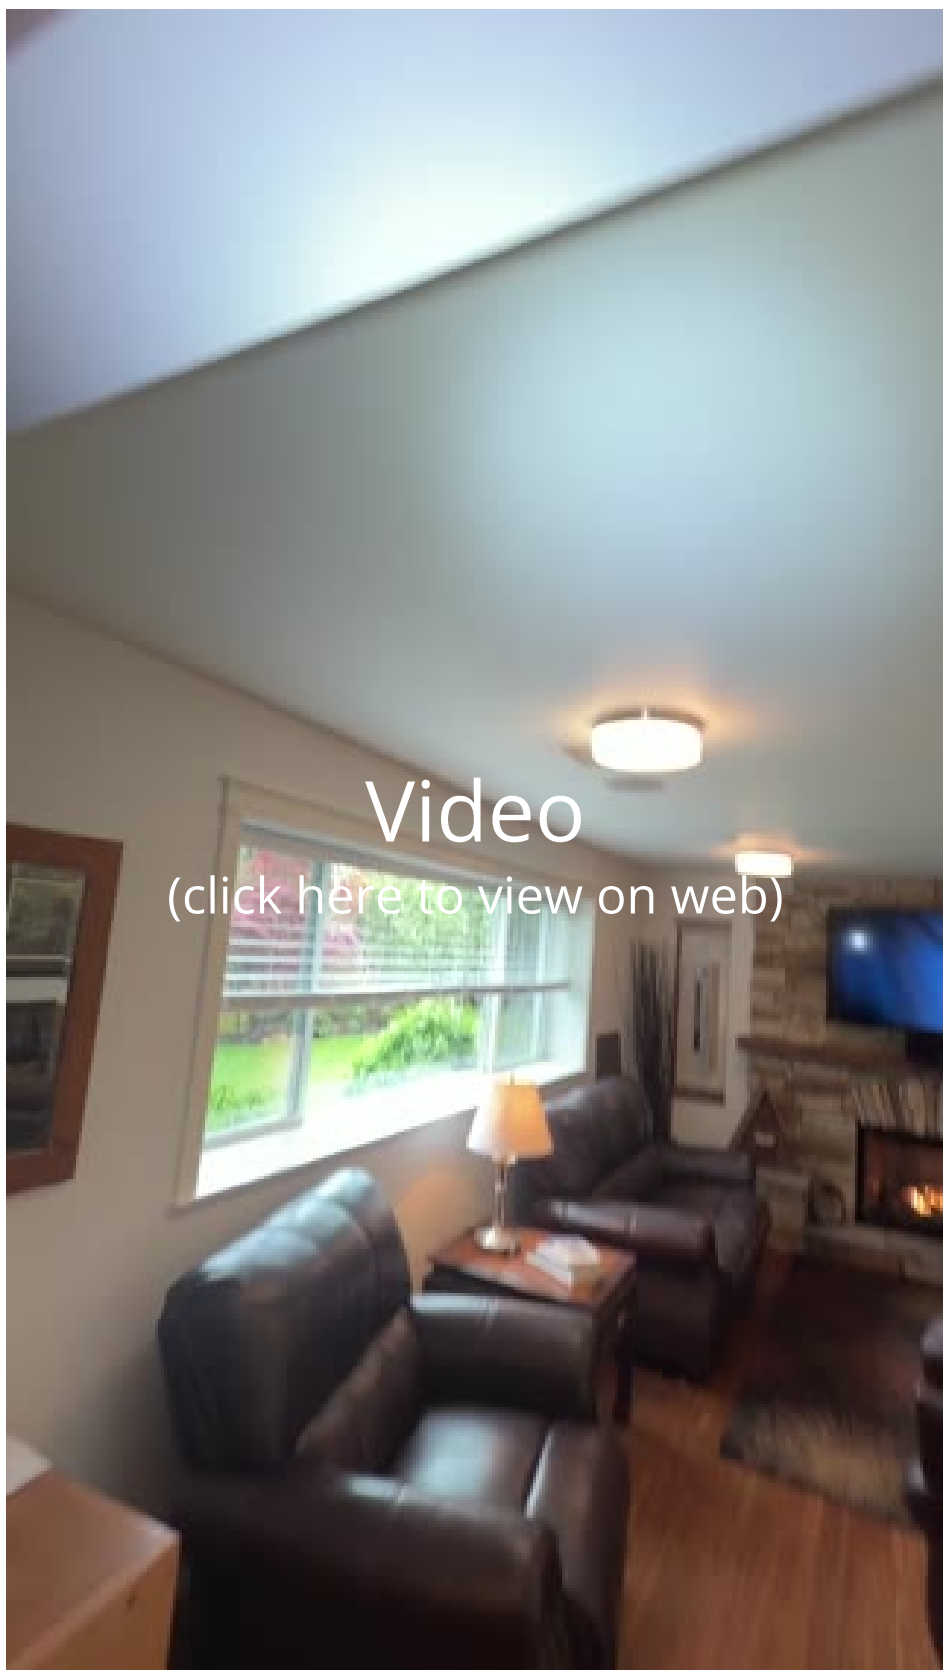

Countertops & Cabinets: Cabinetry
Wood

Countertops & Cabinets: Countertop Material
Quartz

Limitations

General

BELONGINGS BLOCKING INSPECTION ACCESS

Personal belongings and stored items are present in the inspection area. This limits the ability to fully assess all components and conditions during the inspection process. Clear access to walls, floors, and fixtures is necessary for a thorough evaluation.

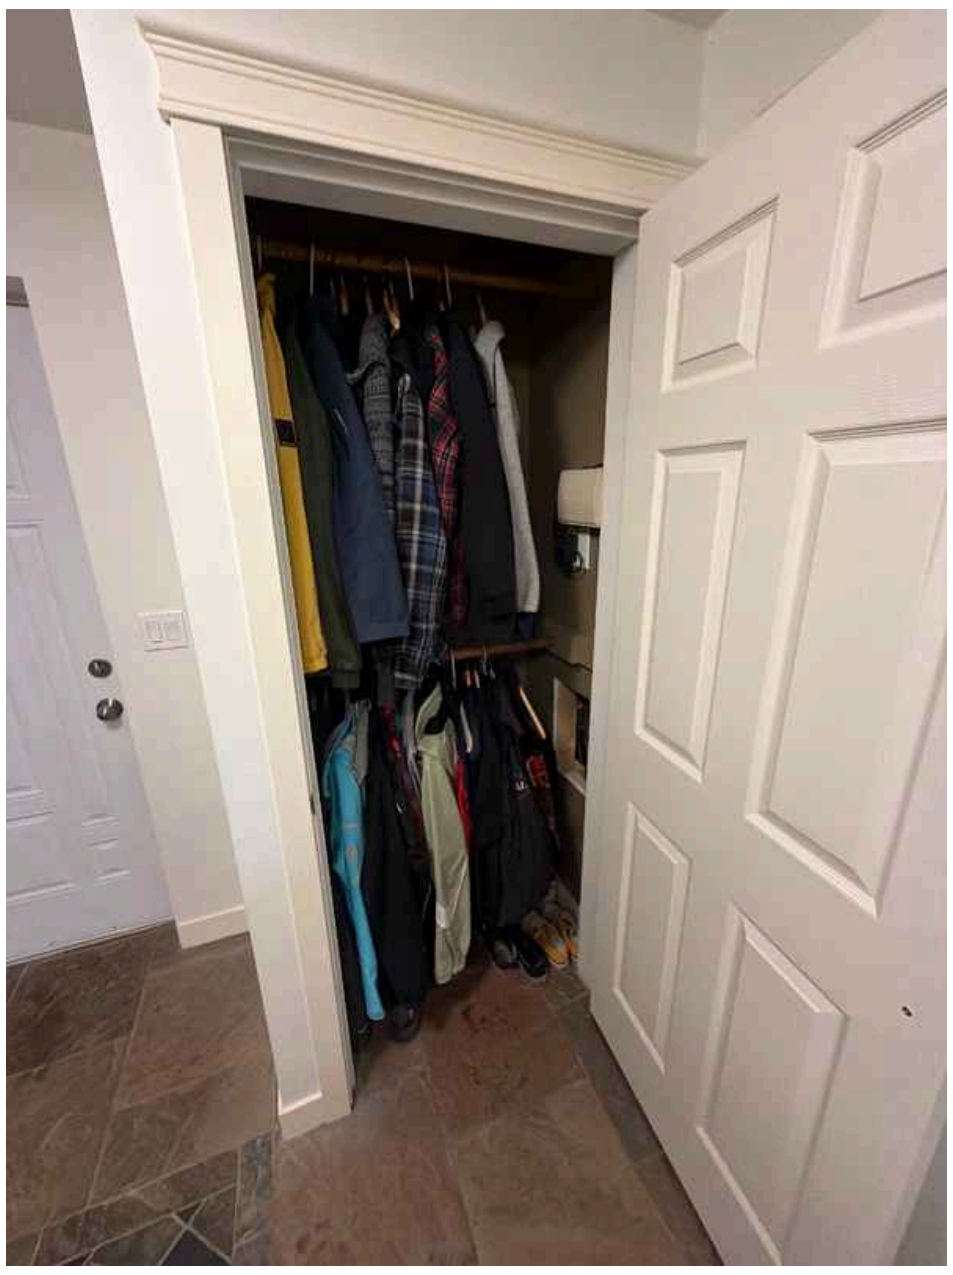


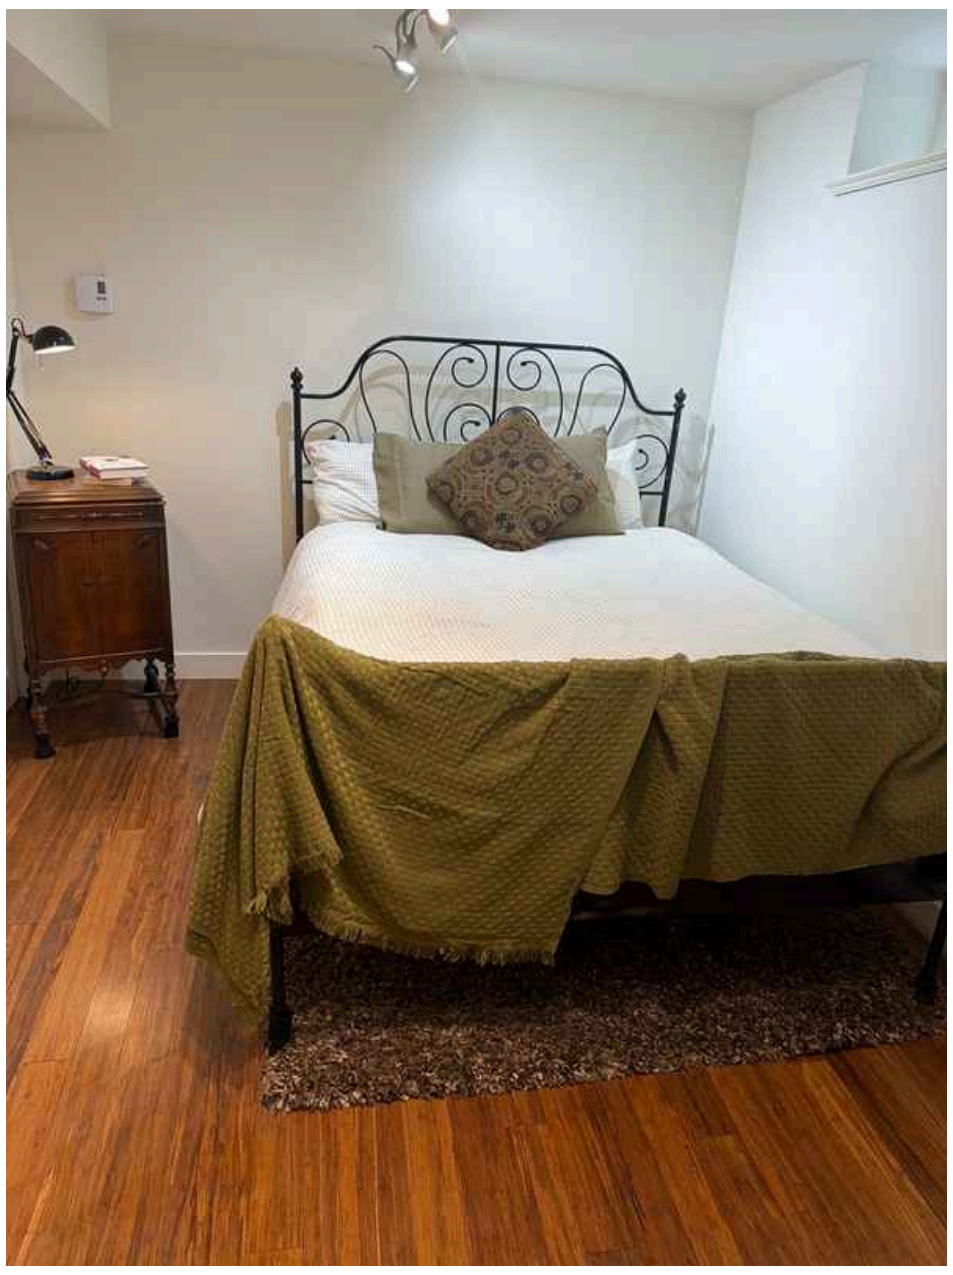

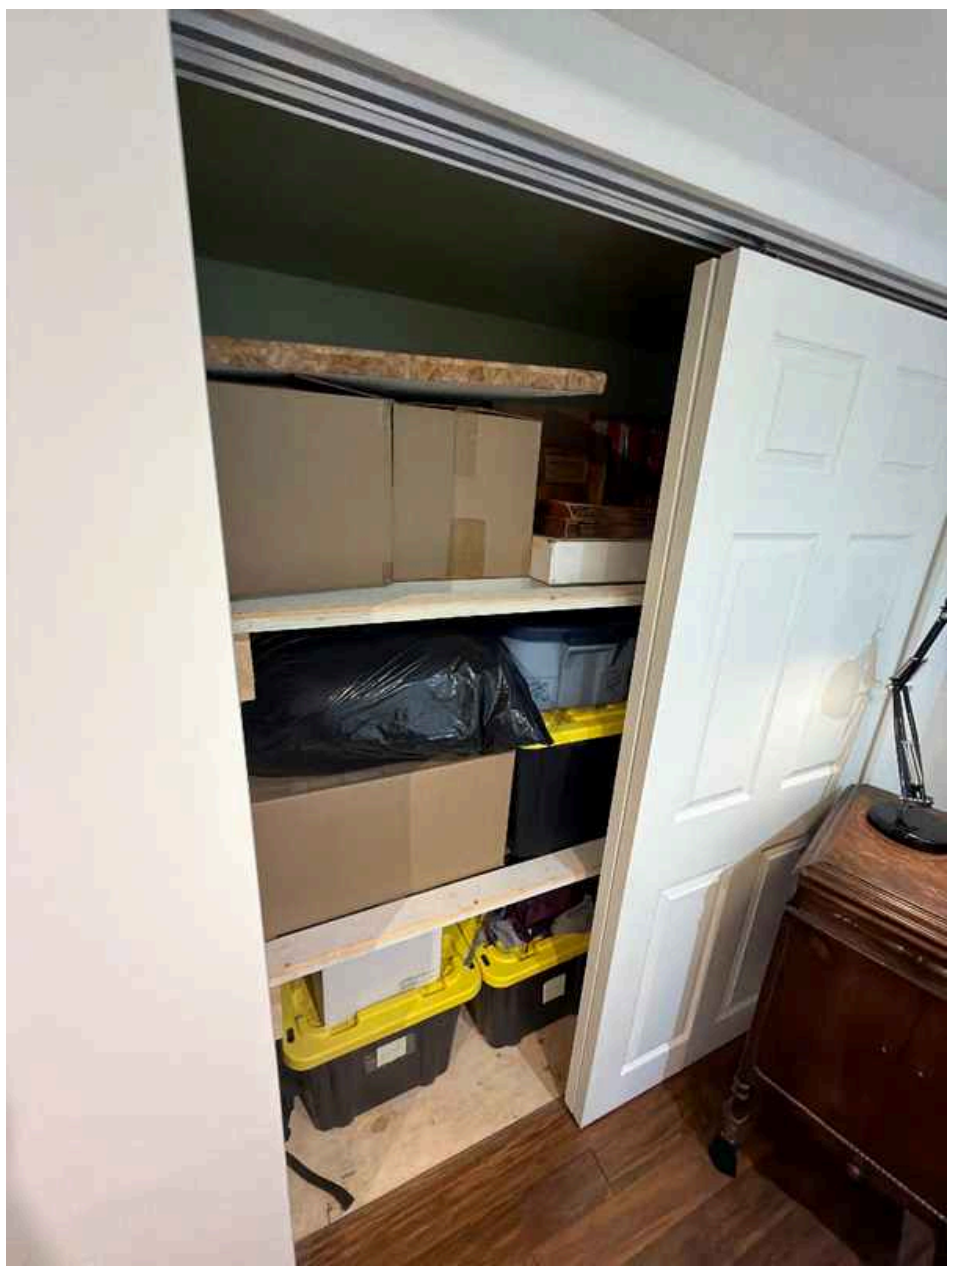

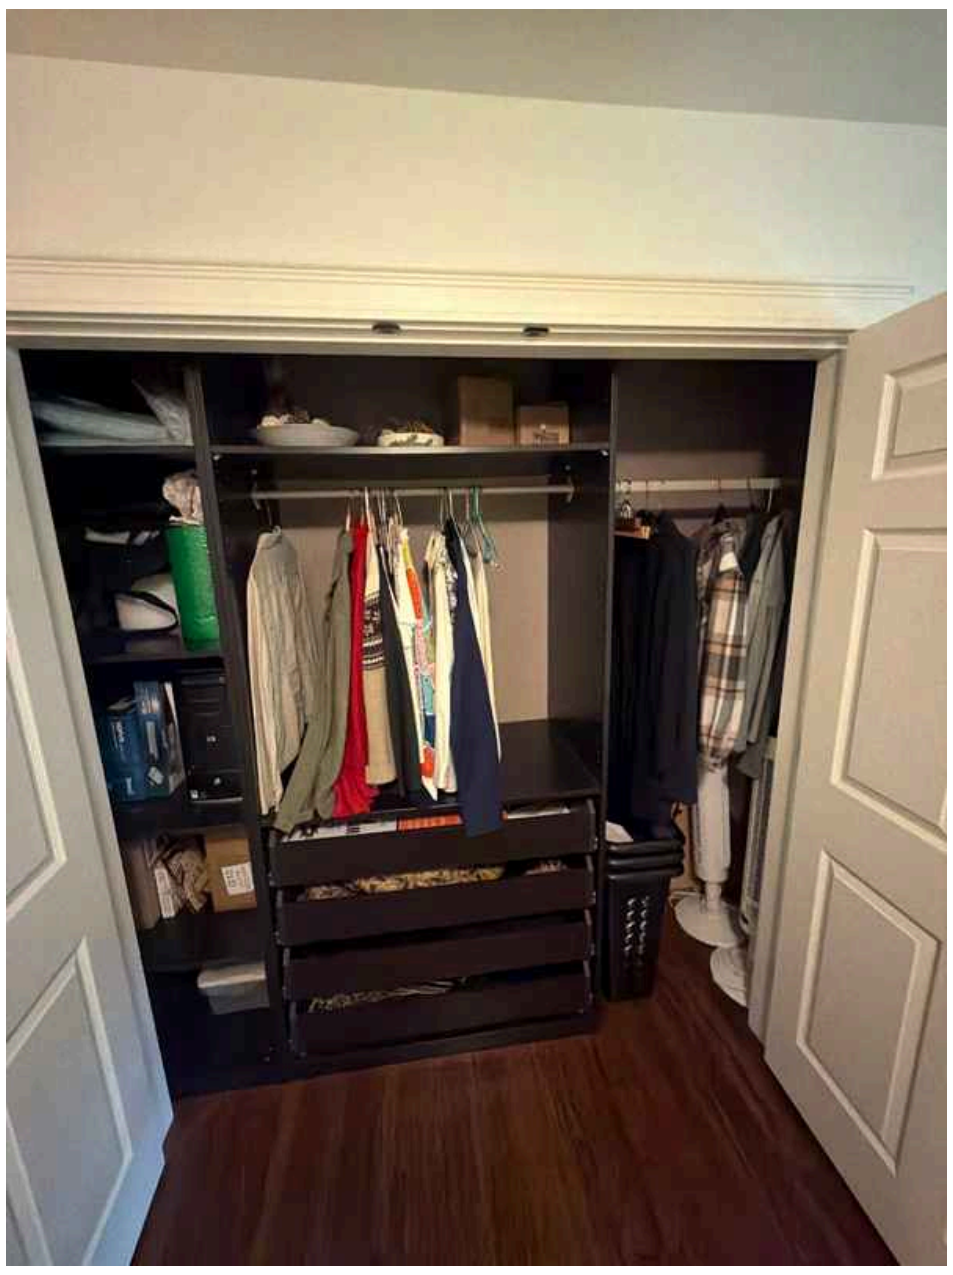

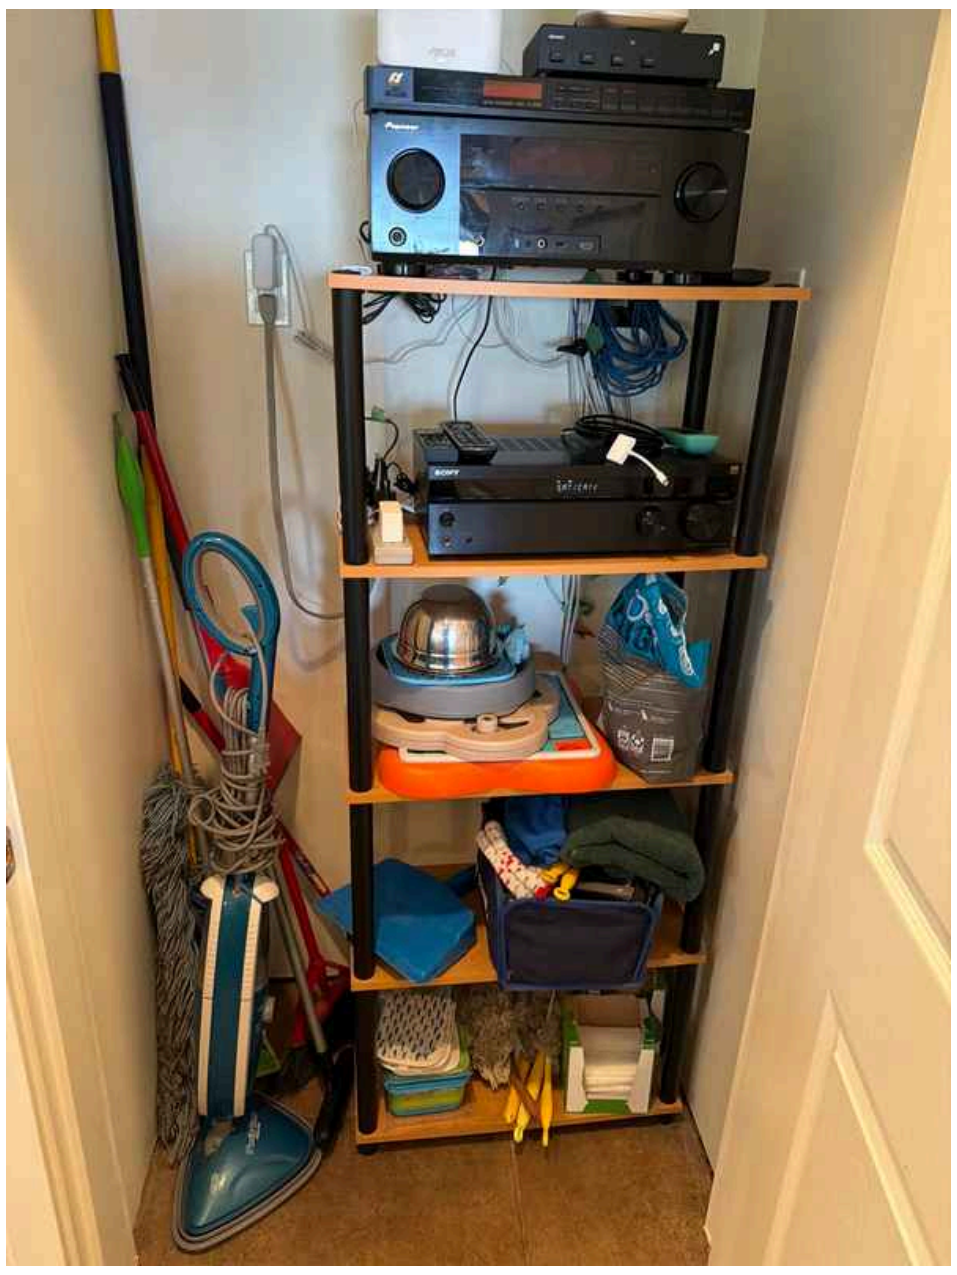

Deficiencies

10.2.1 Windows

Maintenance Item

DETERIORATED WINDOW AND DOOR CAULKING

Caulking around windows and doors has deteriorated and requires maintenance. Compromised caulking allows air and water infiltration, reducing energy efficiency and potentially leading to water damage, rot, and drafts. Have a qualified professional inspect the caulking condition and re-caulk or seal gaps as needed to restore a proper weather-tight barrier.

Recommendation

Contact a qualified professional.

Throughout

10.2.2 Windows

Safety Hazard

WINDOW CHILD SAFETY DEVICES

Windows should be equipped with appropriate child safety devices to prevent accidental falls and injuries. Common safety measures include window locks, stops that limit opening distance, and guards or bars designed to protect young children from falling through open windows.

Recommendation

Contact a qualified professional.

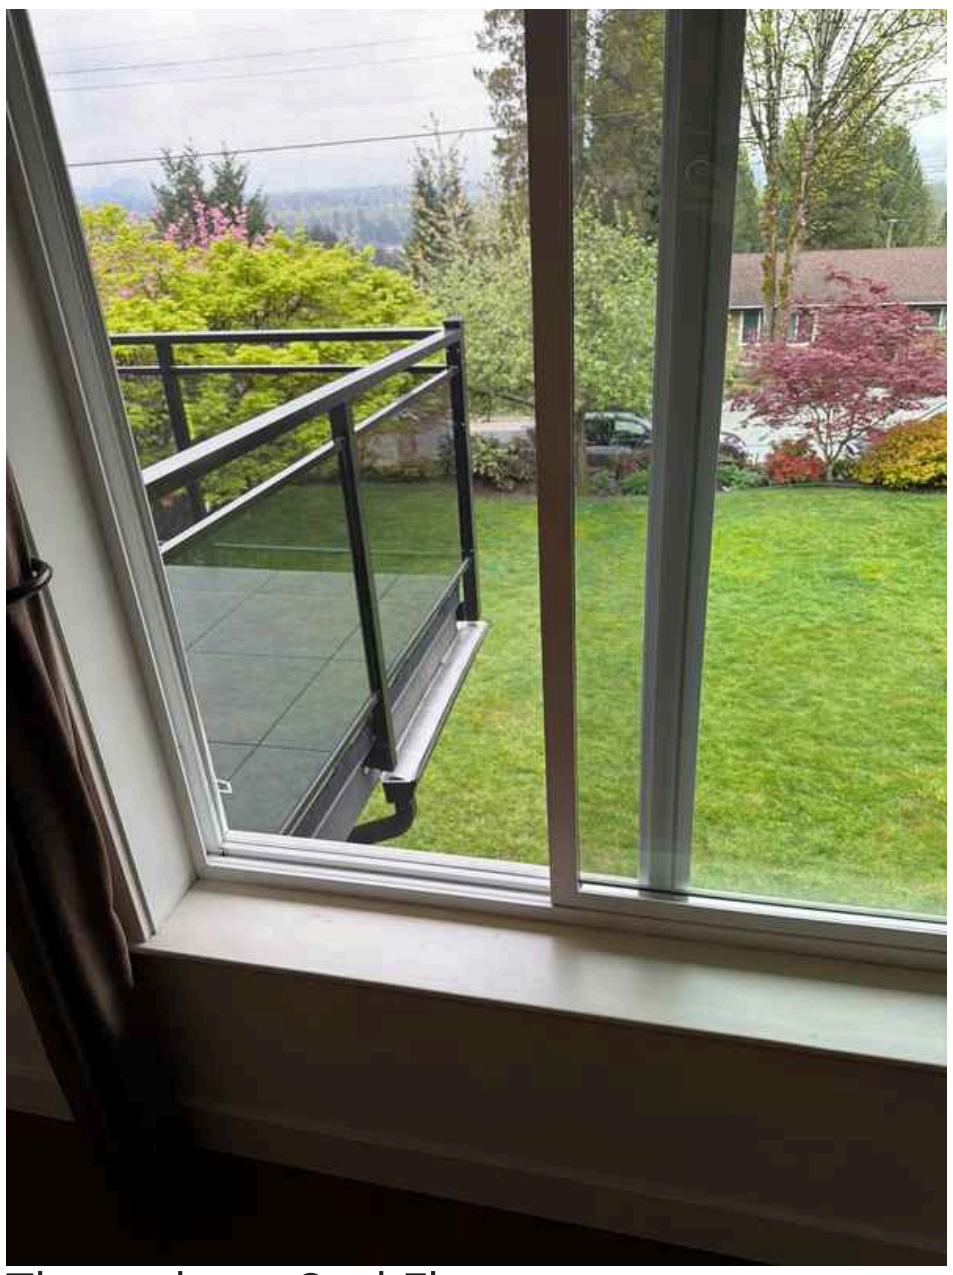
Throughout 2nd Floor


Throughout 2nd Floor


Throughout 2nd Floor

10.3.1 Floors

Maintenance Item

SQUEAKY FLOORS

Minor squeaking sounds were observed in the flooring throughout the home during inspection. Squeaky floors typically result from wood movement, loose subflooring, or fasteners working loose over time. While generally a cosmetic concern, squeaking can sometimes indicate underlying structural movement that warrants monitoring. A flooring contractor can evaluate the extent and determine if any remedial action is needed.

Recommendation

Contact a qualified professional.

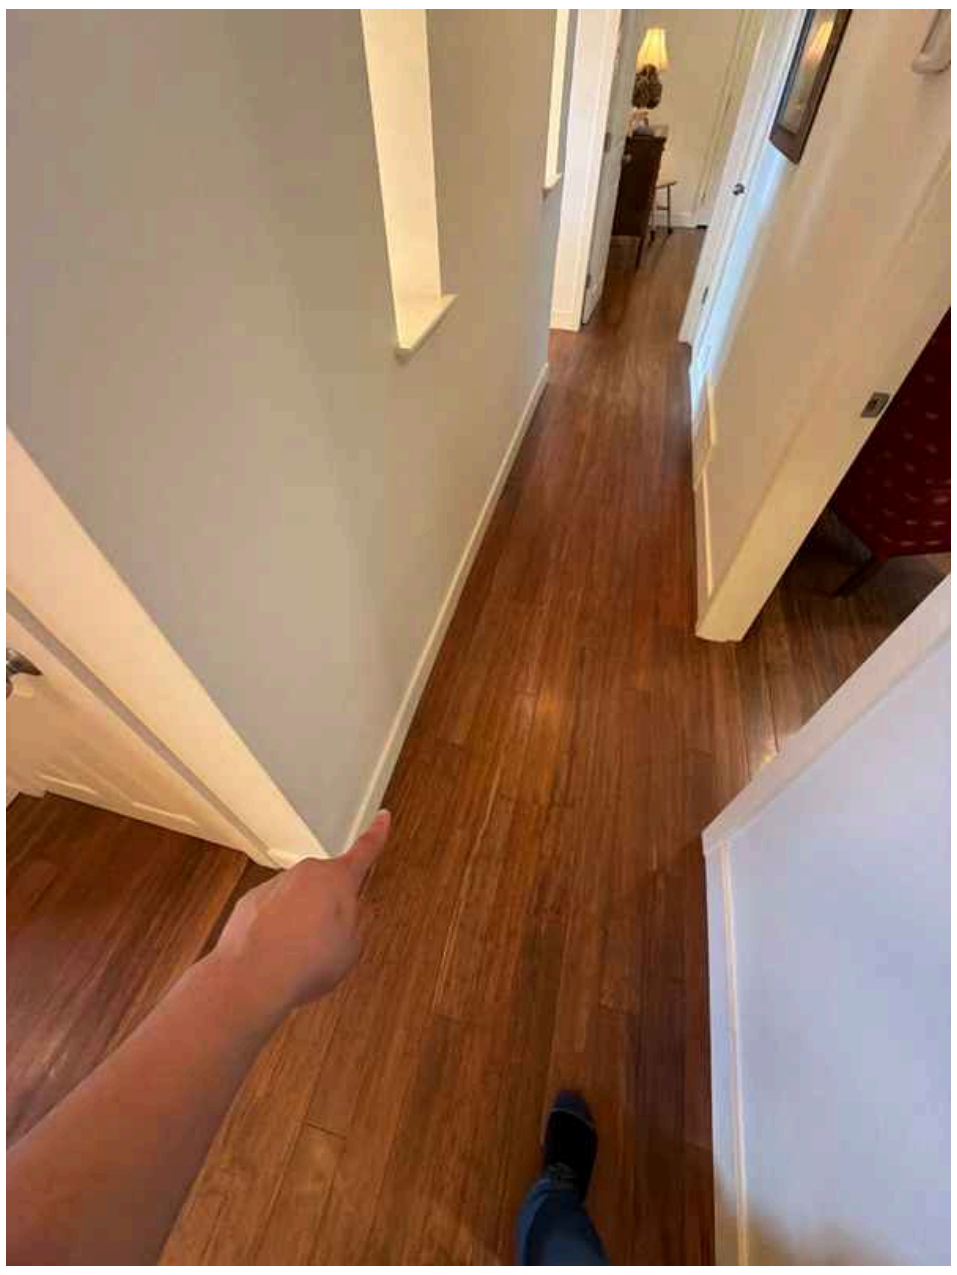

10.5.1 Ceilings

POSSIBLE ASBESTOS IN CEILING MATERIAL

Maintenance Item

Ceiling on second floor material appears to contain asbestos based on the age of the house. Asbestos-containing materials pose a health risk if disturbed or damaged, as inhalation of asbestos fibers can cause serious respiratory diseases. Professional testing and potential abatement by a qualified environmental contractor is strongly recommended before any ceiling work is performed.

Recommendation

Contact a qualified professional.

11: BUILT-IN APPLIANCES

Information

Dishwasher: Brand
Maytag, Thermodor

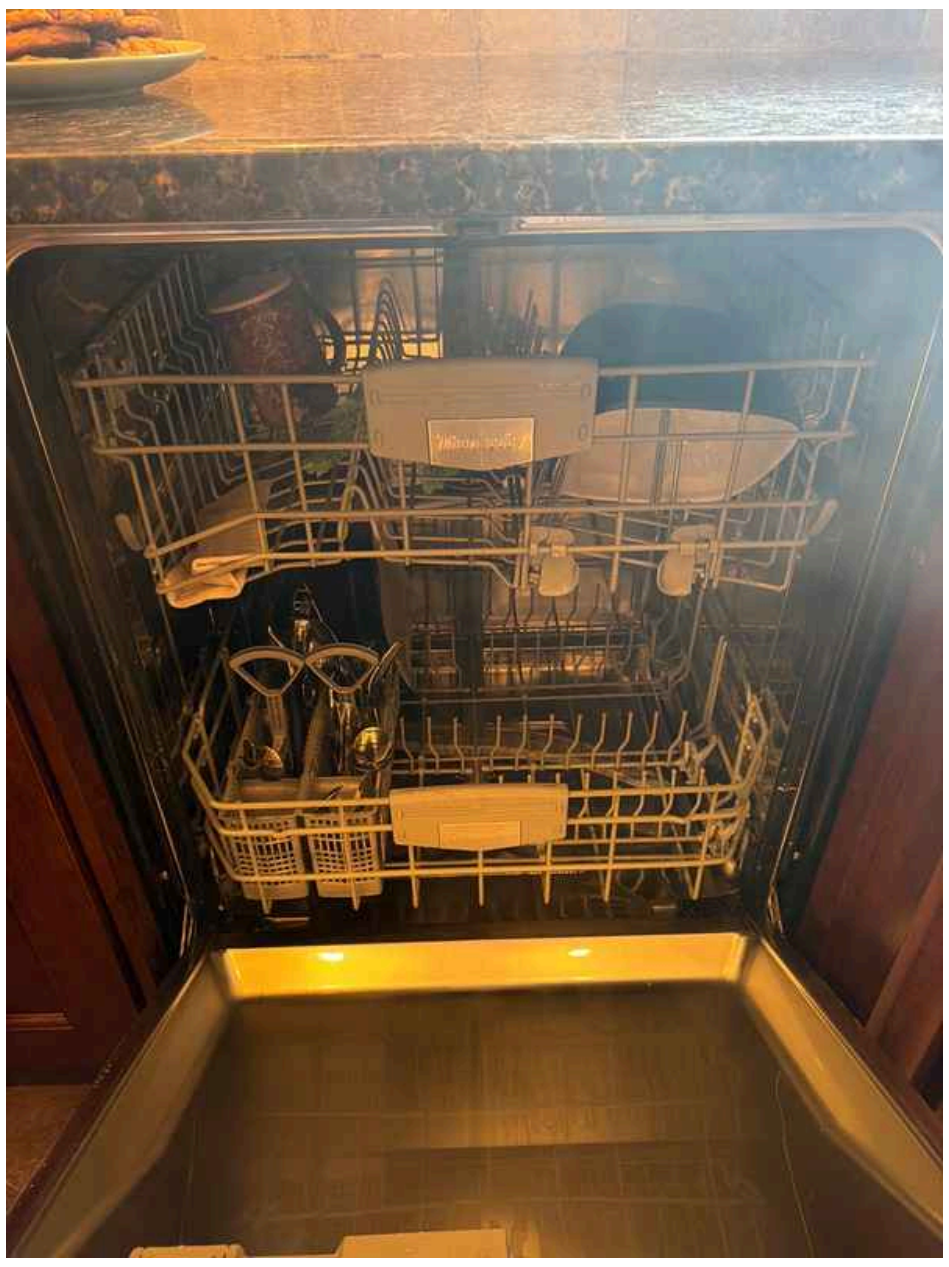

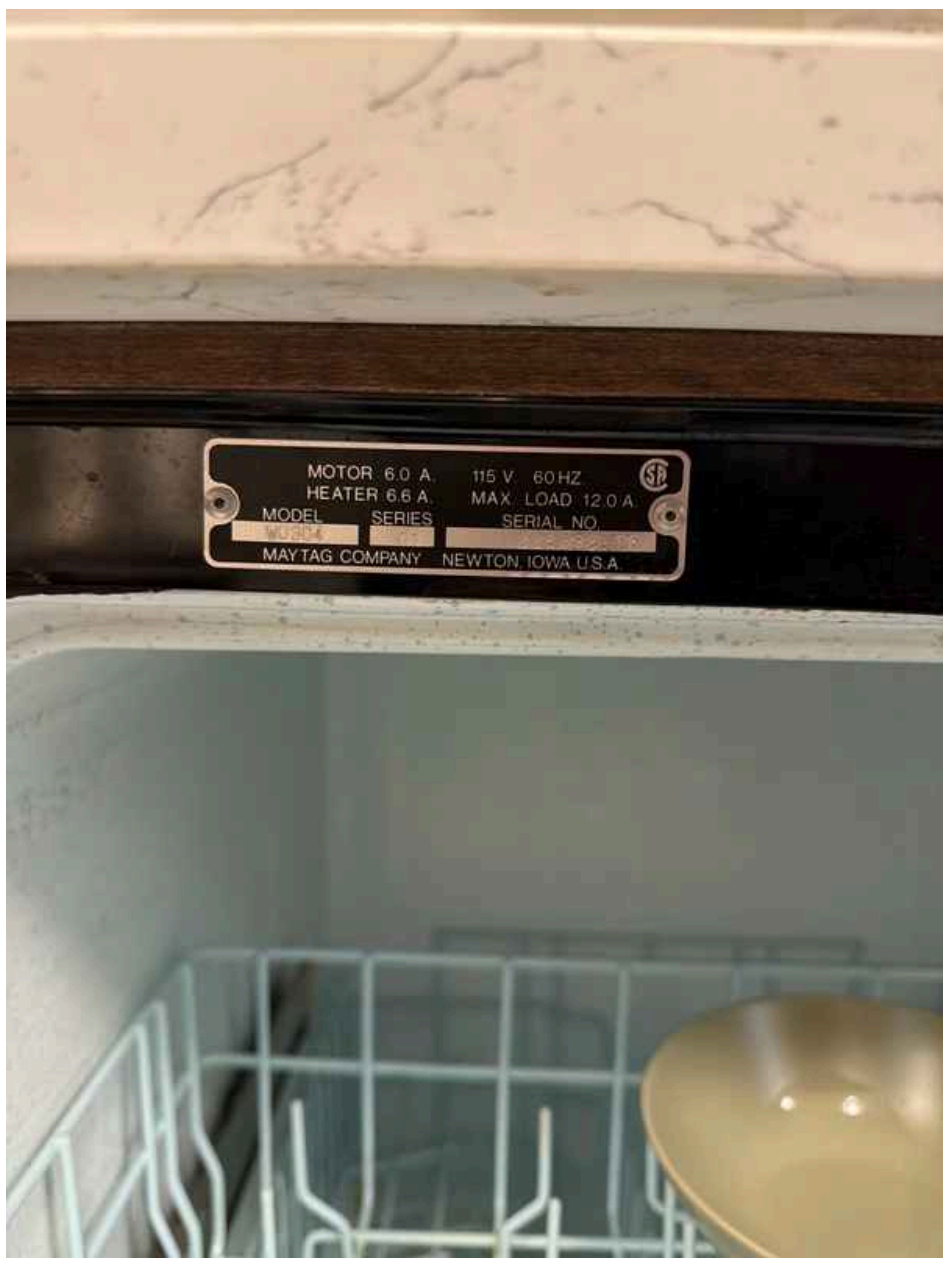

Refrigerator: Brand

Jenn Air, Maytag

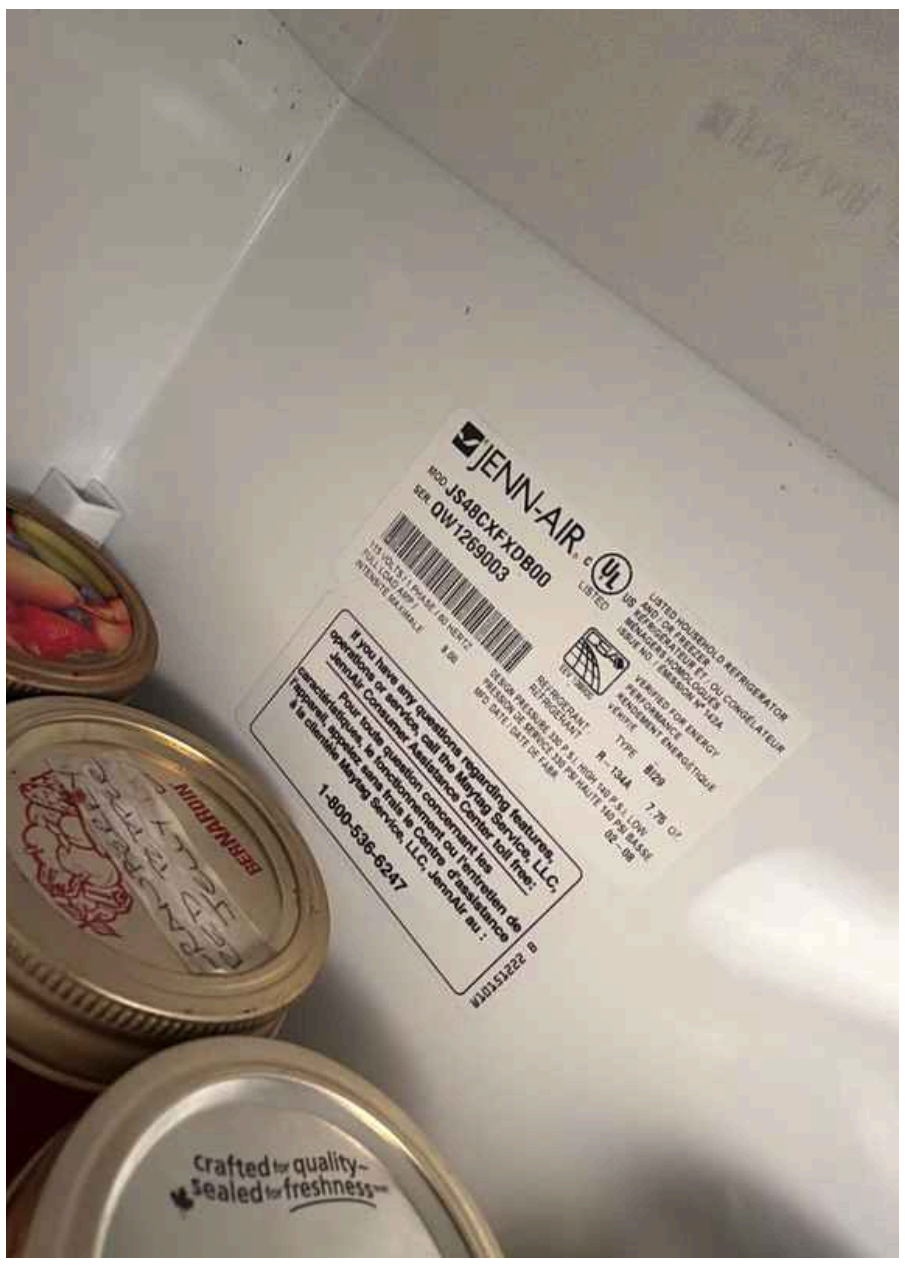







MAYTAG


Budweiser
INDÉTRÔNABLE
Moist Crisp

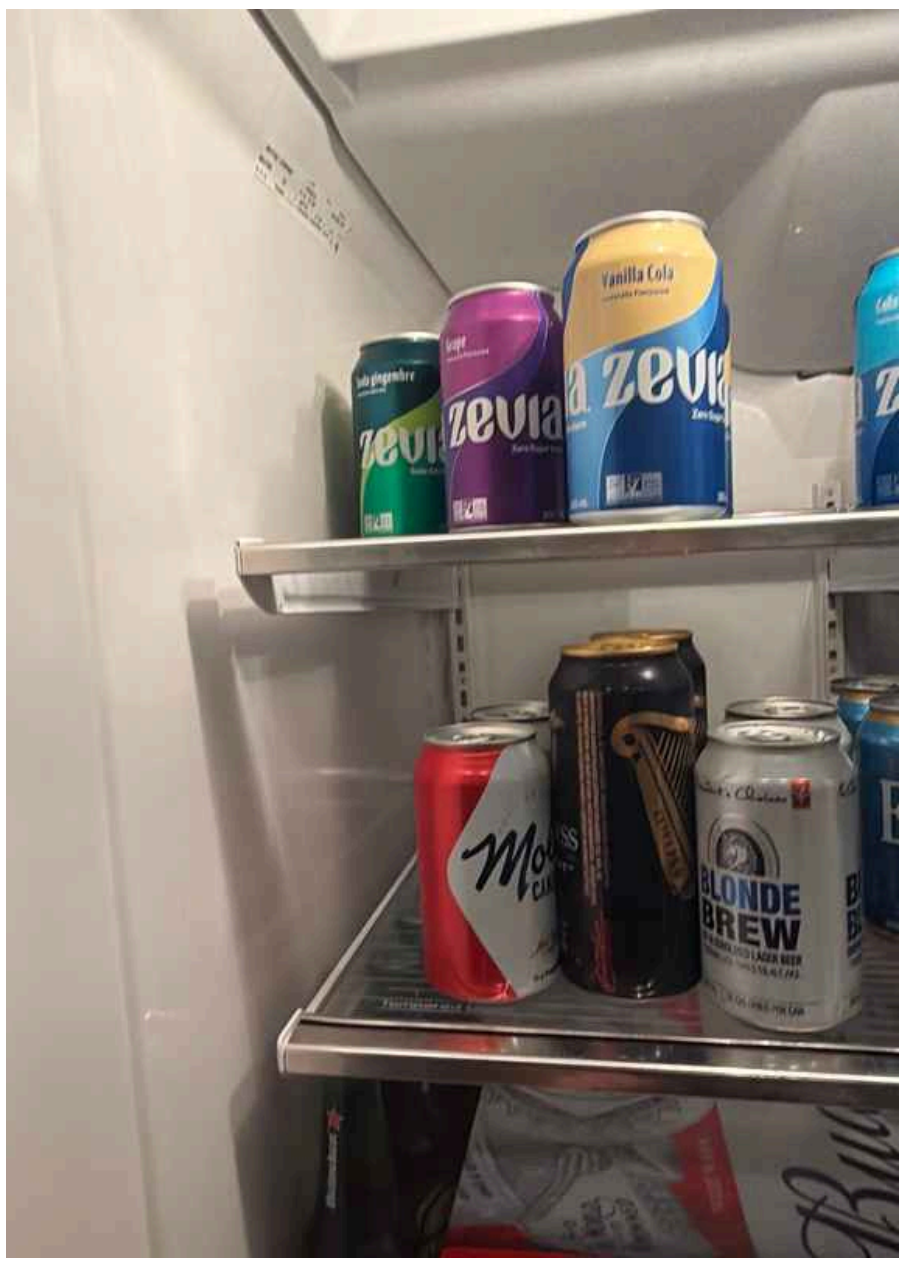
zevia
BLONDE
BREW

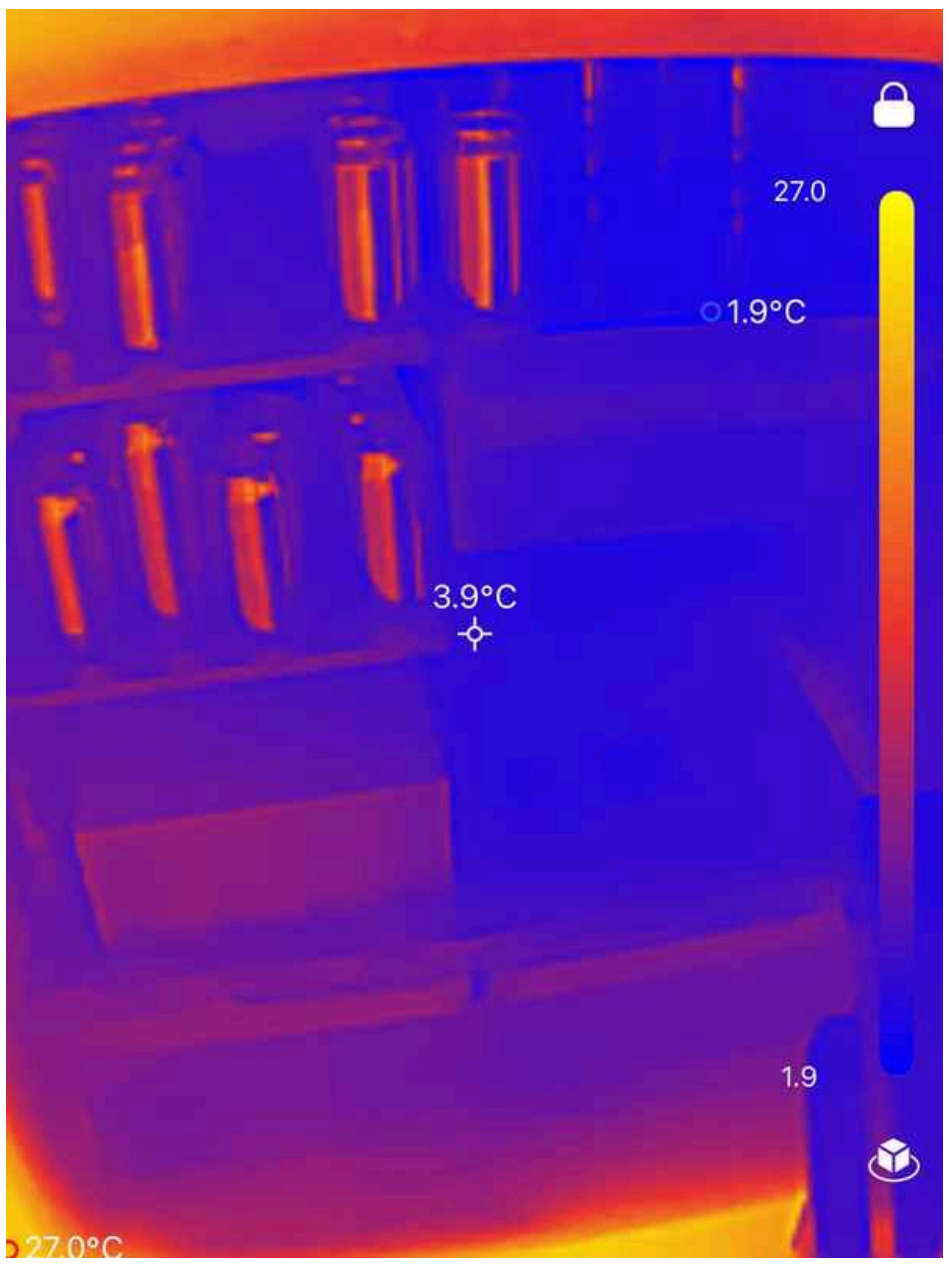
27.0
1.9°C
3.9°C
1.9
27.0°C

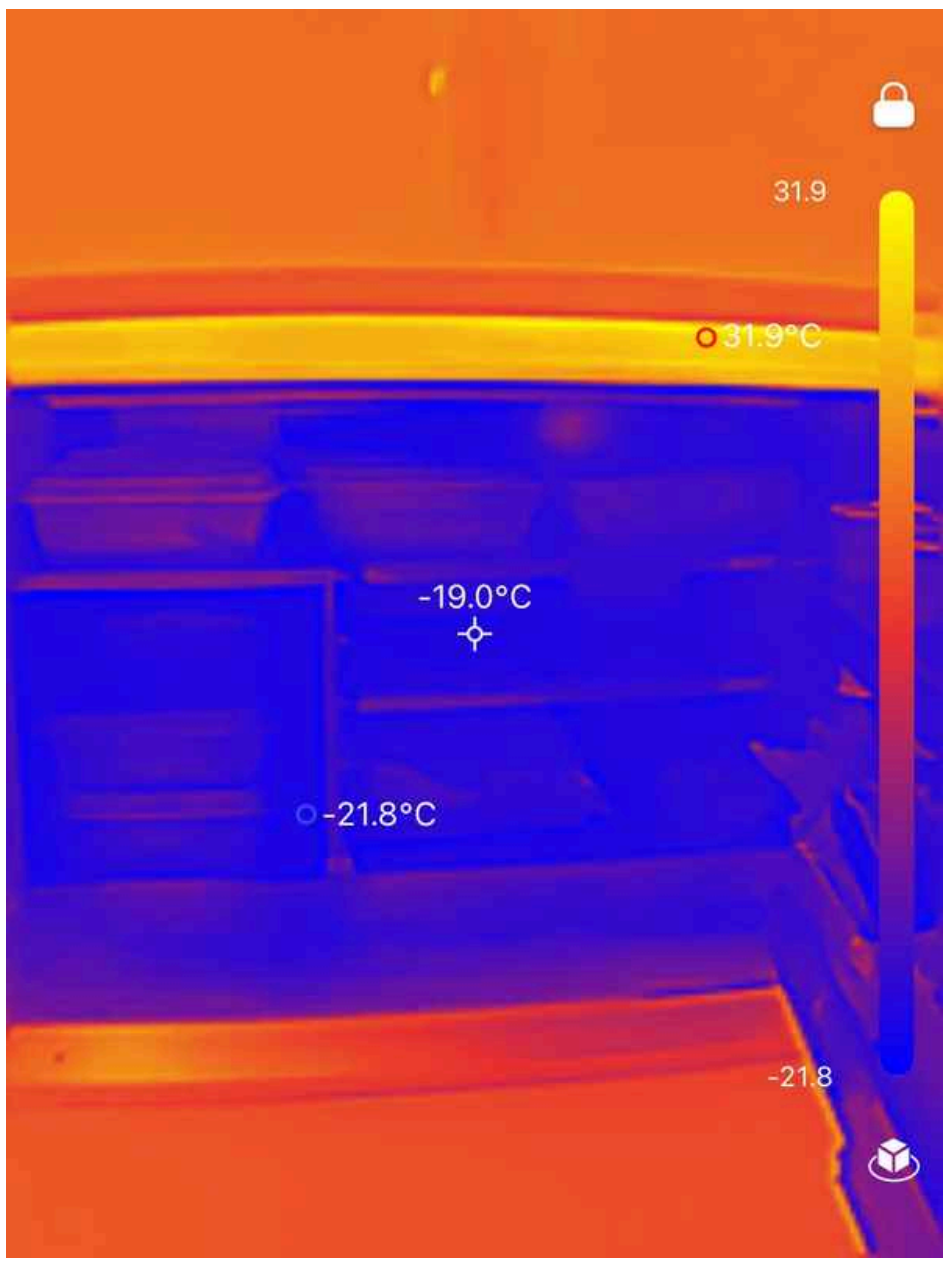
31.9
31.9°C
-19.0°C
-21.8°C
-21.8

Range/Oven/Cooktop: Exhaust Hood Type

Vented




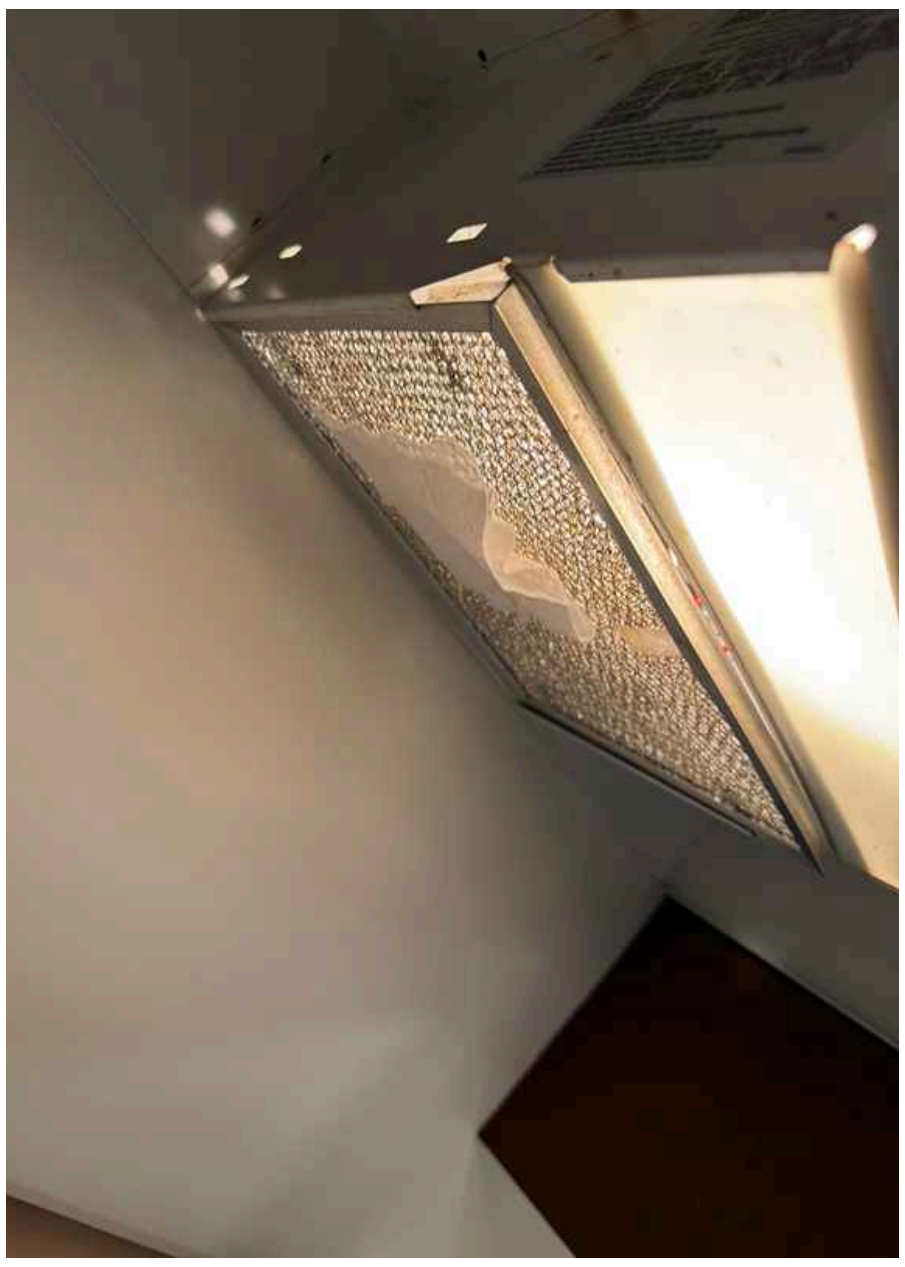

Range/Oven/Cooktop: **Range/Oven Brand**

Thermador, Inqlia

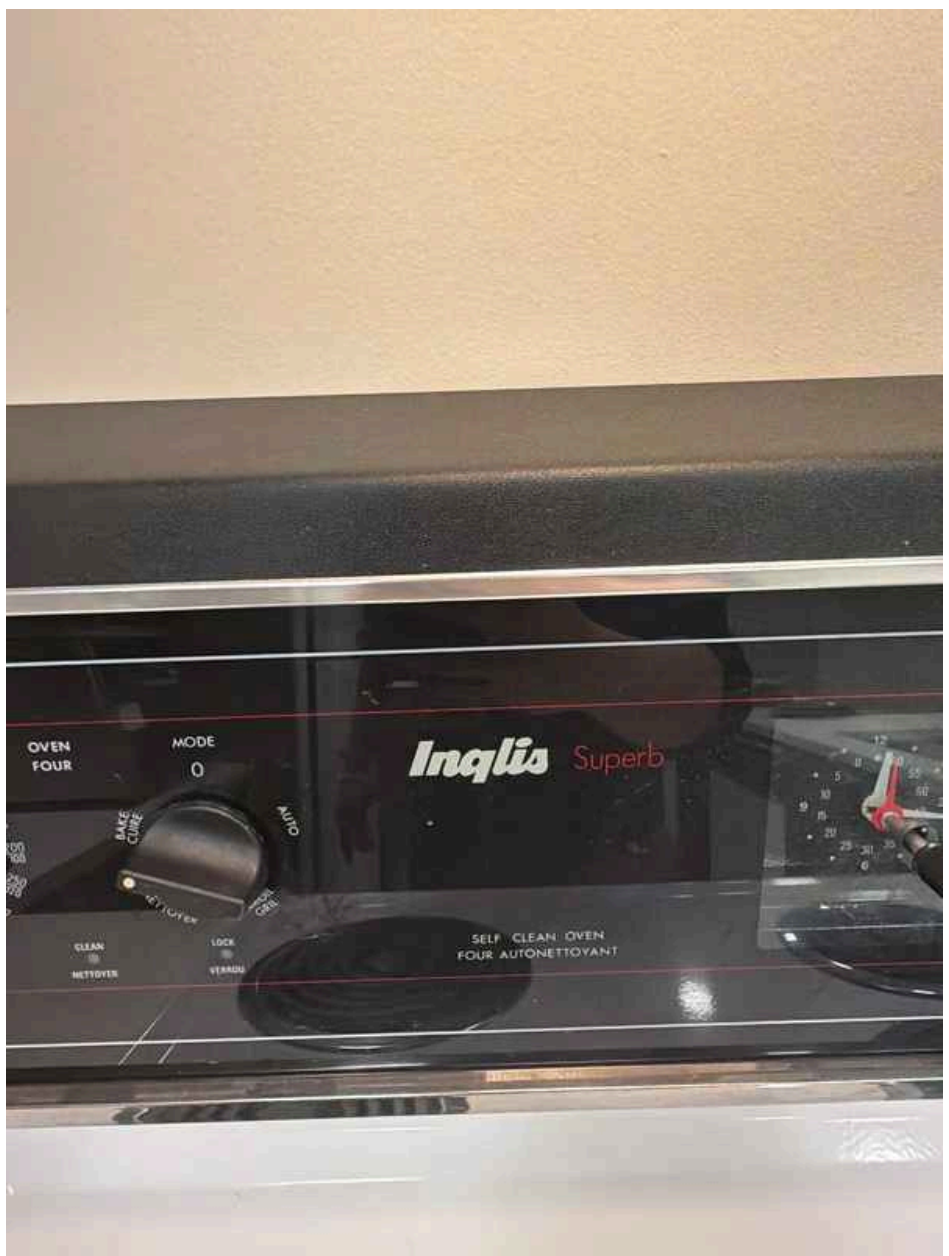

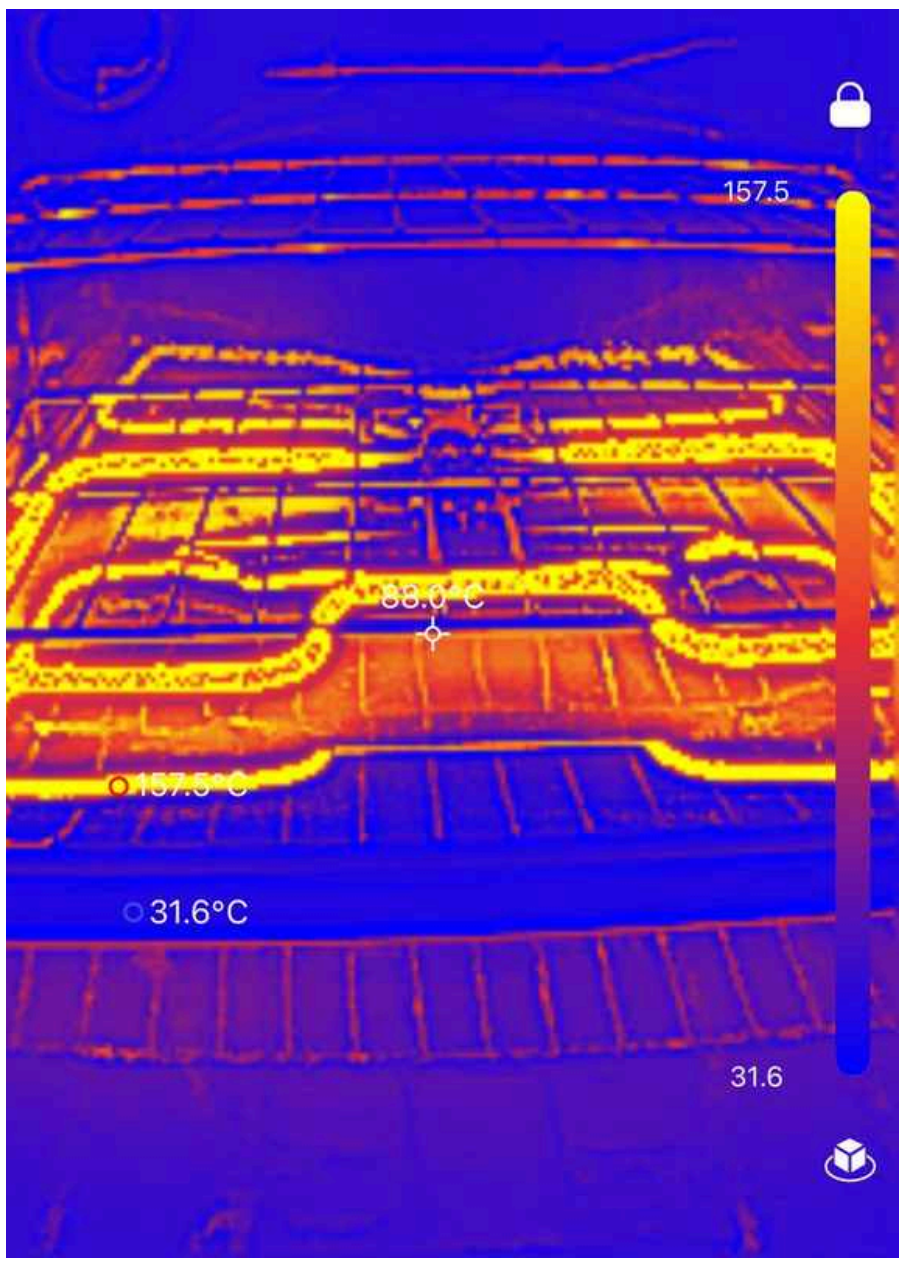

Range/Oven/Cooktop:

Range/Oven Energy Source

Gas, Electric

Washer and dryer : Washer and Dryer

Washer and dryer units are household appliances used for laundry cleaning and drying. These appliances typically require proper installation, adequate utility connections (water supply, drainage, and electrical), and regular maintenance to function effectively and safely.

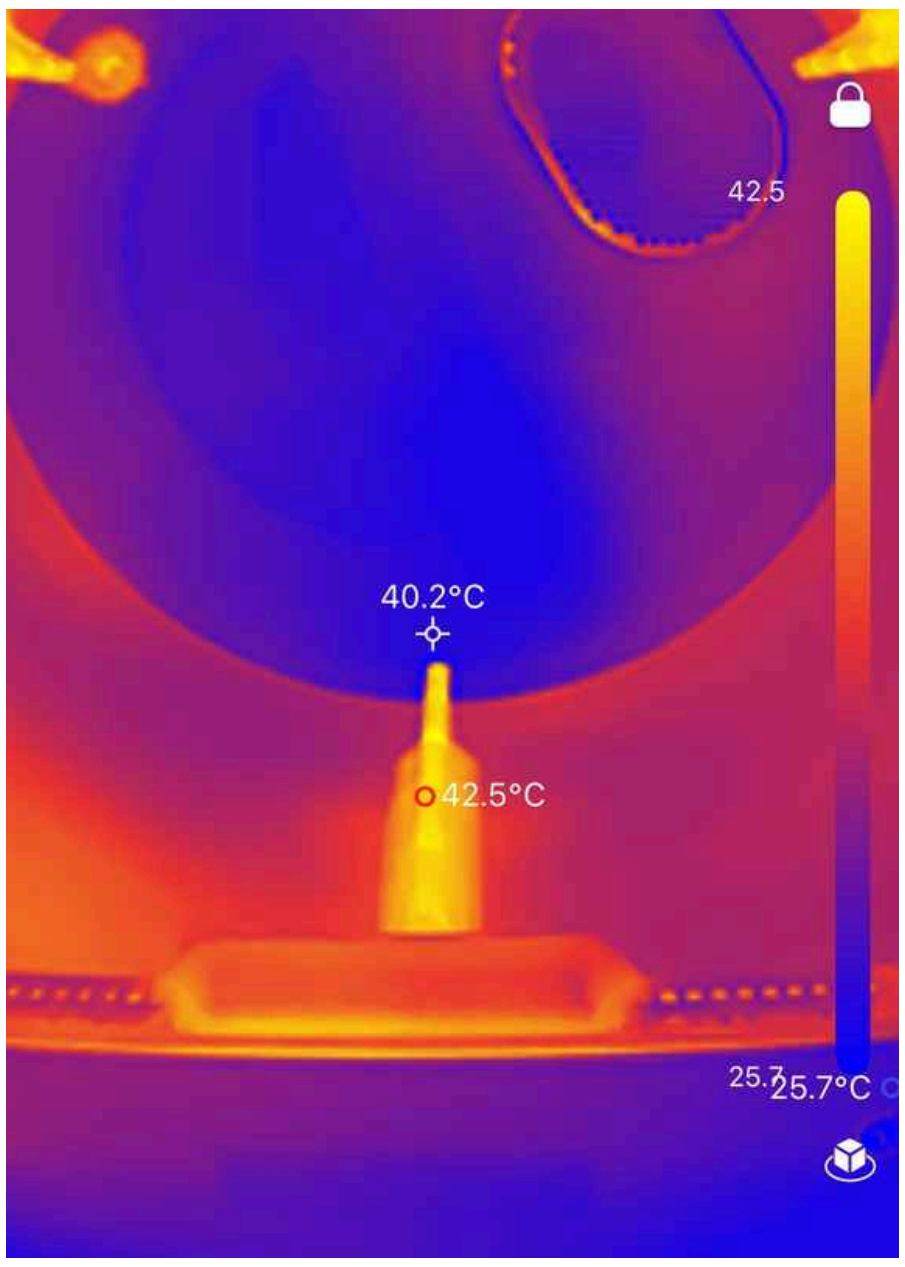

12: GARAGE

Information

Garage Overview

Garage

The garage provides covered parking and storage space for vehicles and household items. Garages typically contain garage doors, openers, flooring, walls, and lighting systems. The condition and functionality of these components affect the property's utility, security, and overall functionality.

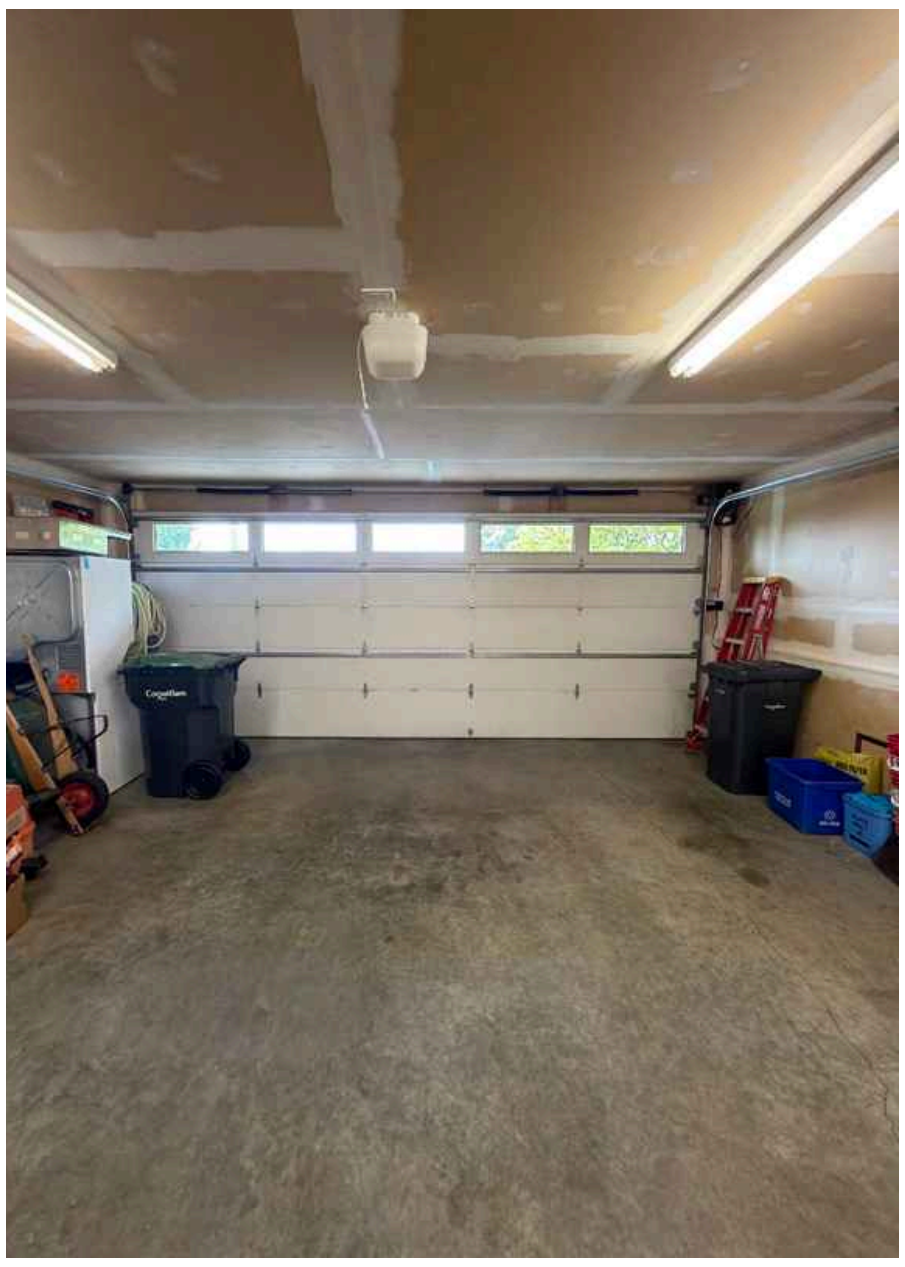

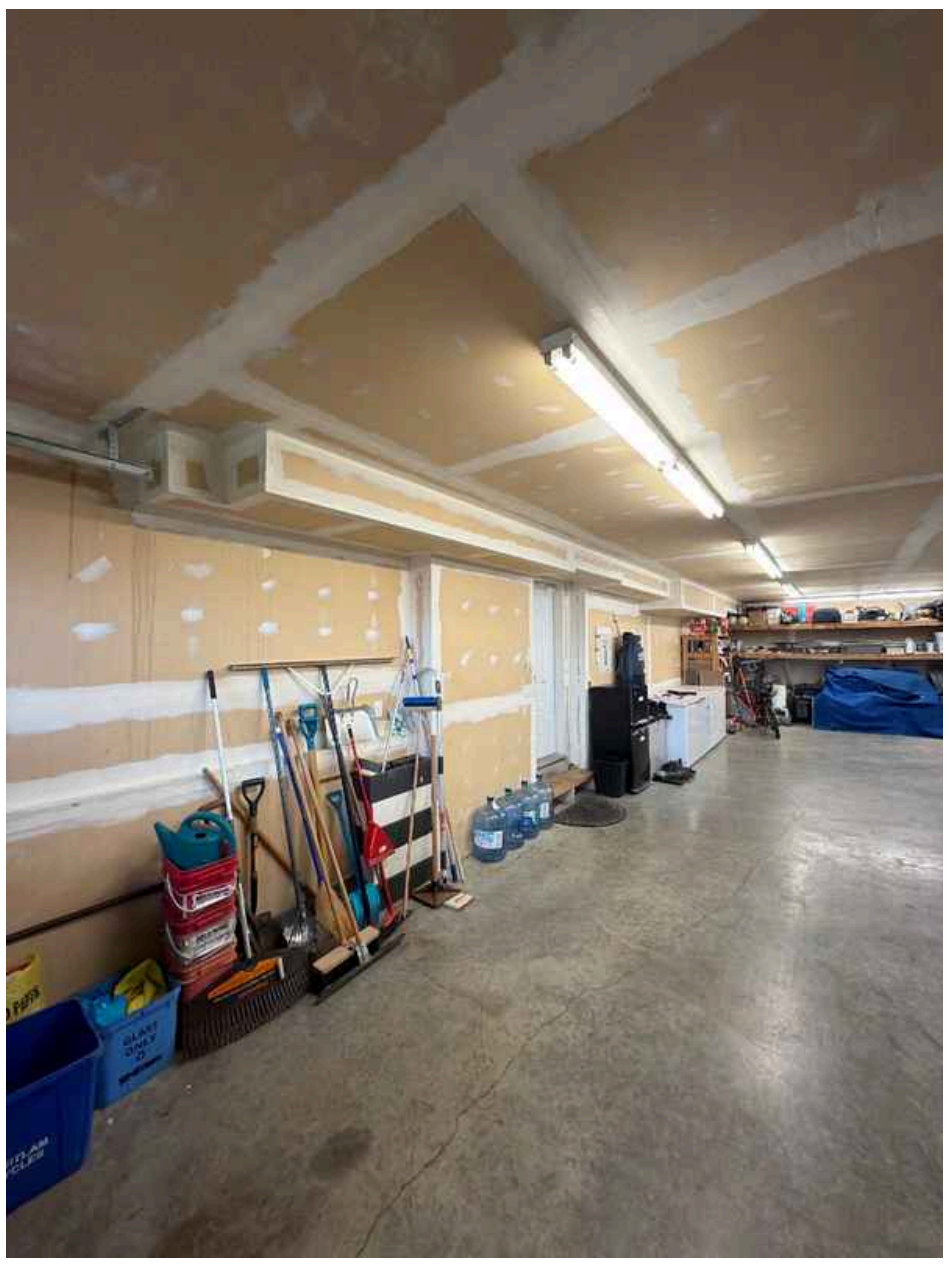
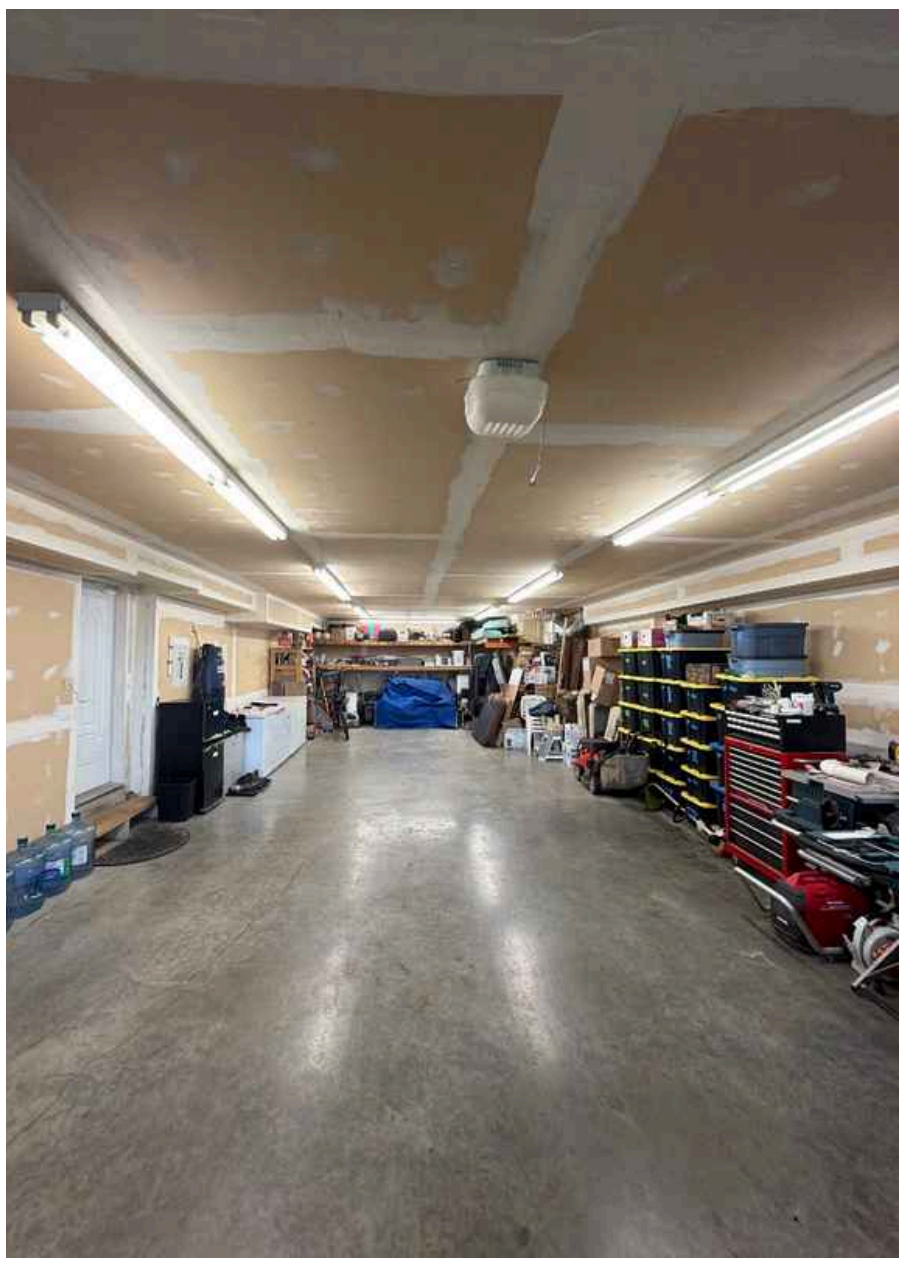
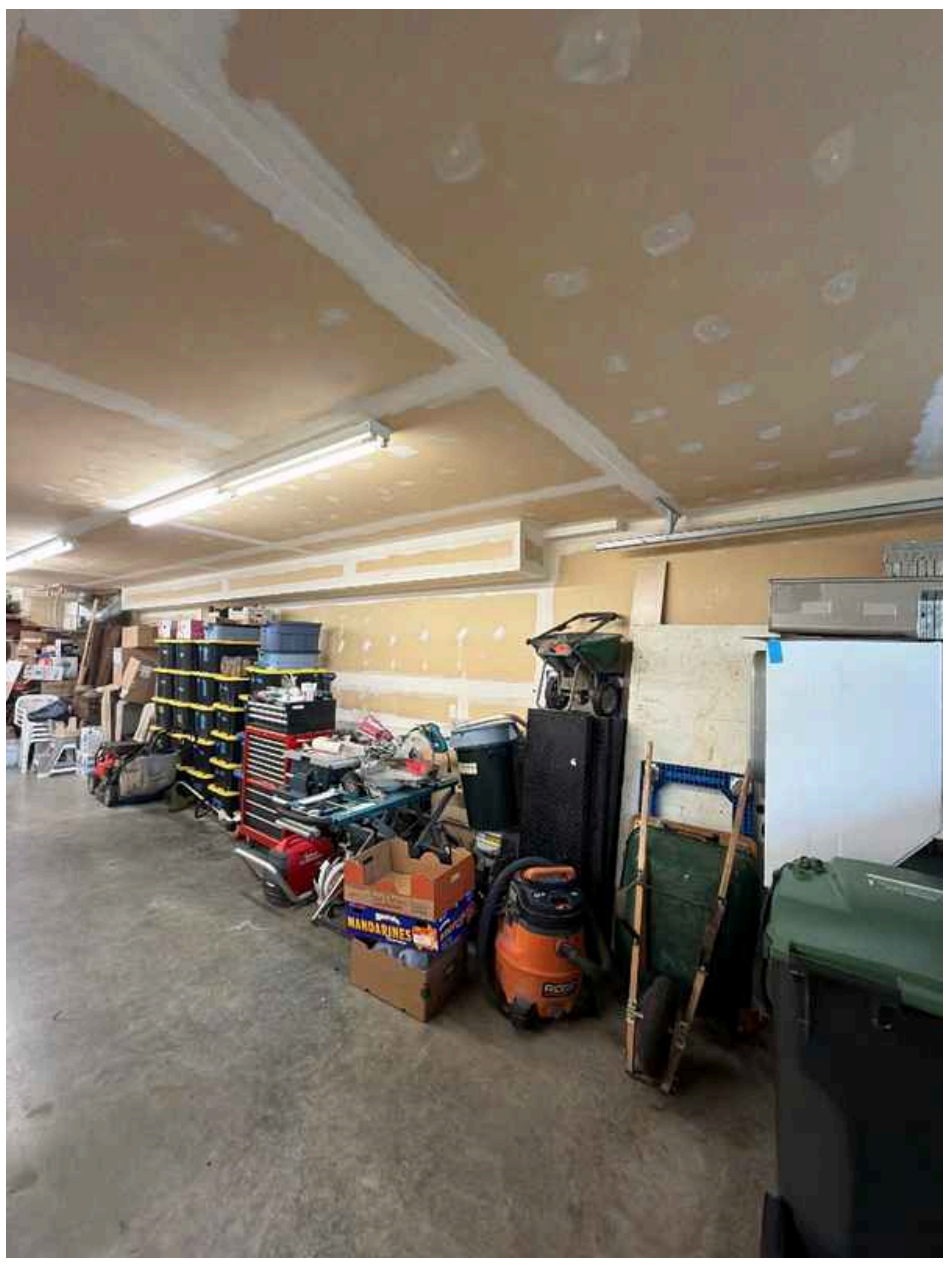
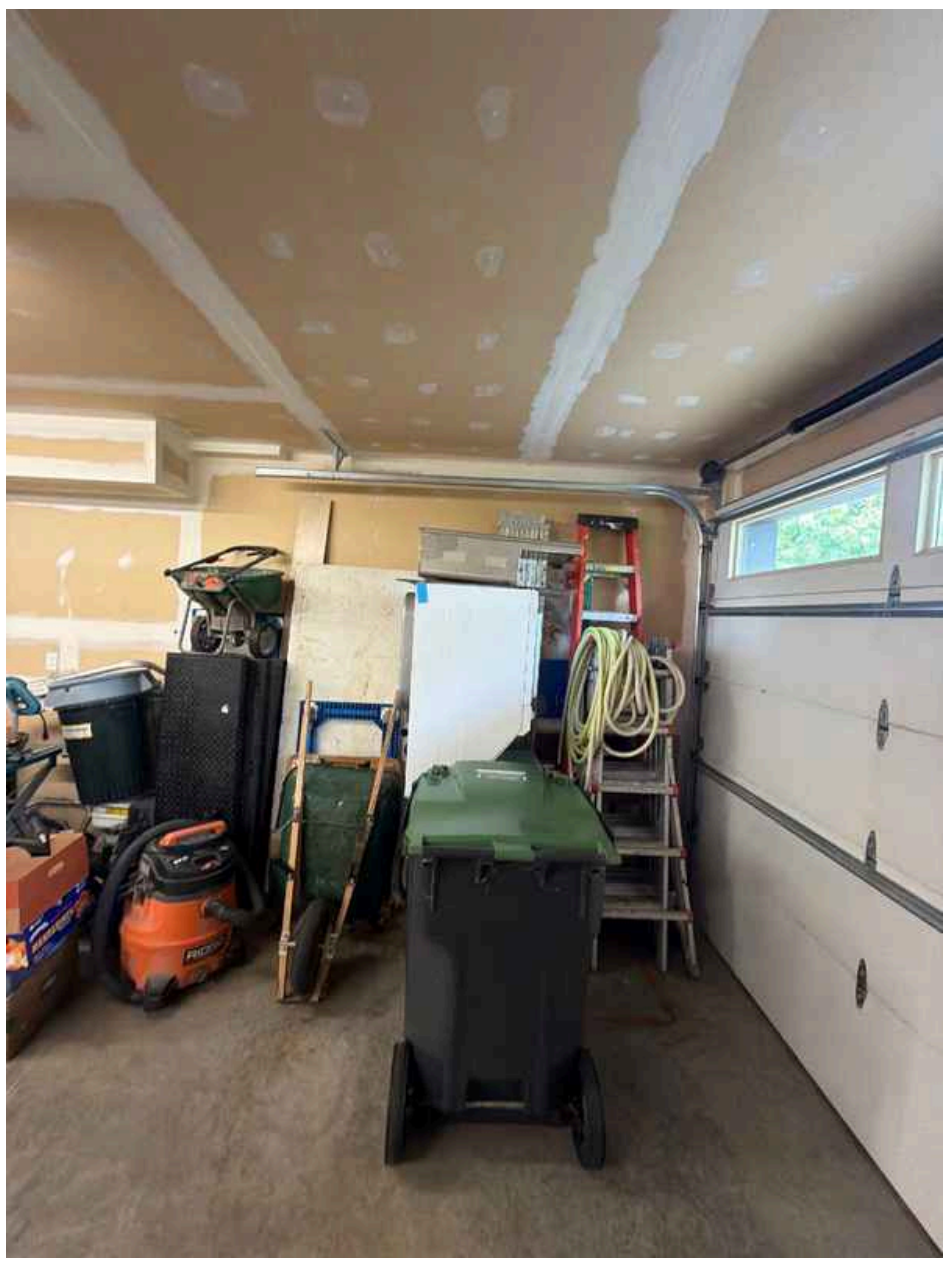

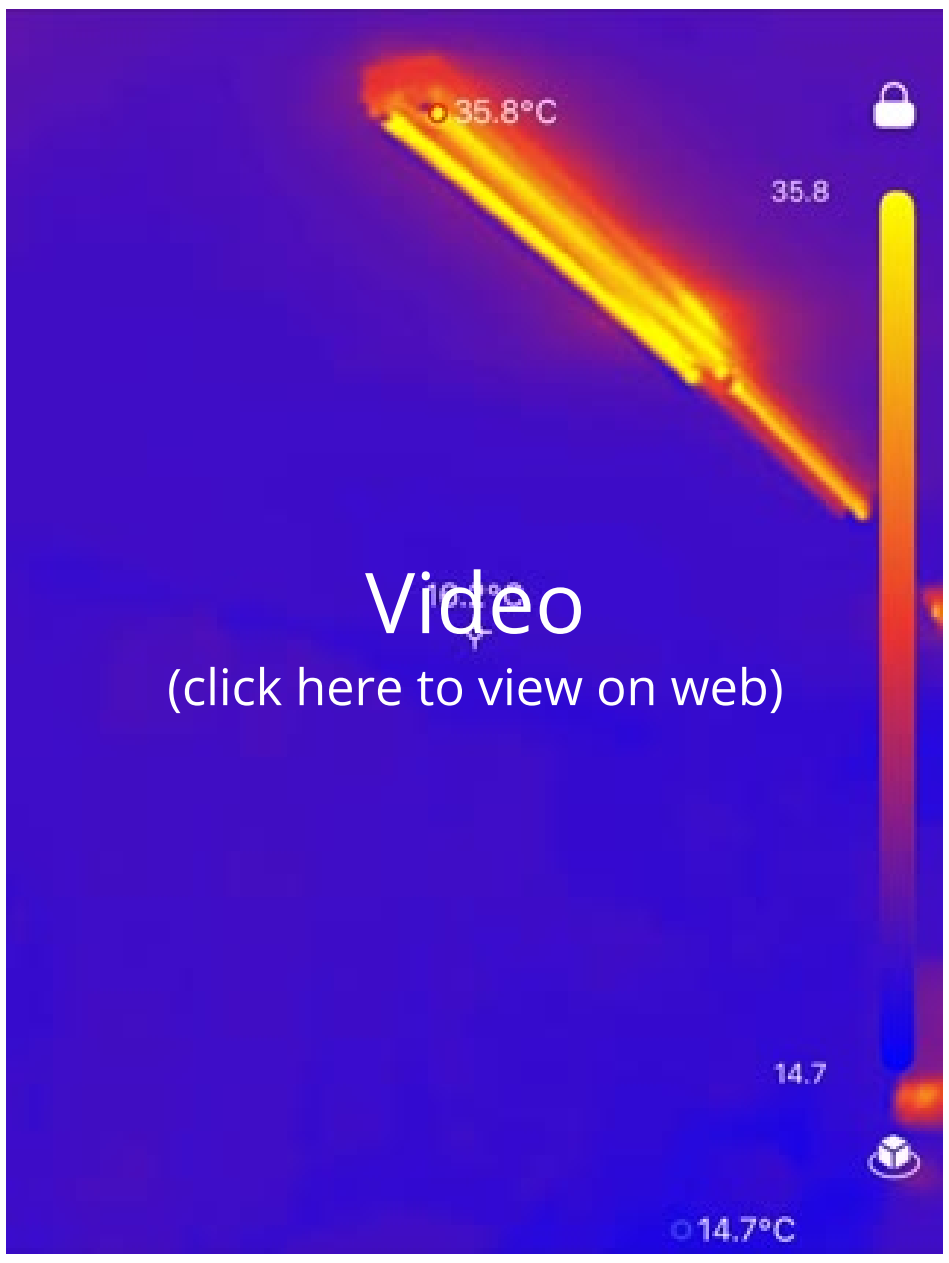

Garage Door: Material
Fiberglass

Garage Door: Type
Automatic

Limitations

General

GARAGE STORAGE LIMITATION

GARAGE

The garage contains a substantial amount of stored belongings and personal items. This storage limits visibility and access to garage components, walls, floor, and overhead areas during the inspection, potentially obscuring structural issues, damage, or maintenance concerns that may be present.

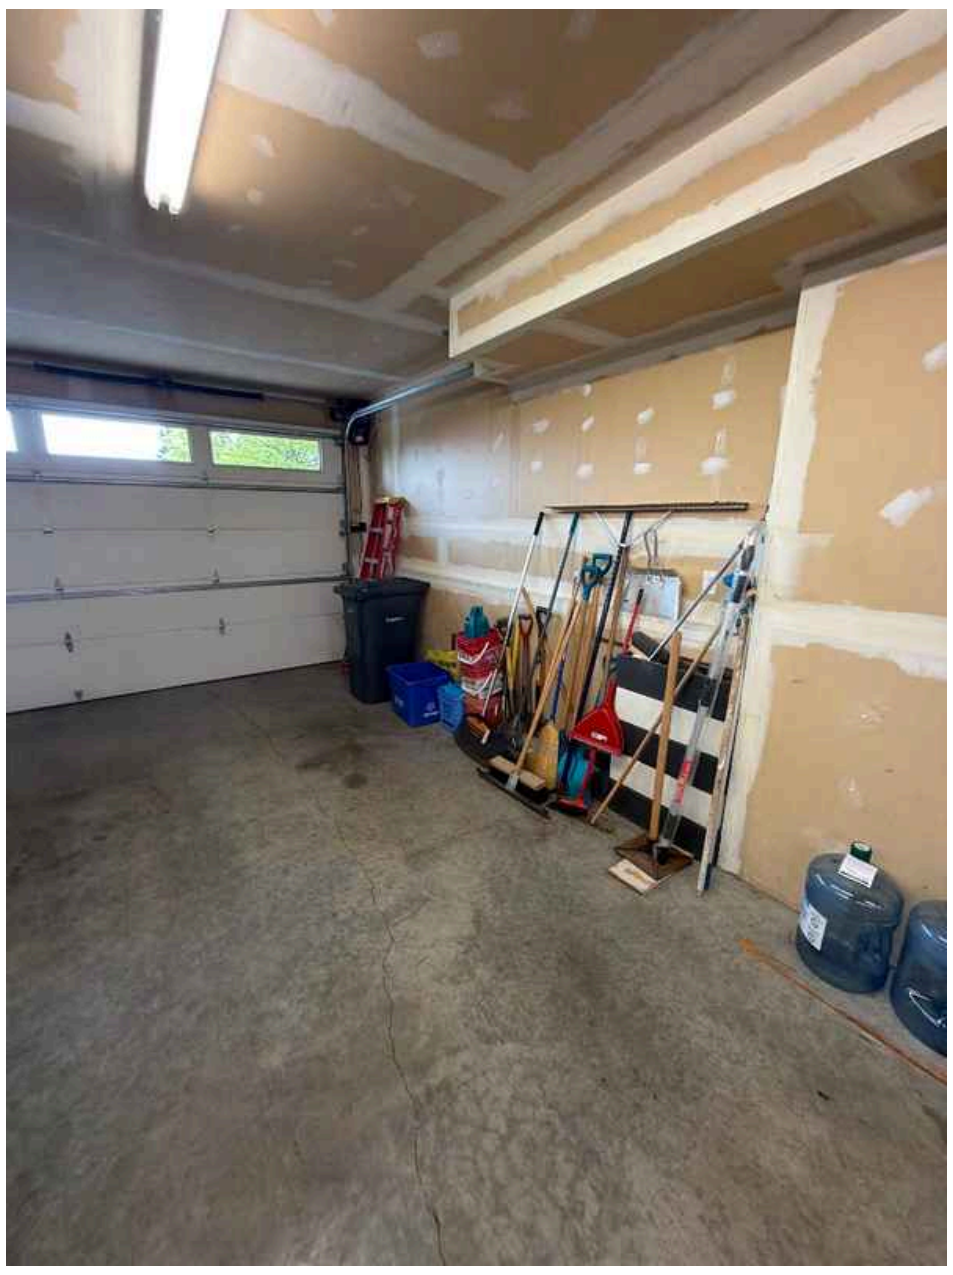

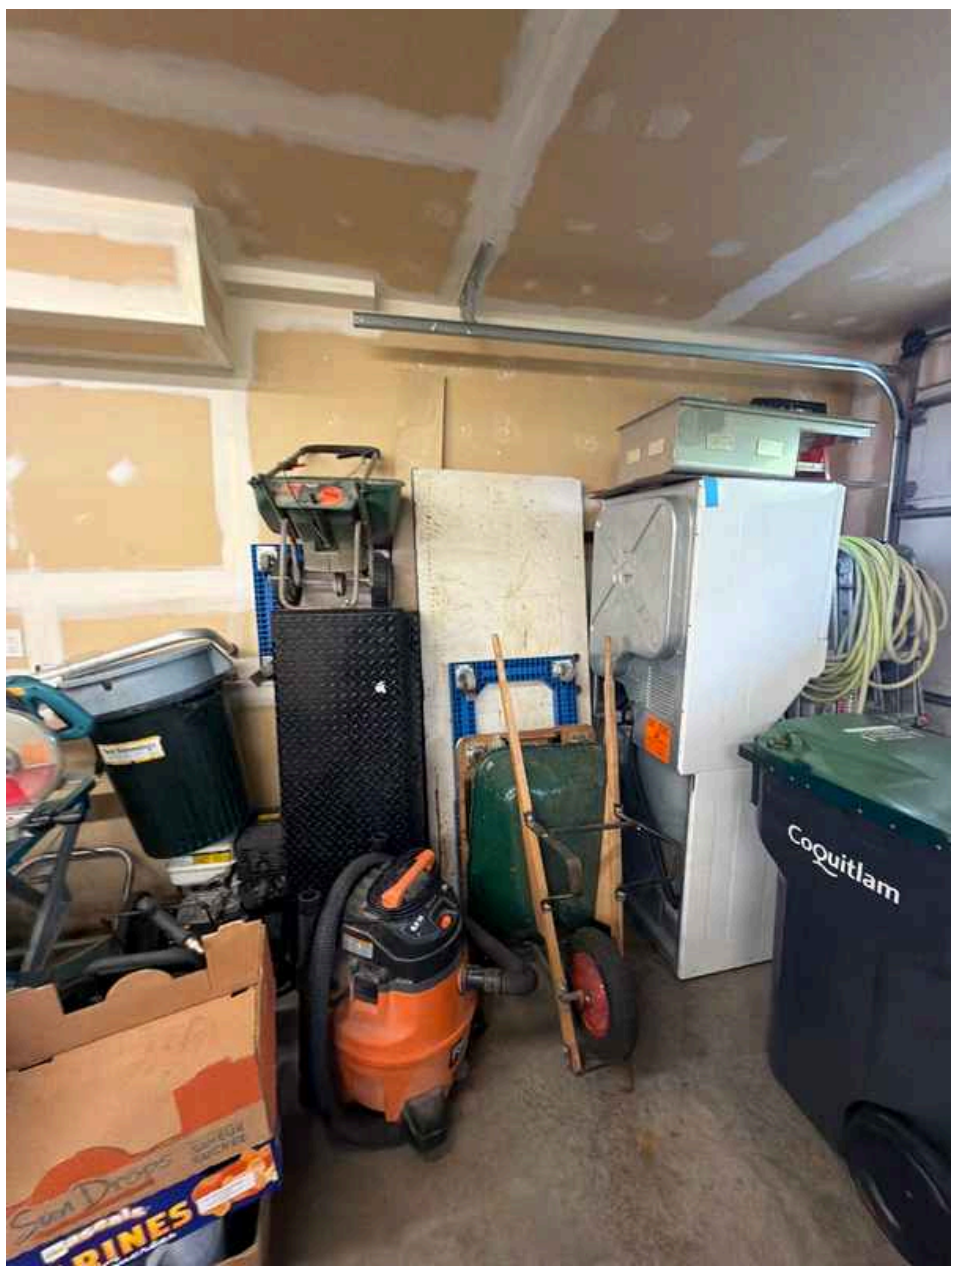

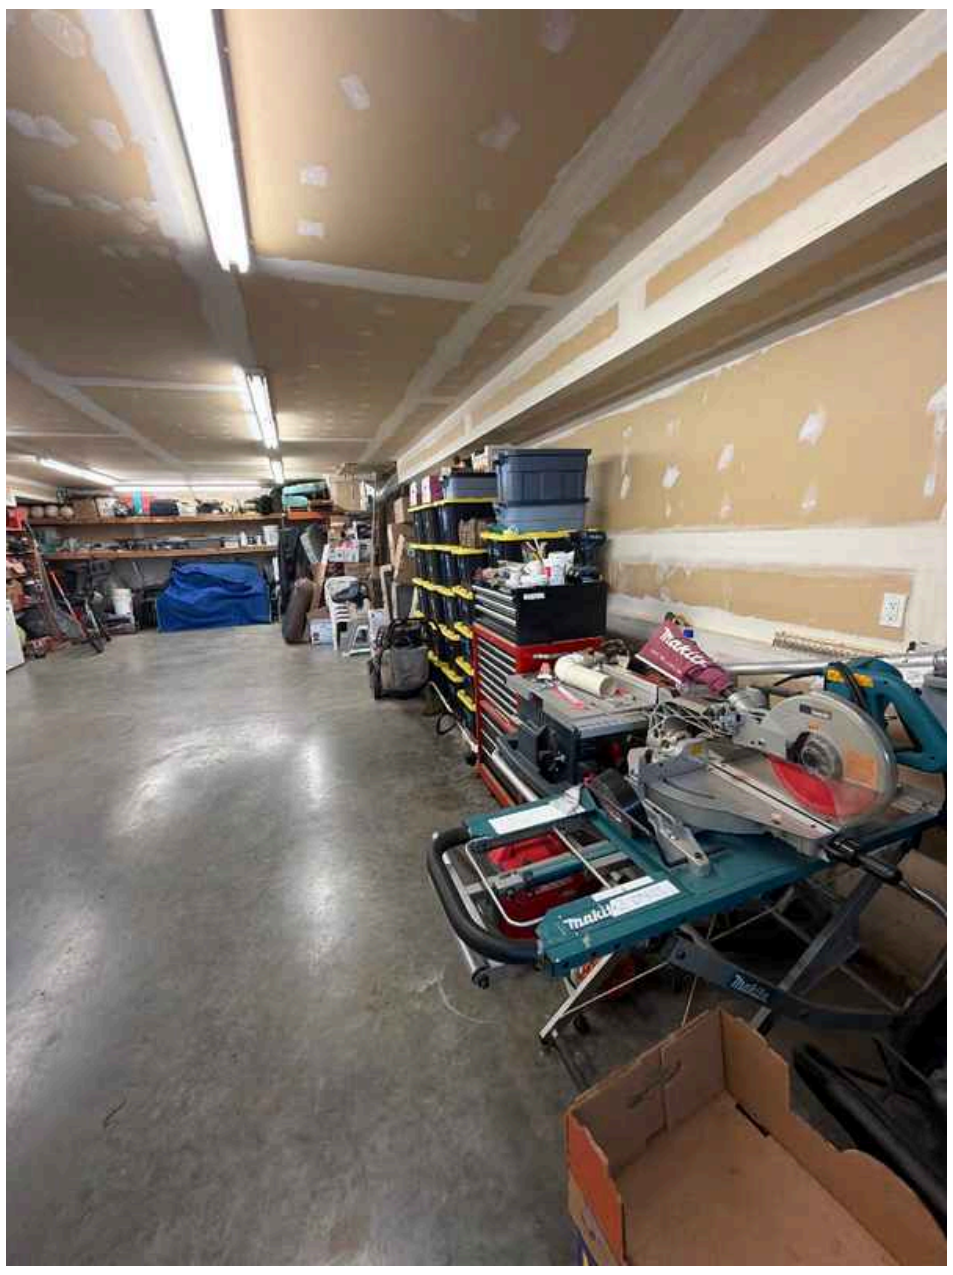

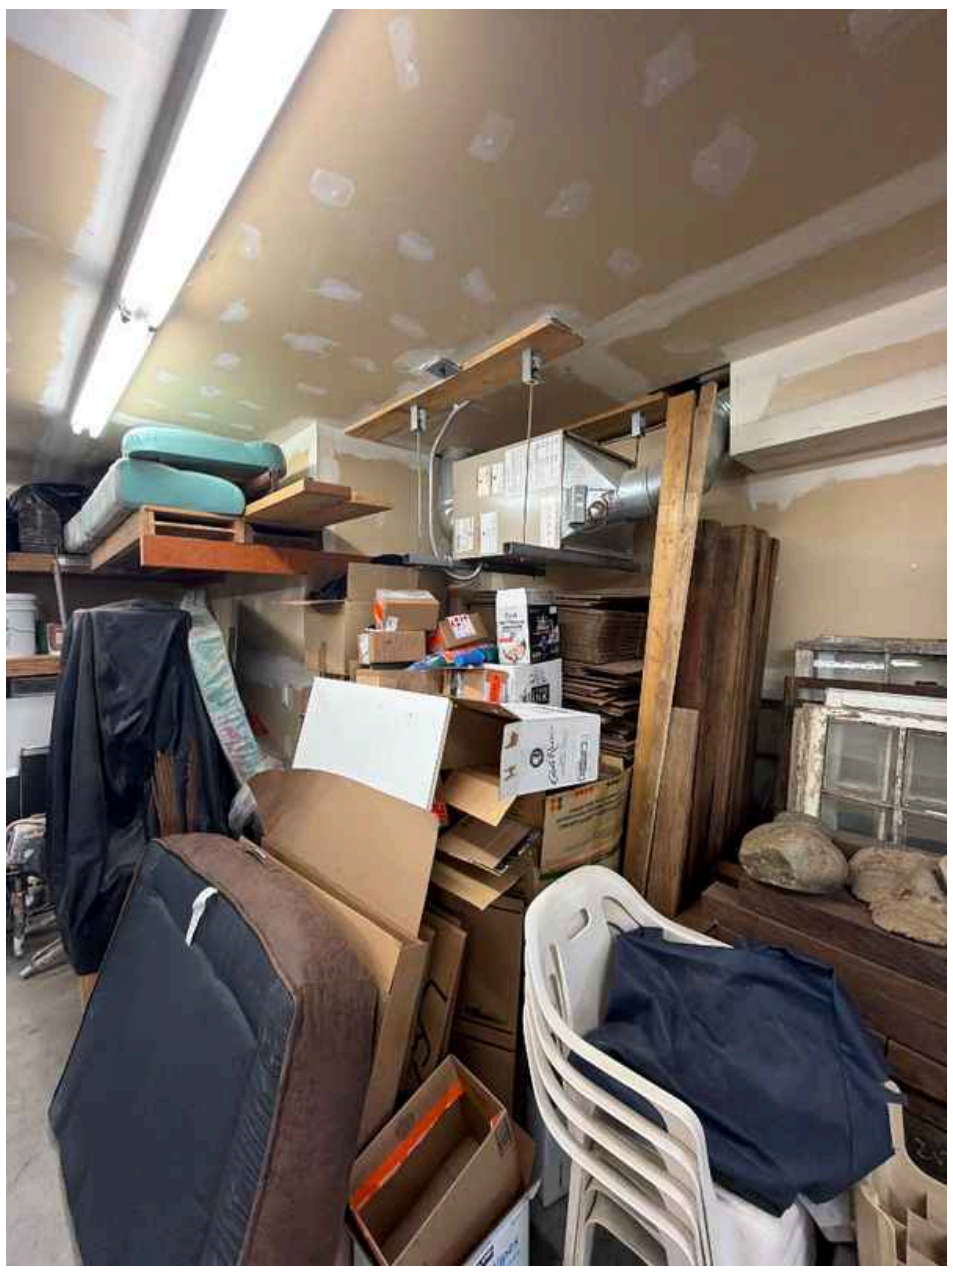
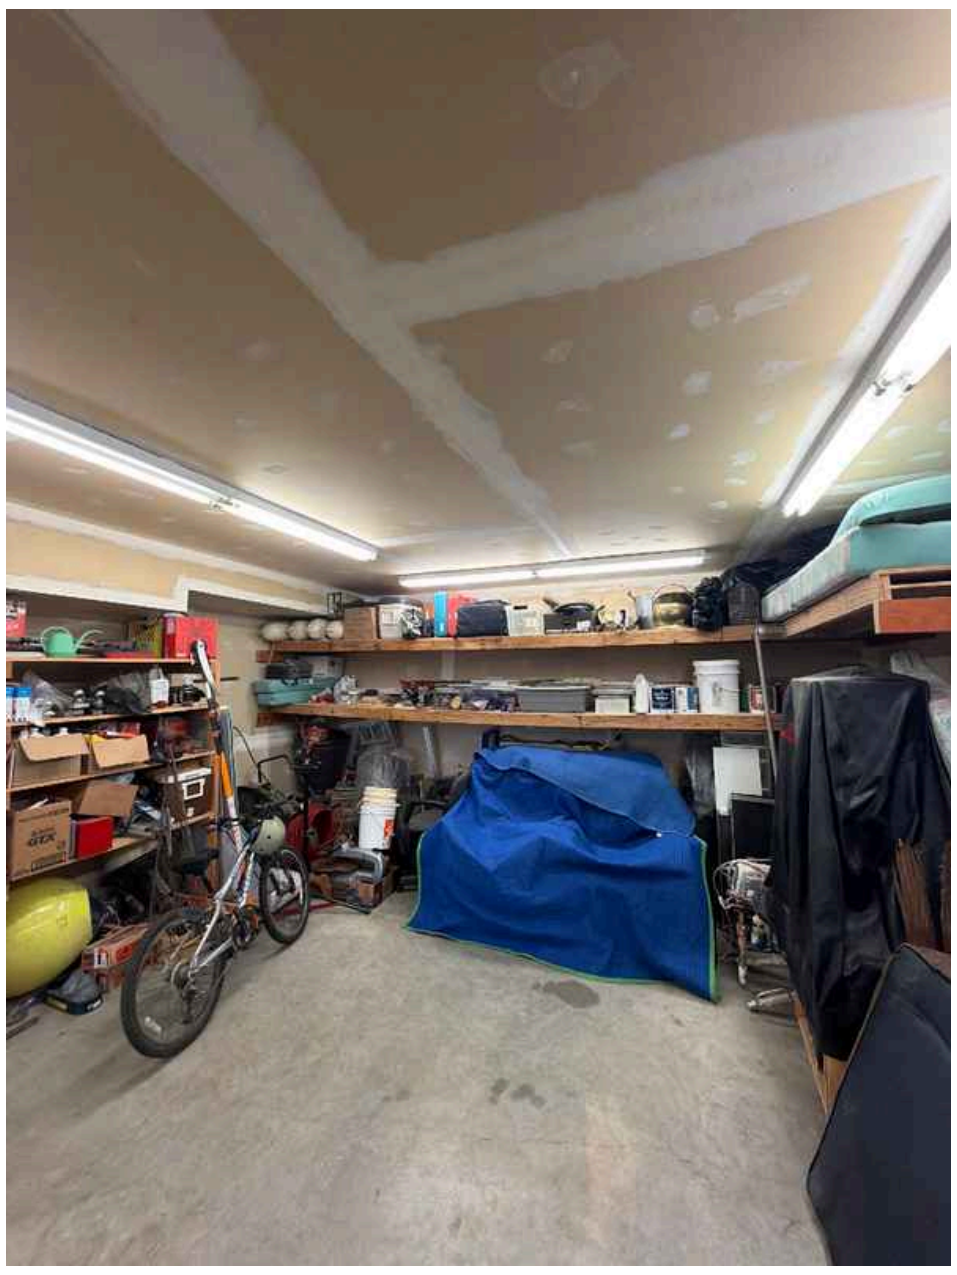


Deficiencies

12.2.1 Floor

Maintenance Item

MINOR FLOOR CRACKS

GARAGE

Minor cracks were observed in the garage floor during inspection. These cracks are typical in concrete surfaces and may result from normal settling, temperature fluctuations, or age-related concrete shrinkage. While minor cracks are generally not a structural concern, monitoring them over time is advisable to ensure they do not expand or indicate deeper issues.

Recommendation

Contact a qualified professional.

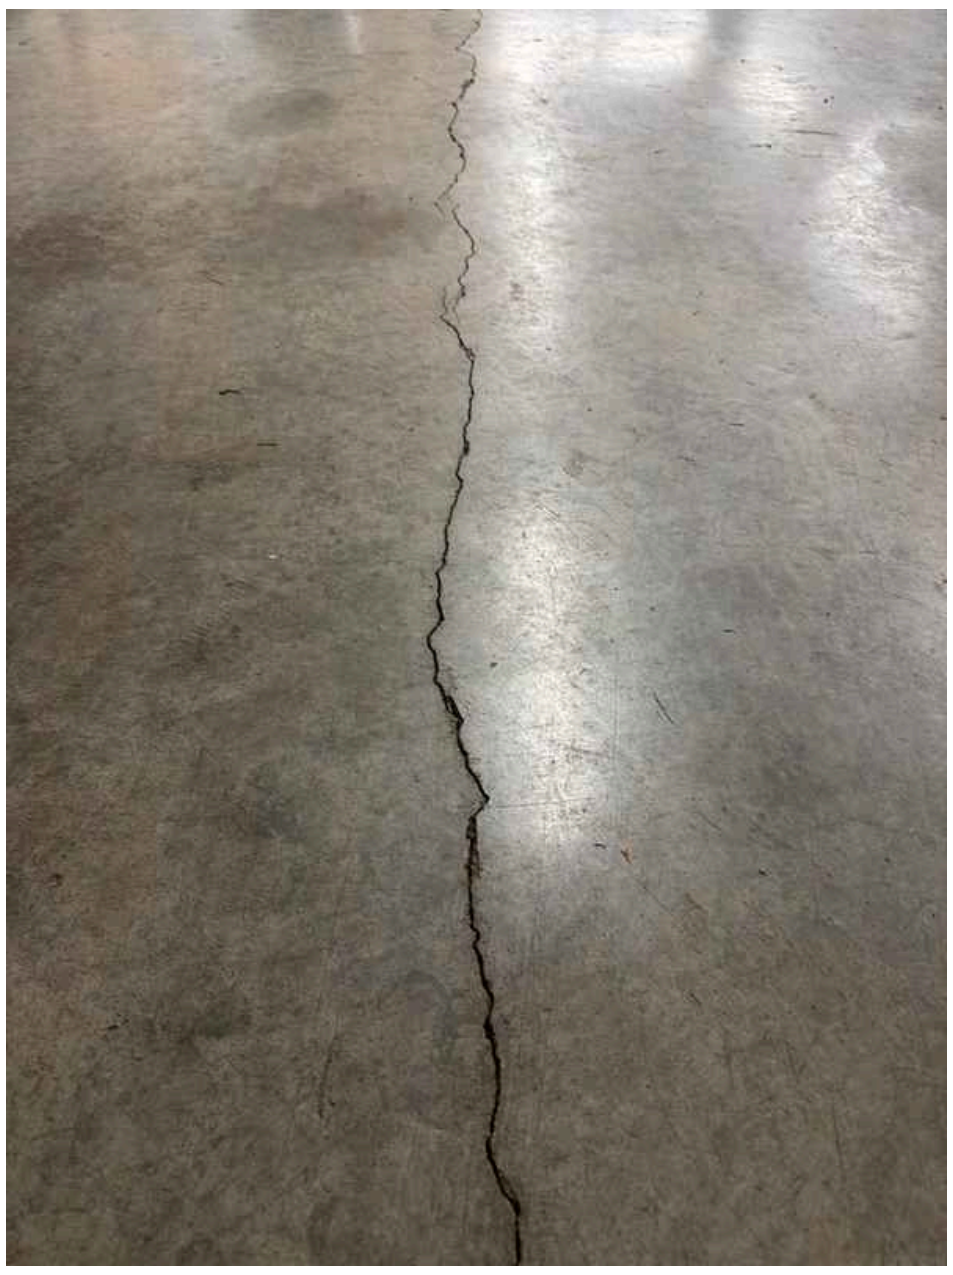
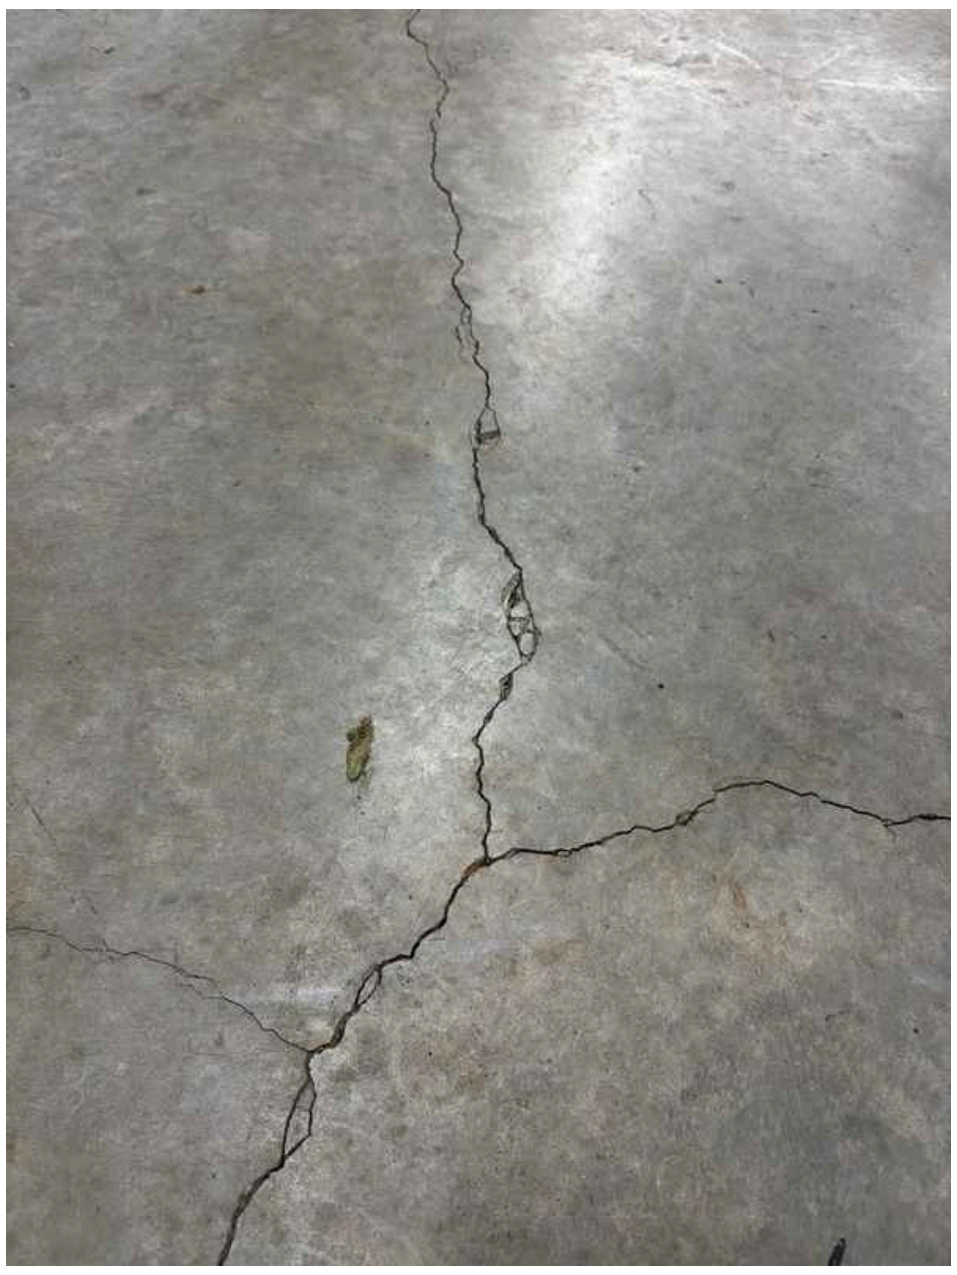


 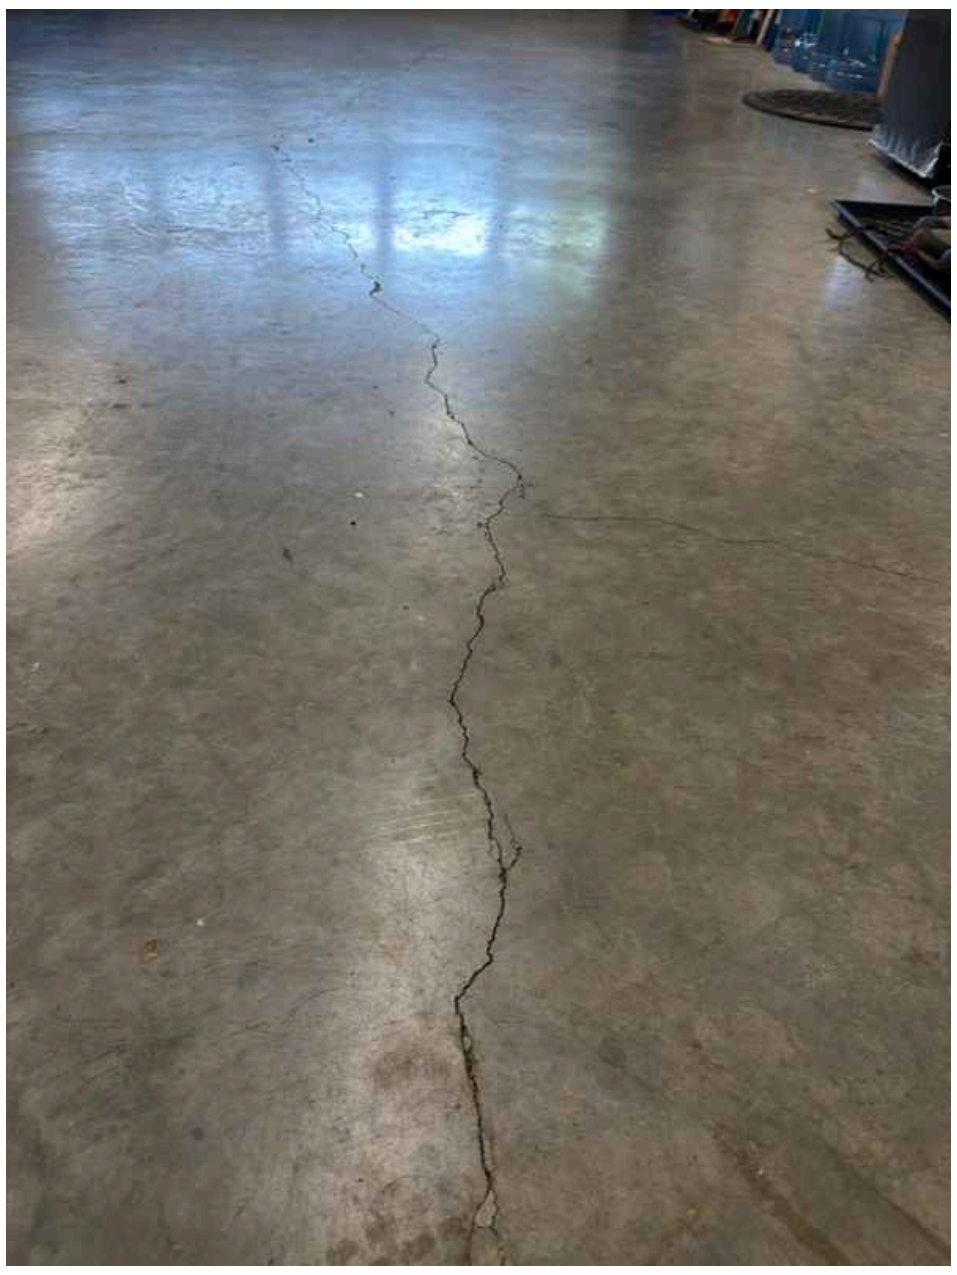

12.4.1 Garage Door

DOOR OPENER UNDER REPAIR

Recommendation

GARAGE

The garage door opener is currently undergoing repairs. Until repairs are completed and verified, the door opener may not function reliably. Have the service technician confirm that all repairs are complete and test the opener's operation before closing on the property.

Recommendation

Contact a qualified professional.

 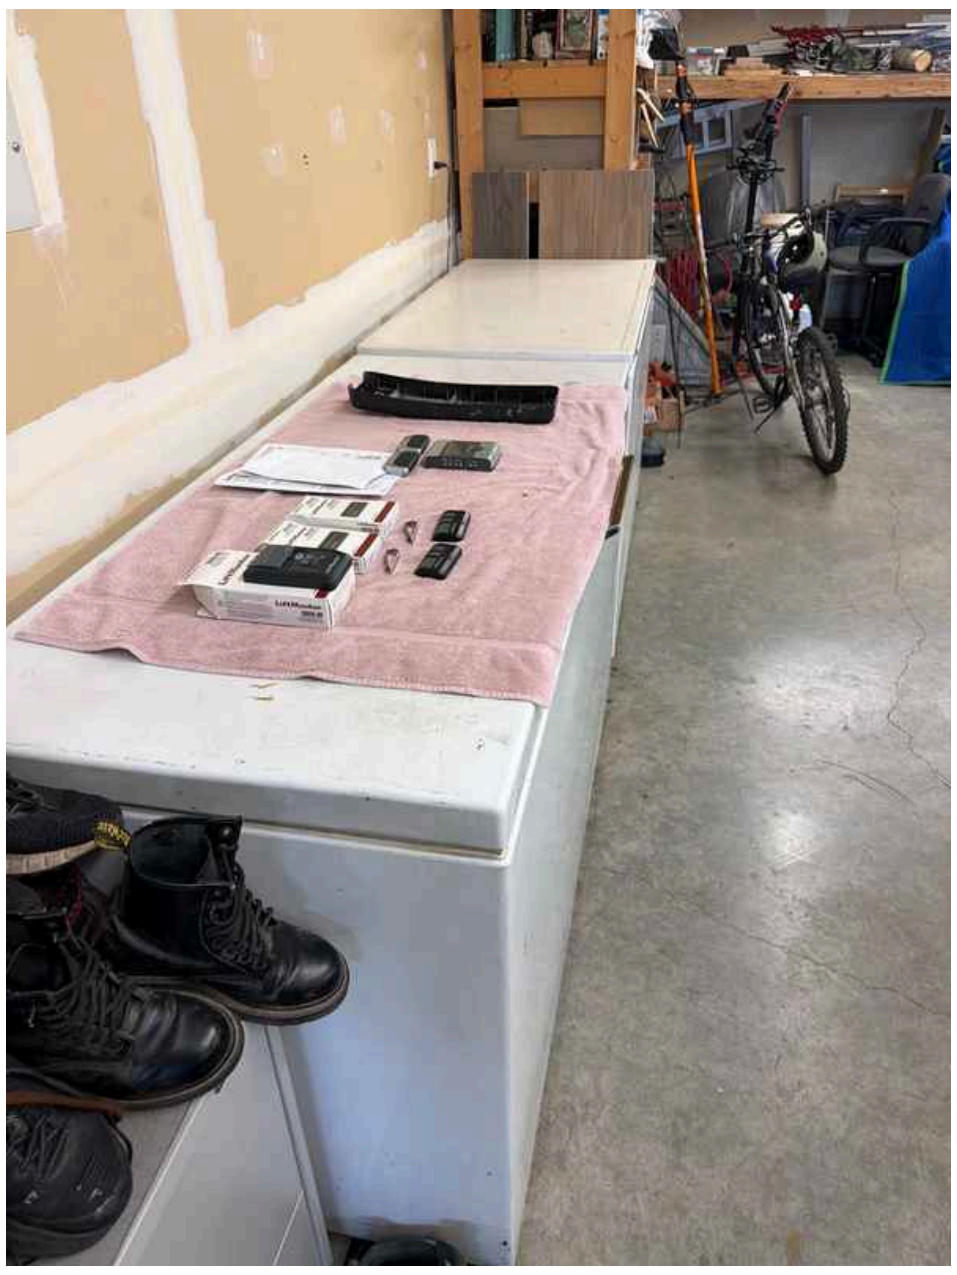

STANDARDS OF PRACTICE

Inspection Details

Exterior
I. The inspector shall: A. inspect: 1. wall coverings, flashing, and trim. 2. exterior doors. 3. attached and adjacent decks, balconies, stoops, steps, porches, and their associated railings. 4. eaves, soffits, and fascias where accessible from the ground level. 5. vegetation, grading, surface drainage, and retaining walls that are likely to adversely affect the building. 6. adjacent and entryway walkways, patios, and driveways. B. describe wall coverings.

II. The inspector is NOT required to inspect: A. screening, shutters, awnings, and similar seasonal accessories. B. fences, boundary walls, and similar structures. C. geological and soil conditions. D. recreational facilities. E. outbuildings other than garages and carports. F. seawalls, break-walls, and docks. G. erosion control and earth stabilization measures.

Roof
I. The inspector shall inspect from ground level or the eaves: A. the roof-covering materials; B. the gutters; C. the downspouts; D. the vents, flashing, skylights, chimney, and other roof penetrations; and E. the general structure of the roof from the readily accessible panels, doors or stairs.

II. The inspector shall describe: A. the type of roof-covering materials.

III. The inspector shall report as in need of correction: A. observed indications of active roof leaks.

IV. The inspector is not required to: A. walk on any roof surface. B. predict the service life expectancy. C. inspect underground downspout diverter drainage pipes. D. remove snow, ice, debris or other conditions that prohibit the observation of the roof surfaces. E. move insulation. F. inspect antennae, satellite dishes, lightning arresters, de-icing equipment, or similar attachments. G. walk on any roof areas that appear, in the inspectors opinion, to be unsafe. H. walk on any roof areas if doing so might, in the inspector's opinion, cause damage. I. perform a water test. J. warrant or certify the roof. K. confirm proper fastening or installation of any roof-covering material.

Basement, Foundation, Crawlspace & Structure
I. The inspector shall inspect: A. the foundation; B. the basement; C. the crawlspace; and D. structural components.

II. The inspector shall describe: A. the type of foundation; and B. the location of the access to the under-floor space.

III. The inspector shall report as in need of correction: A. observed indications of wood in contact with or near soil; B. observed indications of active water penetration; C. observed indications of possible foundation movement, such as sheetrock cracks, brick cracks, out-of-square door frames, and unlevel floors; and D. any observed cutting, notching and boring of framing members that may, in the inspector's opinion, present a structural or safety concern.

IV. The inspector is not required to: A. enter any crawlspace that is not readily accessible, or where entry could cause damage or pose a hazard to him/herself. B. move stored items or debris. C. operate sump pumps with inaccessible floats. D. identify the size, spacing, span or location or determine the adequacy of foundation bolting, bracing, joists, joist spans or support systems. E. provide any engineering or architectural service. F. report on the adequacy of any structural system or component.

Heating
I. The inspector shall inspect: A. the heating system, using normal operating controls.

II. The inspector shall describe: A. the location of the thermostat for the heating system; B. the energy source; and C. the heating method.

III. The inspector shall report as in need of correction: A. any heating system that did not operate; and B. if the heating system was deemed inaccessible.

IV. The inspector is not required to: A. inspect or evaluate the interior of flues or chimneys, fire chambers, heat exchangers, combustion air systems, fresh-air intakes, humidifiers, dehumidifiers, electronic air filters, geothermal systems, or solar heating systems. B. inspect fuel tanks or underground or concealed fuel supply systems. C. determine the uniformity, temperature, flow, balance, distribution, size, capacity, BTU, or supply adequacy of the heating system. D. light or ignite pilot flames. E. activate heating, heat pump systems, or other heating systems when ambient temperatures or other circumstances are not conducive to safe operation or may damage the equipment. F. override electronic thermostats. G. evaluate fuel quality. H. verify thermostat calibration, heat anticipation, or automatic setbacks, timers, programs or clocks.

Plumbing
I. The inspector shall inspect: A. the main water supply shut-off valve; B. the main fuel supply shut-off valve; C. the water heating equipment, including the energy source, venting connections, temperature/pressure-relief (TPR) valves, Watts 210 valves, and seismic bracing; D. interior water supply, including all fixtures and faucets, by running the water; E. all toilets for proper operation by flushing; F. all sinks, tubs and showers for functional drainage; G. the drain, waste and vent system; and H. drainage sump pumps with accessible floats.

II. The inspector shall describe: A. whether the water supply is public or private based upon observed evidence; B. the location of the main water supply shut-off valve; C. the location of the main fuel supply shut-off valve; D. the location of any observed fuel-storage system; and E. the capacity of the water heating equipment, if labeled.

III. The inspector shall report as in need of correction: A. deficiencies in the water supply by viewing the functional flow in two fixtures operated simultaneously; B. deficiencies in the installation of hot and cold water faucets; C. mechanical drain stops that were missing or did not operate if installed in sinks, lavatories and tubs; and D. toilets that were damaged, had loose connections to the floor, were leaking, or had tank components that did not operate.

IV. The inspector is not required to: A. light or ignite pilot flames. B. measure the capacity, temperature, age, life expectancy or adequacy of the water heater. C. inspect the interior of flues or chimneys, combustion air systems, water softener or filtering systems, well pumps or tanks, safety or shut-off valves, floor drains, lawn sprinkler systems, or fire sprinkler systems. D. determine the exact flow rate, volume, pressure, temperature or adequacy of the water supply. E. determine the water quality, potability or reliability of the water supply or source. F. open sealed plumbing access panels. G. inspect clothes washing machines or their connections. H. operate any valve. I. test shower pans, tub and shower surrounds or enclosures for leakage or functional overflow protection. J. evaluate the compliance with conservation, energy or building standards, or the proper design or sizing of any water, waste or venting components, fixtures or piping. K. determine the effectiveness of anti-siphon, backflow prevention or drain-stop devices. L. determine whether there are sufficient cleanouts for effective cleaning of drains. M. evaluate fuel storage tanks or supply systems. N. inspect wastewater treatment systems. O. inspect water treatment systems or water filters. P. inspect water storage tanks, pressure pumps, or bladder tanks. Q. evaluate wait time to obtain hot water at fixtures, or perform testing of any kind to water heater elements. R. evaluate or determine the adequacy of combustion air. S. test, operate, open or close: safety controls, manual stop valves, temperature/pressure-relief valves, control valves, or check valves. T. examine ancillary or auxiliary systems or components, such as, but not limited to, those related to solar water heating and hot water circulation. U. determine the existence or condition of polybutylene plumbing. V. inspect or test for gas or fuel leaks, or indications thereof.

Electrical
I. The inspector shall inspect: A. the service drop; B. the overhead service conductors and attachment point; C. the service head, gooseneck and drip loops; D. the service mast, service conduit and raceway; E. the electric meter and base; F. service-entrance conductors; G. the main service disconnect; H. panelboards and over-current protection devices (circuit breakers and fuses); I. service grounding and bonding; J. a representative number of switches, lighting fixtures and receptacles, including receptacles observed and deemed to be arc-fault circuit interrupter (AFCI)-protected using the AFCI test button, where possible; K. all ground-fault circuit interrupter receptacles and circuit breakers observed and deemed to be GFCIs using a GFCI tester, where possible; and L. smoke and carbon-monoxide detectors.

II. The inspector shall describe: A. the main service disconnect's amperage rating, if labeled; and B. the type of wiring observed.

III. The inspector shall report as in need of correction: A. deficiencies in the integrity of the service entrance conductors insulation, drip loop, and vertical clearances from grade and roofs; B. any unused circuit-breaker panel opening that was not filled; C. the presence of solid conductor aluminum branch-circuit wiring, if readily visible; D. any tested receptacle in which power was not present, polarity was incorrect, the cover was not in place, the GFCI devices were not properly installed or did not operate properly, evidence of arcing or excessive heat, and where the receptacle was not grounded or was not secured to the wall; and E. the absence of smoke detectors.

IV. The inspector is not required to: A. insert any tool, probe or device into the main panelboard, sub-panels, distribution panelboards, or electrical fixtures. B. operate electrical systems that are shut down. C. remove panelboard cabinet covers or dead fronts. D. operate or re-set over-current protection devices or overload devices. E. operate or test smoke or carbon-monoxide detectors or alarms F. inspect, operate or test any security, fire or alarms systems or components, or other warning or signaling systems. G. measure or determine the amperage or voltage of the main service equipment, if not visibly labeled. H. inspect ancillary wiring or remote-control devices. I. activate any electrical systems or branch circuits that are not energized. J. inspect low-voltage systems, electrical de-icing tapes, swimming pool wiring, or any timecontrolled devices. K. verify the service ground. L. inspect private or emergency electrical supply sources, including, but not limited to: generators, windmills, photovoltaic solar collectors, or battery or electrical storage facility. M. inspect spark or lightning arrestors. N. inspect or test de-icing equipment. O. conduct voltage-drop calculations. P. determine the accuracy of labeling. Q. inspect exterior lighting.

Fireplace
I. The inspector shall inspect: readily accessible and visible portions of the fireplaces and chimneys; lintels above the fireplace openings; damper doors by opening and closing them, if readily accessible and manually operable; and cleanout doors and frames.

II. The inspector shall describe: the type of fireplace.

III. The inspector shall report as in need of correction: evidence of joint separation, damage or deterioration of the hearth, hearth extension or chambers; manually operated dampers that did not open and close; the lack of a smoke detector in the same room as the fireplace; the lack of a carbon-monoxide detector in the same room as the fireplace; and cleanouts not made of metal, pre-cast cement, or other non-combustible material.

IV. The inspector is not required to: inspect the flue or vent system. inspect the interior of chimneys or flues, fire doors or screens, seals or gaskets, or mantels. Determine the need for a chimney sweep, perate gas fireplace inserts, light pilot flames, determine the appropriateness of any installation, inspect automatic fuel-fed devices, inspect combustion and/or make-up air devices, inspect heat-distribution assists, whether gravity-controlled or fan-assisted,ignite or extinguish fires, determine the adequacy of drafts or draft characteristics, move fireplace inserts, stoves or firebox contents, perform a smoke test, dismantle or remove any component, perform a National Fire Protection Association (NFPA)-style inspection perform a Phase I fireplace and chimney inspection.

Attic, Insulation & Ventilation

I. The inspector shall inspect: A. insulation in unfinished spaces, including attics, crawlspaces and foundation areas; B. ventilation of unfinished spaces, including attics, crawlspaces and foundation areas; and C. mechanical exhaust systems in the kitchen, bathrooms and laundry area.

II. The inspector shall describe: A. the type of insulation observed; and B. the approximate average depth of insulation observed at the unfinished attic floor area or roof structure.

III. The inspector shall report as in need of correction: A. the general absence of insulation or ventilation in unfinished spaces.

IV. The inspector is not required to: A. enter the attic or any unfinished spaces that are not readily accessible, or where entry could cause damage or, in the inspector's opinion, pose a safety hazard. B. move, touch or disturb insulation. C. move, touch or disturb vapor retarders. D. break or otherwise damage the surface finish or weather seal on or around access panels or covers. E. identify the composition or R-value of insulation material. F. activate thermostatically operated fans. G. determine the types of materials used in insulation or wrapping of pipes, ducts, jackets, boilers or wiring. H. determine the adequacy of ventilation.

Doors, Windows & Interior

I. The inspector shall inspect: A. a representative number of doors and windows by opening and closing them; B. floors, walls and ceilings; C. stairs, steps, landings, stairways and ramps; D. railings, guards and handrails; and E. garage vehicle doors and the operation of garage vehicle door openers, using normal operating controls.

II. The inspector shall describe: A. a garage vehicle door as manually-operated or installed with a garage door opener.

III. The inspector shall report as in need of correction: A. improper spacing between intermediate balusters, spindles and rails for steps, stairways, guards and railings; B. photo-electric safety sensors that did not operate properly; and C. any window that was obviously fogged or displayed other evidence of broken seals.

IV. The inspector is not required to: A. inspect paint, wallpaper, window treatments or finish treatments. B. inspect floor coverings or carpeting. C. inspect central vacuum systems. D. inspect for safety glazing. E. inspect security systems or components. F. evaluate the fastening of islands, countertops, cabinets, sink tops or fixtures. G. move furniture, stored items, or any coverings, such as carpets or rugs, in order to inspect the concealed floor structure. H. move suspended-ceiling tiles. I. inspect or move any household appliances. J. inspect or operate equipment housed in the garage, except as otherwise noted. K. verify or certify the proper operation of any pressure-activated auto-reverse or related safety feature of a garage door. L. operate or evaluate any security bar release and opening mechanisms, whether interior or exterior, including their compliance with local, state or federal standards. M. operate any system, appliance or component that requires the use of special keys, codes, combinations or devices. N. operate or evaluate self-cleaning oven cycles, tilt guards/latches, or signal lights. O. inspect microwave ovens or test leakage from microwave ovens. P. operate or examine any sauna, steamgenerating equipment, kiln, toaster, ice maker, coffee maker, can opener, bread warmer, blender, instant hot-water dispenser, or other small, ancillary appliances or devices. Q. inspect elevators. R. inspect remote controls. S. inspect appliances. T. inspect items not permanently installed. U. discover firewall compromises. V. inspect pools, spas or fountains. W. determine the adequacy of whirlpool or spa jets, water force, or bubble effects. X. determine the structural integrity or leakage of pools or spas.