




INTERNACHI COMMERCIAL TEMPLATE

Coquitlam, BC

03/07/2026

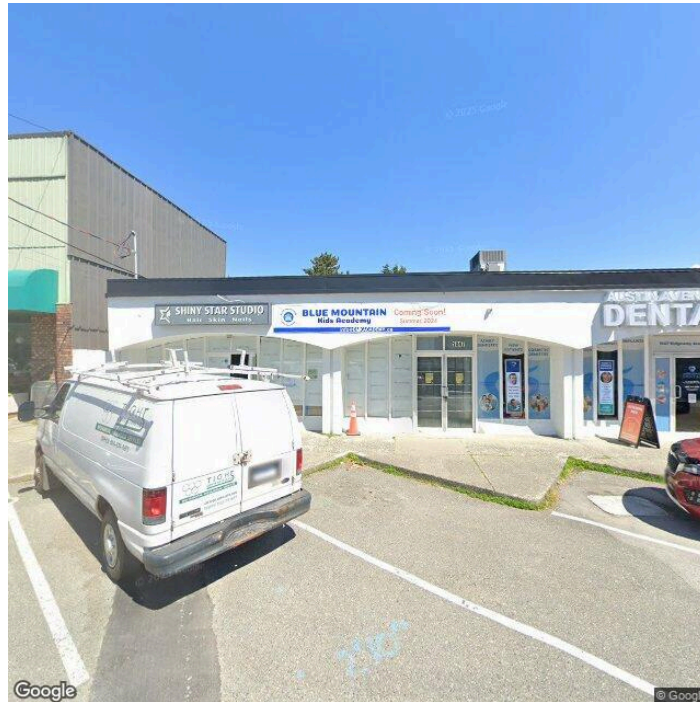

Inspector
Jake choi
CHI, Commercial Inspector
+16725330062
info@newchapterinspectbc.com

TABLE OF CONTENTS

1: Inspection Details	4
2: Roof	6
3: Exterior	12
4: Basement, Foundation and Crawlspace	25
5: Heating and Ventilation	28
6: Cooling	37
7: Plumbing	38
8: Electrical	46
9: Attic, Insulation & Ventilation	53
10: Doors, Windows & Interior	55
11: Life Safety	65
Standards of Practice	70



RECOMMENDATION



SAFETY HAZARD

SUMMARY

- ⊖ 2.1.1 Roof - Coverings: Debris on Roof
- ⊖ 2.3.1 Roof - Flashings: Weak spots
- ⊖ 3.1.1 Exterior - Siding, Flashing & Trim: Holes in Exterior Walls
- ⊖ 3.1.2 Exterior - Siding, Flashing & Trim: Exterior Finish – Localized Paint Peeling
- ⊖ 3.2.1 Exterior - Exterior Doors: Exterior Door Partially Weather Stripping Missing
- ⊖ 3.2.2 Exterior - Exterior Doors: Hardware Damaged
- ⊖ 3.2.3 Exterior - Exterior Doors: Hardware Missing
- ⊖ 3.2.4 Exterior - Exterior Doors: Paint/Refinish Needed
- ⊖ 3.3.1 Exterior - Walkways, Patios & Driveways: Walkway Cracking - Major
- ⊖ 3.3.2 Exterior - Walkways, Patios & Driveways: Walkway Cracking - Minor
- ⊖ 3.5.1 Exterior - Vegetation, Grading, Drainage & Retaining Walls: Negative Grading
- ⊖ 4.1.1 Basement, Foundation and Crawlpace - Foundation: Foundation Cracks - Minor
- ⊖ 5.2.1 Heating and Ventilation - Normal Operating Controls: HVAC – Uneven Temperature
- ⊖ 5.4.1 Heating and Ventilation - Vents, Flues & Chimneys: Vents Require Cleaning
- ⊖ 7.6.1 Plumbing - Fuel Storage & Distribution Systems: Gas Piping – Minor Corrosion
- ⚠ 7.7.1 Plumbing - Sinks: Hot Water Temperature – Child Safety
- ⊖ 8.2.1 Electrical - Main & Subpanels, Service & Grounding, Main Overcurrent Device: Missing Electrical Panel Door Hinge
- ⊖ 8.7.1 Electrical - Smoke & Carbon Monoxide Detectors: Detector – Not Secured
- ⊖ 9.1.1 Attic, Insulation & Ventilation - Insulation of Unfinished Spaces: Insufficient Insulation
- ⊖ 10.5.1 Doors, Windows & Interior - Ceilings: Ceiling Stain
- ⚠ 11.6.1 Life Safety - Fire Alarm Systems: Fire Alarm System – Inspection Label Expired
- ⚠ 11.7.1 Life Safety - Portable Fire Extinguishers: Fire Extinguisher Expired or Missing Tags
- ⚠ 11.12.1 Life Safety - Tripping hazard : Doorway Threshold – Tripping Hazard



1: INSPECTION DETAILS

Information

Commercial Building Structure

Single-Story Commercial Building

This property is a commercial single building structure. Commercial buildings are designed and constructed to house business operations, retail, offices, or other commercial activities. They typically differ from residential properties in their construction standards, occupancy requirements, mechanical systems, and regulatory compliance needs. Understanding the building's commercial classification is important for evaluating its systems, safety features, and maintenance requirements specific to commercial use.

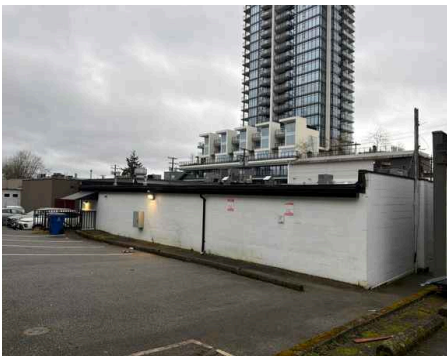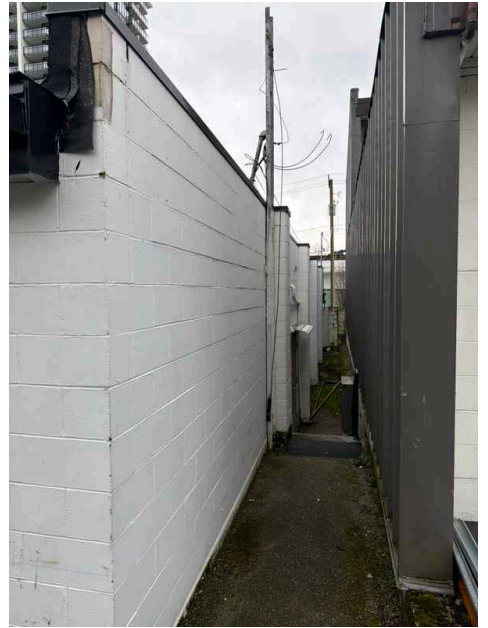

In Attendance

Client, Listing Agent

Occupancy

Furnished, Occupied

Strata Commercial Building Ownership and HVAC Systems

Cloudy

A strata commercial building operates under shared ownership where multiple unit owners collectively own common areas while individually owning their respective units. HVAC systems in such buildings typically serve individual units or zones, with maintenance responsibilities divided between unit owners and the strata corporation depending on the building's governance documents and system configuration.

Style

Commercial



Limitations

General

COMMERCIAL STRATA DISCLAIMER

This inspection identifies physical conditions at the time of the walk-through. In Strata-titled properties, maintenance responsibilities for the building envelope, common HVAC, and exterior doors are governed by the Strata Property Act and specific Strata Bylaws. The Client is advised to review the Strata Plan and Form B Information Certificate to confirm the exact boundaries between the Strata Corporation's and the Unit Owner's responsibilities.

2: ROOF

		IN	NI	NP	D
2.1	Coverings	X			X
2.2	Roof Drainage Systems	X			
2.3	Flashings	X			X
2.4	Skylights, Chimneys & Other Roof Penetrations				X

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information

Inspection Method

Roof


Roof Type/Style

Flat

Coverings: Material


Roof

Modified Bitumen (Flat Roof Membrane)

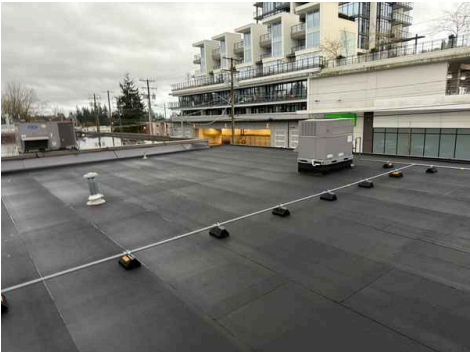


Roof Drainage Systems: Gutter Material

Aluminum, Steel

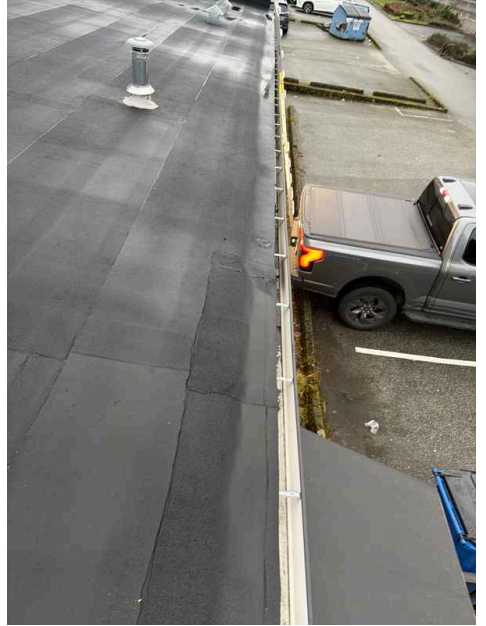

Flashings: Material
Aluminum

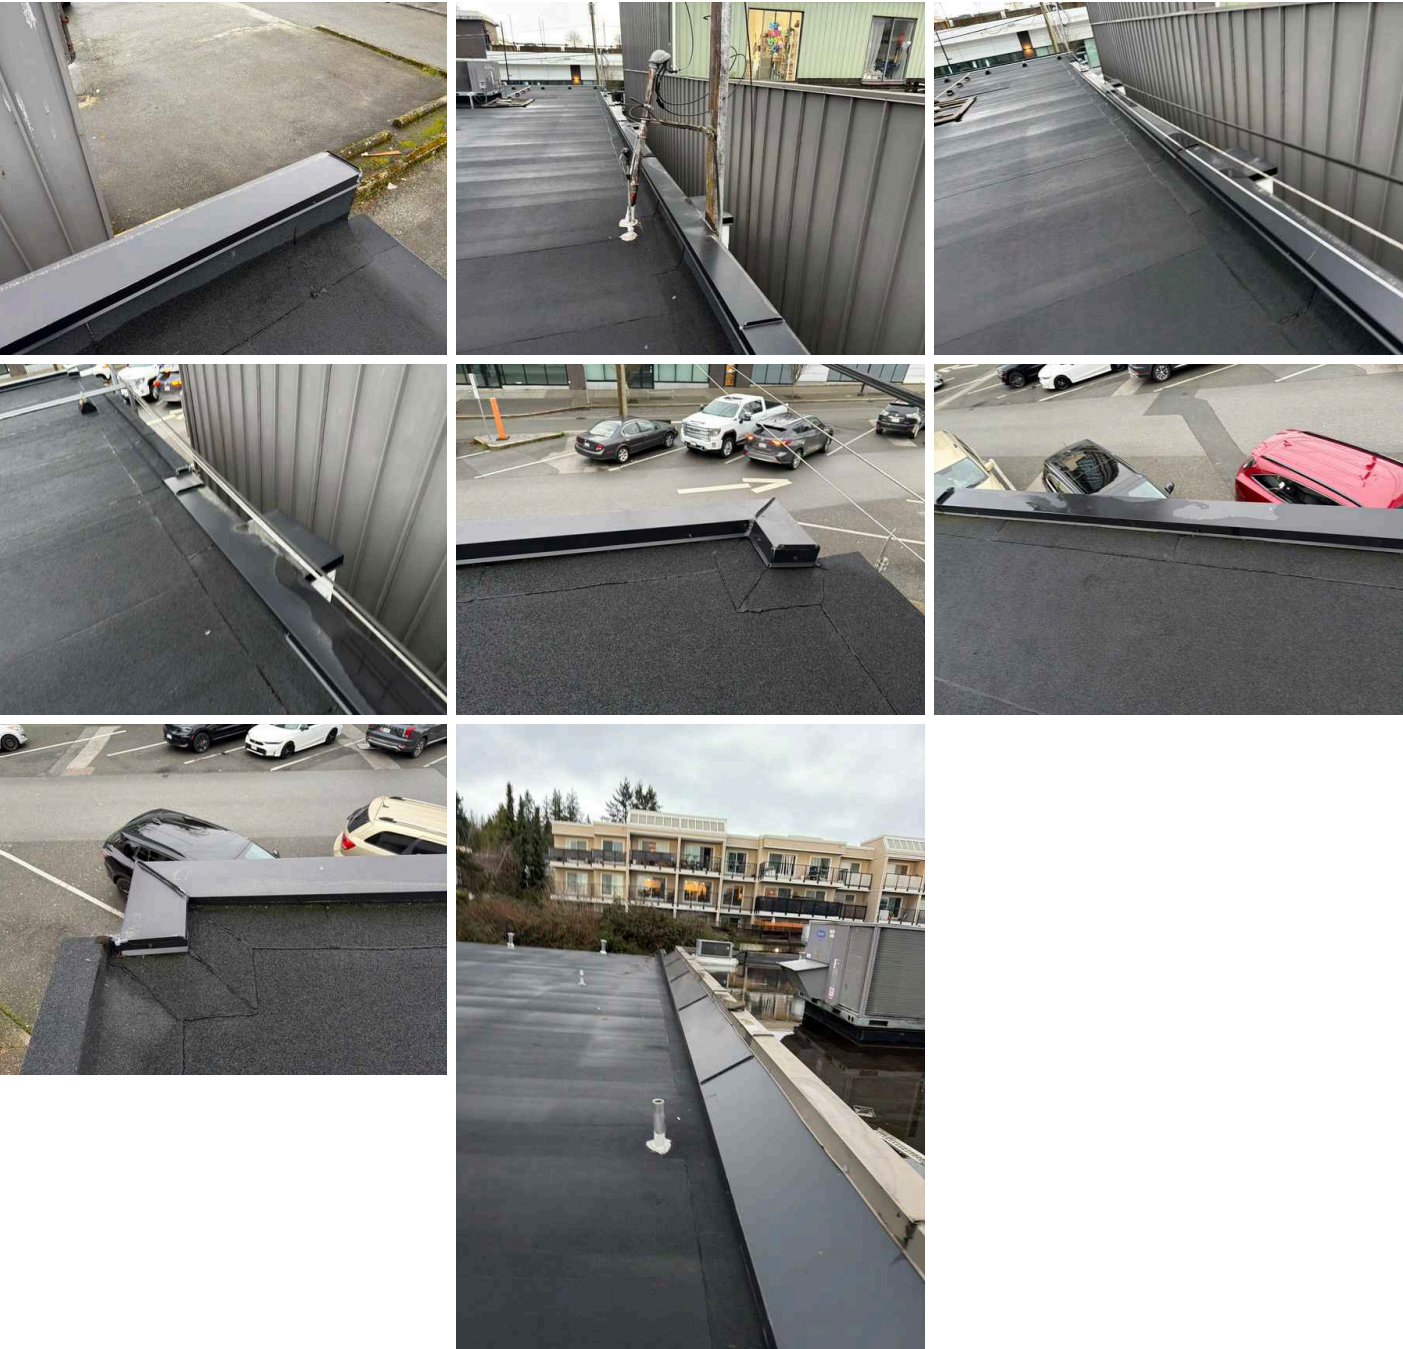

Skylights, Chimneys & Other Roof Penetrations: Roof Penetration Sealant Deterioration

Roof

Plumbing Vent Stack, Roof Penetrations – Maintenance Needed

Sealant around roof penetrations has begun to peel and requires regular maintenance to prevent water intrusion. Deteriorating sealant compromises the waterproof integrity at these vulnerable points. A roofing professional should inspect the affected penetrations, remove failed sealant, and apply new weatherproof sealant to restore proper protection.





Observations

2.1.1 Coverings

DEBRIS ON ROOF


ROOF

Trash and Garbage

Garbage and debris are laying on the roof surface. This debris traps water and may cause damage to the roofing material, potentially leading to leaks and deterioration. The roof should be cleared of all debris to prevent water pooling and premature roof failure.

Recommendation

Contact a qualified professional.

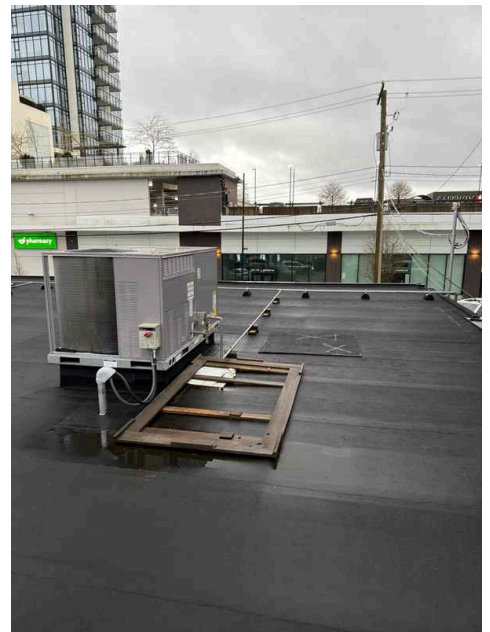

2.3.1 Flashings

WEAK SPOTS

ROOF

Monitor

The roof membrane appears to be a granulated modified bitumen system. Areas of previous repair were observed at roof penetrations and flashing transitions. Sealant and roofing cement have been applied to joints and seams, which may indicate prior leakage or maintenance. These locations represent common points of water intrusion and should be monitored. Evaluation and repair by a qualified roofing contractor is recommended to ensure proper flashing integrity.

Recommendation

Contact a qualified professional.



3: EXTERIOR

		IN	NI	NP	D
3.1	Siding, Flashing & Trim	X			X
3.2	Exterior Doors	X			
3.3	Walkways, Patios & Driveways	X			
3.4	Eaves, Soffits & Fascia	X			
3.5	Vegetation, Grading, Drainage & Retaining Walls	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency




Information






Inspection Method


Visual

Siding, Flashing & Trim: Siding Material


Brick

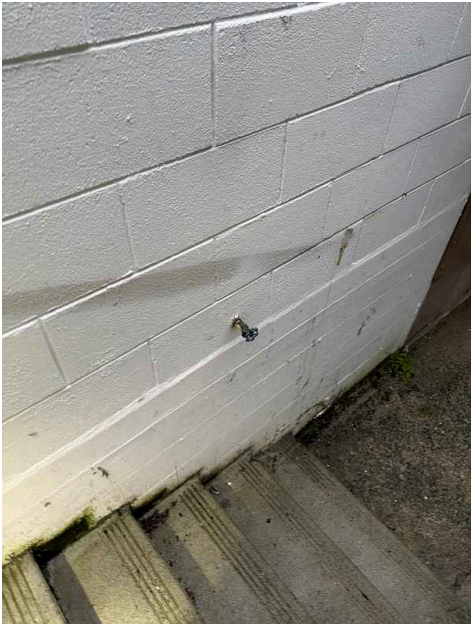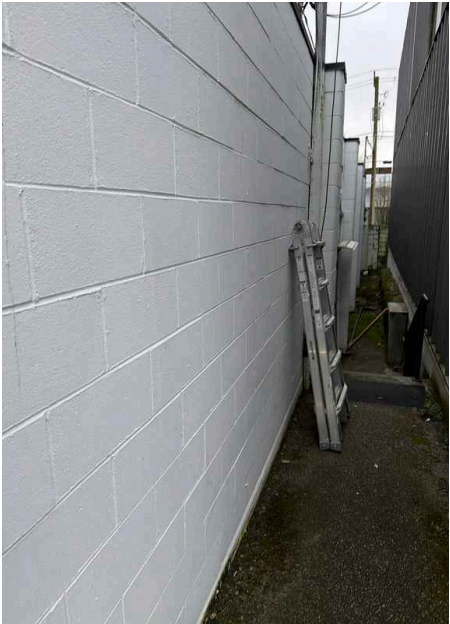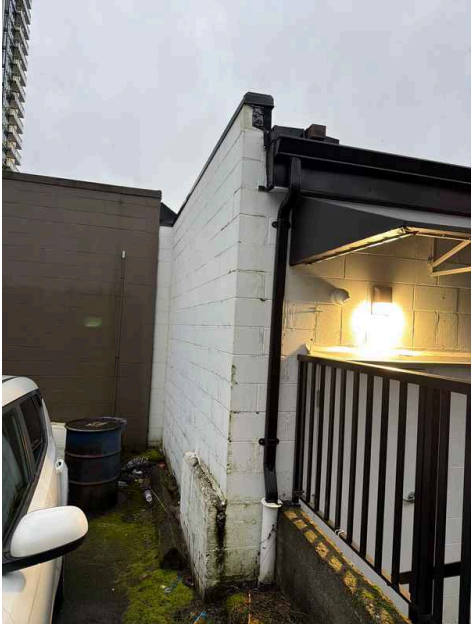


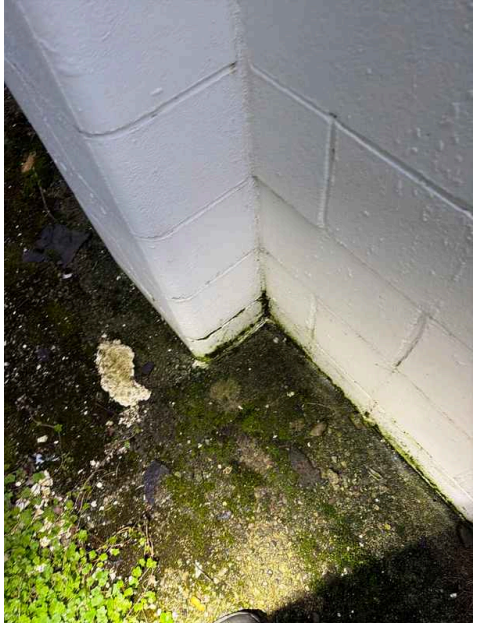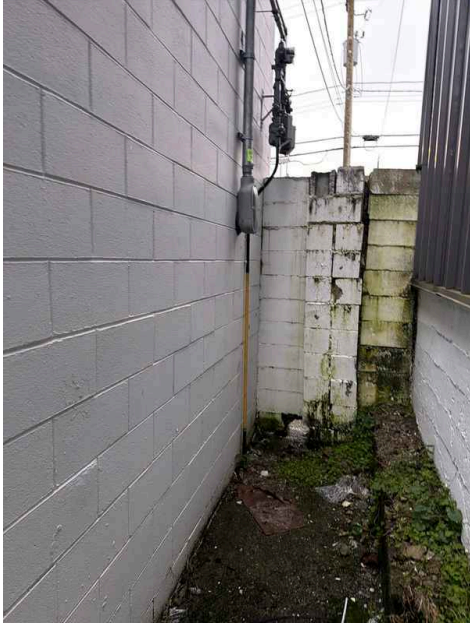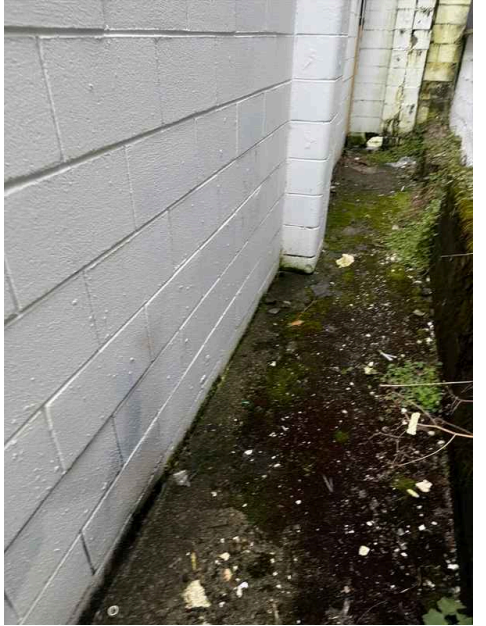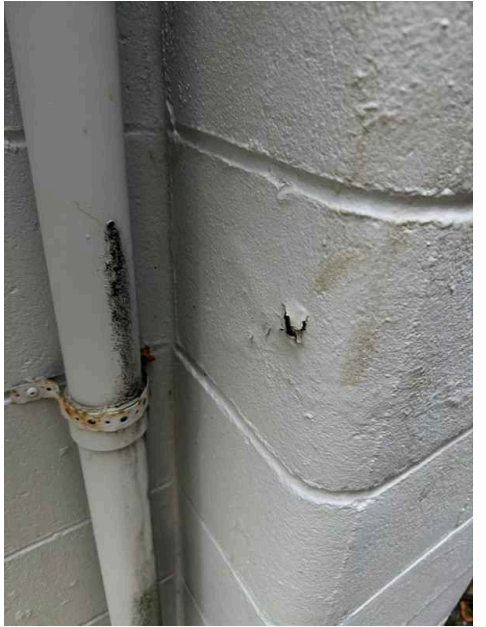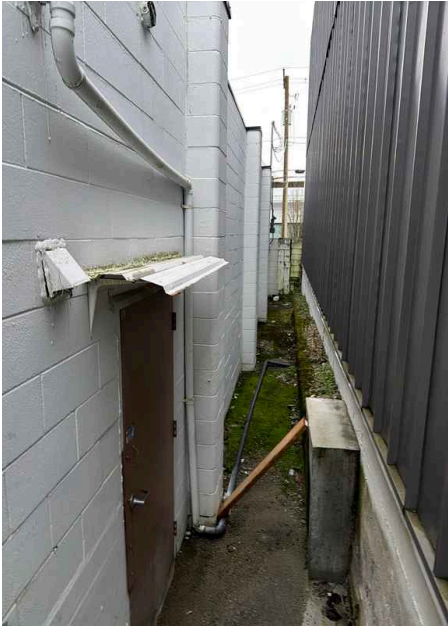


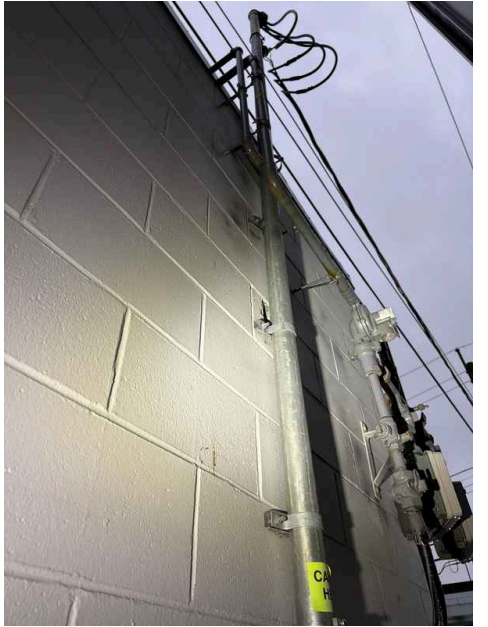


Exterior Doors: Exterior Entry Door
Glass, Steel

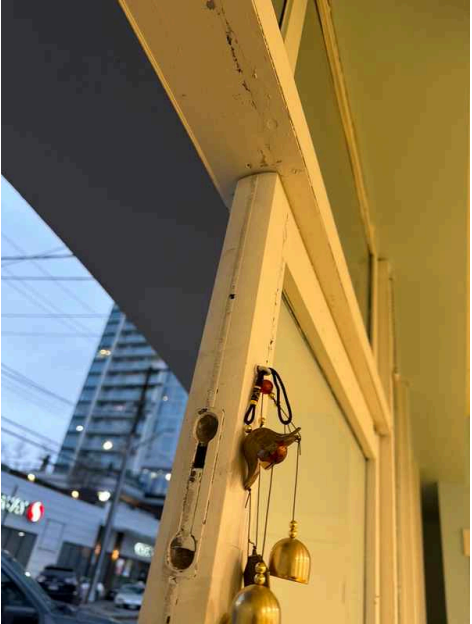

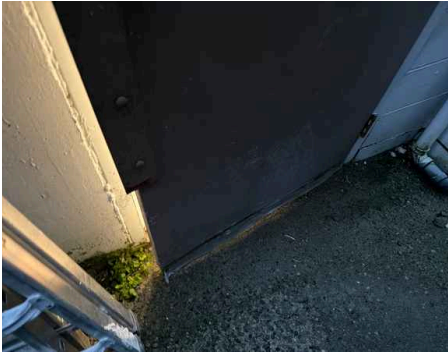

Walkways, Patios & Driveways: Driveway Material
Concrete, Asphalt

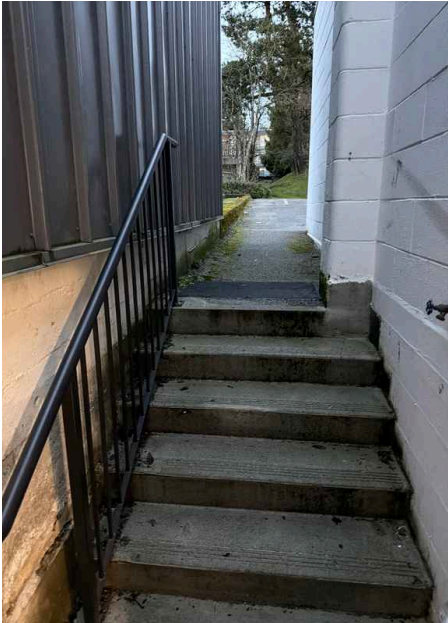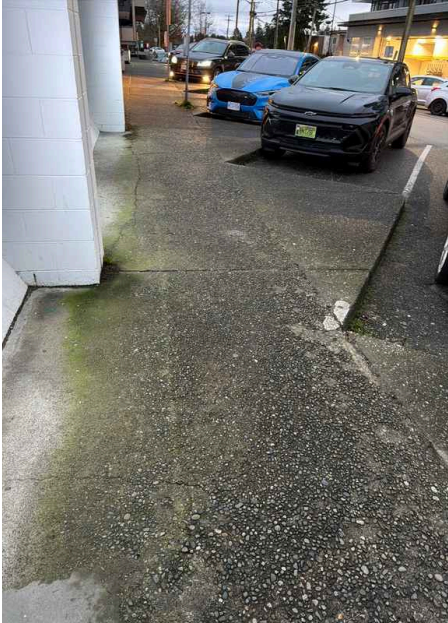

Eaves, Soffits & Fascia: Materials
Aluminum

Observations

3.1.1 Siding, Flashing & Trim

HOLES IN EXTERIOR WALLS

EXTERIOR WALLS

Multiple holes were observed in the exterior wall surfaces during inspection. Holes in siding and trim can allow water infiltration, pest entry, and compromise the weather barrier protecting the home's structure. These openings should be sealed and inspected to determine the underlying cause, then repaired by a qualified professional to prevent further damage.

Recommendation

Contact a qualified concrete contractor.




3.1.2 Siding, Flashing & Trim

EXTERIOR FINISH – LOCALIZED PAINT PEELING

Localized areas of paint peeling were observed on exterior surfaces. This condition may be due to weathering and normal deterioration over time. Surface preparation and repainting are recommended as part of routine exterior maintenance.

Recommendation

Contact a qualified painting contractor.

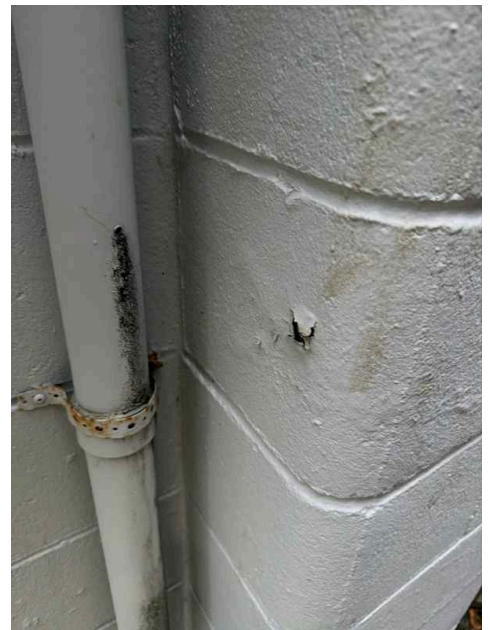

3.2.1 Exterior Doors

EXTERIOR DOOR PARTIALLY WEATHER STRIPPING MISSING



1ST FLOOR

true, Missing Sections, Deteriorated/Worn, Weather Stripping Missing

A portion of the exterior door is missing or incomplete, observed during the exterior inspection. This compromises weather protection and security for the property. The missing section should be replaced or repaired by a door specialist to restore proper function and weatherproofing.

Recommendation

Contact a qualified door repair/installation contractor.

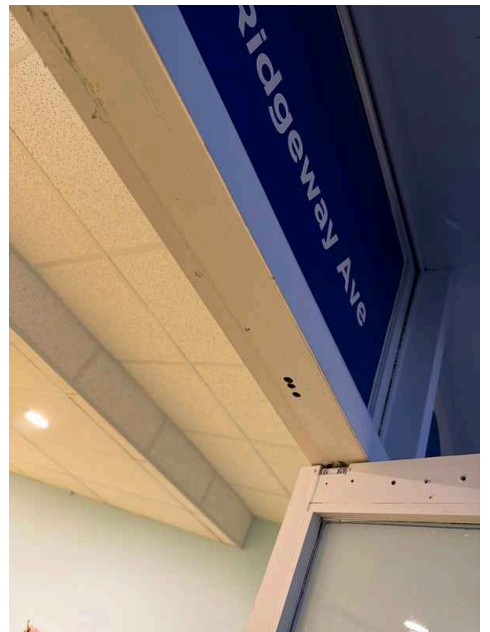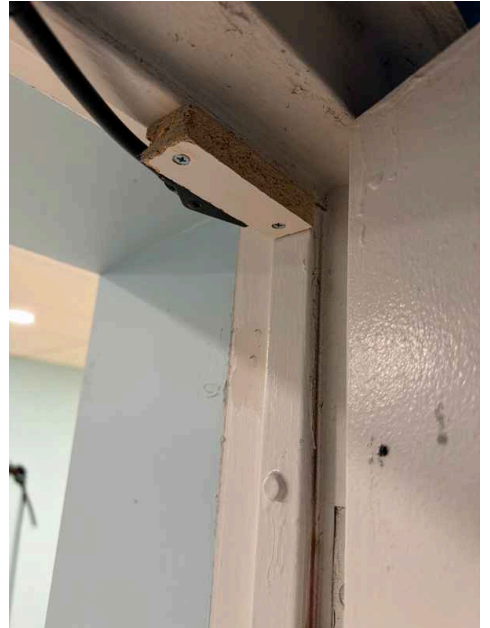



3.2.2 Exterior Doors

HARDWARE DAMAGED

Deficiency:

The door self-closing device was not functioning properly at the time of inspection. The door did not fully close and latch on its own.

Implication:


A non-operational self-closer may affect proper door operation and may not provide the intended fire separation or safety function.

Recommendation:

Recommend evaluation and repair or replacement by a qualified contractor.

Recommendation

Recommended DIY Project

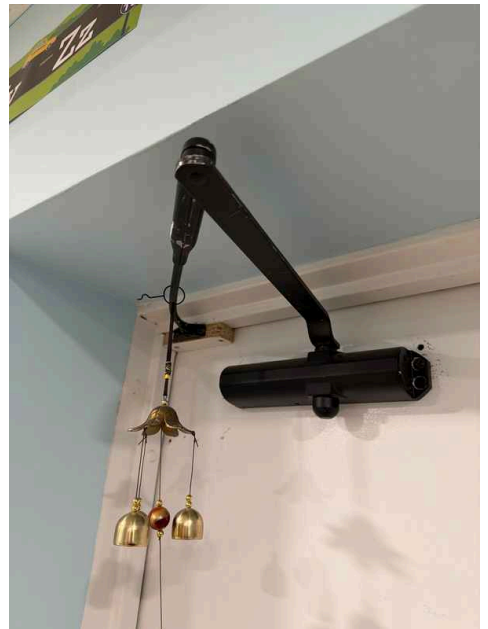

3.2.3 Exterior Doors

HARDWARE MISSING

Door is missing one or more pieces of hardware. Recommend replacing or upgrading.

Recommendation

Recommended DIY Project



3.2.4 Exterior Doors

PAINT/REFINISH NEEDED

Observation: The finish on the aluminum [Front/Side] doors is faded, chalking, or scuffed. Identification: This is a cosmetic condition common with age and sun exposure; however, "chalking" can lead to paint rub-off on clothing and skin. Recommendation: I recommend cleaning and refinishing the door. Note: Aluminum requires specific metal-grade primers and paints for proper adhesion. Consult a painting professional for the best product selection.

Recommendation

Contact a qualified door repair/installation contractor.





3.3.1 Walkways, Patios & Driveways

WALKWAY CRACKING - MAJOR

FRONT

Cracking exceeding approximately 3/8" inch in width was observed in the exterior walkway. While the condition does not appear to present an immediate tripping hazard at the time of inspection, the size of the cracks indicates deterioration of the surface and may worsen over time. Monitoring and repair by a qualified contractor is recommended to prevent further damage and potential safety concerns.

Although not currently a tripping hazard, deteriorated walking surfaces should be monitored and maintained to reduce potential safety risks for children and staff.

Recommendation

Contact a qualified concrete contractor.



3.3.2 Walkways, Patios & Driveways



WALKWAY CRACKING - MINOR

FRONT AND BACK

Minor cosmetic cracks observed. Recommend monitor and/or patch/seal.

Recommendation

Contact a qualified concrete contractor.

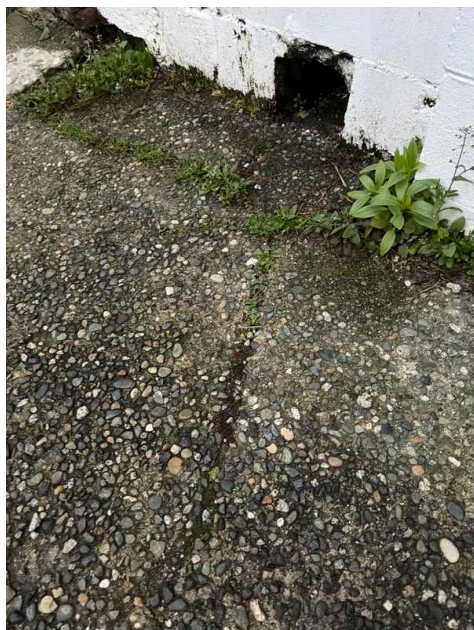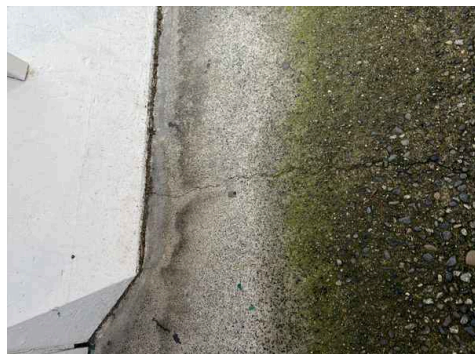

3.5.1 Vegetation, Grading, Drainage & Retaining Walls


NEGATIVE GRADING

Grading is sloping towards the home in some areas. This could lead to water intrusion and foundation issues. Recommend qualified landscaper or foundation contractor regrade so water flows away from home.

[Here is a helpful article](#) discussing negative grading.

Recommendation

Contact a qualified landscaping contractor

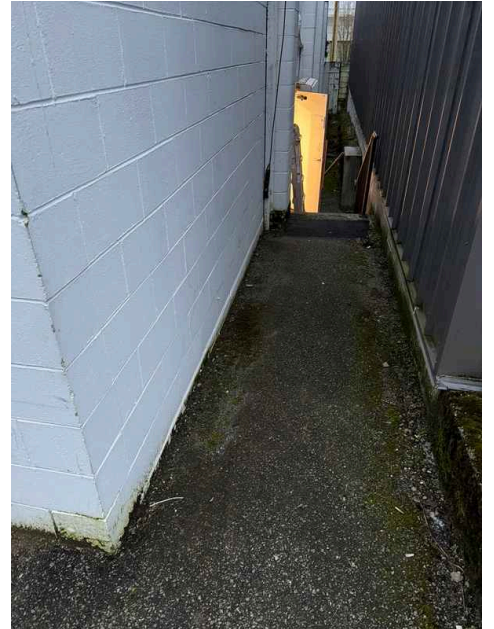

4: BASEMENT, FOUNDATION AND CRAWLSPACE

		IN	NI	NP	D
4.1	Foundation	X			X
4.2	Basements & Crawlspaces			X	
4.3	Floor Structure		X		
4.4	Wall Structure	X			
4.5	Ceiling Structure	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information

Inspection Method

Visual

Foundation: Material

Concrete, Brick

Floor Structure: Sub-floor

Inaccessible

Ceiling Structure: Roof structure

Ceiling

Structural Beam Above Suspended Ceiling

Observation


A glued laminated timber (glulam) beam was observed above the suspended (T-bar) ceiling system. The beam appears to be part of the structural support for the floor or roof assembly above.

Condition

The visible portions of the beam appeared generally intact at the time of inspection. No obvious structural distress such as significant cracking, splitting, or deformation was observed in the visible areas.

Limitation

The inspection was limited to visible portions only, as portions of the structural beam are concealed by ceiling finishes and building components.

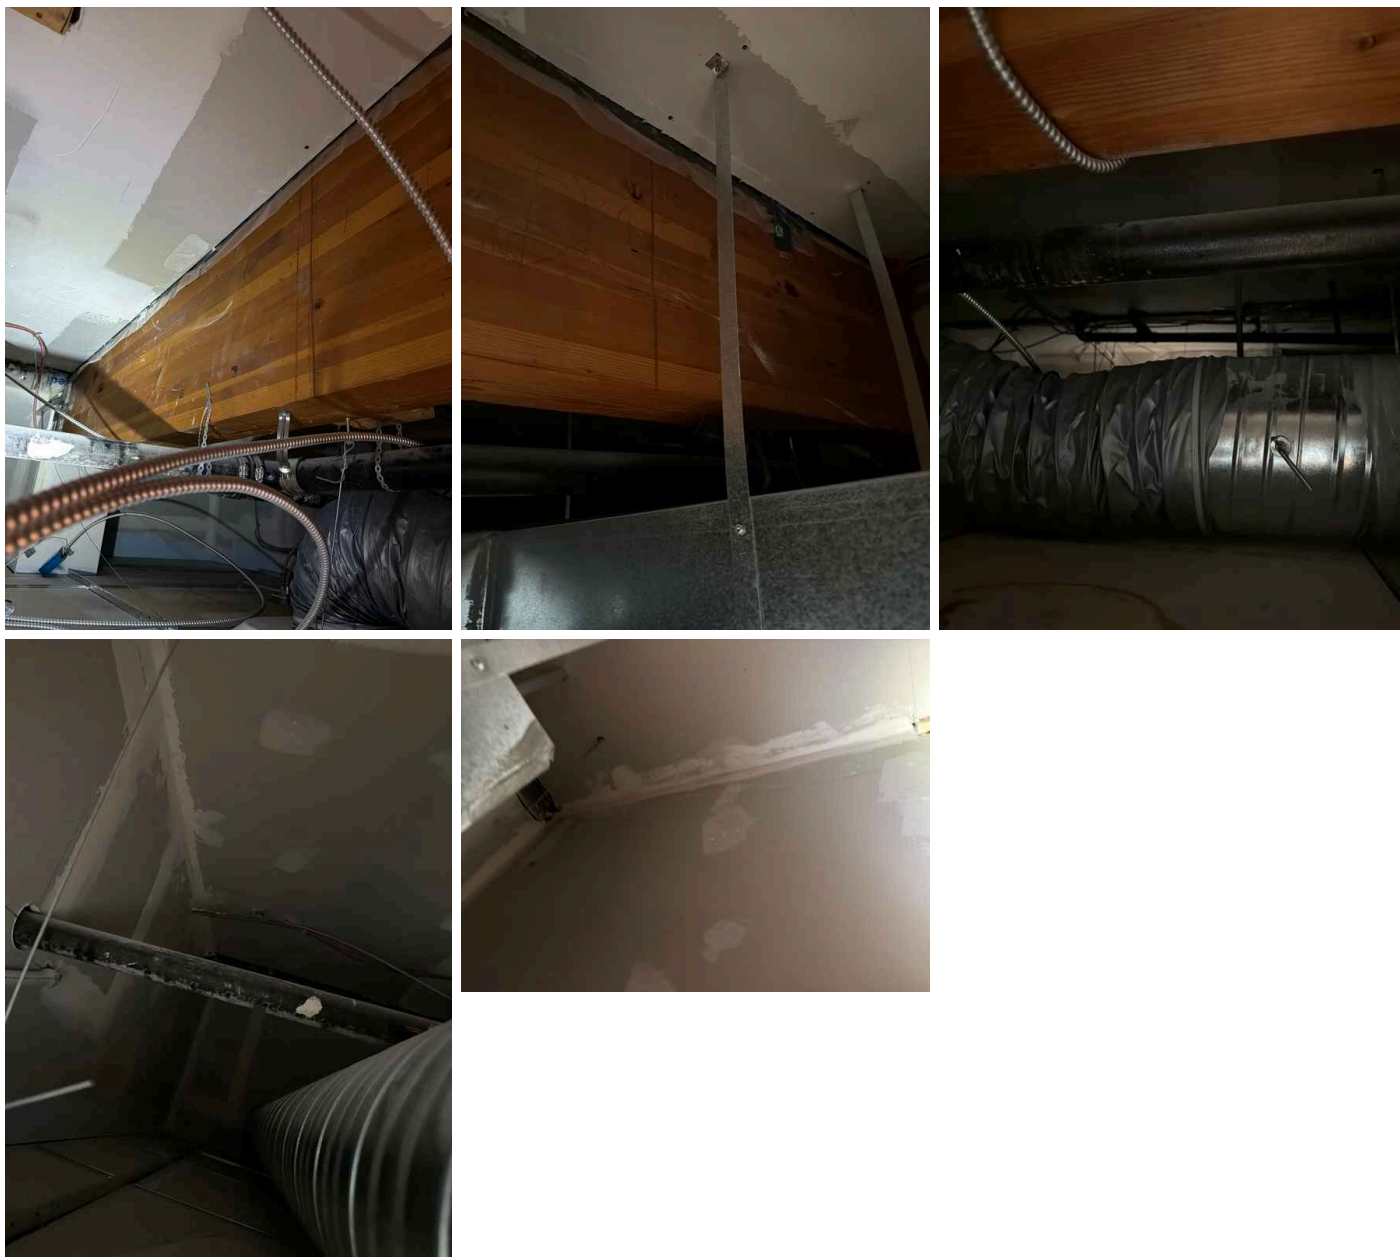

Limitations

General

BASEMENT / FOUNDATION / CRAWLSPACE – INSPECTION LIMITATION

Inspection of the basement, foundation, and crawlspace areas was limited to accessible and visible portions only. Some areas were concealed by finished surfaces, stored materials, or building components. As a result, concealed structural or moisture-related conditions may exist that were not observable at the time of inspection.

Foundation

FOUNDATION – LIMITED VISIBILITY

Portions of the foundation were not visible due to interior finishes, exterior grading, and building components. The inspection was limited to observable areas only, and concealed conditions could not be evaluated.

Floor Structure

FLOOR STRUCTURE – NOT VISIBLE

The structural components of the floor system were not visible due to finished construction and ceiling coverings. Therefore, the inspection was limited to observable conditions only, and no determination can be made regarding the condition of concealed floor framing.

Ceiling Structure

CEILING ACCESS AND MECHANICAL CLEARANCE LIMITATION

BASEMENT

Limited Access, Clearance Issue, Mechanical Obstruction

Ceiling tiles in the basement are obstructed by multiple mechanical members overhead, limiting safe accessibility for inspection and maintenance. The proximity of these mechanical systems to the ceiling structure creates a risk of damage to ceiling tiles during any work or access attempts.

Observations

4.1.1 Foundation

FOUNDATION CRACKS - MINOR

Minor cracking was noted at the foundation. This is common as concrete ages and shrinkage surface cracks are normal. Recommend monitoring for more serious shifting/displacement.

[Here is an informational article](#) on foundation cracks.

Recommendation

Contact a qualified structural engineer.

5: HEATING AND VENTILATION

		IN	NI	NP	D
5.1	Equipment	X			
5.2	Normal Operating Controls	X			X
5.3	Distribution Systems	X			
5.4	Vents, Flues & Chimneys	X			
5.5	Presence of Installed Heat Source in Each Room	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency


Information

Equipment: Brand
Carrier






Equipment: Energy Source
Gas

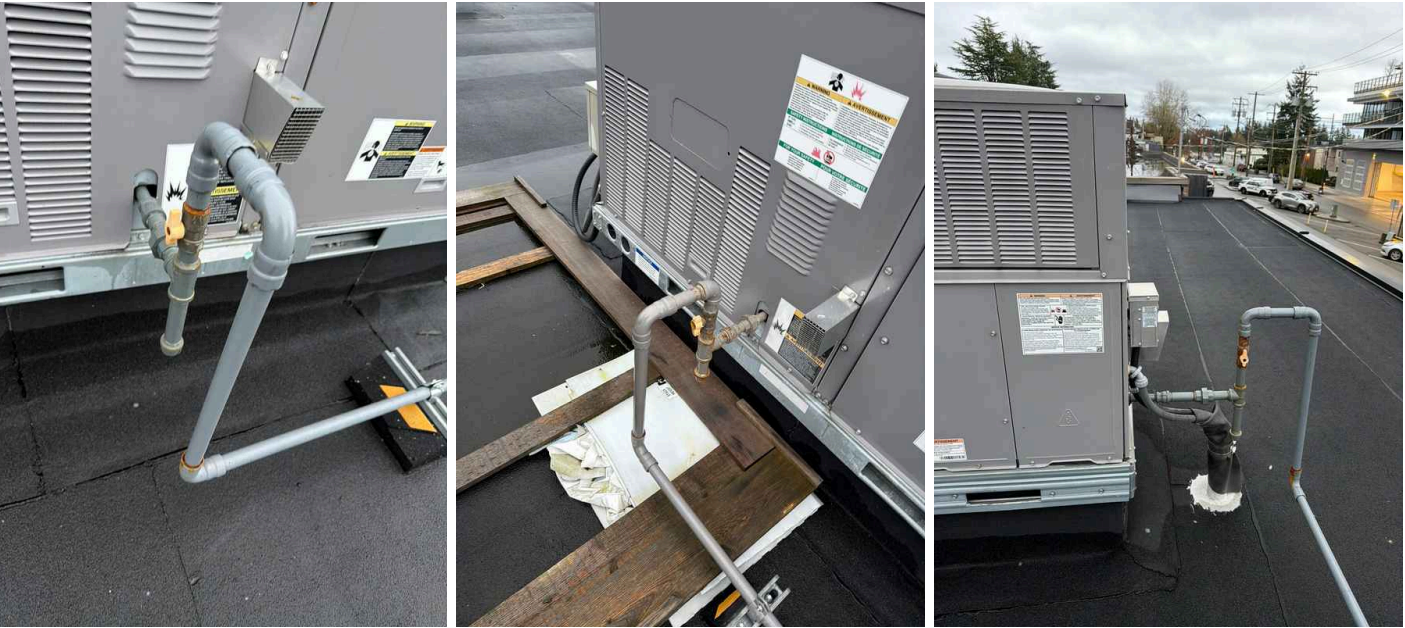


Equipment: Heat Type
Forced Air, Gas-Fired Heat

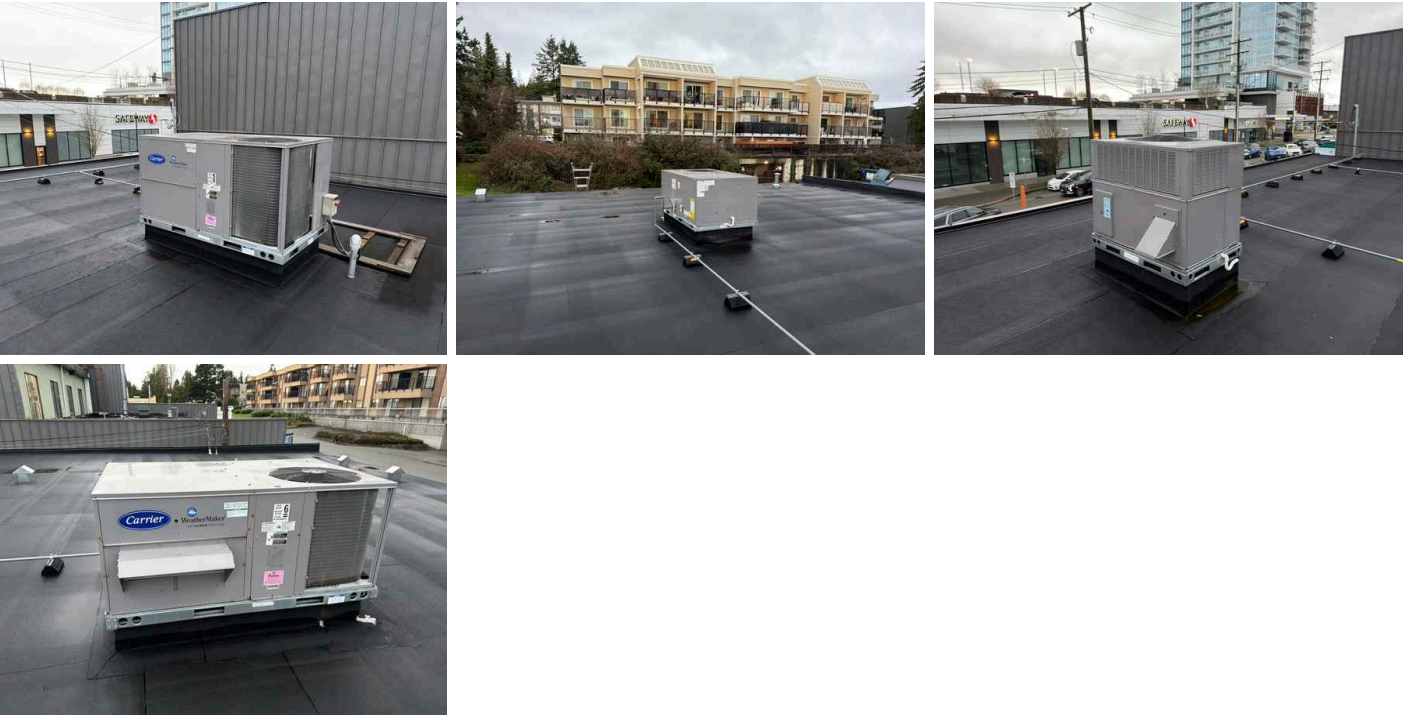

Normal Operating Controls: Thermostats

Thermostat was observed controlling the heating system. The thermostats responded to adjustments during the inspection; however, long-term performance cannot be determined during a limited inspection.

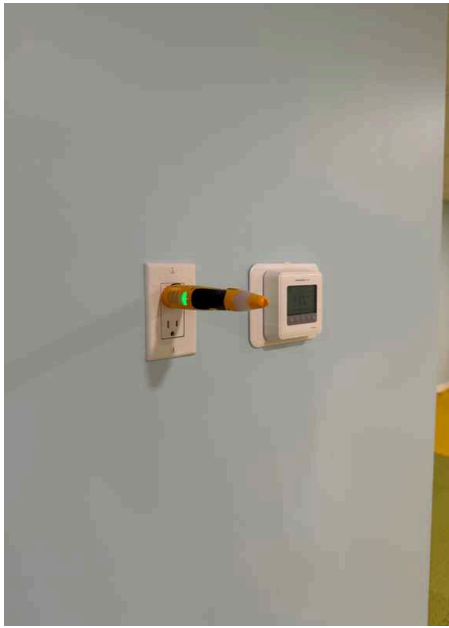

Distribution Systems: Ductwork

Non-insulated




Vents, Flues & Chimneys: Vents

Exterior



Presence of Installed Heat Source in Each Room: Heat source

Ceiling

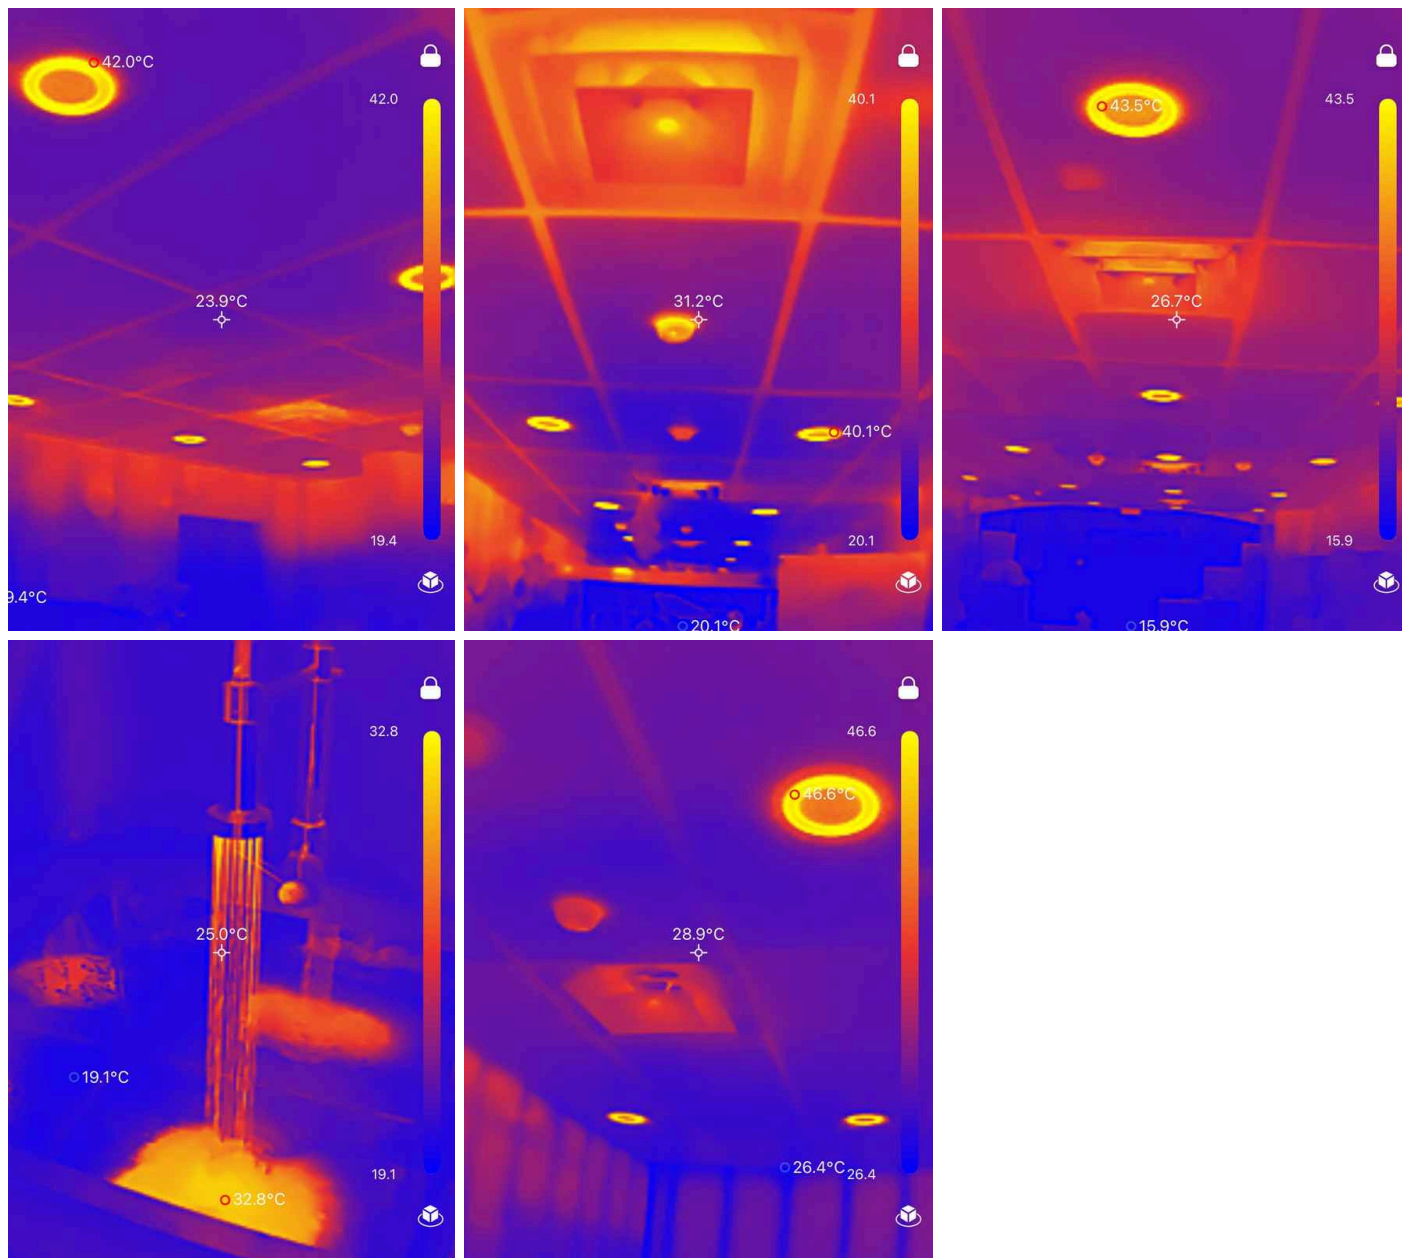

Limitations

General

HVAC – ROOFTOP UNITS (STRATA RESPONSIBILITY)

Observation

The HVAC system serving the unit includes rooftop equipment that appears to be part of the building's common mechanical system and under the responsibility of the strata corporation.

Limitation

Rooftop HVAC equipment was not inspected as it is considered part of the building's common property and is typically maintained by the strata.

Recommendation

Verification of maintenance records and service responsibility with the strata corporation is recommended.

Equipment

EQUIPMENT ACCESS LIMITATION

ROOF

Disassembly Required




The heating and ventilation equipment requires disassembly to open for inspection. This limits the ability to fully evaluate internal components, connections, and operational condition during the inspection.



Distribution Systems

HVAC DISTRIBUTION SYSTEM – LIMITED INSPECTION

The HVAC distribution system was only partially inspected due to limited accessibility. Portions of the ductwork were concealed above the suspended ceiling and behind building finishes. The inspection was therefore limited to visible and accessible areas only.

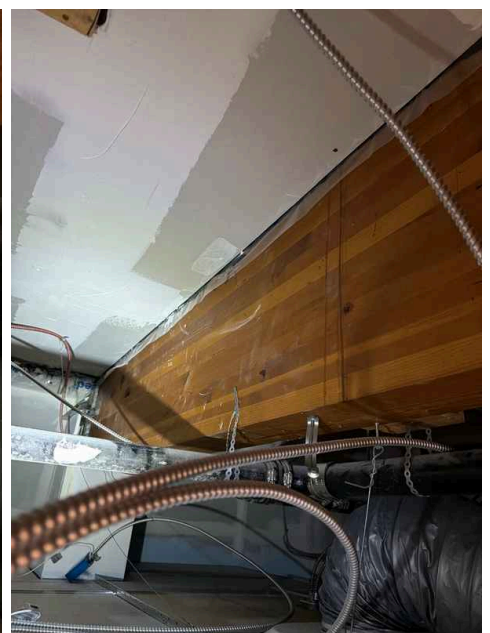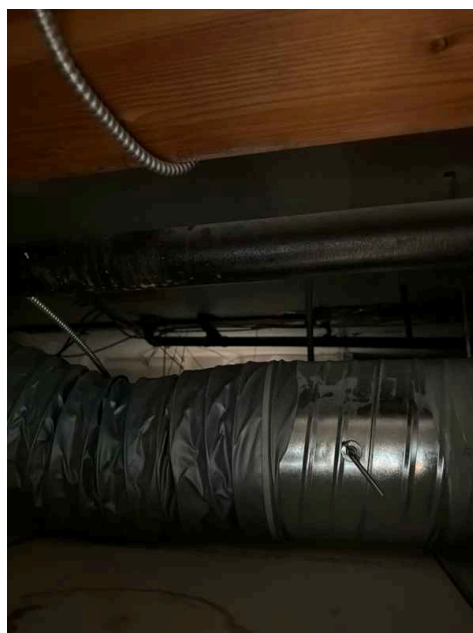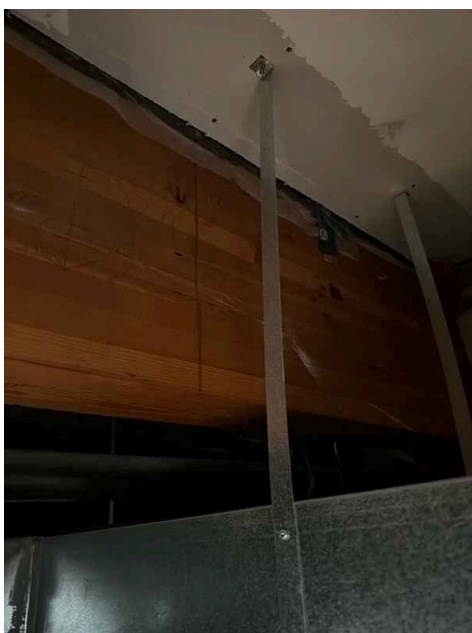

Observations

5.2.1 Normal Operating Controls

HVAC – UNEVEN TEMPERATURE

The thermostat is located within one room of the facility. The room containing the thermostat maintained the desired temperature; however, another occupied room was observed to be significantly warmer. Uneven temperature conditions may affect occupant comfort and should be evaluated if persistent.

Recommendation

Contact a qualified HVAC professional.

5.4.1 Vents, Flues & Chimneys

VENTS REQUIRE CLEANING

EXTERIOR

The exhaust vent was observed to be dirty and may contain accumulated dust and debris. Cleaning and routine maintenance are recommended to maintain proper airflow and ventilation performance.



6: COOLING

		IN	NI	NP	D
6.1	Cooling Equipment		X		
6.2	Normal Operating Controls		X		
6.3	Distribution System		X		
6.4	Presence of Installed Cooling Source in Each Room		X		

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information

Cooling Equipment: Brand
Carrier

Limitations

General

COOLING EQUIPMENT – OPERATIONAL LIMITATION

The cooling equipment was not operated because the outdoor temperature was below approximately 18 °C at the time of inspection. Operation of air-conditioning equipment under these conditions may cause damage; therefore, the cooling system could not be evaluated.

7: PLUMBING

		IN	NI	NP	D
7.1	Main Water Shut-off Device	X			
7.2	Back-flow Prevention Device	X			
7.3	Drain, Waste, & Vent Systems	X			
7.4	Water Supply, Distribution Systems & Fixtures	X			
7.5	Hot Water Systems, Controls, Flues & Vents	X			
7.6	Fuel Storage & Distribution Systems	X			
7.7	Sinks	X			X

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information

Filters

Unknown

Water Source

Public


Main Water Shut-off Device: Location

First floor



Back-flow Prevention Device: Location

First floor

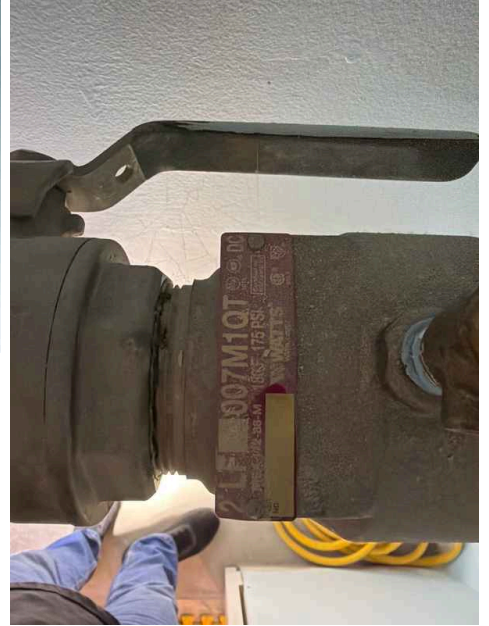

Drain, Waste, & Vent Systems: Drain Size

1 1/2"




Drain, Waste, & Vent Systems: Material
PVC




Water Supply, Distribution Systems & Fixtures: Distribution Material

Pex

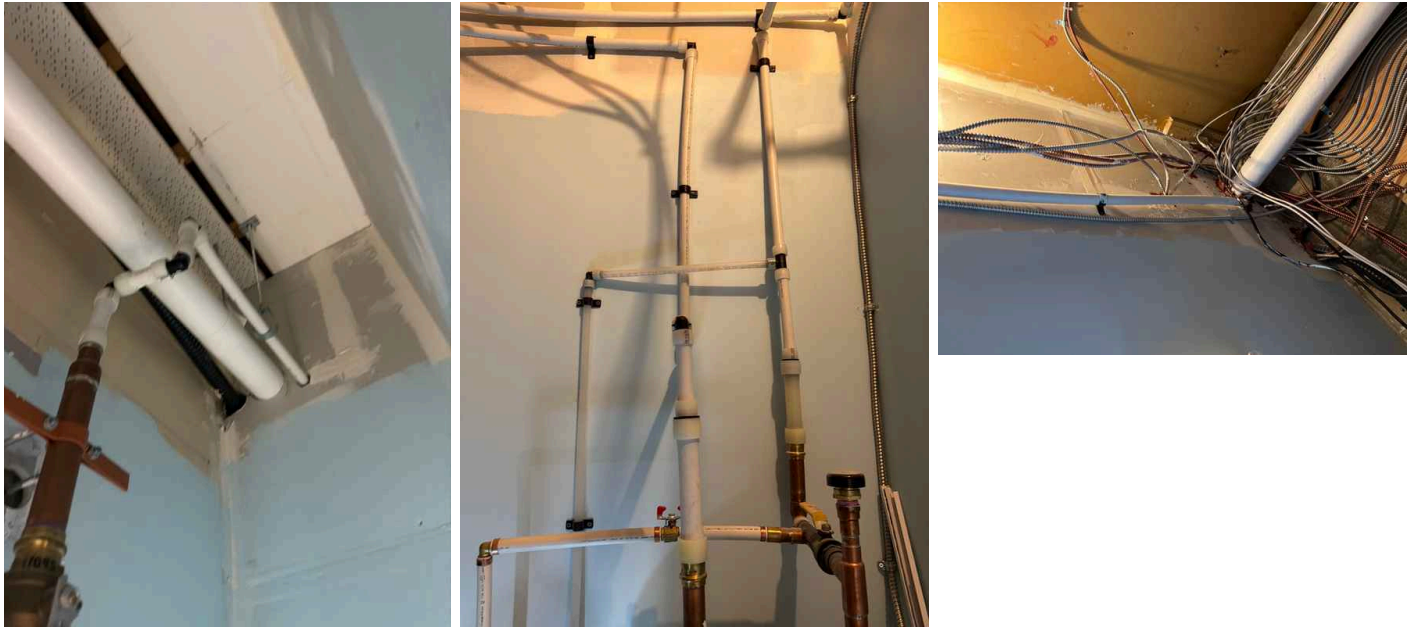

Water Supply, Distribution Systems & Fixtures: Water Supply Material

Copper, Pex, Hose

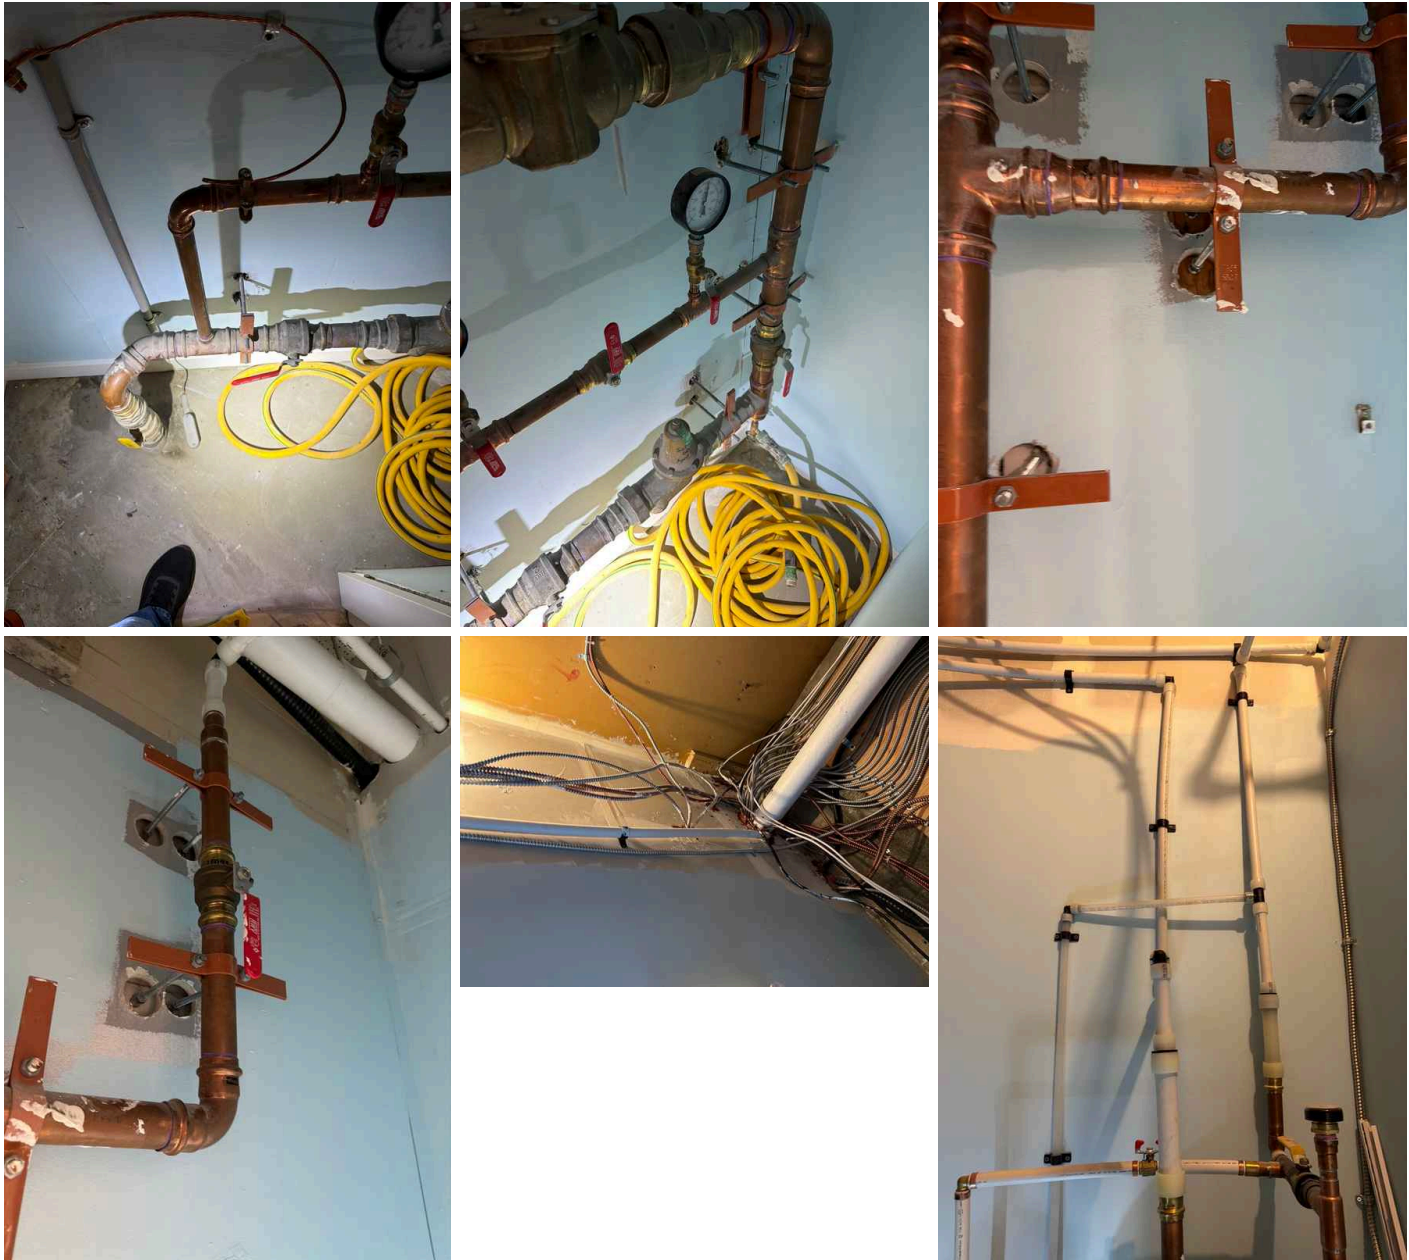

Hot Water Systems, Controls, Flues & Vents: Manufacturer

Utility room
John wood

The building is served by an electric water heater. Electric water heaters use internal heating elements to heat and store water in an insulated tank. Typical service life is approximately 8 - 10 years, depending on maintenance and operating conditions.


Hot water temperatures should be monitored to reduce the risk of scalding, particularly in facilities occupied by children.



Hot Water Systems, Controls, Flues & Vents: Power Source/Type
Electric


Hot Water Systems, Controls, Flues & Vents: Capacity
48 gallons

Hot Water Systems, Controls, Flues & Vents: Location
Utility Room

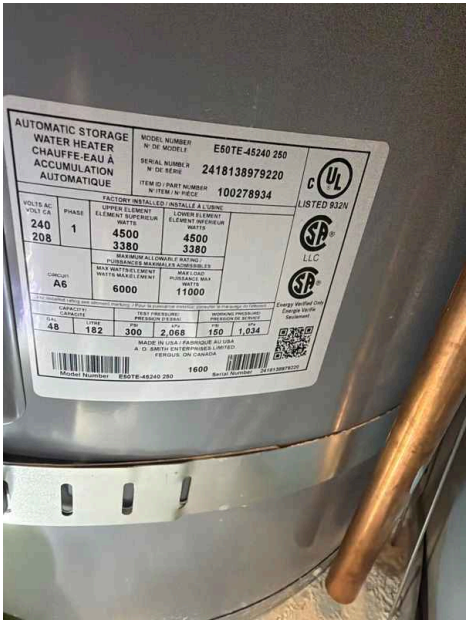

Fuel Storage & Distribution Systems: Main Gas Shut-off Location

Gas Meter

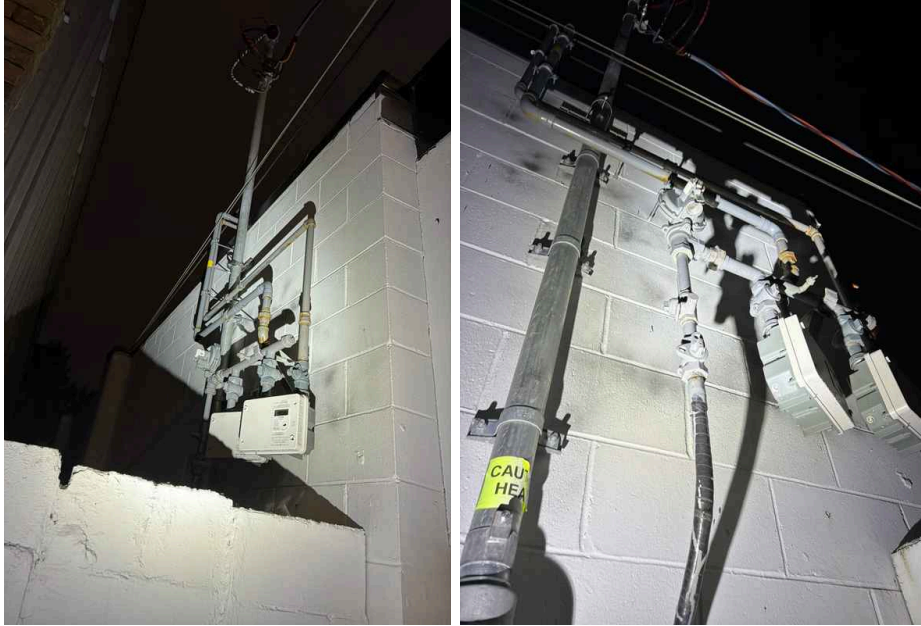

Sinks: Sinks

Observations

7.6.1 Fuel Storage & Distribution Systems


GAS PIPING – MINOR CORROSION

AT GAS METER

Minor surface rust was observed on the gas piping near the gas meter. The corrosion appeared to be superficial at the time of inspection. Cleaning and application of appropriate protective coating is recommended to help prevent further deterioration.

Recommendation

Contact a qualified professional.

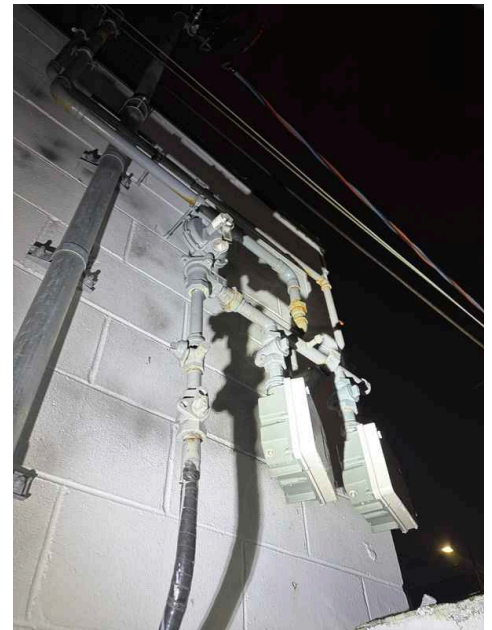

7.7.1 Sinks

HOT WATER TEMPERATURE – CHILD SAFETY

ALL WASHROOMS



Thermostatic mixing valves were not observed at sinks used by children. Hot water temperature appears to be controlled by partially closing the hot water shut-off valve, which is not a reliable temperature-control method. Installation of thermostatic mixing valves or other temperature-limiting devices is recommended to help reduce the risk of scalding in a childcare environment.

Sinks used by children should be equipped with temperature-limiting devices to reduce the risk of scalding. Hot water temperatures should generally not exceed approximately 49 °C. Monitoring and installation of appropriate temperature control devices is recommended where necessary.

8: ELECTRICAL

		IN	NI	NP	D
8.1	Service Entrance Conductors	X			
8.2	Main & Subpanels, Service & Grounding, Main Overcurrent Device	X			X
8.3	Branch Wiring Circuits, Breakers & Fuses	X			
8.4	Lighting Fixtures, Switches & Receptacles	X			
8.5	GFCI & AFCI	X			
8.6	Fire alarms	X			X
8.7	Smoke & Carbon Monoxide Detectors	X			X

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency


Information

Electrical System – General Information

The building is served by a three-phase electrical system. Three-phase electrical systems are commonly used in commercial buildings to provide sufficient power for mechanical equipment, lighting, and other electrical loads. These systems distribute electrical power across three conductors to improve efficiency and balance electrical demand.

Service Entrance Conductors: Electrical Service Conductors

Overhead

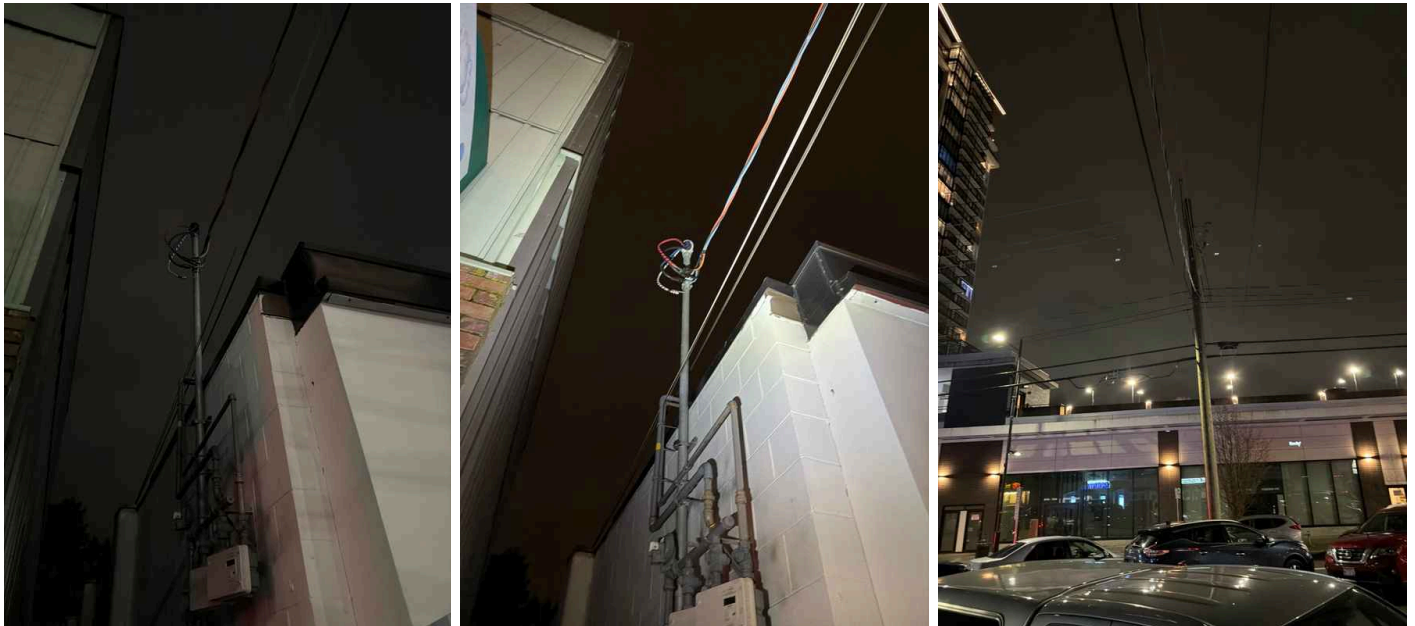

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Main Panel Location
Utility room



Main & Subpanels, Service & Grounding, Main Overcurrent Device: Panel Capacity
100 AMP



Main & Subpanels, Service & Grounding, Main Overcurrent Device: Panel Manufacturer
Siemens

Main & Subpanels, Service & Grounding, Main Overcurrent Device: Panel Type
Circuit Breaker

Branch Wiring Circuits, Breakers & Fuses: Branch Wire 15 and 20 AMP
Copper, Aluminum

Branch Wiring Circuits, Breakers & Fuses: Wiring Method
Not Visible, Conduit, Armored Cable

Lighting Fixtures, Switches & Receptacles: Pictures



GFCI & AFCI: GFCI



Smoke & Carbon Monoxide Detectors: Smoke & Carbon Monoxide Detectors

Smoke and carbon monoxide detectors were observed in the building. These devices are intended to provide early warning in the event of smoke or carbon monoxide accumulation.

Smoke and carbon monoxide detectors were observed in the building. These devices should be regularly tested and maintained to help ensure proper operation.



Limitations

General

ELECTRICAL SYSTEM – INSPECTION LIMITATION

The electrical inspection was limited to a visual evaluation of readily accessible components. The inspection included observation of accessible panels, wiring, and general electrical conditions. The inspection did not include testing of electrical load capacity, detailed evaluation of internal panel components, or verification of electrical code compliance.

General

PANEL INSPECTION LIMITATION

Electrical panels were inspected where safely accessible; however, the inspection was limited to a visual review. Internal components such as breakers, bus bars, and wiring connections were not dismantled or fully tested.

General

LIMITATION

The inspection of the electrical system is not intended to determine the adequacy of the system for current or future electrical loads. Evaluation of electrical system capacity should be performed by a qualified electrical contractor if required.

Branch Wiring Circuits, Breakers & Fuses

BRANCH WIRING CIRCUITS, BREAKERS & FUSES – LIMITED EVALUATION

The inspection of branch wiring circuits and overcurrent protection devices was limited to accessible areas only. The inspection did not include testing of circuit loads, removal of breakers, or verification of internal panel components.

Fire alarms

INSPECTION LIMITATION

The inspection of the fire alarm system was limited to visual observation of accessible components only. Functional testing of the fire alarm system and verification of monitoring or regulatory compliance were outside the scope of this inspection.

Smoke & Carbon Monoxide Detectors

INSPECTION LIMITATION

The inspection of smoke and carbon monoxide detectors was limited to a visual observation of installed devices. The inspection did not include verification of proper placement, interconnection, monitoring systems, or compliance with local fire safety regulations.

Smoke & Carbon Monoxide Detectors

OPERATIONAL LIMITATION

Functional testing of all smoke and carbon monoxide detectors was not performed as part of this inspection. Regular testing and maintenance are recommended.

Observations

8.2.1 Main & Subpanels, Service & Grounding, Main Overcurrent Device

MISSING ELECTRICAL PANEL DOOR HINGE


UTILITY ROOM

true, Hinge Missing

The hinge on the electrical box door is missing, preventing the door from closing and latching properly. This creates a safety hazard by leaving live electrical components exposed and accessible. A qualified electrician should inspect the panel and install a replacement hinge to ensure the door functions correctly and provides proper protection.

Recommendation


Contact a qualified electrical contractor.

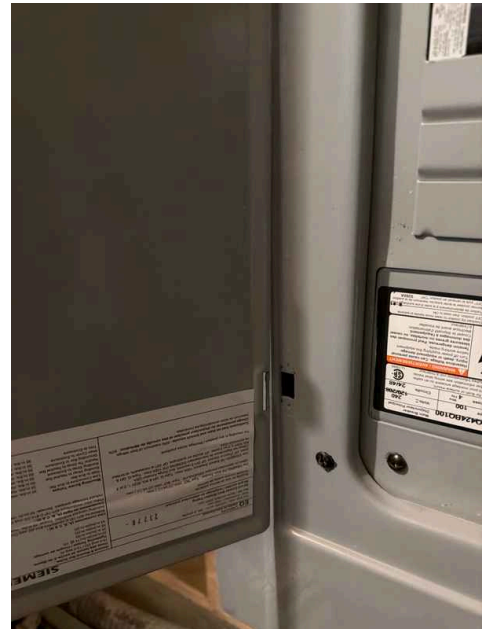

8.7.1 Smoke & Carbon Monoxide Detectors

DETECTOR – NOT SECURED

A smoke/CO detector was observed to be loose and not properly secured to its mounting surface. Proper installation and securing are recommended.

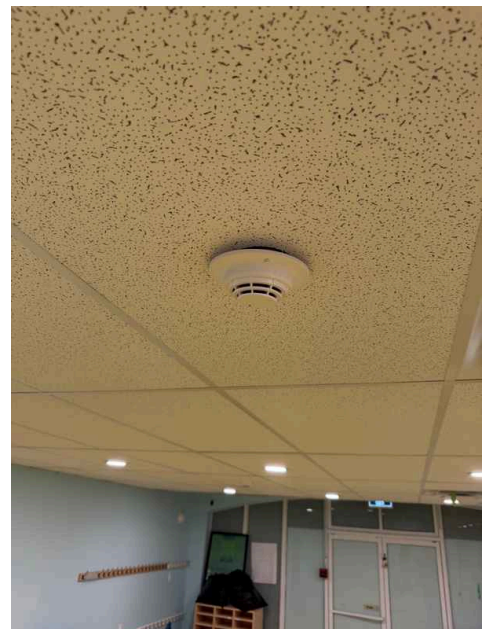

9: ATTIC, INSULATION & VENTILATION

		IN	NI	NP	D
9.1	Insulation of Unfinished Spaces	X			X
9.2	Ventilation			X	
9.3	Exhaust Systems	X			

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information

Dryer Power Source

unknown

Dryer Vent

Metal, Unknown

Flooring Insulation

Unknown

Insulation of Unfinished Spaces:

Insulation Type

Batt, None

Ventilation: Ventilation Type

None Found

Mechanical ventilation provided by rooftop HVAC units and exhaust systems.

Return air grille observed above the door as part of the central HVAC air distribution system. This component returns room air back to the air handler for filtration and recirculation. This is not an exhaust vent.

Exhaust Systems: Exhaust Fans

Fan Only

Exhaust fans were observed serving restroom areas. Operation appeared functional at the time of inspection. Cleaning and routine maintenance of vents is recommended to maintain airflow.



Limitations

NON VISABLE

Ventilation

VENTILATION – INSPECTION LIMITATION

The building appears to utilize mechanical ventilation systems rather than attic ventilation. The inspection of roof ventilation systems was limited as the building does not contain a conventional attic space.

Ventilation

VENTILATION – INSPECTION LIMITATION

The building appears to rely on mechanical ventilation through HVAC systems. Traditional attic ventilation systems were not present and therefore were not evaluated.

Observations

9.1.1 Insulation of Unfinished Spaces

INSUFFICIENT INSULATION

Insulation depth was inadequate. Recommend a qualified attic insulation contractor install additional insulation.

Recommendation

Contact a qualified insulation contractor.


10: DOORS, WINDOWS & INTERIOR

		IN	NI	NP	D
10.1	Doors	X			X
10.2	Windows			X	
10.3	Floors	X			
10.4	Walls	X			
10.5	Ceilings	X			
10.6	Steps, Stairways & Railings	X			
10.7	Garage Door			X	
10.8	Garage Door Opener			X	
10.9	Occupant Door (From garage to inside of property)			X	


IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information


Doors: Door materials
wood

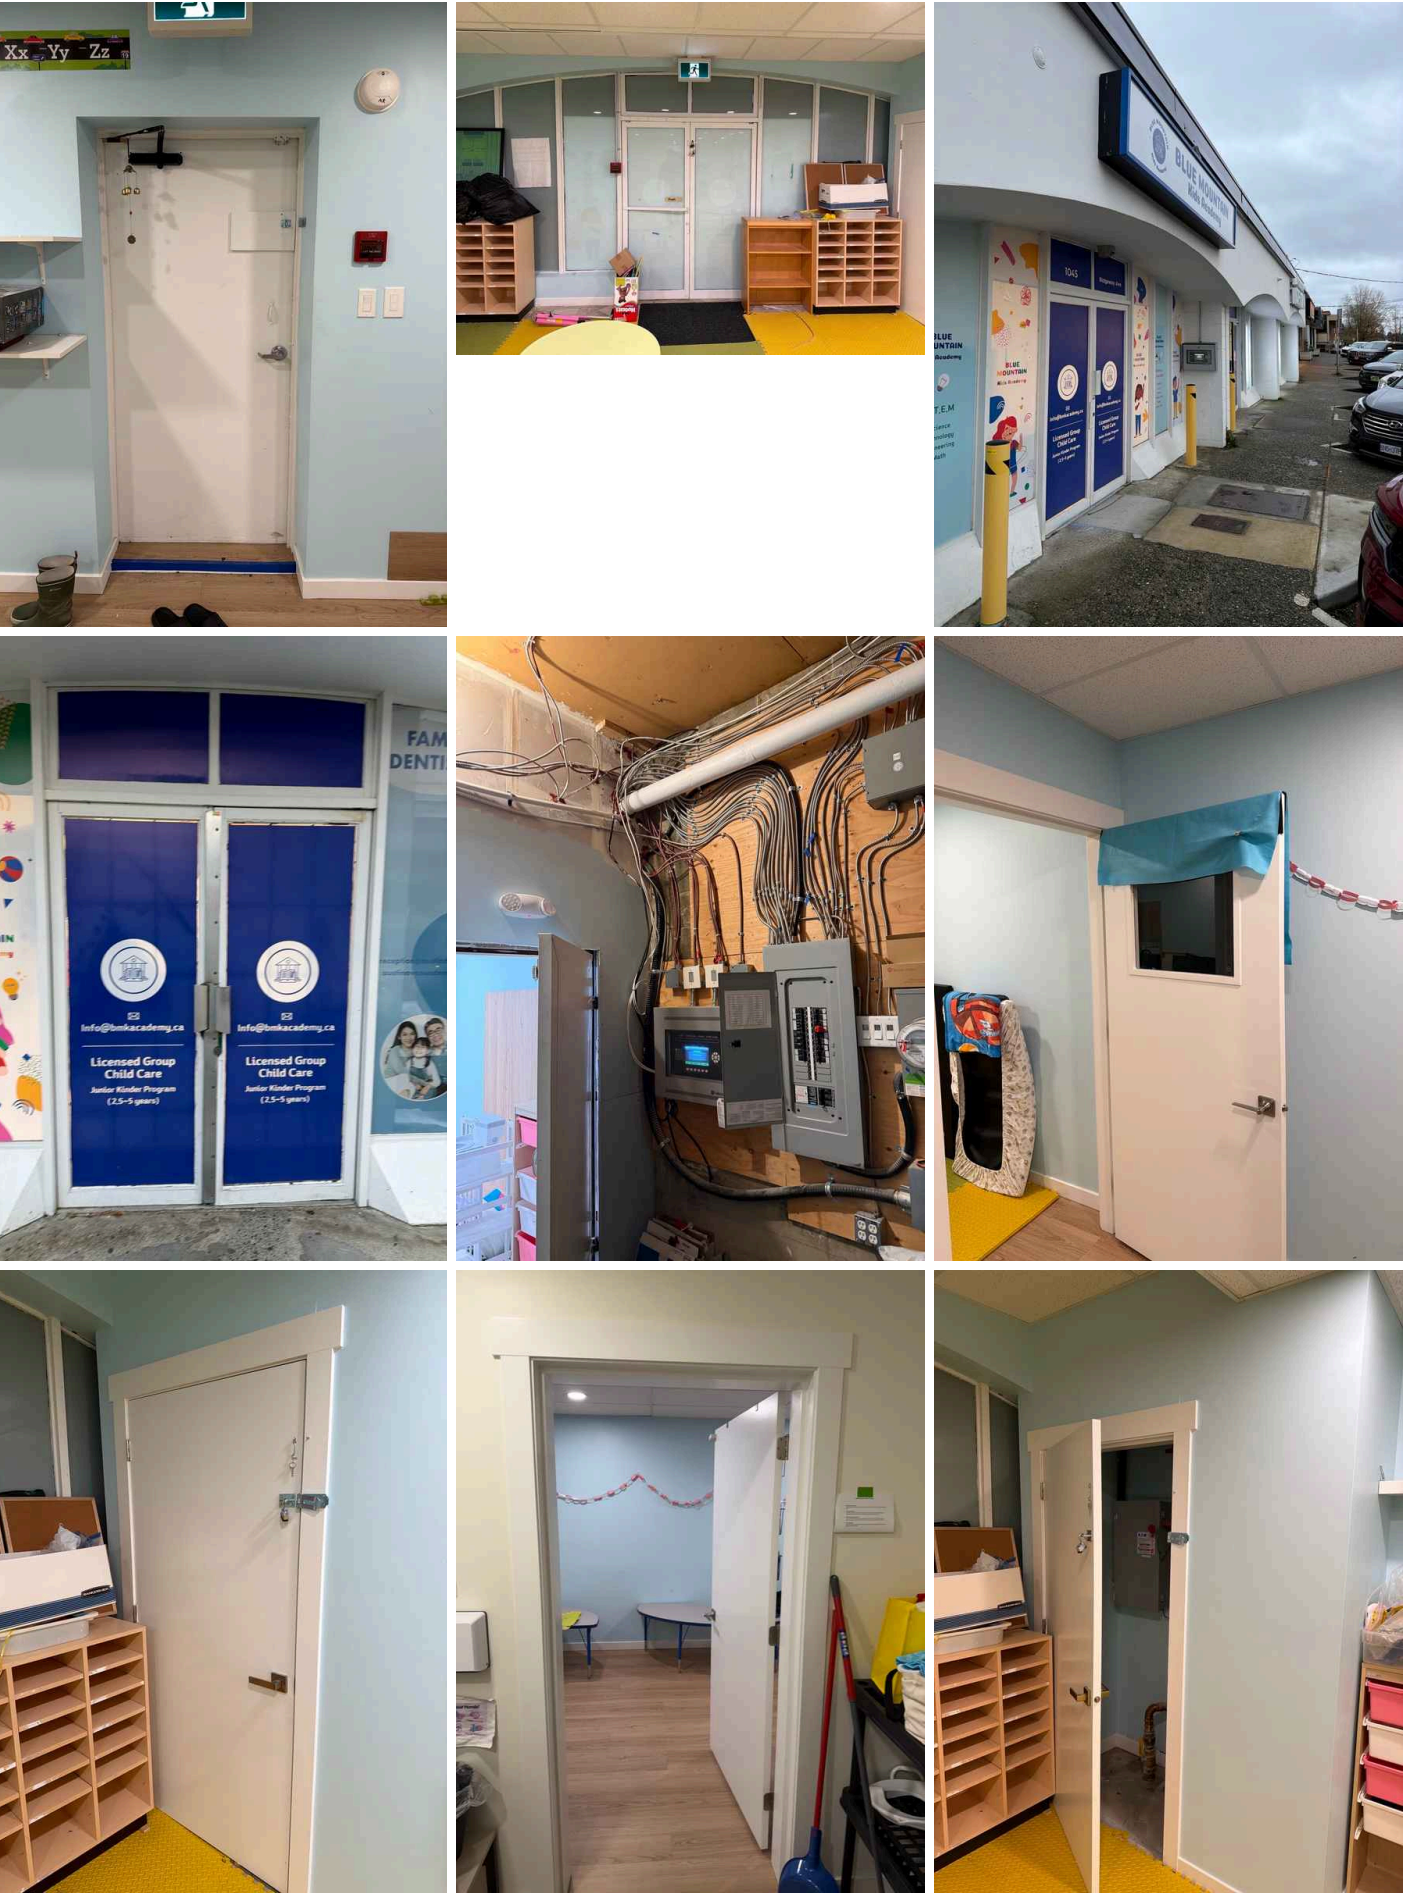

Floors: Floor Coverings
Laminate





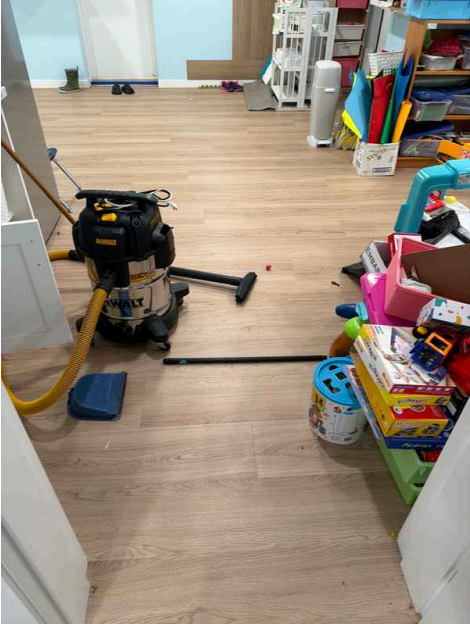



Walls: Wall Material
Drywall

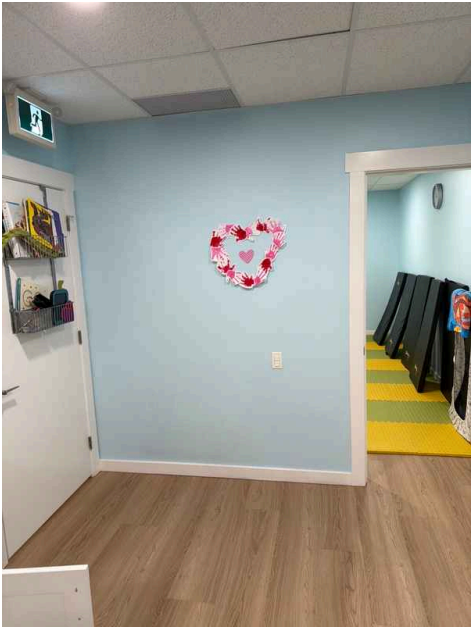

Ceilings: Ceiling Material

Ceiling Tiles

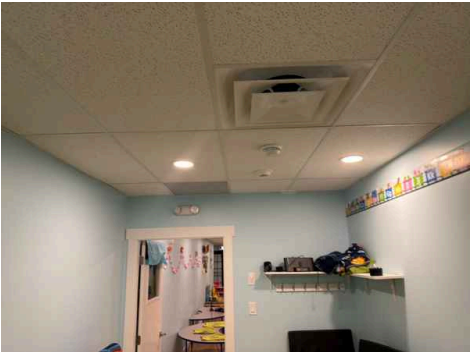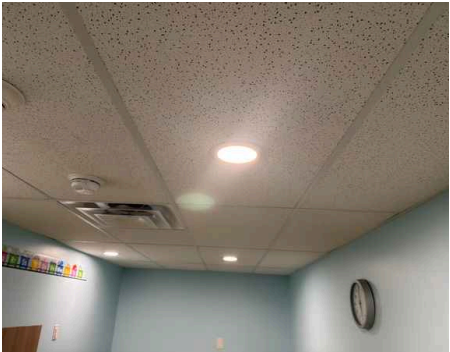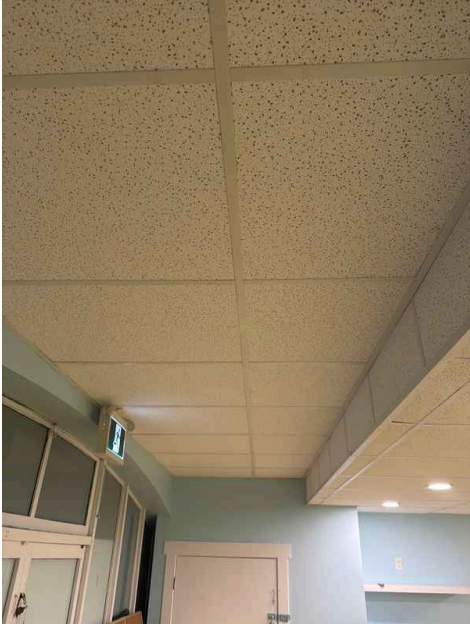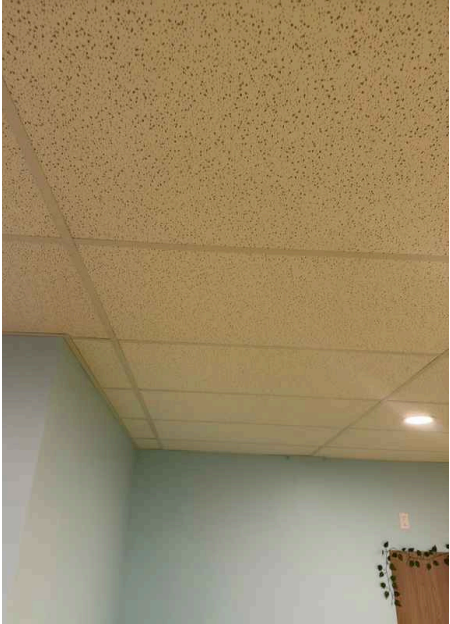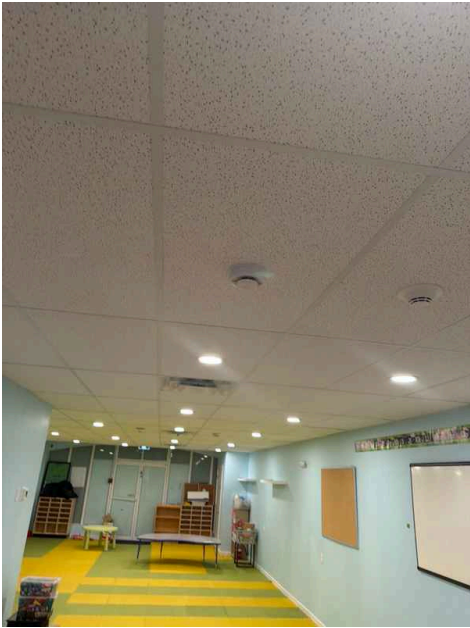


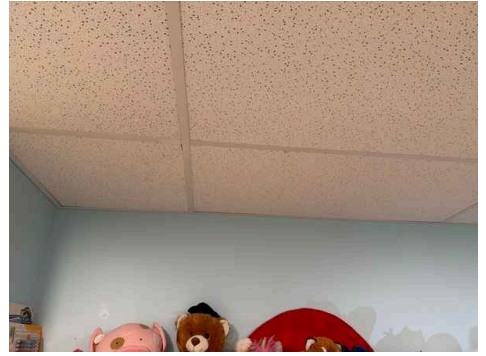

Steps, Stairways & Railings: Steps, Stairways & Railings

[Back](#)

Steps, stairways, and railings should be maintained in good condition to help reduce the risk of slips or falls, particularly in facilities occupied by children.

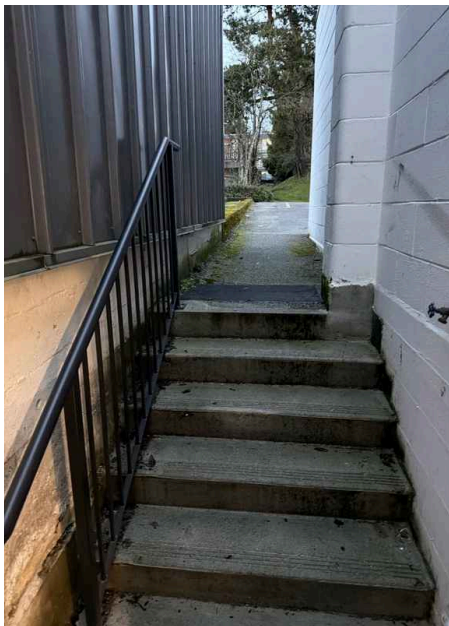

Limitations

Doors

DOOR WON'T OPEN FULLY




Floors


FLOOR COVERING INSPECTION LIMITATIONS

FLOOR

Mat Coverage, Structural Condition Unknown

Inspection of flooring materials such as carpet or mats is limited and may not reveal underlying conditions, stains, wear patterns, or structural issues beneath the coverings. A thorough assessment of the subfloor and actual floor condition cannot be completed without removal or lifting of these materials.

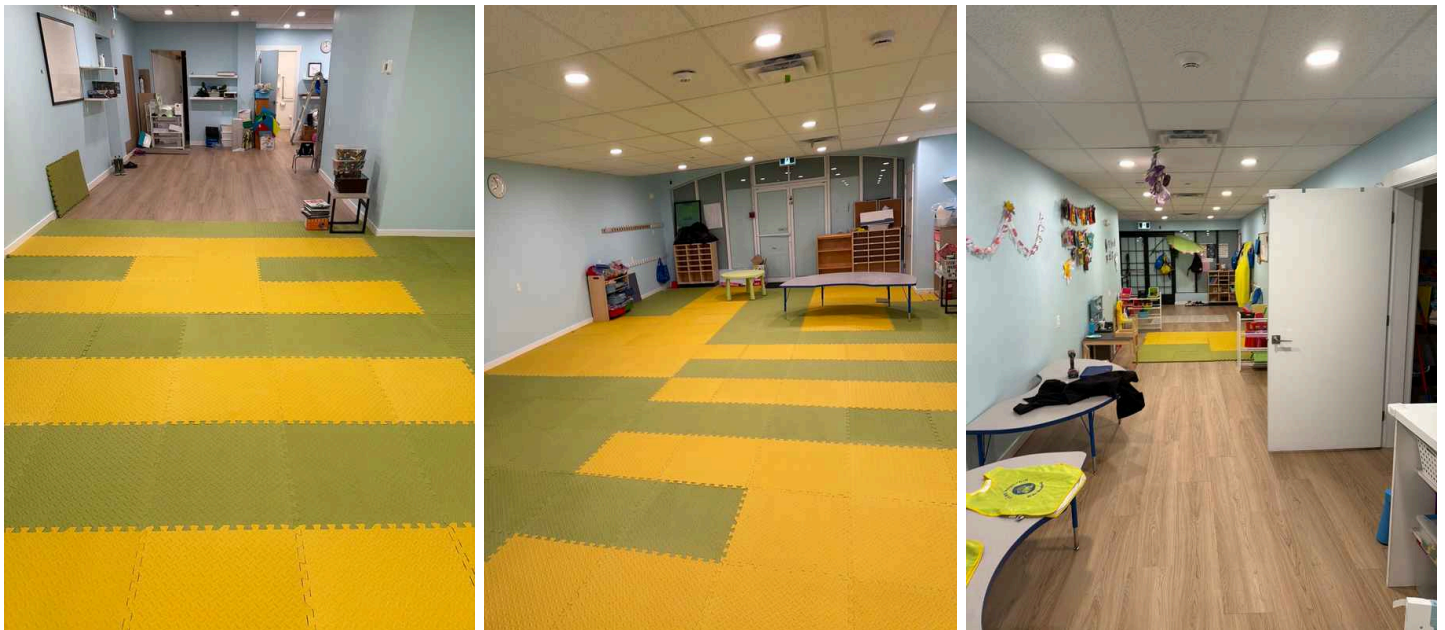

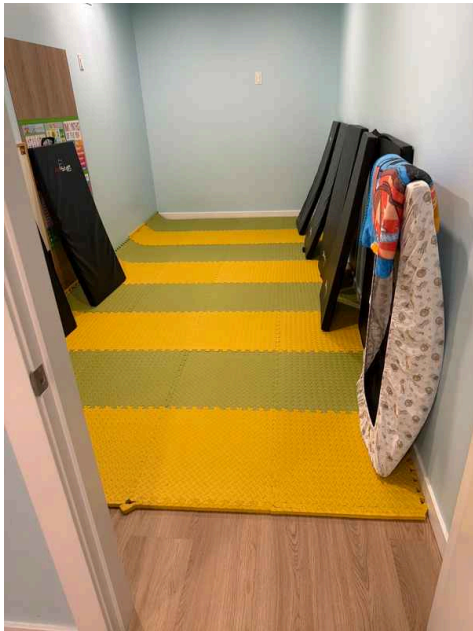



Walls

WALL ACCESS LIMITED BY FURNISHINGS

Furniture Blocking Access, Storage Items Against Walls, Decorations Obscuring Surfaces, Belongings Stacked on Walls, Equipment or Appliances Positioned Against Walls

Furniture or belongings were positioned against walls during the inspection, which prevented complete visual examination of wall surfaces in those areas. This limitation means that wall condition, paint, drywall damage, moisture stains, or other issues behind or obscured by these items could not be fully assessed.



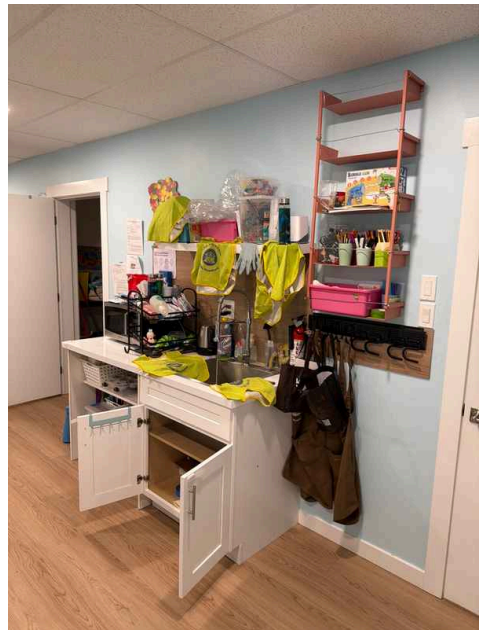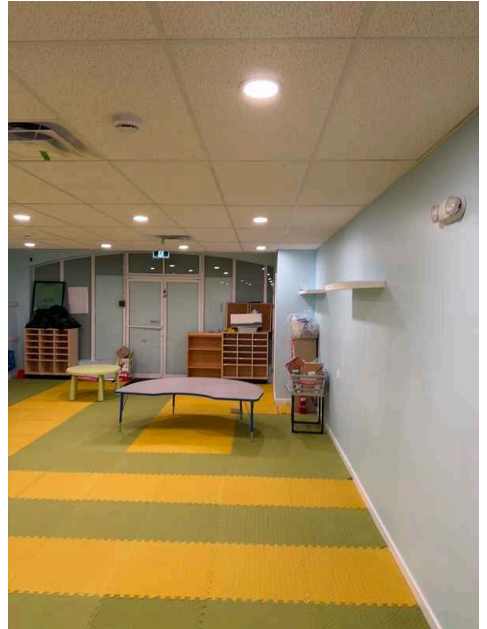

Observations

10.5.1 Ceilings

CEILING STAIN

true, Previous Leak - Now Resolved

A stain was observed on the ceiling during inspection. Moisture testing with a moisture meter indicated no active moisture present at the time of inspection. This suggests a previous water intrusion event that has since dried.

Recommendation

Contact a qualified professional.



11: LIFE SAFETY

		IN	NI	NP	D
11.1	Fire Access Roads	X			
11.2	Fire Hydrant Clearance			X	
11.3	Hinged Shower Doors			X	
11.4	Storage of Flammable and Combustible Materials	X			
11.5	No Smoking Signs	X			
11.6	Fire Alarm Systems	X			X
11.7	Portable Fire Extinguishers	X			X
11.8	Commercial Cooking Appliances			X	
11.9	Sprinkler System			X	
11.10	Emergency Lighting Systems	X			
11.11	Exit Signs, Doors, Stairwells and Handrails	X			
11.12	Tripping hazard	X			X

IN = Inspected NI = Not Inspected NP = Not Present D = Deficiency

Information

Life Safety – General Information

Life safety components were visually observed where accessible. This inspection is not a fire code compliance inspection. Evaluation of fire protection systems, alarms, sprinklers, and emergency systems is limited to general visual observations only.

Fire Access Roads: Fire Access Roads

Fire access to the building appeared generally adequate at the time of inspection.

Storage of Flammable and Combustible Materials: Storage of Flammable & Combustible Materials

Storage of combustible materials should be maintained in a safe manner away from ignition sources.

No Smoking Signs: No Smoking Signs

No smoking signage should be maintained as required by local regulations.

Fire Alarm Systems: Fire Alarm Control Panel

A fire alarm control panel (FACP) was observed in the building. This panel receives signals from smoke detectors and other fire detection devices and activates audible and visual alarms when a fire condition is detected.



Fire Alarm Systems: Fire Alarm System – General Information

A fire alarm system was observed serving the building. Commercial fire alarm systems typically include smoke detectors, alarm devices, and a central control panel designed to detect smoke or fire conditions and alert occupants.



Portable Fire Extinguishers: Portable Fire Extinguishers

Portable fire extinguishers were observed. Fire extinguishers should be inspected and serviced regularly.

Emergency Lighting Systems: Emergency Lighting Systems

Every room


Emergency lighting units were observed. Functional testing was not performed as part of this inspection.



Emergency Lighting Systems: Emergency Lighting – Maintenance

Emergency lighting units were observed within the building. These devices typically contain internal batteries and should be inspected and tested regularly to help ensure proper operation during a power outage. Monthly functional testing and annual full-duration testing are commonly recommended maintenance practices. Verification of the current inspection and maintenance records is recommended.

Exit Signs, Doors, Stairwells and Handrails: Exit signs

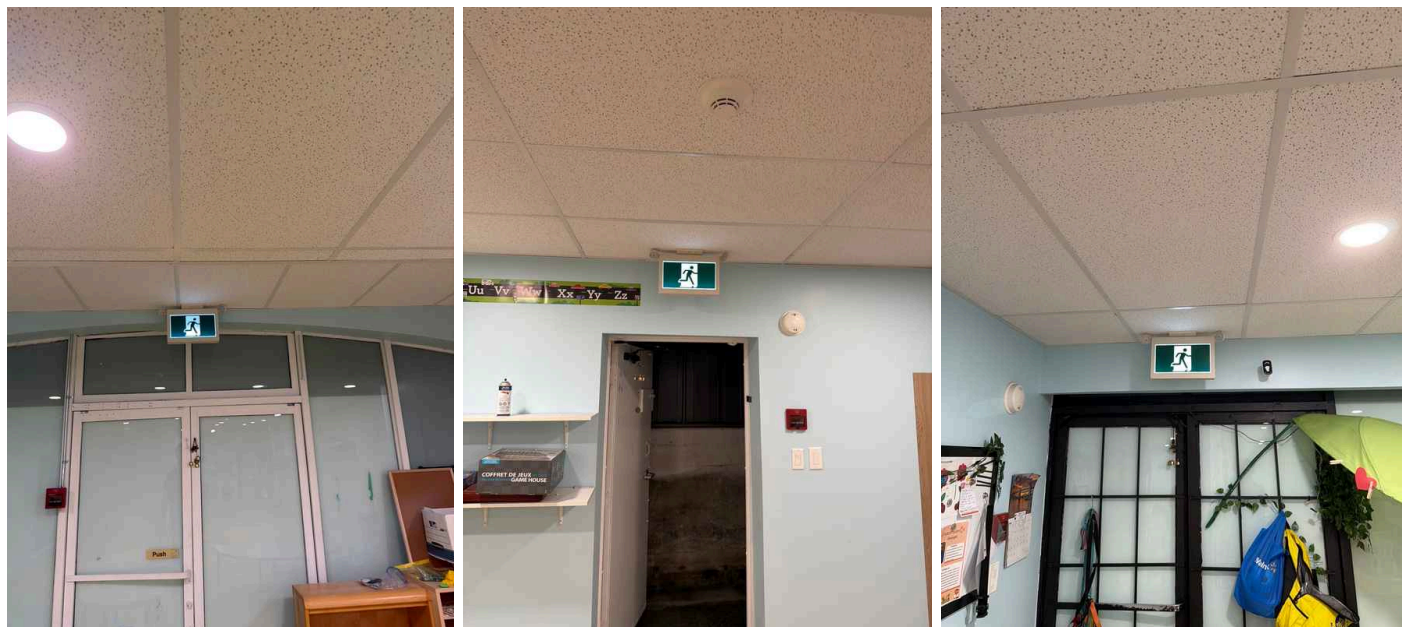

Tripping hazard : Tripping Hazard – Doorway

Back door

A tripping hazard was observed at the doorway due to an uneven floor transition. Repair is recommended.

Limitations

Emergency Lighting Systems

INSPECTION LIMITATION

Functional testing of the emergency lighting system and verification of maintenance records were outside the scope of this inspection.

Observations

11.6.1 Fire Alarm Systems

FIRE ALARM SYSTEM – INSPECTION LABEL EXPIRED

MAIN ENTRANCE AND UTILITY ROOM

The fire alarm control panel was observed with an expired inspection/service label. Regular inspection and servicing of fire alarm systems is important to help ensure proper operation. Verification of current maintenance records is recommended

Verification of the current inspection status and servicing by a qualified fire alarm contractor is recommended. Fire alarm systems should be inspected and maintained regularly to help ensure proper operation.

 Safety Hazard



11.7.1 Portable Fire Extinguishers

FIRE EXTINGUISHER EXPIRED OR MISSING TAGS

 Safety Hazard

Expired Inspection Tag

Fire extinguisher observed with expired inspection tag or missing identification tag. This indicates the unit has not been serviced within the required inspection interval. An expired or untagged extinguisher may not function properly in an emergency and does not meet safety standards for life safety equipment.

Recommendation

Contact a qualified professional.




11.12.1 Tripping hazard

DOORWAY THRESHOLD – TRIPPING HAZARD

BACK DOOR

A tripping hazard was observed at the doorway due to an uneven transition between flooring surfaces. This condition may increase the risk of trips or falls. Repair or adjustment is recommended to provide a safer transition.

An uneven transition at the doorway was observed and may present a tripping hazard. Adjustment or repair of the flooring/threshold is recommended to reduce the risk of trips or falls.

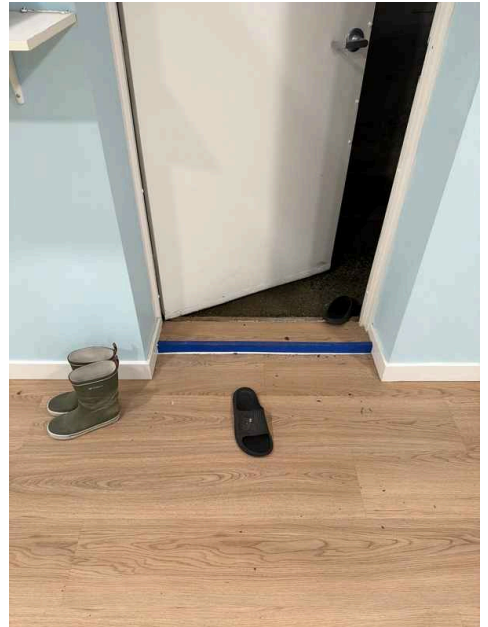

STANDARDS OF PRACTICE

Inspection Details

8.1. Limitations:

- I. An inspection is not technically exhaustive.
- II. An inspection will not identify concealed or latent defects.
- III. An inspection will not deal with aesthetic concerns or what could be deemed matters of taste, cosmetic defects, etc.
- IV. An inspection will not determine the suitability of the property for any use.
- V. An inspection does not determine the market value of the property, or its marketability.
- VI. An inspection does not determine the insurability of the property.
- VII. An inspection does not determine the advisability or inadvisability of the purchase of the inspected property.
- VIII. An inspection does not determine the life expectancy of the property, or any components or systems therein.
- IX. An inspection does not include items not permanently installed.
- X. These Standards of Practice apply only to commercial properties.

8.2. Exclusions:

- I. The inspector is not required to determine:

- A. property boundary lines or encroachments.
 - B. the condition of any component or system that is not readily accessible.
 - C. the service-life expectancy of any component or system.
 - D. the size, capacity, BTU, performance or efficiency of any component or system.
 - E. the cause or reason of any condition.
 - F. the cause of the need for repair or replacement of any system or component.
 - G. future conditions.
 - H. the compliance with codes or regulations.
 - I. the presence of evidence of rodents, animals or insects.
 - J. the presence of mold, mildew, fungus or toxic drywall.
 - K. the presence of airborne hazards.
 - L. the presence of birds.
 - M. the presence of other flora or fauna.
 - N. the air quality.
 - O. the presence of asbestos.
 - P. the presence of environmental hazards.
 - Q. the presence of electromagnetic fields.
 - R. the presence of hazardous materials including, but not limited to, the presence of lead in paint.
 - S. any hazardous-waste conditions.
 - T. any manufacturers' recalls, or conformance with manufacturers' installations, or any information included for consumer-protection purposes.
 - U. operating costs of systems.
 - V. replacement or repair cost estimates.
 - W. the acoustical properties of any systems.
 - X. estimates of the cost of operating any given system.
 - Y. resistance to wind, hurricanes, tornadoes, earthquakes or seismic activities.
 - Z. geological conditions or soil stability.
 - AA. compliance with the Americans with Disabilities Act.
- II. The inspector is not required to operate:

- A. any system that is shut down.
 - B. any system that does not function properly.
 - C. or evaluate low-voltage electrical systems, such as, but not limited to:
 - phone lines;
 - cable lines;
 - antennae;
 - lights; or
 - remote controls.
 - D. any system that does not turn on with the use of normal operating controls.
 - E. any shut off-valves or manual stop valves.
 - F. any electrical disconnect or over-current protection devices.
 - G. any alarm systems.
 - H. moisture meters, gas detectors or similar equipment.
 - I. sprinkler or fire-suppression systems.
- III. The inspector is not required to:

- A. move any personal items or other obstructions, such as, but not limited to:

-
1. throw rugs;
 2. furniture;
 3. floor or wall coverings;
 4. ceiling tiles;
 5. window coverings;
 6. equipment;
 7. plants;
 8. ice;
 9. debris;
 10. snow;
 11. water;
 12. dirt;
 13. foliage; or
 14. pets.
- B. dismantle, open or uncover any system or component.
- C. enter or access any area that may, in the opinion of the inspector, be unsafe.
- D. enter crawlspaces or other areas that are unsafe or not readily accessible.
- E. inspect or determine the presence of underground items, such as, but not limited to, underground storage tanks, whether abandoned or actively used.
- F. do anything which, in the inspector's opinion, is likely to be unsafe or dangerous to the inspector or others, or may damage property, such as, but not limited to, walking on roof surfaces, climbing ladders, entering attic spaces, or interacting with pets or livestock.
- G. inspect decorative items.
- H. inspect common elements or areas in multi-unit housing.
- I. inspect intercoms, speaker systems, radio-controlled, security devices, or lawn-irrigation systems.
- J. offer guarantees or warranties.
- K. offer or perform any engineering services.
- L. offer or perform any trade or professional service other than commercial property inspection.
- M. research the history of the property, or report on its potential for alteration, modification, extendibility or suitability for a specific or proposed use for occupancy.
- N. determine the age of construction or installation of any system, structure or component of a building, or differentiate between original construction and subsequent additions, improvements, renovations or replacements thereto.
- O. determine the insurability of a property.
- P. perform or offer Phase 1 environmental audits.
- Q. inspect or report on any system or component that is not included in these Standards.

Roof

I. The inspector should inspect from ground level, eaves or rooftop (if a rooftop access door exists):

- A. the roof covering;
- B. for the presence of exposed membrane;
- C. slopes;
- D. for evidence of significant ponding;
- E. the gutters;
- F. the downspouts;
- G. the vents, flashings, skylights, chimney and other roof penetrations;
- H. the general structure of the roof from the readily accessible panels, doors or stairs; and
- I. for the need for repairs.

II. The inspector is not required to:

- A. walk on any pitched roof surface.
- B. predict service-life expectancy.
- C. inspect underground downspout diverter drainage pipes.
- D. remove snow, ice, debris or other conditions that prohibit the observation of the roof surfaces.
- E. move insulation.
- F. inspect antennae, lightning arresters, de-icing equipment or similar attachments.
- G. walk on any roof areas that appear, in the opinion of the inspector, to be unsafe.
- H. walk on any roof areas if it might, in the opinion of the inspector, cause damage.
- I. perform a water test.
- J. warrant or certify the roof.
- K. walk on any roofs that lack rooftop access doors.

Exterior

I. The inspector should inspect:

- A. the siding, flashing and trim;
- B. all exterior doors, decks, stoops, steps, stairs, porches, railings, eaves, soffits and fasciae;
- C. and report as in need of repair any safety issues regarding intermediate balusters, spindles or rails for steps, stairways, balconies and railings;

- D. a representative number of windows;
- E. the vegetation, surface drainage, and retaining walls when these are likely to adversely affect the structure;
- F. the exterior for accessibility barriers;
- G. the storm water drainage system;
- H. the general topography;
- I. the parking areas;
- J. the sidewalks;
- K. exterior lighting;
- L. the landscaping;
- M. and determine that a 3-foot clear space exists around the circumference of fire hydrants;
- N. and describe the exterior wall covering.

II. The inspector is not required to:

- A. inspect or operate screens, storm windows, shutters, awnings, fences, outbuildings or exterior accent lighting.
- B. inspect items, including window and door flashings, that are not visible or readily accessible from the ground.
- C. inspect geological, geotechnical, hydrological or soil conditions.
- D. inspect recreational facilities.
- E. inspect seawalls, breakwalls or docks.
- F. inspect erosion-control or earth-stabilization measures.
- G. inspect for proof of safety-type glass.
- H. determine the integrity of thermal window seals or damaged glass.
- I. inspect underground utilities.
- J. inspect underground items.
- K. inspect wells or springs.
- L. inspect solar systems.
- M. inspect swimming pools or spas.
- N. inspect septic systems or cesspools.
- O. inspect playground equipment.
- P. inspect sprinkler systems.
- Q. inspect drainfields or dry wells.
- R. inspect manhole covers.
- S. operate or evaluate remote-control devices, or test door or gate operators.

Basement, Foundation and Crawlspce

I. The inspector should inspect:

- A. the basement;
- B. the foundation;
- C. the crawlspace;
- D. the visible structural components;
- E. and report on the location of under-floor access openings;
- F. and report any present conditions or clear indications of active water penetration observed by the inspector;
- G. for wood in contact with or near soil;
- H. and report any general indications of foundation movement that are observed by the inspector, such as, but not limited to: sheetrock cracks, brick cracks, out-of-square door frames, or floor slopes;
- I. and report on any cutting, notching or boring of framing members that may present a structural or safety concern.

II. The inspector is not required to:

- A. enter any crawlspaces that are not readily accessible, or where entry could cause damage or pose a hazard to the inspector.
- B. move stored items or debris.
- C. operate sump pumps.
- D. identify size, spacing, span or location, or determine the adequacy of foundation bolting, bracing, joists, joist spans or support systems.
- E. perform or provide any engineering or architectural service.
- F. report on the adequacy of any structural system or component.

Heating and Ventilation

I. The inspector should inspect:

- A. multiple gas meter installations, such as a building with multiple tenant spaces, and verify that each meter is clearly and permanently identified with the respective space supplied;
- B. the heating systems using normal operating controls, and describe the energy source and heating method;
- C. and report as in need of repair heating systems that do not operate;
- D. and report if the heating systems are deemed inaccessible;
- E. and verify that a permanent means of access, with permanent ladders and/or catwalks, are present for equipment and appliances on roofs higher than 16 feet;
- F. and verify the presence of level service platforms for appliances on roofs with a slope of 25% or greater;
- G. and verify that luminaire and receptacle outlets are provided at or near the appliance;

- H. and verify that the system piping appears to be sloped to permit the system to be drained;
- I. for connectors, tubing and piping that might be installed in a way that exposes them to physical damage;
- J. wood framing with cutting, notching or boring that might cause a structural or safety issue;
- K. pipe penetrations in concrete and masonry building elements to verify that they are sleeved;
- L. exposed gas piping for identification by a yellow label marked "Gas" in black letters occurring at intervals of 5 feet or less;
- M. and determine if any appliances or equipment with ignition sources are located in public, private, repair or parking garages or fuel-dispensing facilities;
- N. and verify that fuel-fired appliances are not located in or obtain combustion air from sleeping rooms, bathrooms, storage closets or surgical rooms;
- O. for the presence of exhaust systems in occupied areas where there is a likelihood of excess heat, odors, fumes, spray, gas, noxious gases or smoke;
- P. and verify that outdoor air-intake openings are located at least 10 feet away from any hazardous or noxious contaminant sources, such as vents, chimneys, plumbing vents, streets, alleys, parking lots or loading docks;
- Q. outdoor exhaust outlets for the likelihood that they may cause a public nuisance or fire hazard due to smoke, grease, gases, vapors or odors;
- R. for the potential of flooding or evidence of past flooding that could cause mold in ductwork or plenums; and
- S. condensate drains.

II. The inspector is not required to:

- A. inspect or evaluate interiors of flues or chimneys, fire chambers, heat exchangers, humidifiers, dehumidifiers, electronic air filters, solar heating systems, fuel tanks, safety devices, pressure gauges, or control mechanisms.
- B. determine the uniformity, temperature, flow, balance, distribution, size, capacity, BTU, or supply adequacy of the heating system.
- C. light or ignite pilot flames.
- D. activate heating, heat pump systems, or other heating systems when ambient temperatures or other circumstances are not conducive to safe operation or may damage the equipment.
- E. over-ride electronic thermostats.
- F. evaluate fuel quality.
- G. verify thermostat calibration, heat anticipation or automatic setbacks, timers, programs or clocks.
- H. inspect tenant-owned or tenant-maintained heating equipment.
- I. determine ventilation rates.
- J. perform capture and containment tests.
- K. test for mold.

Cooling

I. The inspector should inspect:

- A. multiple air-conditioning compressor installations, such as a building with multiple tenant spaces, and verify that each compressor is clearly and permanently identified with the respective space supplied;
- B. the central cooling equipment using normal operating controls;
- C. and verify that luminaire and receptacle outlets are provided at or near the appliance;
- D. and verify that a permanent means of access, with permanent ladders and/or catwalks, are present for equipment and appliances on roofs higher than 16 feet;
- E. and verify the presence of level service platforms for appliances on roofs with a slope of 25% or greater;
- F. wood framing with cutting, notching or boring that might cause a structural or safety issue;
- G. pipe penetrations in concrete and masonry building elements to verify that they are sleeved;
- H. piping support;
- I. for connectors, tubing and piping that might be installed in a way that exposes them to physical damage;
- J. for the potential of flooding or evidence of past flooding that could cause mold in ductwork and plenums; and
- K. condensate drains.

II. The inspector is not required to:

- A. inspect or test compressors, condensers, vessels, evaporators, safety devices, pressure gauges, or control mechanisms.
- B. determine the uniformity, temperature, flow, balance, distribution, size, capacity, BTU, or supply adequacy of the cooling system.
- C. inspect window units, through-wall units, or electronic air filters.
- D. operate equipment or systems if exterior temperature is below 60° Fahrenheit, or when other circumstances are not conducive to safe operation or may damage the equipment.
- E. inspect or determine thermostat calibration, cooling anticipation, or automatic setbacks or clocks.
- F. examine electrical current, coolant fluids or gases, or coolant leakage.
- G. inspect tenant-owned or tenant-maintained cooling equipment.
- H. test for mold.

Plumbing

I. The inspector should inspect:

- A. and verify the presence of and identify the location of the main water shut-off valve to each building;
- B. and verify the presence of a back-flow prevention device if, in the inspector's opinion, a cross-connection could occur

between the water-distribution system and non-potable water or private source;
C. the water-heating equipment, including combustion air, venting, connections, energy-source supply systems, and seismic bracing, and verify the presence or absence of temperature-/pressure-relief valves and/or Watts 210 valves;
D. and flush a representative number of toilets;
E. and water-test a representative number of sinks, tubs and showers for functional drainage;
F. and verify that hinged shower doors open outward from the shower, and have safety glass-conformance stickers or indicators;
G. the interior water supply, including a representative number of fixtures and faucets;
H. the drain, waste and vent systems, including a representative number of fixtures;
I. and describe any visible fuel-storage systems;
J. and test sump pumps with accessible floats;
K. and describe the water supply, drain, waste and main fuel shut-off valves, as well as the location of the water main and main fuel shut-off valves;
L. and determine whether the water supply is public or private;
M. the water supply by viewing the functional flow in several fixtures operated simultaneously, and report any deficiencies as in need of repair;
N. and report as in need of repair deficiencies in installation and identification of hot and cold faucets;
O. and report as in need of repair mechanical drain stops that are missing or do not operate if installed in sinks, lavatories and tubs;
P. and report as in need of repair commodes that have cracks in the ceramic material, are improperly mounted on the floor, leak, or have tank components that do not operate; and
Q. piping support.

II. The inspector is not required to:

A. determine the adequacy of the size of pipes, supplies, vents, traps or stacks.
B. ignite pilot flames.
C. determine the size, temperature, age, life expectancy or adequacy of the water heater.
D. inspect interiors of flues or chimneys, cleanouts, water-softening or filtering systems, dishwashers, interceptors, separators, sump pumps, well pumps or tanks, safety or shut-off valves, whirlpools, swimming pools, floor drains, lawn sprinkler systems or fire sprinkler systems.
E. determine the exact flow rate, volume, pressure, temperature or adequacy of the water supply.
F. verify or test anti-scald devices.
G. determine the water quality, potability or reliability of the water supply or source.
H. open sealed plumbing access panels.
I. inspect clothes washing machines or their connections.
J. operate any main, branch or fixture valve.
K. test shower pans, tub and shower surrounds, or enclosures for leakage.
L. evaluate compliance with local or state conservation or energy standards, or the proper design or sizing of any water, waste or venting components, fixtures or piping.
M. determine the effectiveness of anti-siphon, back-flow prevention or drain-stop devices.
N. determine whether there are sufficient cleanouts for effective cleaning of drains.
O. evaluate gas, liquid propane or oil-storage tanks.
P. inspect any private sewage waste-disposal system or component within such a system.
Q. inspect water-treatment systems or water filters.
R. inspect water-storage tanks, pressure pumps, ejector pumps, or bladder tanks.
S. evaluate wait time for hot water at fixtures, or perform testing of any kind on water-heater elements.
T. evaluate or determine the adequacy of combustion air.
U. test, operate, open or close safety controls, manual stop valves, or temperature- or pressure-relief valves.
V. examine ancillary systems or components, such as, but not limited to, those relating to solar water heating or hot-water circulation.
W. determine the presence or condition of polybutylene plumbing.

Electrical

I. The inspector should inspect:

A. the service drop/lateral;
B. the meter socket enclosures;
C. the service-entrance conductors, and report on any noted deterioration of the conductor insulation or cable sheath;
D. the means for disconnecting the service main;
E. the service-entrance equipment, and report on any noted physical damage, overheating or corrosion;
F. and determine the rating of the service disconnect amperage, if labeled;
G. panelboards and over-current devices, and report on any noted physical damage, overheating, corrosion, or lack of accessibility or working space (minimum 30 inches wide, 36 inches deep, and 78 inches high in front of panel) that would hamper safe operation, maintenance or inspection;
H. and report on any unused circuit-breaker panel openings that are not filled;
I. and report on absent or poor labeling;
J. the service grounding and bonding;
K. a representative number of switches, lighting fixtures and receptacles, including receptacles observed and deemed to be AFCI-protected using the AFCI test button, where possible. Although a visual inspection, the removal of faceplates or other covers or luminaires (fixtures) to identify suspected hazards is permitted;

- L. and report on any noted missing or damaged faceplates or box covers;
- M. and report on any noted open junction boxes or open wiring splices;
- N. and report on any noted switches and receptacles that are painted;
- O. and test all ground-fault circuit interrupter (GFCI) receptacles and GFCI circuit breakers observed and deemed to be GFCIs using a GFCI tester, where possible;
- P. and report the presence of solid-conductor aluminum branch-circuit wiring, if readily visible;
- Q. and report on any tested GFCI receptacles in which power was not present, polarity was incorrect, the cover was not in place, the GFCI devices were not installed properly or did not operate properly, any evidence of arcing or excessive heat, or where the receptacle was not grounded or was not secured to the wall;
- R. and report the absence of smoke detectors;
- S. and report on the presence of flexible cords being improperly used as substitutes for the fixed wiring of a structure or running through walls, ceilings, floors, doorways, windows, or under carpets.

II. The inspector is not required to:

- A. insert any tool, probe or device into the main panelboard, sub-panels, distribution panelboards, or electrical fixtures.
- B. operate electrical systems that are shut down.
- C. remove panelboard cabinet covers or dead fronts if they are not readily accessible.
- D. operate over-current protection devices.
- E. operate non-accessible smoke detectors.
- F. measure or determine the amperage or voltage of the main service equipment, if not visibly labeled.
- G. inspect the fire or alarm system and components.
- H. inspect the ancillary wiring or remote-control devices.
- I. activate any electrical systems or branch circuits that are not energized.
- J. operate or reset overload devices.
- K. inspect low-voltage systems, electrical de-icing tapes, swimming pool wiring, or any time-controlled devices.
- L. verify the service ground.
- M. inspect private or emergency electrical supply sources, including, but not limited to: generators, windmills, photovoltaic solar collectors, or the battery- or electrical-storage facility.
- N. inspect spark or lightning arrestors.
- O. inspect or test de-icing equipment.
- P. conduct voltage-drop calculations.
- Q. determine the accuracy of labeling.
- R. inspect tenant-owned equipment.
- S. inspect the condition of or determine the ampacity of extension cords.

Attic, Insulation & Ventilation

I. The inspector should inspect:

- A. the insulation in unfinished spaces;
- B. the ventilation of attic spaces;
- C. mechanical ventilation systems;
- D. and report on the general absence or lack of insulation.

II. The inspector is not required to:

- A. enter the attic or any unfinished spaces that are not readily accessible, or where entry could cause damage or pose a safety hazard to the inspector, in his or her opinion.
- B. move, touch or disturb insulation.
- C. move, touch or disturb vapor retarders.
- D. break or otherwise damage the surface finish or weather seal on or around access panels or covers.
- E. identify the composition or exact R-value of insulation material.
- F. activate thermostatically operated fans.
- G. determine the types of materials used in insulation or wrapping of pipes, ducts, jackets, boilers or wiring.
- H. determine the adequacy of ventilation.

Doors, Windows & Interior

I. The inspector should:

- A. open and close a representative number of doors and windows;
- B. inspect the walls, ceilings, steps, stairways and railings;
- C. inspect garage doors and garage door-openers;
- D. inspect interior steps, stairs and railings;
- E. inspect all loading docks;
- F. ride all elevators and escalators;
- G. and report as in need of repair any windows that are obviously fogged or display other evidence of broken seals.

II. The inspector is not required to:

- A. inspect paint, wallpaper, window treatments or finish treatments.
- B. inspect central-vacuum systems.

- C. inspect safety glazing.
- D. inspect security systems or components.
- E. evaluate the fastening of countertops, cabinets, sink tops or fixtures, or firewall compromises.
- F. move furniture, stored items, or any coverings, such as carpets or rugs, in order to inspect the concealed floor structure.
- G. move drop-ceiling tiles.
- H. inspect or move any appliances.
- I. inspect or operate equipment housed in the garage, except as otherwise noted.
- J. verify or certify safe operation of any auto-reverse or related safety function of a garage door.
- K. operate or evaluate any security bar-release and opening mechanisms, whether interior or exterior, including their compliance with local, state or federal standards.
- L. operate any system, appliance or component that requires the use of special keys, codes, combinations or devices.
- M. operate or evaluate self-cleaning oven cycles, tilt guards/latches, gauges or signal lights.
- N. inspect microwave ovens, or test leakage from microwave ovens.
- O. operate or examine any sauna, steam-jenny, kiln, toaster, ice maker, coffee maker, can opener, bread warmer, blender, instant hot-water dispenser, or other ancillary devices.
- P. inspect elevators.
- Q. inspect remote controls.
- R. inspect appliances.
- S. inspect items not permanently installed.
- T. examine or operate any above-ground, movable, freestanding, or otherwise non-permanently installed pool/spa, recreational equipment, or self-contained equipment.
- U. come into contact with any pool or spa water in order to determine the system's structure or components.
- V. determine the adequacy of a spa's jet water force or bubble effect.
- W. determine the structural integrity or leakage of a pool or spa.
- X. determine combustibility or flammability.
- Y. inspect tenant-owned equipment or personal property.

Life Safety

I. The inspector should:

- A. inspect fire access roads and report on any obstructions or overhead wires lower than 13 feet and 6 inches;
- B. inspect the address or street number to determine whether it is visible from the street, with numbers in contrast to their background;
- C. inspect to determine whether a 3-foot clear space exists around the circumference of fire hydrants;
- D. verify that hinged shower doors open outward from the shower and have safety glass-conformance stickers or indicators;
- E. inspect to determine whether the storage of flammable and combustible materials is orderly, separated from heaters by distance or shielding so that ignition cannot occur, and not stored in exits, boiler rooms, mechanical rooms or electrical equipment rooms;
- F. inspect to determine whether a "No Smoking" sign is posted in areas where flammable or combustible material is stored, dispensed or used;
- G. inspect for the presence of fire alarm systems;
- H. inspect for alarm panel accessibility;
- I. inspect for the presence of portable extinguishers, and determine whether they are located in conspicuous and readily available locations immediately available for use, and not obstructed or obscured from view;
- J. inspect to determine whether a portable fire extinguisher is stored within a 30-foot travel distance of commercial-type cooking equipment that uses cooking oil or animal fat;
- K. inspect to determine whether manual-actuation devices for commercial cooking appliances exist near the means of egress from the cooking area, 42 to 48 inches above the floor and 10 and 20 feet away, and clearly identifying the hazards protected;
- L. inspect to determine whether the maximum travel distance to a fire extinguisher is 75 feet;
- M. inspect for the presence of sprinkler systems, and determine if they were ever painted other than at the factory;
- N. inspect for the presence of emergency lighting systems;
- O. inspect for exit signs at all exits, and inspect for independent power sources, such as batteries;
- P. inspect for the presence of directional signs where an exit location is not obvious;
- Q. inspect for the presence of signs over lockable exit doors stating: "This Door Must Remain Unlocked During Business Hours";
- R. inspect for penetrations in any walls or ceilings that separate the exit corridors or stairwells from the rest of the building;
- S. inspect for fire-separation doors that appear to have been blocked or wedged open, or that do not automatically close and latch;
- T. inspect exit stairwell handrails;
- U. inspect for exit trip hazards;
- V. inspect for the presence of at least two exits to the outside, or one exit that has a maximum travel distance of 75 feet;
- W. inspect exit doorways to determine that they are less than 32 inches in clear width;
- X. inspect to determine whether the exit doors were locked from the inside, chained, bolted, barred, latched or otherwise rendered unusable at the time of the inspection;
- Y. inspect to determine whether the exit doors swing open in the direction of egress travel; and
- Z. inspect the storage to determine if it is potentially obstructing access to fire hydrants, fire extinguishers, alarm panels or electric panelboards, or if it is obstructing aisles, corridors, stairways or exit doors, or if it is within 18 inches of sprinkler heads, or if it is within 3 feet of heat-generating appliances or electrical panelboards.

II. The inspector is not required to:

-
- A. test alarm systems, or determine if alarms systems have been tested.
 - B. inspect or test heat detectors, fire-suppression systems, or sprinkler systems.
 - C. determine the combustibility or flammability of materials in storage.
 - D. determine the adequate number of fire extinguishers needed, or their ratings.
 - E. test or inspect fire extinguishers, their pressure, or for the presence of extinguisher inspection tags or tamper seals.
 - F. inspect or test fire pumps or fire department connections.
 - G. inspect or test cooking equipment suppression systems.
 - H. determine the operational time of emergency lighting or exit signs.
 - I. inspect for proper occupant load signs.
 - J. determine fire ratings of walls, ceilings, doors, etc.
 - K. inspect, test or determine the adequacy of fire escapes or ladders.
 - L. inspect fire department lock boxes or keys.
 - M. determine the flame resistance of curtains or draperies.
 - N. inspect parking or outdoor lighting.
 - O. inspect for unauthorized entry or crime issues.
 - P. inspect or test security systems.
 - Q. inspect for pet or livestock safety issues.
 - R. inspect for unsafe candle use or decoration hazards.
 - S. inspect or test emergency generators.
 - T. test kitchen equipment, appliances or hoods.
 - U. verify that elevator keys exist, or that they work properly.