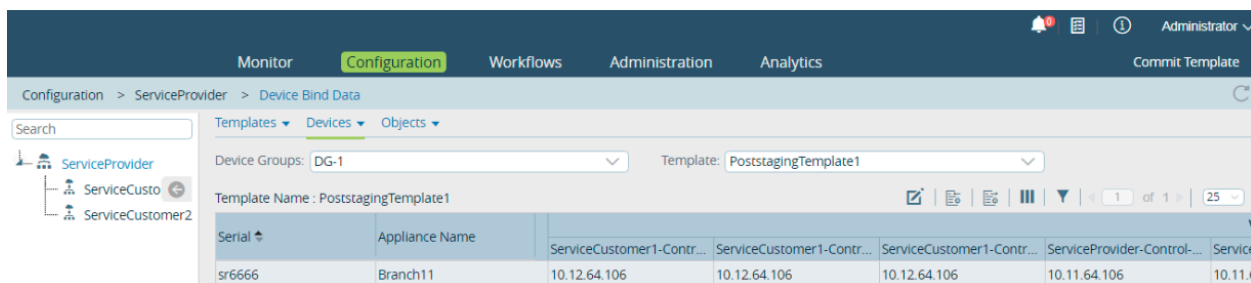# Bind Parameterized Variables to Values for a Post-Staging Template
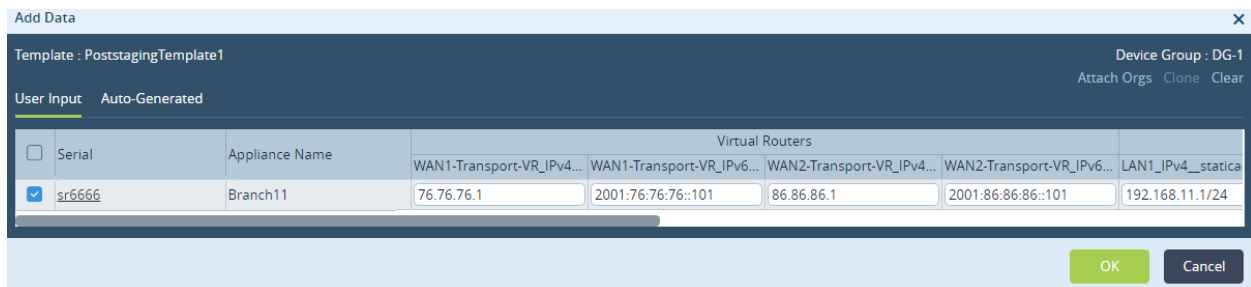
For supported software information, click here.

For a post-staging template, you can bind parameterized data variable values to a Versa Operating System^{TM} (VOS^{TM}) branch device:

1. In Director view, select the Configuration tab in the top menu bar.
2. Select Devices > Device Bind Data in the horizontal menu bar.
3. From the Device Groups list, select a device group, and from the Template list, select a post-staging template.

4. Click the Edit icon to edit the information.

5. Select the User Input tab. Enter or change the bind data for the parameters shown on the popup screen.
6. Select the Autogenerated tab to display parameters that are assigned automatically.

Add Data						✕
Template : PoststagingTemplate1					Device Group : DG-1	
					Attach Orgs Autofill Clone Clear	
User Input **Auto-Generated**						

	Serial	Appliance Name	Virtual Routers				
			ServiceCustomer1-Contro..	ServiceCustomer1-Contro..	ServiceCustomer1-Contro..	ServiceCustomer1-Contro..	ServiceProvider-Co..
☐	sr6666	Branch11	10.12.64.106	10.12.64.106	10.12.64.106	10.12.64.106	10.11.64.106

OK Cancel

7. Click OK. The system then validates the bind data variables based on the variable type. If the data and variable type do not match, an error message is displayed.

Supported Software Information

Releases 20.2 and later support all content described in this article.

Additional Information

Configure Basic Features
Create and Manage Staging and Post-Staging Templates