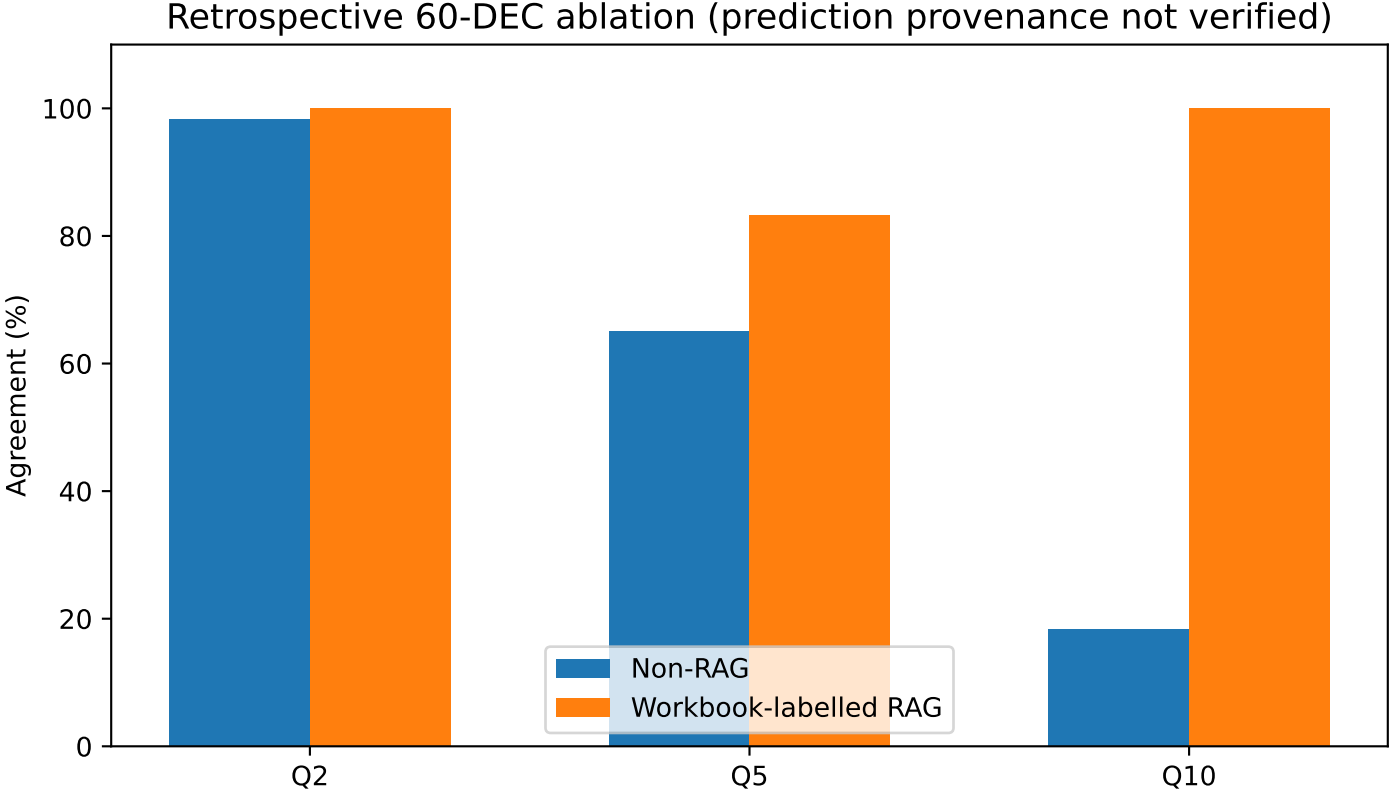
Retrospective 60-DEC ablation (prediction provenance not verified)
Agreement (%)
0
20
40
60
80
100
Q2
Q5
Q10
Non-RAG
Workbook-labelled RAG