


NOTE: ADDITIONAL SPRINKLER HEADS OVER AND ABOVE THOSE SPECIFICALLY NOTED ON THESE DRAWINGS MAY BE REQUIRED DEPENDING ON THE REQUIRED ROUTING AROUND TRUSSES, HVAC DUCTWORK, HOODS AND OTHER SIMILAR OBSTRUCTIONS. FIELD VERIFY EXISTING CONDITIONS DURING CONSTRUCTION AND PROVIDE ANY AND ALL ADDITIONAL HEADS AS REQUIRED FOR FULL COVERAGE AND A COMPLETE CODE COMPLIANT SYSTEM.

Hydraulic Information	
Remote Area 2-3	
OCCUPANCY CLASSIFICATION	Light Hazard
DENSITY (gpm/ft ²)	0.10 for 414ft ² (Actual 414ft ²)
TOTAL HOSE STREAMS	100.0
TOTAL HEADS FLOWING	7
K-FACTOR	8
TOTAL WATER REQUIRED	379.5
TOTAL PRESSURE REQUIRED	67.9
BASE OF RISER (gpm)	279.5
BASE OF RISER (psi)	53.7
SAFETY MARGIN (psi)	+11.1 (14.1%)

Hydraulic Information	
Remote Area 2-1	
OCCUPANCY CLASSIFICATION	Light Hazard
DENSITY (gpm/ft ²)	0.10 for 422ft ² (Actual 412ft ²)
TOTAL HOSE STREAMS	100.0
TOTAL HEADS FLOWING	7
K-FACTOR	8
TOTAL WATER REQUIRED	371.5
TOTAL PRESSURE REQUIRED	73.6
BASE OF RISER (gpm)	271.5
BASE OF RISER (psi)	59.9
SAFETY MARGIN (psi)	+5.4 (6.8%)

Hydraulic Information	
Remote Area 2-2	
OCCUPANCY CLASSIFICATION	Light Hazard
DENSITY (gpm/ft ²)	0.10 for 537ft ² (Actual 537ft ²)
TOTAL HOSE STREAMS	100.0
TOTAL HEADS FLOWING	9
K-FACTOR	8
TOTAL WATER REQUIRED	438.4
TOTAL PRESSURE REQUIRED	69.6
BASE OF RISER (gpm)	338.4
BASE OF RISER (psi)	53.7
SAFETY MARGIN (psi)	+9.4 (11.9%)


Sprinkler Legend									
Symbol	Manufacturer	SIN	Model	Quantity	K-Factor	Type	Size	Response	Finish
●	Tyco	TY4180	BB1	50	5.6	Upright	1/2"	Quick	Brass
●	Tyco	TY3183	SD1	6	5.6	Upright	1/2"	Quick	Brass
●	Tyco	TY3131	TY-FRB	4	5.6	Upright	1/2"	Quick	Natural Brass
				Total = 60					

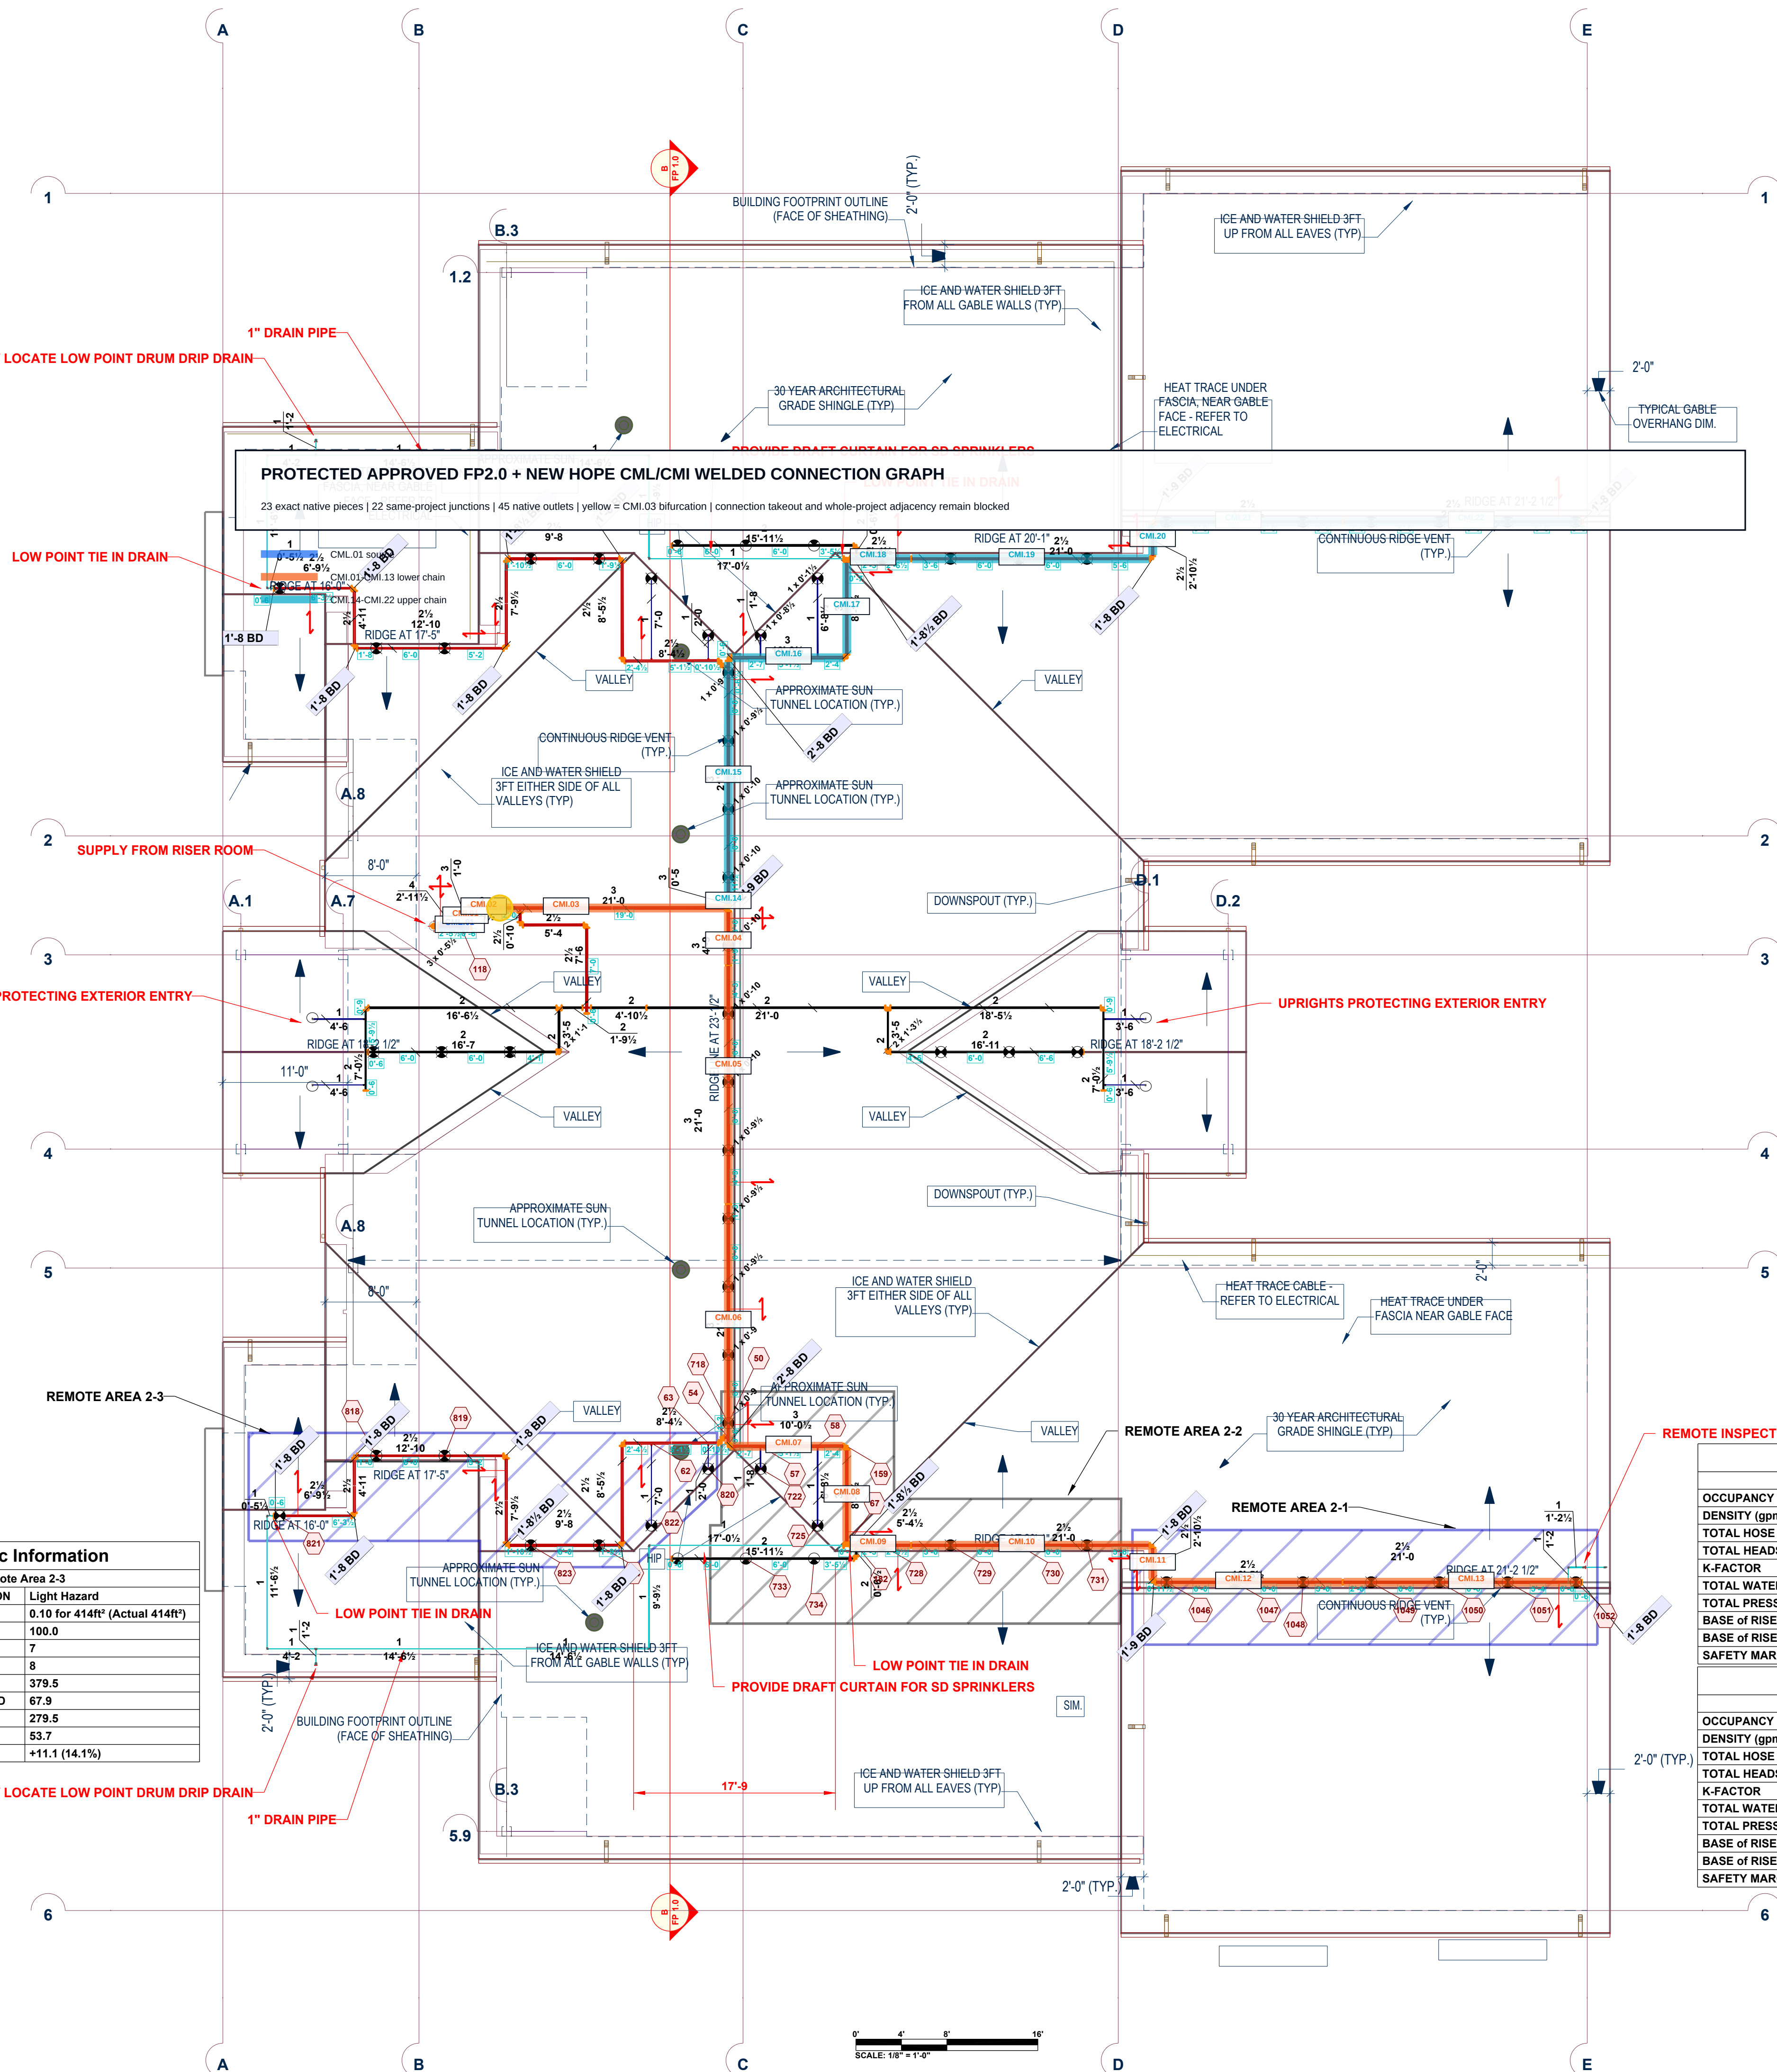

FIRE SPRINKLER LAYOUT - ATTIC
1/8" = 1 Foot

FIGURE 20-A-1. BB SPRINKLERS


- Wet Systems: Calculate the most demanding five sprinklers.
- Dry Systems: Calculate the most demanding seven sprinklers. See the adjacent figure.

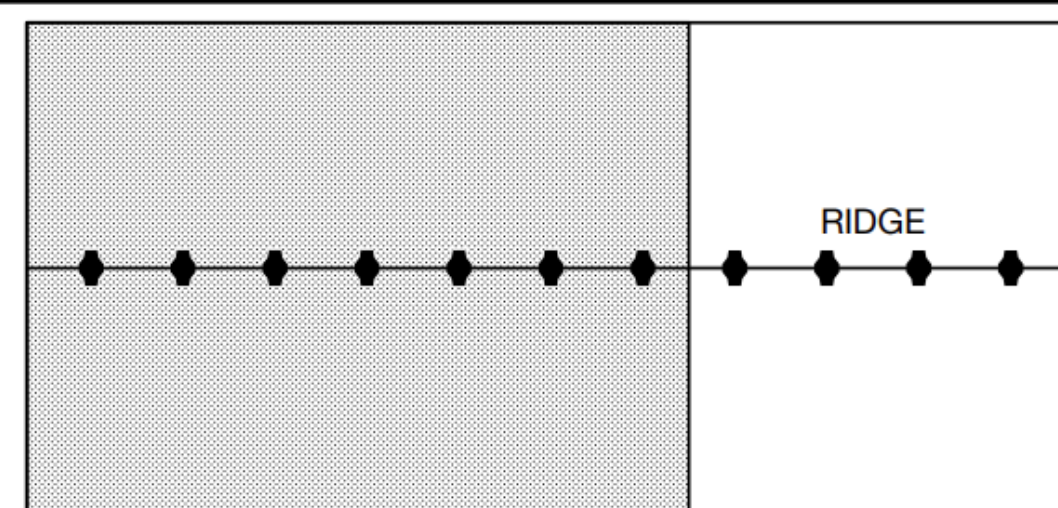

DRY SYSTEM SHOWN

FIGURE 20-A-3. BB AND SD SPRINKLERS

- Wet Systems: Calculate the most demanding five BB Sprinklers plus two SD Sprinklers.
- Dry Systems: Calculate the most demanding seven BB Sprinklers plus up to two SD Sprinklers. See the adjacent figure.

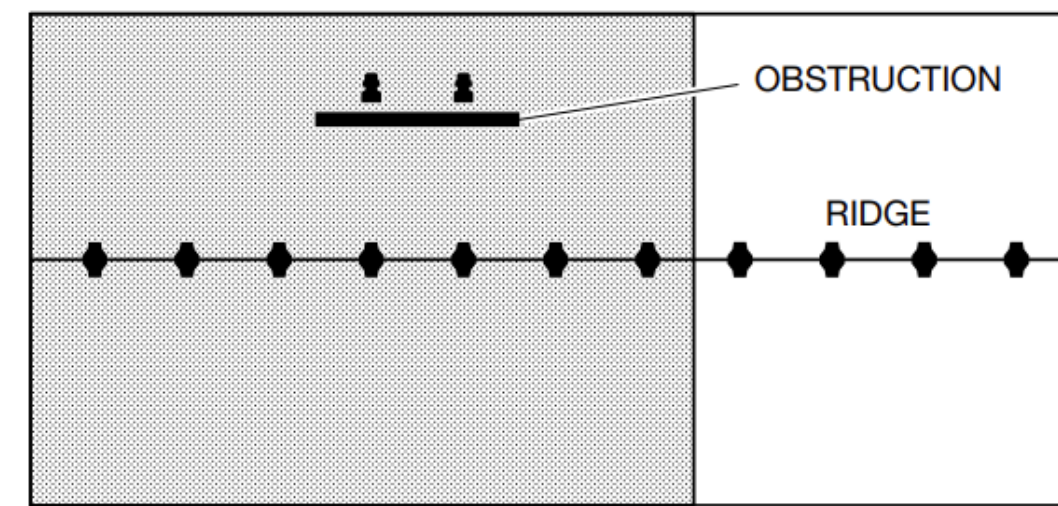

DRY SYSTEM SHOWN


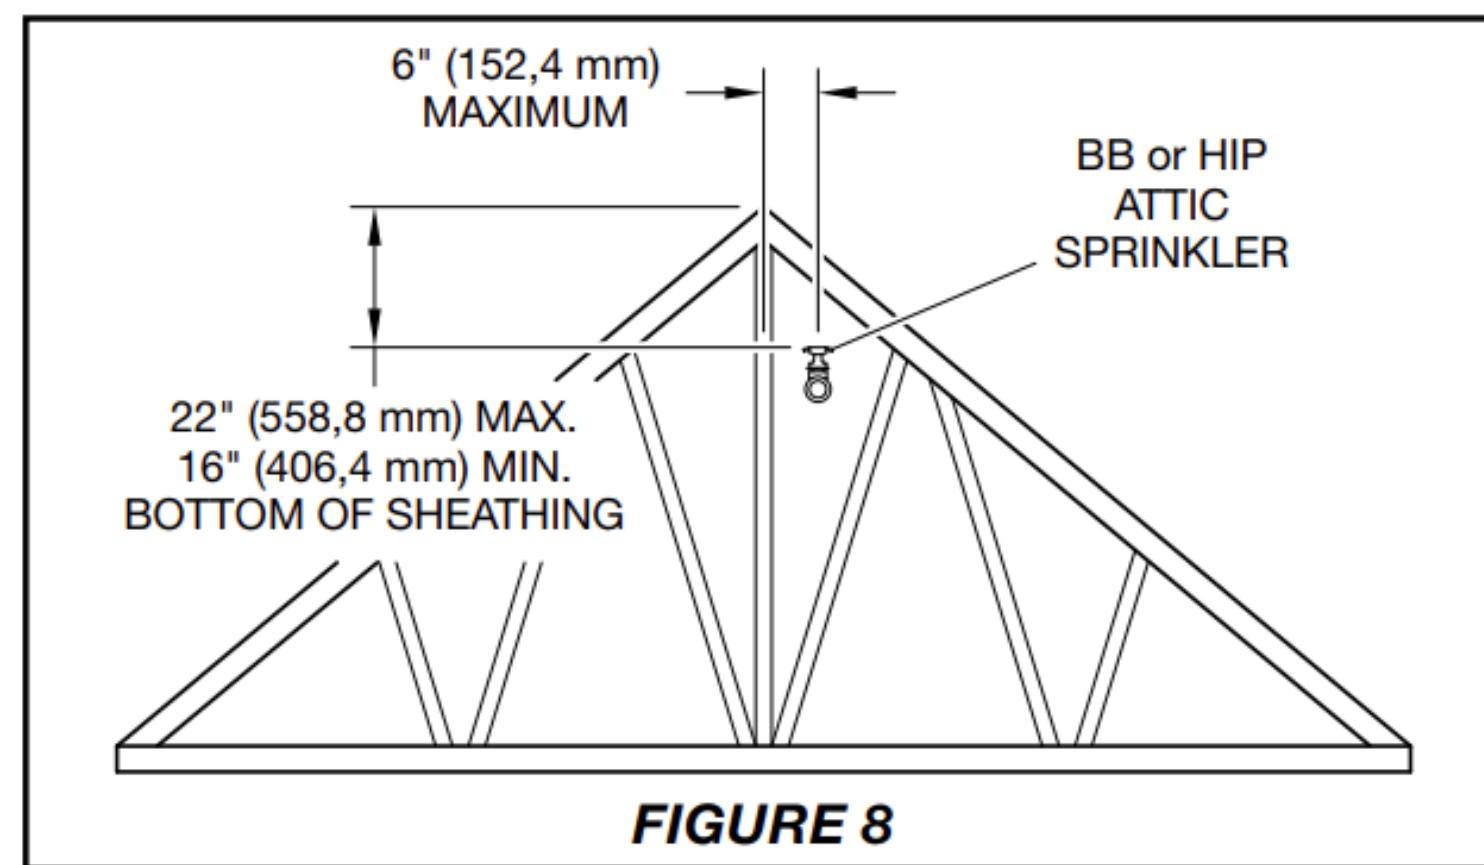


FIGURE 8

DRUM DRIP DETAIL

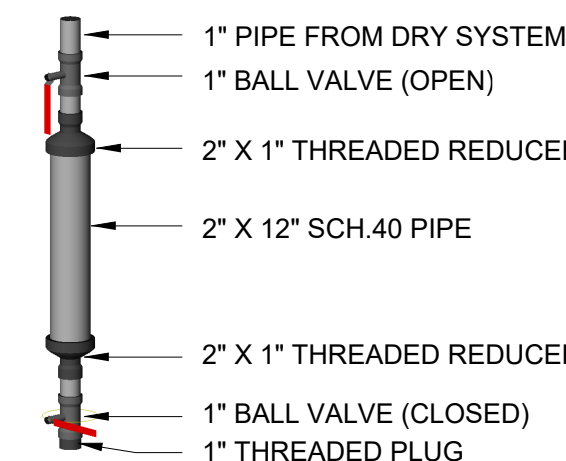

DRY PIPE NOTE:
SLOPE BRANCH LINES 1/8" EVERY 10'-0"
SLOPE CROSS MAINS 1/4" EVERY 10'-0"

NO.	DATE	DESCRIPTION	BY
1	3/3/2025	FIRE MARSHAL REVIEW COMMENTS	HFPD

DRAWN BY: HFPD
DATE: 1/29/2025
PLOT DATE: 03/03/25

A New Building For:
New Hope Crisis Center
650 E 700 S
BRIGHAM CITY, UTAH 84302
FIRE SPRINKLER SYSTEM - ATTIC

CONTRACT NUMBER
24-052
DRAWING FILE NAME
NHCC_FIRE
AUTHORITY
BRIGHAM CITY F.D.
SHEET NUMBER