ELEVATION - BEAM W24x68 AT GRID B-4 (LOOKING NORTH)

Scale: 1" = 1'-0" (for coordination only - not for fabrication)

FOR REVIEW

Issued to Vanguard for RFI
with EOR - Oct 14

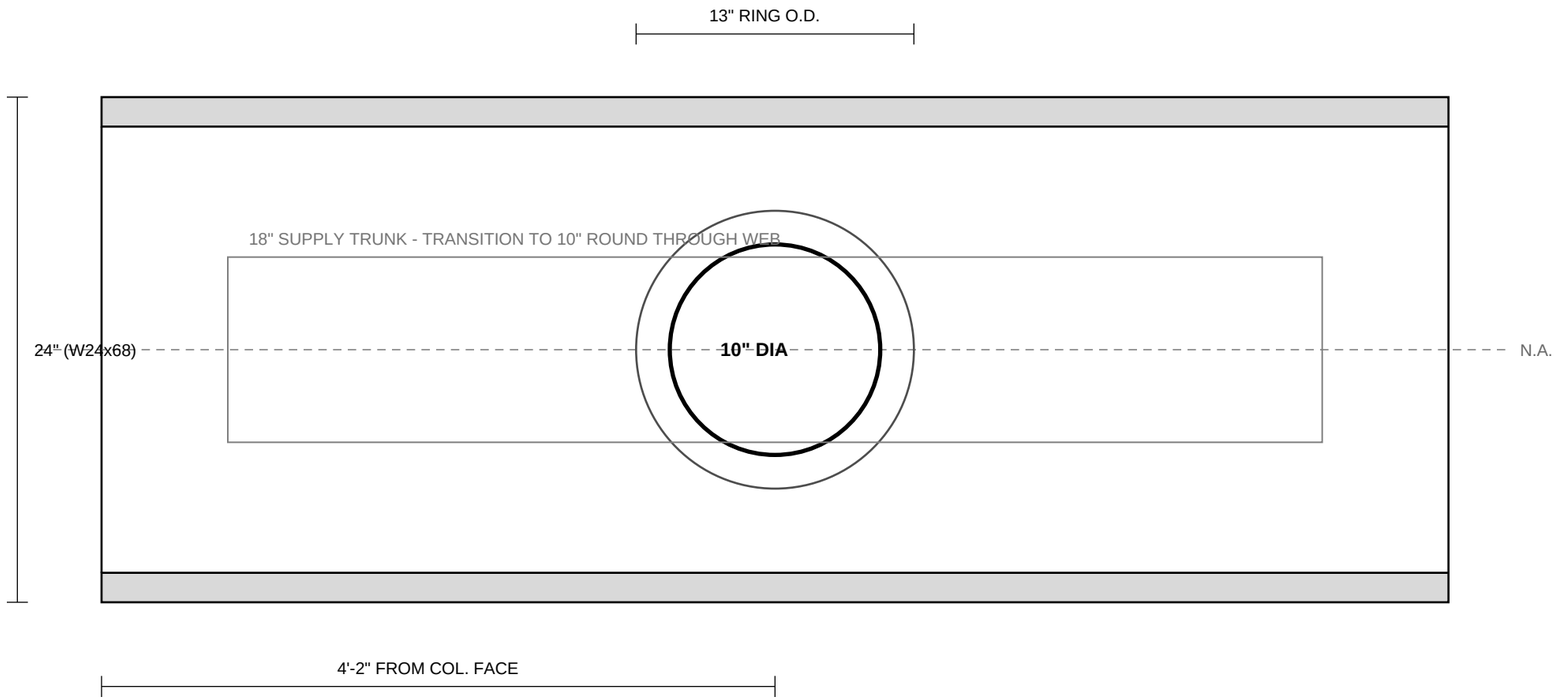

NOTES

1. Opening centred on the beam neutral axis; min. clear distance to flanges 7".
2. 3/8" x 1-1/2" reinforcing ring plate, both faces, 1/4" fillet all round (by others).
3. Duct transitions 18"x14" rect to 10" round 2'-0" each side of beam; static pressure checked, see calc M-14.
4. Penetration subject to approval by Thornton Structural Engineers (EOR). Do not cut until approved.
5. Acoustic cove framing in Corridor 3E holds at +9'-6" AFF per A-302 Rev 3.

APEX MECHANICAL SYSTEMS

W24x68 web penetration - Grid B-4, Level 3

Drawn D. Okafor - Oct 14
Riverside Medical Center - North Tower (RMC-04)

SK-M-014