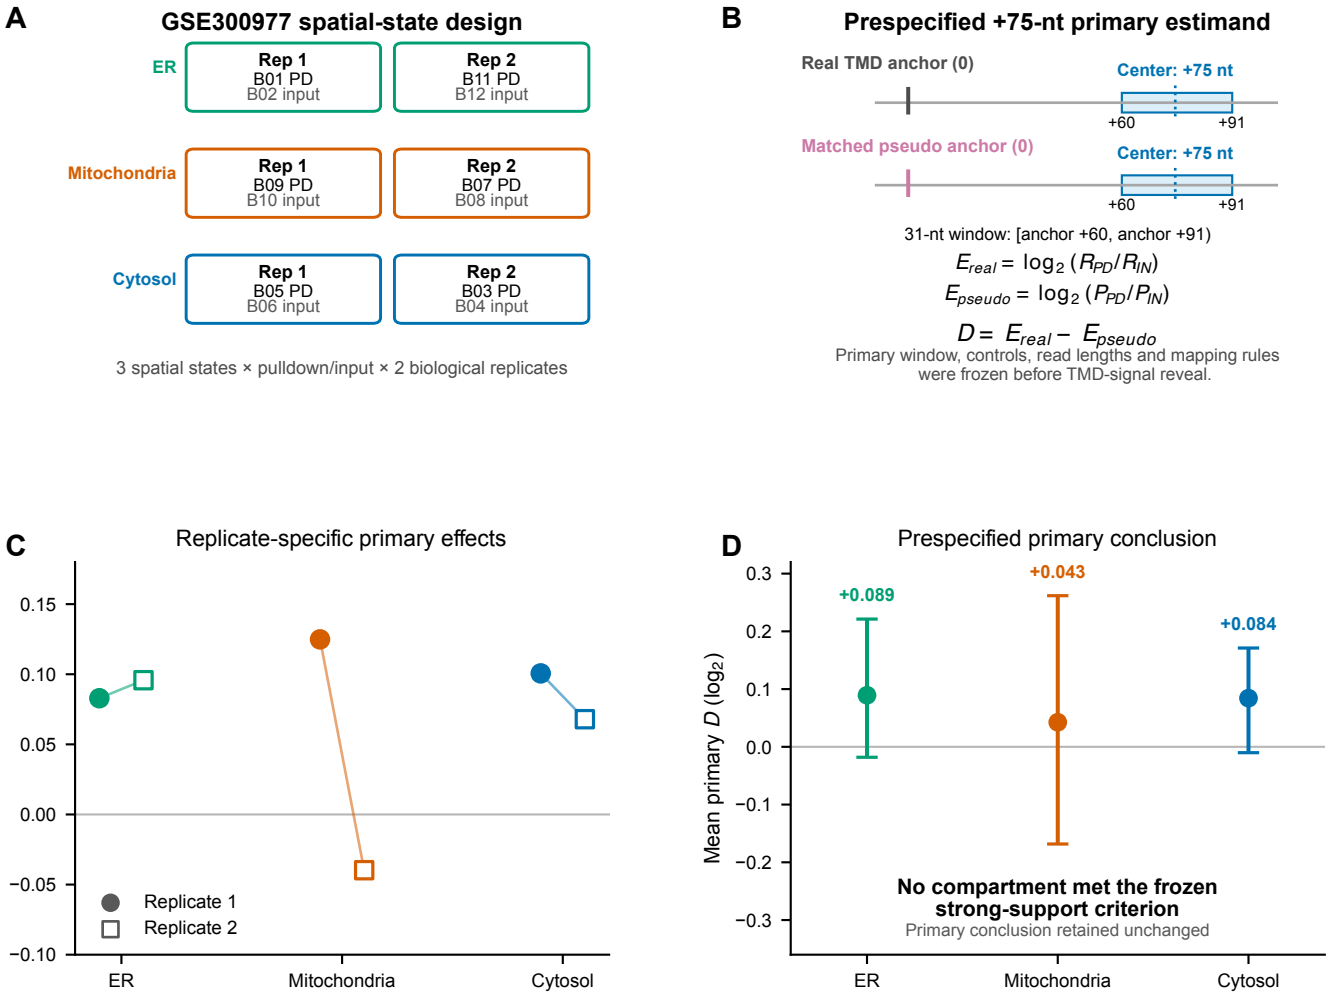


Primary +75-nt estimand was frozen before reveal; bootstrap intervals are unit-level and do not replace biological-replicate uncertainty.