
Ground floor | extinguisher + sign locations

11 proposed stations. Each numbered symbol = one extinguisher and its matching high-level location sign. Existing exit signs remain on pages 2-4.

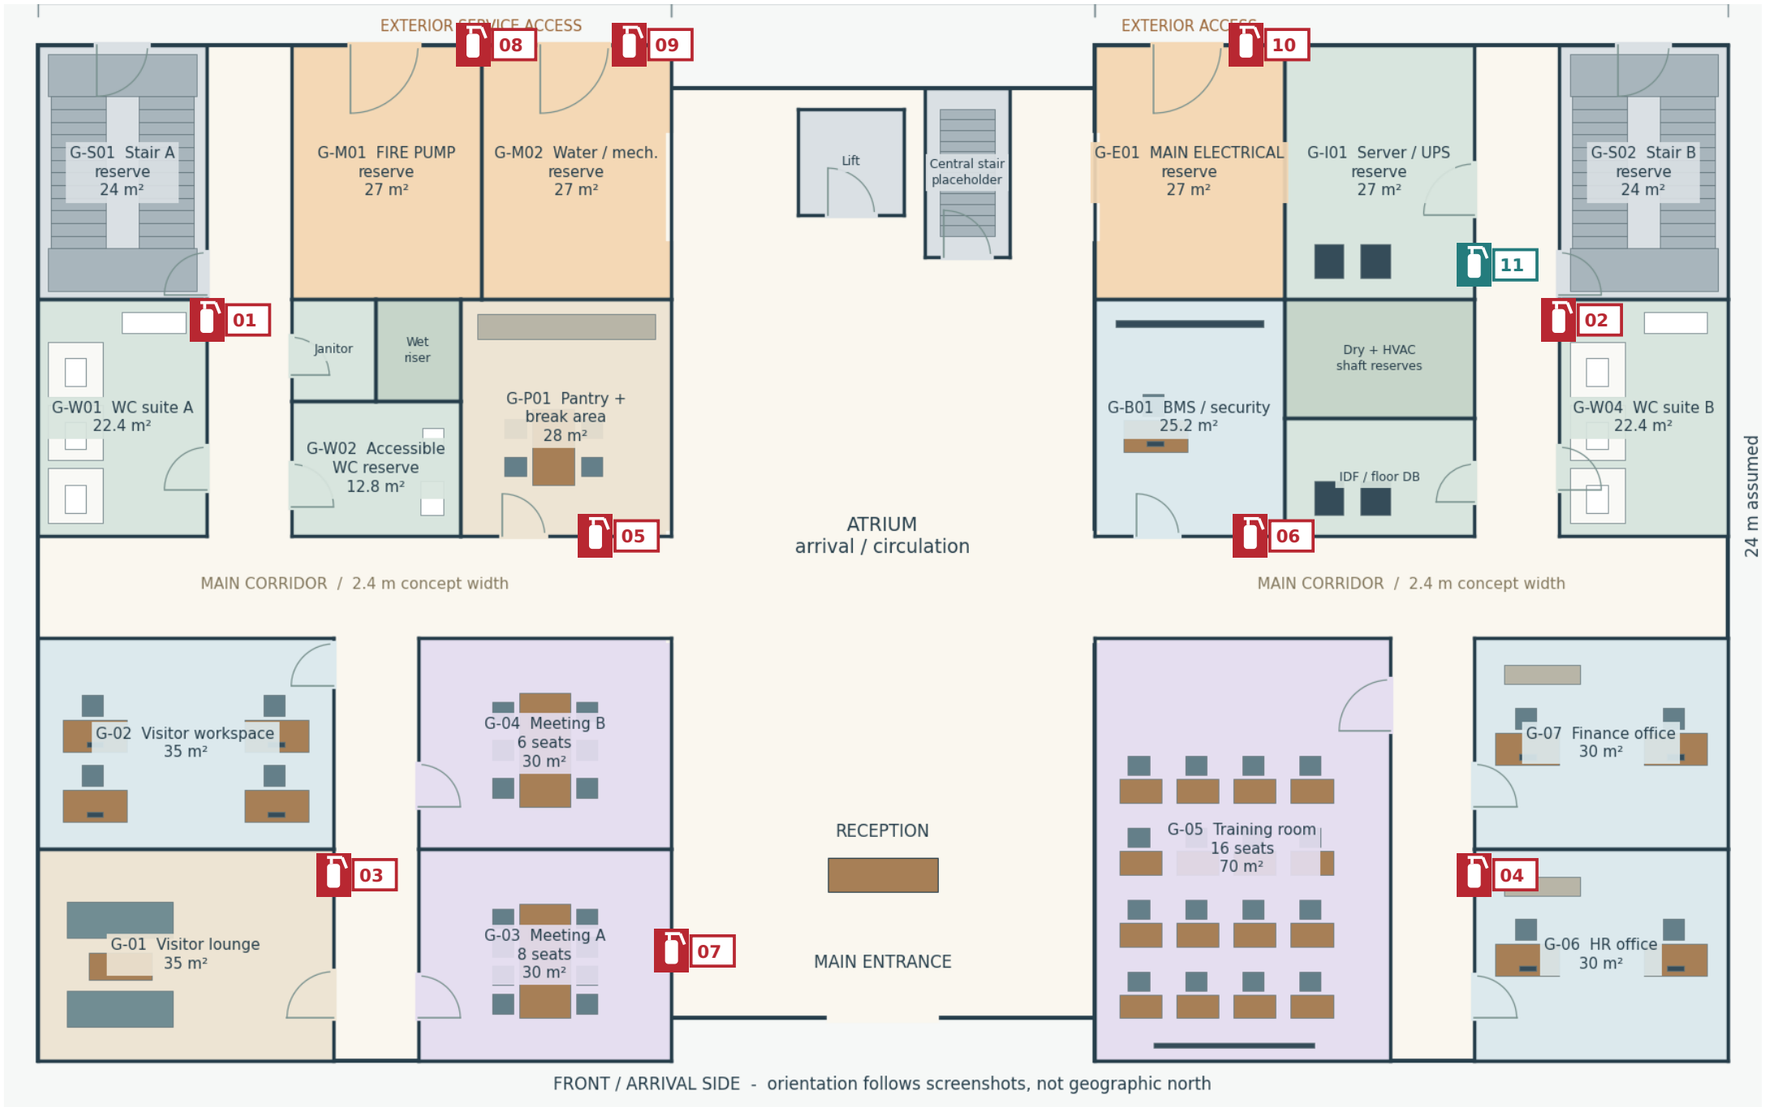

Mount at the wall shown, not in the walking aisle. Symbols are enlarged. Snap to the finished wall and move clear of door swings, furniture and equipment maintenance zones. Signs are directly above their units; use a projecting face where a flat sign cannot be seen along the corridor.

FE-G- / SG-G-

01 Left rear corridor
ABC-O | sign SG-G-01

02 Right rear corridor
ABC-O | sign SG-G-02

03 Left front spine
ABC-O | sign SG-G-03

04 Right front spine
ABC-O | sign SG-G-04

05 Outside pantry
ABC-O | sign SG-G-05

06 Right inner corridor
ABC-O | sign SG-G-06

07 Reception / entrance
ABC-O | sign SG-G-07

08 G-M01 / fire pump
ABC-S | sign SG-G-08

09 G-M02 / water room
ABC-S | sign SG-G-09

10 G-E01 / electrical
ABC-S | sign SG-G-10

11 G-I01 / server-UPS
CA-E | sign SG-G-11

ABC-O: office multipurpose.
ABC-S: special-room review.
CA-E: clean-agent electrical/electronic unit; rating to be verified.

Plant and room stations are inside the indicated room; common stations are outside stairs and rooms.