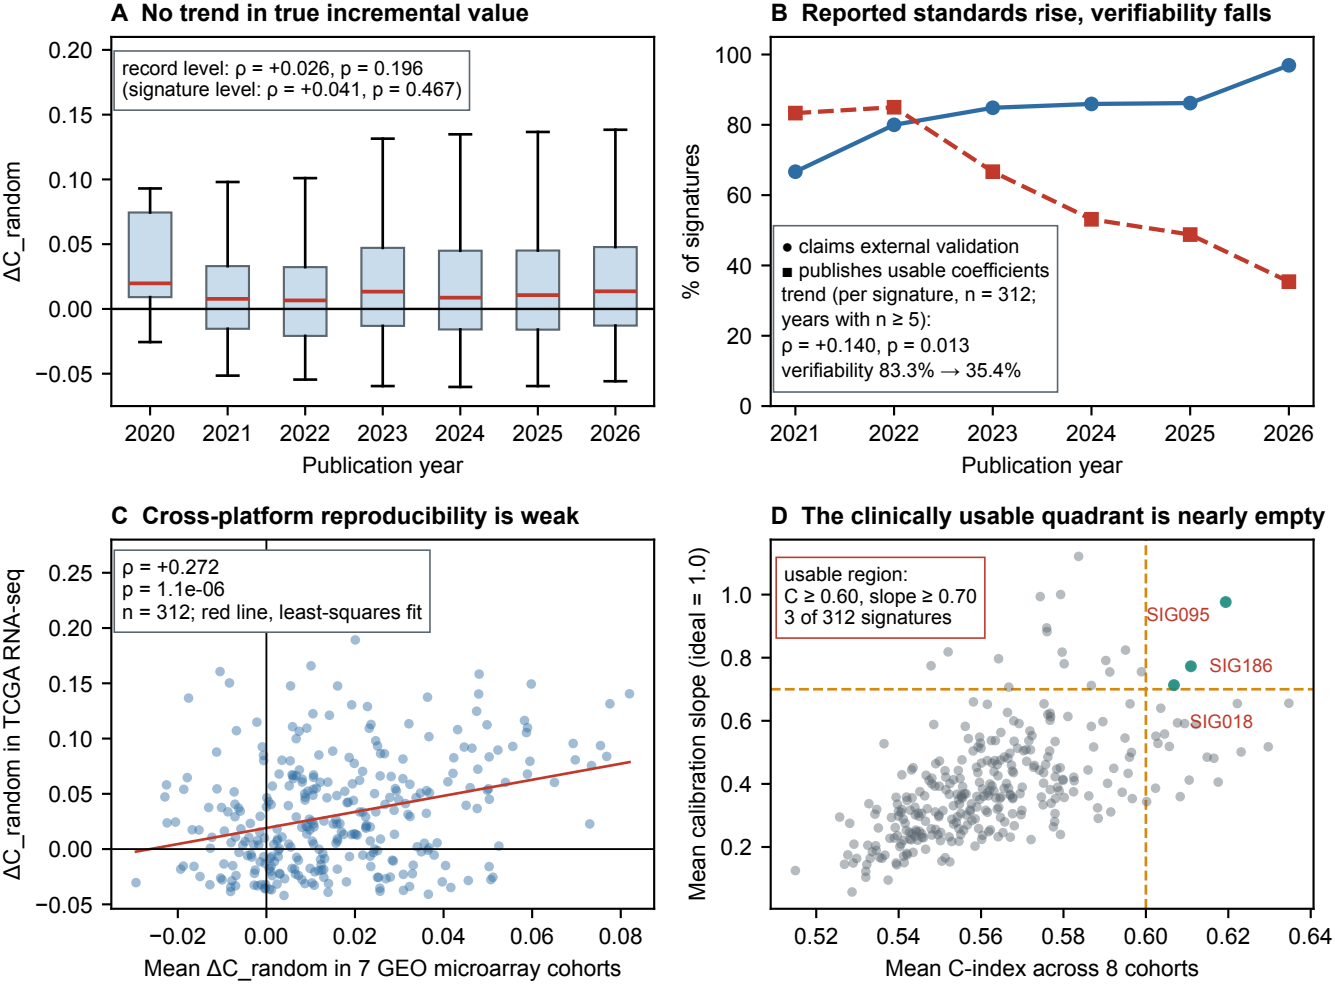

A No trend in true incremental value
record level: ρ = +0.026, p = 0.196
(signature level: ρ = +0.041, p = 0.467)
ΔC_random
Publication year
B Reported standards rise, verifiability falls
% of signatures
● claims external validation
■ publishes usable coefficients
trend (per signature, n = 312;
years with n ≥ 5):
ρ = +0.140, p = 0.013
verifiability 83.3% → 35.4%
Publication year
C Cross-platform reproducibility is weak
ρ = +0.272
p = 1.1e-06
n = 312; red line, least-squares fit
ΔC_random in TCGA RNA-seq
Mean ΔC_random in 7 GEO microarray cohorts
D The clinically usable quadrant is nearly empty
usable region:
C ≥ 0.60, slope ≥ 0.70
3 of 312 signatures
SIG095
SIG186
SIG018
Mean calibration slope (ideal = 1.0)
Mean C-index across 8 cohorts